

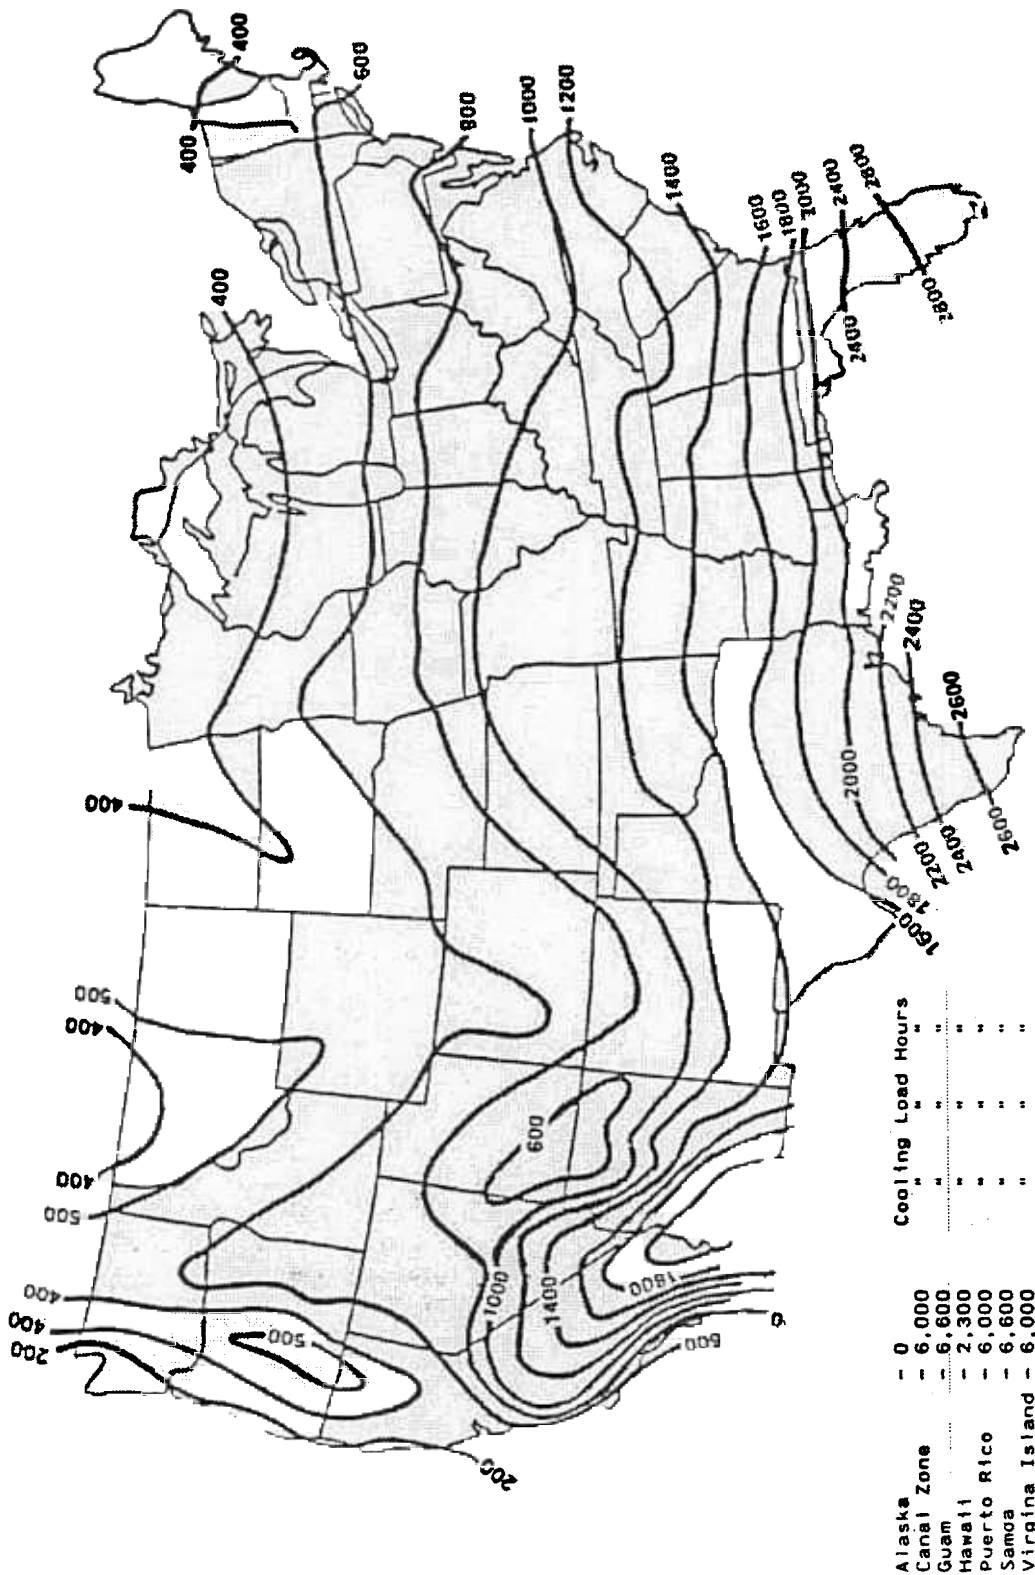


FIG 1. SUMMER COOLING LOAD HOURS

Effective February 1, 1997 — July 31, 1997
• SUPERSEDES ALL PREVIOUS DIRECTORIES •

**DIRECTORY
OF
CERTIFIED
UNITARY
EQUIPMENT
STANDARDS
210/240
270**



**Unitary Air-Conditioners AC
Unitary Air-Source Heat Pumps HP
Sound-Rated Outdoor Unitary Equipment**

ENERGYGUIDE

This issue includes the
*"ARI Guide for Estimating Annual
Operating Cost of a Central Air
Conditioner or Heat Pump".*