



Control Number: 35077



Item Number: 156

Addendum StartPage: 0

Project No. 35077

First Amendment to

INTERCONNECTION AGREEMENT

Between

City of Bellville

and

LCRA Transmission Services Company

RECEIVED
09 DEC -4 PM 2:58
PUBLIC UTILITY COMMISSION
FILING CLERK

November 18, 2009

**FIRST AMENDMENT TO
INTERCONNECTION AGREEMENT**

This First Amendment ("Amendment") is made and entered into this 18 day of November, 2009, between the City of Bellville ("City") and LCRA Transmission Services Corporation ("Corporation"), collectively referred to hereinafter as the Parties

WHEREAS, the Corporation and the City entered into that certain Interconnection Agreement dated May 1, 2008 ,and

WHEREAS, the City replaced three distribution breakers BS-10, BS-20 and BS-50, formerly leased or grandfathered from the Corporation, with breakers owned by the City of Bellville, and

WHEREAS, the Corporation replace circuit switcher CS11715 with one that had a bypass switch ll171

NOW, THEREFORE, in consideration of the mutual promises and undertakings herein set forth, the Parties agree to amend the Agreement as follows:

1. Exhibit "A" attached to the Agreement is deleted in its entirety and the Exhibit "A" attached to this First Amendment is hereby added to the Agreement in lieu thereof.

2. Facility Schedule No. 1 (including the diagrams attached thereto) is deleted in its entirety and Facility Schedule No. 1 attached to this First Amendment is hereby added to the Agreement in lieu thereof.

3. Facility Schedule No. 1 (including the diagrams attached thereto) attached to this First Amendment will become effective upon execution of this First Amendment by the Parties.

Except as otherwise expressly provided for herein, the Agreement will continue in full force and effect in accordance with its terms.

--- The remainder of this page has intentionally been left blank. ---

IN WITNESS WHEREOF, the Parties have caused this First Amendment to be executed in several counterparts, each of which shall be deemed an original but all shall constitute one and the same instrument.

CITY OF BELLVILLE


By: 

Name: Lynn S. Roberts

Title: City Administrator

Date: 11/18/09

LCRA TRANSMISSION SERVICES
CORPORATION

By: 

Name: Ray Pfefferkorn, P.E.

Title: LCRA Transmission Engineering
Manager

Date: 11/5/09



First Amendment
EXHIBIT A

[illegible]

First Amendment
FACILITY SCHEDULE NO. 1

1. **Name:** Bellville South Substation
2. **Facility Location:** The Bellville South Substation is located at 1099 Shumann Rd., Bellville, Austin County, Texas.
3. **Points of Interconnection:** There are nine (9) Points of Interconnection in the Bellville South Substation generally described as:
 - where the incoming distribution lines connect with the tubular bus between switches BS-11 and BS-13 at breaker BS-10.
 - where the jumper from breaker BS-10, connects to the 4 hole pad on switch BS-9.
 - where the jumper from breaker BS-10 connects to the 4 hole pad on switch BS-11.
 - where the incoming distribution lines connect with the tubular bus between switches BS-21 and BS-23 at breaker BS-20.
 - where the jumper from breaker BS-20 connects to the 4 hole pad on switch BS-19.
 - where the jumper from breaker BS-20 connects to the 4 hole pad on switch BS-21.
 - where the incoming distribution lines connect with the tubular bus between switches BS-51 and BS-53 at breaker BS-50.
 - where the jumper from breaker BS-50 connects to the 4 hole pad on switch BS-49.
 - where the jumper from breaker BS-50 connects to the 4 hole pad on switch BS-51.
4. **Transformation Services Provided by LCRA TSC:** Yes
5. **Metering Services Provided by LCRA TSC:** Yes
6. **Delivery Voltage:** 12.5 kV
7. **Metered Voltage and Location:** The metered voltage is 12.5 kV. The metering current transformer is located in the totalizing bay. The metering potential transformer is located on the 12.5 kV operating bus.
8. **One Line Diagram Attached:** Yes.
9. **Description of Facilities Owned by Each Party:**

City of Bellville owns:

 - Three (3) distribution circuits including dead-end insulators that attach to the dead-end structure, conductor, and hardware
 - Three (3) distribution circuit breakers BS-10, BS-20, and BS-50, and associated foundations, jumpers, relaying, panels, and cabling

LCRA TSC owns:

The Bellville South Substation including, but not limited to, the following items:

- One (1) circuit switcher CS11715 with disconnect switch 11714 and bypass switch 11717
- One (1) power transformer PWT-1, T-1 with associated surge arresters
- Five (5) distribution and total bays including A-frames, trusses, insulators, disconnect switches, surge arresters, 12.5 kV operating and transfer bus, bus potential transformer, and metering current transformer
- Under frequency relay panel
- Station Service equipment
- Control house (20' x 41'), battery house (12' x 21') and battery bank with charger


10. Operational Responsibilities of Each Party:

- The City will be responsible for the operation of the three (3) distribution circuit breakers serving the City feeders.
- LCRA TSC will be responsible for the operation from the total bay and through the power transformer to the high voltage equipment.

11. Maintenance Responsibilities of Each Party: Each Party will be fully responsible for the maintenance of the equipment it owns.

12. Other Terms and Conditions: The City and LCRA TSC are to share access to the substation by LCRA TSC locks in the gate and in the control house doors.

First Amendment
BELLVILLE SOUTH ONE-LINE DIAGRAM

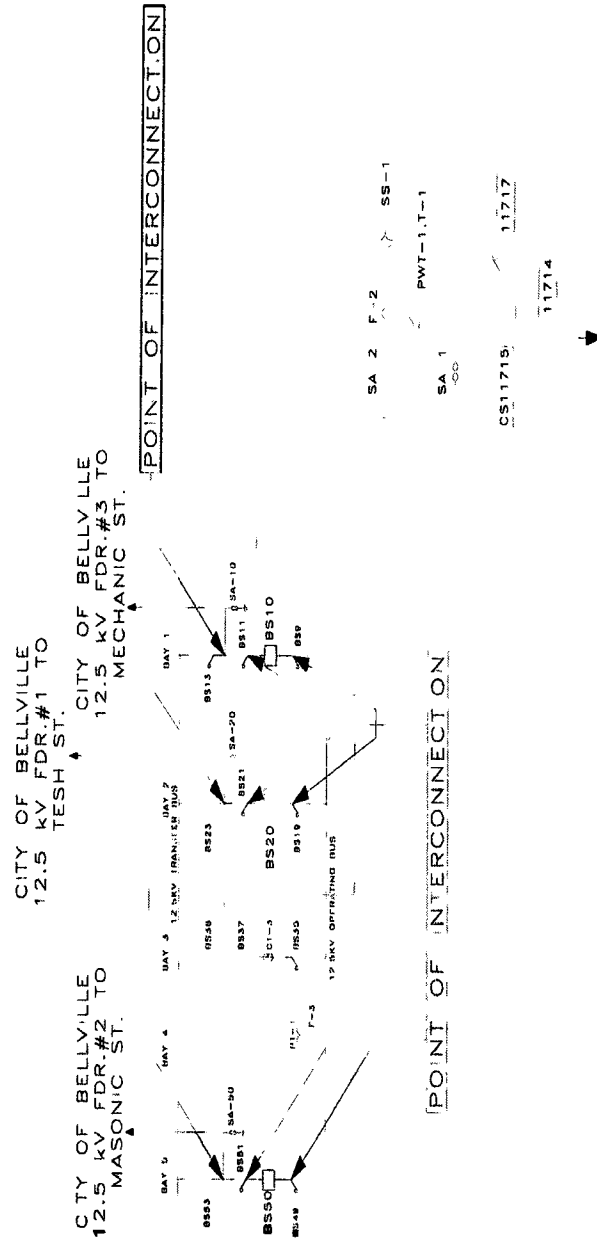

THIS IS NOT A COMPLETE ONE-LINE DIAGRAM
 FOR A COMPLETE ONE-LINE DIAGRAM OF THIS
 SUBSTATION, REFER TO DWG. S198-E-41.