



Filing Receipt

Filed Date - 2025-05-19 01:12:37 PM

Control Number - 35077

Item Number - 2138



BRAZOS ELECTRIC POWER COOPERATIVE, INC.
P.O. Box 2585, Waco, Texas 76702-2585
7616 Bagby Ave., Waco, Texas 76712
(254) 750-6500

May 19, 2025

To: Public Utility Commission of Texas
Attention: Filing Clerk *via online filing system*
Re: PUC Project No. 35077 – Generation Interconnection Agreement Filing Pursuant
to Subst. Rule §25.195(e)

Dear Filing Clerk:

Please find attached the Generation Interconnection Agreement by and between Alina Energy LLC and Brazos Electric Power Cooperative, Inc. for the Alina Solar and BESS project in Wilson County, TX for filing with the Public Utility Commission pursuant to Substantive Rule §25.195(e).

Respectfully submitted,

Shari Heino
Chief Risk & Compliance Officer – V.P. – Regulatory Compliance
Brazos Electric Power Cooperative, Inc.

ERCOT STANDARD GENERATION
INTERCONNECTION AGREEMENT

Between

Alina Energy LLC

and

Brazos Electric Cooperative, Inc.

for

*Alina Solar and BESS
Wilson County, TX*

GIR 26INR0074 & GIR 26INR0077

Effective: March 6th, 2025

TABLE OF CONTENTS

ERCOT STANDARD GENERATION INTERCONNECTION AGREEMENT	3
Exhibit “A” Terms and Conditions of the ERCOT	
Standard Generation Interconnection Agreement.....	5
ARTICLE 1. DEFINITIONS.....	5
ARTICLE 2. TERMINATION.....	7
ARTICLE 3. REGULATORY FILINGS	8
ARTICLE 4. INTERCONNECTION FACILITIES ENGINEERING, PROCUREMENT, AND CONSTRUCTION	8
ARTICLE 5. FACILITIES AND EQUIPMENT.....	12
ARTICLE 6. OPERATION AND MAINTENANCE	14
ARTICLE 7. DATA REQUIREMENTS.....	16
ARTICLE 8. PERFORMANCE OBLIGATION	17
ARTICLE 9. INSURANCE.....	19
ARTICLE 10. MISCELLANEOUS	21
Exhibit “B” Time Schedule	29
Exhibit “C” Interconnection Details	31
Exhibit “D” Notice and EFT Information of the ERCOT Standard Generation Interconnection Agreement	39
Exhibit “E” Security Arrangement Details	35

ERCOT STANDARD GENERATION INTERCONNECTION AGREEMENT

This Standard Generation Interconnection Agreement (“Agreement”) is made and entered into this 6th day of March, 2025, between Brazos Electric Power Cooperative, Inc. (“Brazos Electric” or “Transmission Service Provider” or “TSP”) and Alina Energy LLC on behalf of the Alina Solar Phase represented by ERCOT generation interconnection request number 26INR0074 and the Alina BESS Phase representation by ERCOT generation interconnection request number 26INR0077 (“Generator”), hereinafter individually referred to as “Party,” and collectively referred to as “Parties”. In consideration of the mutual covenants and agreements herein contained, the Parties hereto agree as follows:

Transmission Service Provider represents it is an electric cooperative that owns and operates facilities for the transmission and distribution of electricity. Generator represents it will own and operate or cause to be operated, the Plant. Generator also represents that it is not a company which meets the criteria set forth in Texas Business & Commerce Code Sec. 113.002, Prohibited Access to Critical Infrastructure, and is not otherwise prohibited from controlling or accessing critical infrastructure in the State of Texas. Pursuant to the terms and conditions of this Agreement, Transmission Service Provider shall interconnect Generator’s Plant with Transmission Service Provider’s System consistent with this Agreement.

This Agreement applies only to the Plant and the Parties’ interconnection facilities as identified in Exhibit “C”.

This Agreement shall become effective upon execution, subject to Governmental Authority approval, if required, and shall continue in full force and effect until terminated in accordance with Exhibit “A”.

This Agreement will be subject to the following, all of which are incorporated herein:

- A. The “Terms and Conditions of the ERCOT Standard Generation Interconnection Agreement” as revised and attached hereto as Exhibit “A”;
- B. The ERCOT Requirements (unless expressly stated herein, where the ERCOT Requirements are in conflict with this Agreement, the ERCOT Requirements shall prevail);
- C. The PUCT Rules (where the PUCT Rules are in conflict with this Agreement, the PUCT Rules shall prevail);
- D. The Time Schedule attached hereto as Exhibit “B”;
- E. The Interconnection Details attached hereto as Exhibit “C”;
- F. The notice requirements attached hereto as Exhibit “D”; and
- G. The Security Arrangement Details attached hereto as Exhibit “E”.


[SIGNATURE PAGE FOLLOWS]

IN WITNESS WHEREOF, the Parties have executed this Agreement to be effective as of the date first written above in duplicate originals, each of which shall constitute and be an original effective Agreement between the Parties.

Brazos Electric Power Cooperative, Inc.

Alina Energy LLC

By:  (24)

By: 

Name: Mark Fagan

Name: Collin Brown

Title: Executive Vice President
and General Manager

Title: Vice President

Date: 3/6/25 ^{BA}

Date: March 5, 2025

Exhibit “A”

**Terms and Conditions of the ERCOT
Standard Generation Interconnection Agreement**

ARTICLE 1. DEFINITIONS

Capitalized terms shall have the meanings as set forth below, except as otherwise specified in the Agreement:

- 1.1 “Alina BESS In-Service Date” means the date that the Alina BESS TIF has been installed and is ready to operate, as reflected in Exhibit “B.”
- 1.2 “Alina BESS TIF” means the TSP’s incremental metering, telemetry and communications equipment necessary to interconnect the Alina BESS Phase, as described in Exhibit “C.”
- 1.3 “Alina BESS Phase” corresponds to the battery energy storage system (BESS) portion of the Alina Energy project corresponding to ERCOT generator interconnection request 26INR0077.
- 1.4 “Alina Solar In-Service Date” means the date that the Alina Solar TIF will be ready to connect to the GIF, as reflected in Exhibit “B.”
- 1.5 “Alina Solar TIF” means the TSP’s interconnection facilities as described in Exhibit “C”, excluding the Alina BESS TIF.
- 1.6 “Alina Solar Phase” corresponds to the solar generation portion of the Alina Energy project corresponding to ERCOT generator interconnection request 26INR0074.
- 1.7 “CCN” shall mean a Certificate of Convenience and Necessity issued by the PUCT.
- 1.8 “Commercial Operation” shall mean the date on which Generator declares that the construction of a Phase of the Plant has been substantially completed, Trial Operation of the Plant has been completed, and such Phase of the Plant is ready for dispatch. Generator may achieve Commercial Operation with respect to each Phase of the Plant separately.
- 1.9 “ERCOT” shall mean the Electric Reliability Council of Texas, Inc., or its successor in function.
- 1.10 “ERCOT Requirements” shall mean ERCOT operating guides and protocols, ERCOT Generation Interconnection Procedures as well as any other documents adopted by ERCOT relating to the interconnection and operation of generators and transmission systems in

- ERCOT in effect and as amended from time to time, and any successors thereto. Any requirement in the foregoing documents imposed upon generation entities or generation facilities shall become the responsibility of the Generator, and any requirements imposed on transmission providers or transmission facilities shall become the responsibility of the TSP.
- 1.11 “Facilities Study” shall have the meaning as described in PUCT Rule 25.198(d) or its successor.
- 1.12 “Facilities Study Agreement” shall mean an agreement, if any, executed by the Parties relating to the performance of the Facilities Study.
- 1.13 “GIF” shall mean Generator’s interconnection facilities as described in Exhibit “C”.
- 1.14 “Good Utility Practice” shall have the meaning described in PUCT Rule 25.5 or its successor. Good Utility Practice shall include, but not be limited to, conformance with the applicable and consistently applied reliability criteria, standards and operating guides of ERCOT and NERC, or successor organization(s).
- 1.15 “Governmental Authority(ies)” shall mean any federal, state, local or municipal body having jurisdiction over a Party.
- 1.16 “In-Service Date” shall be the date, as reflected in Exhibit “B”, that the TIF will be ready to connect to the GIF.
- 1.17 “NERC” shall mean the North American Electric Reliability Corporation or successor.
- 1.18 “Phase” means either the Alina Solar Phase or the Alina BESS Phase of the Plant, as described in Exhibit “C.”
- 1.19 “Plant” shall mean the electric generation facility owned and operated by the Generator, as specified in Exhibit “C”.
- 1.20 “Point of Interconnection” shall mean the location(s) where the GIF connects to the TIF as negotiated and defined by the Parties and as shown on Exhibit “C” of this Agreement.
- 1.21 “PUCT” shall mean the Public Utility Commission of Texas.
- 1.22 “PUCT Rules” shall mean the Substantive Rules of the PUCT (or any such successor rules).
- 1.23 “Reasonable Efforts” shall mean the use of Good Utility Practice and the exercise of due diligence (pursuant to PUCT Rule 25.198(e) or its successor).
- 1.24 “RUS” shall mean the Rural Utilities Service (or any successor agency), a division of the United States Department of Agriculture.
- 1.25 “System Protection Equipment” shall mean those facilities located within the TIF and the

GIF as described in Section 5.6 and Exhibit “C”.

- 1.26 “System Security Study” shall have the meaning as described in PUCT Rule 25.198(c)(6) or its successor.
- 1.27 “TCOS” shall mean the TSP’s transmission cost of service as allowed by the applicable Governmental Authority.
- 1.28 “TIF” shall mean the TSP’s interconnection facilities as described in Exhibit “C” to this Agreement.
- 1.29 “Trial Operation” shall mean the process by which the Generator is engaged in on-site test operations and commissioning of each Phase of the Plant prior to Commercial Operation.
- 1.30 “TSP” shall mean the Transmission Service Provider.
- 1.31 “TSP System” shall mean the electric transmission facilities, including the TIF, and all associated equipment and facilities owned and/or operated by the TSP.

ARTICLE 2. TERMINATION

2.1 Termination Procedures. This Agreement may be terminated as follows:

- A. the Generator may terminate this Agreement after giving the TSP thirty (30) days advance written notice; or
- B. the TSP may terminate this Agreement (subject to Governmental Authority approval, if required) on written notice to the Generator if Alina Solar Phase has not achieved Commercial Operation within one year after the scheduled Commercial Operation date for Alina Solar Phase reflected in Exhibit “B”; or
- C. either Party may terminate this Agreement in accordance with Section 10.6.

2.2 Termination Costs. If a Party elects to terminate the Agreement pursuant to Section 2.1 above, the Generator shall pay all costs incurred (or committed to be incurred) by TSP, as of the date of the other Party’s receipt of such notice of termination, that are the responsibility of the Generator under this Agreement. In the event of termination by either Party, both Parties shall use commercially reasonable efforts to mitigate the damages and charges they may incur as a consequence of termination. The provisions of the Sections 2.2 and 2.3 shall survive termination of the Agreement.

2.3 Disconnection. Upon termination of this Agreement, the Parties will disconnect the GIF from the TIF.

ARTICLE 3. REGULATORY FILINGS

3.1 Filing. The TSP shall file this executed Agreement with the appropriate Governmental Authority, if required. Any portions of this Agreement asserted by Generator to contain competitively sensitive commercial or financial information shall be filed by the TSP identified as “confidential” under seal stating, for the TSP’s showing of good cause that Generator asserts such information is confidential information and has requested such filing under seal. If requested by the TSP, Generator shall provide the TSP, in writing, with the Generator’s basis for asserting that the information referred to in this Section 3.1 is competitively sensitive information, and the TSP may disclose such writing to the appropriate Governmental Authority.

3.2 Regulatory Approvals. Unless exempt, the TSP shall timely request ERCOT and all regulatory approvals necessary for it to carry out its responsibilities under this Agreement. Such approvals shall include any CCN required for the construction of the TIF and approvals, if any, by the RUS.

ARTICLE 4. INTERCONNECTION FACILITIES ENGINEERING, PROCUREMENT, AND CONSTRUCTION

4.1 Options. The Generator shall select one of the following options (subsection A or subsection B) and include the selected option in Exhibit “B” for completion of the TIF:

A. The TSP shall design, procure, and construct the TIF, using Reasonable Efforts to complete the TIF by the In-Service Date reflected in Exhibit “B”. The TSP will utilize its own resources and will contract for additional resources, as reasonably necessary, to meet the In-Service Date. Such resources shall include, as the TSP believes is reasonable, use of other contractors, other equipment suppliers, other material suppliers, additional contract personnel, additional payments to contractors for expedited work, and premiums paid to equipment and material suppliers for expedited delivery. The TSP shall not be required to undertake any initiative which is inconsistent with its standard safety practices, its material and equipment specifications, its design criteria and construction procedures, its labor agreements, applicable laws and regulations, and ERCOT Requirements. In the event the TSP reasonably expects that it will not be able to complete the TIF by the In-Service Date, the TSP will promptly provide written notice to the Generator and will undertake Reasonable Efforts to meet the earliest date thereafter.

B. (i) The TSP shall design, procure, and construct the TIF by the In-Service Date reflected in Exhibit "B". The Parties acknowledge that the In-Service Date was either agreed upon through good faith negotiations or designated by the Generator upon failure of the Parties to agree. In the process of negotiating the In-Service Date, Generator will request a date upon which it reasonably expects it will be ready to begin use of the TIF and upon which it reasonably expects to begin doing so. Any date designated by the Generator shall in no event be less than fifteen (15) months from the date that all conditions of Sections 4.2 and 4.3 have been satisfied. The designated In-Service Date will be extended day for day for each day that the ERCOT refuses to grant clearances to install equipment. If the TSP fails to complete the TIF by the In-Service Date reflected in Exhibit "B", the TSP shall pay the Generator liquidated damages in accordance with this Section 4.1.B.

(ii) The Parties agree that actual damages to the Generator, in the event the TIF are not completed by the In-Service Date, may include Generator's fixed operation and maintenance costs and lost opportunity costs. Such actual damages are uncertain and impossible to determine at this time. The Parties agree that, because of such uncertainty, any liquidated damages paid by the TSP to the Generator shall be an amount equal to $\frac{1}{2}$ of 1% of the actual cost of the TIF, per day. However, in no event shall the total liquidated damages exceed twenty percent (20%) of the actual cost of the TIF. The Parties agree that such liquidated damages are less than the Generator's actual damages. The Parties agree that the foregoing payments will be made by the TSP to the Generator as just compensation for the damages caused to the Generator, which actual damages are uncertain and impossible to determine at this time, and as reasonable liquidated damages, but not as a penalty or a method to secure performance of this Agreement.

(iii) The TSP shall apply to have the full costs of the TIF included in TCOS. If the PUCT issues a final, appealable order excluding from TCOS any portion of the TIF costs, including higher contractor and vendor costs due to liquidated damage provisions in those contracts and insurance costs to cover liquidated damages, which costs may have been reasonably incurred but which the PUCT finds should not be recovered through TCOS, the Generator shall reimburse the TSP for such costs in an amount not to exceed the difference between the TSP's estimate of the cost of the TIF under section 4.1.A and the TSP's estimate of the cost of the TIF under Section 4.1.B as reflected in Exhibit "C". Such costs shall be estimated using Good Utility Practice.

(iv) No liquidated damages shall be paid to Generator if the Generator is not ready to commence use of the TIF for the delivery of power to the Plant for Trial Operation or export of power from the Plant on the In-Service Date, unless the Generator would have been able to commence use of the TIF for the delivery of power to the Plant for Trial Operation or export of power from the Plant but for TSP's delay.

(v) If the In-Service Date has been designated by the Generator upon a failure of the Parties to agree on the In-Service Date, the TSP may, at its option, require the Generator to subcontract with the TSP for all or part of the design, procurement and construction of the TIF in accordance with the TSP's standard subcontractor agreements. In such event, the TSP shall be subject to the payment of liquidated damages to the Generator only if the In-Service Date is not met solely due to the TSP's failure to complete the portion of the TIF for which the TSP has retained responsibility. It is the intent of this subsection to give the TSP full control of the contents and quality of the TIF. To the extent the Generator acts as a subcontractor to the TSP, the following will apply: 1) The Generator shall engineer, procure equipment, and construct the TIF (or portions thereof) using Good Utility Practice and using standards and specifications provided in advance by the TSP; 2) In its engineering, procurement and construction of the TIF, the Generator shall comply with all requirements of law to which the TSP would be subject in the engineering, procurement or construction of the TIF; 3) The TSP shall review and approve the engineering design, acceptance tests of equipment, and the construction of the TIF; 4) The TSP shall have the right to approve and accept for operation the TIF in accordance with the standards and specifications provided in advance by the TSP, such approval and acceptance shall not be unreasonably withheld, conditioned, or delayed; 5) Should any phase of the engineering, equipment procurement, or construction of the TIF, including selection of subcontractors, not meet the standards and specifications provided by the TSP and therefore be deemed unacceptable, then the Generator shall be obligated to remedy that portion of the TIF or selection of subcontractors that is deemed unacceptable, the TSP's approval of the Generator's selection of subcontractors will not be unreasonably withheld, conditioned or delayed; and 6) Once the TIF is accepted for operation by the TSP, then the TSP shall reimburse the Generator for the reasonable and necessary costs incurred by the Generator to complete the TIF. Such reimbursement shall be made within thirty days after receipt of the invoice, unless otherwise agreed to by the Parties.

4.2 Equipment Procurement. If responsibility for construction of the TIF is borne by the TSP, then the TSP shall commence design of the TIF and procure necessary equipment within a reasonable time after all of the following conditions are satisfied:

- A. The TSP has completed any required Facilities Study pursuant to the Facilities Study Agreement; and
- B. The TSP has received written authorization to proceed with design and procurement from the Generator by the date specified in Exhibit “B”; and
- C. The Generator has provided security to the TSP in accordance with Section 8.3 by the dates specified in Exhibit “B”.

4.3 Construction Commencement. The TSP shall commence construction of the TIF as soon as practicable after the following additional conditions are satisfied:

- A. Approval of the appropriate Governmental Authority has been obtained for any facilities requiring regulatory approval;
- B. Necessary real property rights, if any, have been obtained;
- C. The TSP has received written authorization to proceed with construction from the Generator by the date specified in Exhibit “B”; and
- D. The Generator has provided security to the TSP in accordance with Section 8.3 by the dates specified in Exhibit “B”.

4.4 Work Progress. The Parties will keep each other advised periodically as to the progress of their respective design, procurement and construction efforts. If, at any time, the Generator becomes aware that the completion of the TIF will not be required until after the specified In-Service Date, the Generator will promptly provide written notice to the TSP of a new, later In-Service Date.

4.5 Conditions Precedent Delay. To the extent this Agreement incorporates a specified In-Service Date and the Generator fails to satisfy conditions precedent under Sections 4.2 and 4.3 so that the TSP may meet the In-Service Date, the Parties will negotiate in good faith to establish a new schedule for completion of the TIF, and the In-Service Date shall be extended accordingly.

ARTICLE 5. FACILITIES AND EQUIPMENT

5.1 Information Exchange. The Parties shall exchange information and mutually agree upon the design and compatibility of the Parties' interconnection facilities. The Parties shall work diligently and in good faith to make any necessary design changes to ensure compatibility of the GIF to the TSP System.

5.2 GIF Construction. Generator agrees to cause the GIF to be designed and constructed in accordance with Good Utility Practice, ERCOT Requirements and the National Electrical Safety Code in effect at the time of construction. Within one-hundred twenty (120) days after Commercial Operation of the Alina Solar Phase, unless the Parties agree on another mutually acceptable deadline, the Generator shall deliver to the TSP the following "as-built" drawings, information and documents for the GIF: a one-line diagram, a site plan showing the Plant and the GIF, plan and elevation drawings showing the layout of the GIF, a relay functional diagram, relaying AC and DC schematic wiring diagrams and relay settings for all facilities associated with the Generator's main-power transformers, the facilities connecting the Plant to the main power transformers and the GIF, the impedances (determined by factory tests) for the associated main power transformers and the generators, and the impedance of any transmission voltage lines that are part of the GIF. Within one hundred and twenty (120) days after Commercial Operation of the Alina BESS Phase, Generator shall deliver updated versions of the foregoing, if necessary, to reflect the incremental metering and communications GIF installed in connection with the Alina BESS Phase.

5.3 TIF Construction. The TSP agrees to cause the TIF to be designed and constructed in accordance with Good Utility Practice, ERCOT Requirements and the National Electrical Safety Code in effect at the time of construction.

5.4 Equipment Changes. For facilities not described in Exhibit "C", if either Party makes equipment changes to the Plant, the GIF, the TIF or the TSP System which it knows will affect the operation or performance of the other Party's interconnection facilities or the Plant, the Parties agree to notify the other Party, in writing, of such changes. Such changes shall be made in accordance with ERCOT Requirements and coordinated between the Parties.

5.5 Metering, Telemetry and Communications Requirements.

A. Metering and telemetry of data shall be accomplished in accordance with ERCOT Requirements. The specific metering, telemetry and communications equipment to be installed and data to be telemetered are described in Exhibit “C”.

B. At or near the Point of Interconnection, the metering and telemetry equipment shall be owned by the TSP. However, the TSP shall provide the Generator with metering and telemetry values in accordance with ERCOT Requirements.

C. A minimum set of inputs to the telemetry equipment is specified in Exhibit “C”. Additional sets of inputs may be subsequently mutually agreed upon.

D. The TSP will notify the Generator at least five (5) working days in advance of any planned maintenance, inspection, testing, or calibration of the metering equipment, unless otherwise agreed to in writing. The Generator, or its designated representative, shall have the right to be present for these activities and to receive copies of any documents related to the procedures and results.

E. Prior to the connection of the GIF to the TIF, acceptance tests will be performed by the owning Party to ensure the proper functioning of all metering, telemetry and communications equipment associated with the Point of Interconnection and both Parties’ interconnection facilities, and to verify the accuracy of data being received by the TSP, ERCOT, and the Generator. All acceptance tests will be performed consistent with ERCOT Requirements.

F. The TSP shall, in accordance with Good Utility Practice and ERCOT Requirements, specify communications facilities, including those necessary to transmit data from the metering equipment to the TSP, that are necessary for the effective operation of the Plant and the GIF with the TSP System. Such communication facilities shall be included in Exhibit “C”. The Generator shall make arrangements to procure and bear the cost of such facilities.

G. Any changes to the meters, telemetry equipment, voltage transformers, current transformers, and associated panels, hardware, conduit and cable, which will affect the data being received by the other Party must be mutually agreed to by the Parties.

H. Each Party will promptly advise the other Party if it detects or otherwise learns of any metering, telemetry or communications equipment errors or malfunctions that require the attention and/or correction by the other Party. The Party owning such equipment shall correct such error or malfunction as soon as reasonably feasible in accordance with ERCOT Requirements.

5.6 System Protection and Other Controls Requirements.

A. Each Party's facilities shall be designed to isolate any fault, or to correct or isolate any abnormality that would negatively affect the other Party's system or other entities connected to the TSP System.

B. Each Party shall be responsible for protection of its facilities consistent with ERCOT Requirements and Good Utility Practice.

C. Each Party's protective relay design shall incorporate the necessary test switches to perform the tests required in Section 5.6.F. The required test switches shall be placed such that they allow operation of lockout relays while preventing breaker failure schemes from operating and causing unnecessary breaker operations and tripping the Generator's units.

D. Recording equipment shall be installed to analyze all system disturbances in accordance with ERCOT Requirements.

E. Each Party will test, operate and maintain System Protection Equipment in accordance with ERCOT Requirements. Each Party will provide reasonable notice to the other Party of any testing of its System Protection Equipment allowing such other Party the opportunity to have representatives present during testing of its System Protection Equipment.

F. Prior to the In-Service Date, and again prior to Commercial Operation, each Party or its agent shall perform a complete calibration test and functional trip test of the System Protection Equipment. At intervals suggested by Good Utility Practice or at intervals described in the ERCOT Requirements if so defined therein, and following any apparent malfunction of the System Protection Equipment, each Party shall perform both calibration and functional trip tests of its System Protection Equipment. These tests do not require the tripping of any in-service generation unit. These tests do, however, require that all protective relays and lockout contacts be activated.

5.7 No Annexation. Any and all equipment placed on the premises of a Party shall be and remain the property of the Party providing such equipment regardless of the mode and manner of annexation or attachment to real property, unless otherwise mutually agreed by the Parties.

ARTICLE 6. OPERATION AND MAINTENANCE

6.1 Operation and Maintenance of Interconnection Facilities. The Parties agree to operate and maintain their systems in accordance with Good Utility Practice, National Electrical Safety Code,

the ERCOT Requirements, PUCT Rules and all applicable laws and regulations. Subject to any necessary ERCOT approval, each Party shall provide necessary equipment outages to allow the other Party to perform periodic maintenance, repair or replacement of its facilities. Such outages shall be scheduled at mutually agreeable times, unless conditions exist which a Party believes, in accordance with Good Utility Practice, may endanger persons or property. No changes shall be made in the normal operation of the Point of Interconnection without the mutual agreement of the Parties except as otherwise provided herein. All testing of the Plant that affects the operation of the Point of Interconnection shall be coordinated between the TSP, ERCOT, and the Generator and will be conducted in accordance with ERCOT Requirements.

6.2 Land Rights and Easements. Terms and conditions addressing the rights of the TSP and the Generator regarding any facilities located on the other Party's property shall be addressed in a separate, duly executed and recorded easement agreement between the Parties. Prior to Commercial Operation, the Parties will mutually agree upon procedures to govern access to each other's property as necessary for the Parties to fulfill their obligations hereunder.

6.3 Service Interruption. The Parties recognize that the interruption of service provisions of the PUCT Rules give TSP the right to disconnect the TSP System from the Plant under the conditions specified therein. The Generator will promptly disconnect the Plant from the TSP System when required by and in accordance with the PUCT Rules and ERCOT Requirements.

6.4 Switching and Clearance.

- A. Any switching or clearances needed on the TIF or the GIF will be done in accordance with ERCOT Requirements.
- B. Any switching and clearance procedure necessary to comply with Good Utility Practice or ERCOT Requirements that may have specific application to the Plant shall be addressed in Exhibit "C".

6.5 Start-Up and Synchronization. Consistent with ERCOT Requirements and the Parties' mutually acceptable procedure, the Generator is responsible for the proper synchronization of the Plant to the TSP System.

6.6 Routine Operational Communications. On a timely basis, the Parties shall exchange all information necessary to comply with ERCOT Requirements.

6.7 Blackstart Operations. If the Plant is capable of blackstart operations, Generator will coordinate individual Plant start-up procedures consistent with ERCOT Requirements. Any

blackstart operations shall be conducted in accordance with the blackstart criteria included in the ERCOT Requirements and the TSP Blackstart Plan on file with ERCOT. Notwithstanding this section, the Generator is not required to have blackstart capability by virtue of this Agreement. If the Generator will have blackstart capability, then Generator shall provide and maintain an emergency communication system that will interface with the TSP during a blackstart condition.

6.8 Power System Stabilizers. The Generator shall procure, install, maintain and operate power system stabilizers if required to meet ERCOT Requirements and as described in Exhibit “C”.

ARTICLE 7. DATA REQUIREMENTS

7.1 Data Acquisition. The acquisition of data to realistically simulate the electrical behavior of system components is a fundamental requirement for the development of a reliable interconnected transmission system. Therefore, the TSP and the Generator shall be required to submit specific information regarding the electrical characteristics of their respective facilities to each other as described below in accordance with ERCOT Requirements.

7.2 Initial Data Submission by TSP. The initial data submission by the TSP shall occur no later than one hundred twenty (120) days prior to Trial Operation and shall include transmission system data necessary to allow the Generator to select equipment and meet any system protection and stability requirements.

7.3 Initial Data Submission by Generator. The initial data submission by the Generator, including manufacturer data, shall occur no later than 90 days prior to the Trial Operation and shall include a completed copy of the following forms contained in ERCOT’s Generation Interconnection Procedure: (1) Plant Description/Data and (2) Generation Stability Data. It shall also include any additional data provided to ERCOT for the System Security Study. Data in the initial submissions shall be the most current Plant design or expected performance data. Data submitted for stability models shall be compatible with ERCOT standard models. If there is no compatible model, the Generator will work with an ERCOT designated consultant to develop and supply a standard model and associated data.

7.4 Data Supplementation. Prior to Commercial Operation, the Parties shall supplement their initial data submissions with any and all “as-built” Plant data or “as-tested” performance data that differs from the initial submissions or, alternatively, written confirmation that no such differences exist. Subsequent to Commercial Operation, the Generator shall provide the TSP any data changes

due to equipment replacement, repair, or adjustment. The TSP shall provide the Generator any data changes due to equipment replacement, repair, or adjustment in the directly connected substation or any adjacent TSP-owned substation that may affect the GIF equipment ratings, protection or operating requirements. The Parties shall provide such data no later than 30 days after the date of the actual change in equipment characteristics. Also, the Parties shall provide to each other a copy of any additional data later required by ERCOT concerning these facilities.

7.5 Data Exchange. Each Party shall furnish to the other Party real-time and forecasted data as required by ERCOT Requirements. The Parties will cooperate with one another in the analysis of disturbances to either the Plant or the TSP's System by gathering and providing access to any information relating to any disturbance, including information from oscillography, protective relay targets, breaker operations and sequence of events records.

ARTICLE 8. PERFORMANCE OBLIGATION

8.1 Generator's Cost Responsibility. The Generator will acquire, construct, operate, test, maintain and own the Plant and the GIF at its sole expense. In addition, the Generator may be required to make a contribution in aid of construction in the amount set out in and for the facilities described in Exhibit "C", if any, in accordance with PUCT Rules.

8.2 TSP's Cost Responsibility. The TSP will acquire, own, operate, test, and maintain the TIF at its sole expense, subject to the provisions of Section 4.1.B and the contribution in aid of construction provisions of Section 8.1 of this Agreement.

8.3 Financial Security Arrangements. The TSP may require the Generator to pay a reasonable deposit or provide another means of security, to cover the costs of planning, licensing, procuring equipment and materials, and constructing the TIF. The required security arrangements shall be specified in Exhibit "E". Within five business days after Alina Solar Phase achieves Commercial Operation, the TSP shall return the deposit(s) or security to the Generator, subject to the provisions of Section 8.4. However, the TSP may retain an amount to cover the incremental difference between the TSP's actual out of pocket costs associated with the choice of Section 4.1.B over Section 4.1.A, pending a final PUCT Order as contemplated in Section 4.1.B(iii). If Alina Solar Phase has not achieved Commercial Operation within one year after the scheduled Commercial Operation date identified in Exhibit "B", or if the Generator terminates this Agreement in accordance with Section 2.1 and the TIF are not required, the TSP may, subject to the provisions of Section 2.2, retain as much of the deposit or security as is required to cover the costs it incurred

in planning, licensing, procuring equipment and materials, and constructing the TIF. If a cash deposit is made pursuant to Exhibit “E”, any repayment of such cash deposit shall include interest at a rate applicable to customer deposits as established from time to time by the PUCT or other Governmental Authority.

8.4 Retention Procedures. For purposes of Section 8.3:

A. If the security furnished by the Generator pursuant to and as contemplated by Section 8.3 and Exhibit “E” consists of a cash deposit, any retention by the TSP with respect thereto that is permitted by Section 8.3 shall be effected by the TSP retaining for its own account (subject only to the provisions of Section 4.1.B(iii), but only if and to the extent applicable) from such cash deposit each amount that the TSP is permitted to retain under Section 8.3, and any obligation of the TSP to return such cash deposit to the Generator shall be expressly and solely limited to that amount of such cash deposit, if any, that exceeds the aggregate amount thereof that the TSP is permitted to retain under Section 8.3.

B. If the security furnished by the Generator pursuant to and as contemplated by Section 8.3 and Exhibit “E” consists of a letter of credit in favor of the TSP, any retention by the TSP with respect thereto that is permitted by Section 8.3 shall be effected by the TSP drawing on such letter of credit for each amount that the TSP is permitted to retain under Section 8.3 and retaining the proceeds of each such drawing for its own account (subject only to the provisions of Section 4.1.B(iii), but only if and to the extent applicable), and any obligation of the TSP to return such letter of credit to the Generator shall be expressly and solely conditioned upon the issuer of such letter of credit having duly honored each draft presented by TSP under such letter of credit for an amount that the TSP is permitted to retain under Section 8.3, the full amount of the proceeds of which may be retained by the TSP for its own account (subject only to the provisions of Section 4.1.B(iii), but only if and to the extent applicable).

C. If the security furnished by the Generator pursuant to and as contemplated by Section 8.3 and Exhibit “E” consists of a guaranty in favor of the TSP, any retention by the TSP with respect thereto that is permitted by Section 8.3 shall be effected by the TSP as follows:

- (i) The TSP shall determine, using Good Utility Practice, the amount that the TSP is permitted to retain under Section 8.3;

(ii) Promptly after making the determination contemplated in clause (i) preceding, the TSP will notify the Generator in writing of the amount so determined pursuant to the preceding clause (i); and

(iii) Within five (5) Business Days after the TSP shall have given the written notice contemplated in clause (ii) preceding to the Generator, the Generator shall pay to the TSP, in immediately available US Dollars, the amount specified by the TSP in the written notice contemplated in clause (ii) preceding, failing which the TSP shall be entitled to make demand for payment of such amount under such guaranty.

The TSP shall be entitled to retain the full amount paid to the TSP by the Generator (or by a guarantor party to such guaranty) pursuant to this Section 8.4.C for its own account (subject only to the provisions of Section 4.1.B(iii), but only if and to the extent applicable), and any obligation of the TSP to return such guaranty to the Generator shall be expressly and solely conditioned upon the TSP having received payment in full of the amount payable by the Generator pursuant to clause (iii) of this Section 8.4.C, the full amount of which may be retained by the TSP for its own account (subject only to the provisions of Section 4.1.B(iii), but only if and to the extent applicable).

ARTICLE 9. INSURANCE

9.1 Each Party shall, at its own expense, maintain in force throughout the period of this Agreement, until released by the other Party, the following minimum insurance coverages, with insurers authorized to do business in Texas:

A. Employers Liability and Worker's Compensation Insurance providing statutory benefits in accordance with the laws and regulations of the State of Texas. The minimum limits for the Employer's Liability insurance shall be One Million Dollars (\$1,000,000) each accident bodily injury by accident, One Million Dollars (\$1,000,000) each employee bodily injury by disease, and One Million Dollars (\$1,000,000) policy limit bodily injury by disease.

B. Commercial General Liability Insurance including premises and operations, personal injury, broad form property damage, broad form blanket contractual liability coverage (including coverage for the contractual indemnification) products and completed operations coverage, coverage for explosion, collapse and underground hazards, independent contractors coverage, coverage for pollution to the extent normally available and punitive damages to the extent normally available and a cross liability endorsement, with minimum limits of One Million

Dollars (\$1,000,000) per occurrence/One Million Dollars (\$1,000,000) aggregate combined single limit for personal injury, bodily injury, including death and property damage.

C. Comprehensive Automobile Liability Insurance for coverage of owned, non-owned and hired vehicles, trailers or semi-trailers designed for travel on public roads, with a minimum combined single limit of One Million Dollars (\$1,000,000) per occurrence for bodily injury, including death, and property damage.

D. Umbrella Liability Insurance over and above the Employer's Liability, Commercial General Liability and Comprehensive Automobile Liability Insurance coverage, with a minimum combined single limit of Twenty Million Dollars (\$20,000,000) per occurrence/Twenty Million Dollars (\$20,000,000) aggregate.

E. The Commercial General Liability Insurance, Comprehensive Automobile Liability Insurance, and Umbrella Liability Insurance policies shall name the other Party, its parent, associated and affiliated companies and their respective directors, officers, agents, servants and employees ("Other Party Group") as additional insured. All policies shall contain provisions whereby the insurers waive all rights of subrogation in accordance with the provisions of this Agreement against the Other Party Group and provide thirty (30) days advance written notice to Other Party Group prior to cancellation or any material change in coverage or condition.

F. The Commercial General Liability Insurance, Comprehensive Automobile Liability Insurance and Umbrella Liability Insurance policies shall contain provisions that specify that the policies are primary and shall apply to such extent without consideration for other policies separately carried and shall state that each insured is provided coverage as though a separate policy had been issued to each, except the insurer's liability shall not be increased beyond the amount for which the insurer would have been liable had only one insured been covered. Each Party shall be responsible for its respective deductibles or retentions.

G. The Commercial General Liability Insurance, Comprehensive Automobile Liability Insurance and Umbrella Liability Insurance policies, if written on a Claims First Made basis, shall be maintained in full force and effect for two (2) years after termination of this Agreement, which coverage may be in the form of tail coverage or extended reporting period coverage if agreed by the Parties.

H. The requirements contained herein as to the types and limits of all insurance to be maintained by the Parties are not intended to and shall not in any manner, limit or qualify the liabilities and obligations assumed by the Parties under this Agreement.

I. Within ten (10) days following execution of this Agreement, and as soon as practicable at the renewal of the insurance policy and in any event within ninety (90) days thereafter, each Party shall provide certification of all insurance required in this Agreement, executed by each insurer or by an authorized representative of each insurer.

J. Notwithstanding the foregoing, each Party may self-insure to the extent it maintains a self-insurance program; provided that, such Party's senior secured debt is rated at investment grade, or better, by Standard & Poor's. For any period of time that a Party's senior secured debt is unrated by Standard & Poor's or is rated at less than investment grade by Standard & Poor's, such Party shall comply with the insurance requirements applicable to it under Sections 9.1.A through 9.1.I. In the event that a Party is permitted to self-insure pursuant to this Section 9.1.J, it shall not be required to comply with the insurance requirements applicable to it under Sections 9.1.A through 9.1.I.

K. The Parties agree to report to each other in writing as soon as practical all accidents or occurrences resulting in injuries to any person constituting grievous bodily harm, including death, and any property loss in excess of the greater of (i) \$150,000 and (ii) the property loss deductible on such Party's property insurance, related to and arising out of this Agreement.

ARTICLE 10. MISCELLANEOUS

10.1 Governing Law and Applicable Tariffs.

A. This Agreement for all purposes shall be construed in accordance with and governed by the laws of the State of Texas, excluding conflicts of law principles that would refer to the laws of another jurisdiction. The Parties submit to the jurisdiction of the federal and state courts in the State of Texas.

B. This Agreement is subject to all valid, applicable rules, regulations and orders of, and tariffs approved by, duly constituted Governmental Authorities.

C. Each Party expressly reserves the right to seek changes in, appeal, or otherwise contest any laws, orders, rules, or regulations of a Governmental Authority.

10.2 No Other Services. This Agreement is applicable only to the interconnection of the Plant to the TSP System at the Point of Interconnection and does not obligate either Party to provide, or

entitle either Party to receive, any service not expressly provided for herein. Each Party is responsible for making the arrangements necessary for it to receive any other service that it may desire from the other Party or any third party. This Agreement does not address the sale or purchase of any electric energy, transmission service or ancillary services by either Party, either before or after Commercial Operation.

10.3 Entire Agreement. This Agreement, including all Exhibits, Attachments and Schedules attached hereto, constitutes the entire agreement between the Parties with reference to the subject matter hereof, and supersedes all prior and contemporaneous understandings or agreements, oral or written, between the Parties with respect to the subject matter of this Agreement. There are no other agreements, representations, warranties, or covenants which constitute any part of the consideration for, or any condition to, either Party's compliance with its obligations under this Agreement. Notwithstanding the other provisions of this Section, the Facilities Study Agreement, if any, is unaffected by this Agreement.

10.4 Notices. Except as otherwise provided in Exhibit "D", any formal notice, demand or request provided for in this Agreement shall be in writing and shall be deemed properly served, given or made if delivered in person, or sent by either registered or certified mail, postage prepaid, overnight mail or fax to the address or number identified on Exhibit "D" of this Agreement. Either Party may change the notice information on Exhibit "D" by giving five (5) business days written notice prior to the effective date of the change.

10.5 Force Majeure.

A. The term "Force Majeure" as used herein shall mean any cause beyond the reasonable control of the Party claiming Force Majeure, and without the fault or negligence of such Party, which materially prevents or impairs the performance of such Party's obligations hereunder, including but not limited to, storm, flood, lightning, earthquake, fire, explosion, failure or imminent threat of failure of facilities, civil disturbance, strike or other labor disturbance, sabotage, war, national emergency, or restraint by any Governmental Authority.

B. Neither Party shall be considered to be in Default (as hereinafter defined) with respect to any obligation hereunder (including obligations under Article 4), other than the obligation to pay money when due, if prevented from fulfilling such obligation by Force Majeure. A Party unable to fulfill any obligation hereunder (other than an obligation to pay money when due) by reason of Force Majeure shall give notice and the full particulars of such Force Majeure

to the other Party in writing or by telephone as soon as reasonably possible after the occurrence of the cause relied upon. Telephone notices given pursuant to this Section shall be confirmed in writing as soon as reasonably possible and shall specifically state full particulars of the Force Majeure, the time and date when the Force Majeure occurred and when the Force Majeure is reasonably expected to cease. The Party affected shall exercise due diligence to remove such disability with reasonable dispatch, but shall not be required to accede or agree to any provision not satisfactory to it in order to settle and terminate a strike or other labor disturbance.

10.6 Default

A. The term “Default” shall mean the failure of either Party to perform any obligation in the time or manner provided in this Agreement. No Default shall exist where such failure to discharge an obligation (other than the payment of money or the obligation of the Generator under Exhibit “E”) is the result of Force Majeure as defined in this Agreement or the result of an act or omission of the other Party. Upon a Default, the non-defaulting Party shall give written notice of such Default to the defaulting Party. Except as provided in Section 10.6.B or, if applicable, Section 2 of Exhibit “E”, the defaulting Party shall have thirty (30) days from receipt of the Default notice within which to cure such Default; provided however, if such Default is not capable of cure within 30 days, the defaulting Party shall commence such cure within 30 days after the Default notice and continuously and diligently complete such cure within 90 days from receipt of the Default notice; and, if cured within such time, the Default specified in such Default notice shall cease to exist.

B. If a Default is not cured as provided in this Section, or if a Default is not capable of being cured within the period provided for in Section 10.6.A herein, the non-defaulting Party shall have the right to terminate this Agreement by written notice at any time until cure occurs, and be relieved of any further obligation hereunder and, whether or not that Party terminates this Agreement, to recover from the defaulting Party all amounts due hereunder, plus all other damages and remedies to which it is entitled at law or in equity. The provisions of this Section will survive termination of this Agreement.

10.7 Intrastate Operation. The operation of the Plant by Generator shall not cause there to be a synchronous or an asynchronous interconnection between ERCOT and any other transmission facilities operated outside of ERCOT unless ordered by the Federal Energy Regulatory

Commission under Section 210 of the Federal Power Act. The Parties recognize and agree that any such interconnection will constitute an adverse condition giving the TSP the right to immediately disconnect the TIF from the GIF, until such interconnection has been disconnected. The Generator will not be prohibited by this Section from interconnecting the Plant with facilities operated by the Comision Federal de Electricidad of Mexico, unless such interconnection would cause ERCOT utilities that are not “public utilities” under the Federal Power Act to become subject to the plenary jurisdiction of the Federal Energy Regulatory Commission.

10.8 No Third Party Beneficiaries. This Agreement is not intended to and does not create rights, remedies, or benefits of any character whatsoever in favor of any persons, corporations, associations, or entities other than the Parties, and the obligations herein assumed are solely for the use and benefit of the Parties, their successors in interest and, where permitted, their assigns.

10.9 No Waiver. The failure of a Party to this Agreement to insist, on any occasion, upon strict performance of any provision of this Agreement will not be considered a waiver of obligations, rights, or duties imposed upon the Parties. Termination or Default of this Agreement for any reason by the Generator shall not constitute a waiver of the Generator’s legal rights to obtain an interconnection from the TSP under a new interconnection agreement.

10.10 Headings. The descriptive headings of the various articles and sections of this Agreement have been inserted for convenience of reference only and are of no significance in the interpretation or construction of this Agreement.

10.11 Multiple Counterparts. This Agreement may be executed in two or more counterparts, each of which is deemed an original but all constitute one and the same instrument.

10.12 Amendment. This Agreement may be amended only upon mutual agreement of the Parties, which amendment will not be effective until reduced to writing and executed by the Parties.

10.13 No Partnership. This Agreement shall not be interpreted or construed to create an association, joint venture, agency relationship, or partnership between the Parties or to impose any partnership obligation or liability upon either Party. Neither Party shall have any right, power or authority to enter into any agreement or undertaking for, or act on behalf of, or to act as or be an agent or representative of, or to otherwise bind, the other Party.

10.14 Further Assurances. The Parties agree to (i) furnish upon request to each other such further information, (ii) execute and deliver to each other such other documents, and (iii) do such other acts and things, all as the other Party may reasonably request for the purpose of carrying out the

intent of this Agreement and the documents referred to in this Agreement. Without limiting the generality of the foregoing, the TSP shall, at the Generator's expense, when reasonably requested to do so by the Generator at any time after the execution of this Agreement, prepare and provide such information in connection with this Agreement (including, if available, resolutions, certificates, opinions of counsel or other documents relating to the TSP's corporate authorization to enter into this Agreement and to undertake the obligations set out herein) as may be reasonably required by any potential lender to the Generator under a proposed loan agreement. The TSP will use commercially reasonable efforts to obtain any opinion of counsel reasonably requested by Generator, but the TSP shall not be in Default of any obligation under this Agreement if the TSP is unable to provide an opinion of counsel that will satisfy any potential lender to the Generator. Specifically, upon the written request of one Party, the other Party shall provide the requesting Party with a letter stating whether or not, up to the date of the letter, that Party is satisfied with the performance of the requesting Party under this Agreement.

10.15 Indemnification and Liability. The indemnification and liability provisions of the PUCT Rule 25.202(b)(2) or its successor shall govern this Agreement.

10.16 Consequential Damages. OTHER THAN THE LIQUIDATED DAMAGES HERETOFORE DESCRIBED, IN NO EVENT SHALL EITHER PARTY BE LIABLE UNDER ANY PROVISION OF THIS AGREEMENT FOR ANY LOSSES, DAMAGES, COSTS OR EXPENSES FOR ANY SPECIAL, INDIRECT, INCIDENTAL, CONSEQUENTIAL, OR PUNITIVE DAMAGES, INCLUDING BUT NOT LIMITED TO LOSS OF PROFIT OR REVENUE, LOSS OF THE USE OF EQUIPMENT, COST OF CAPITAL, COST OF TEMPORARY EQUIPMENT OR SERVICES, WHETHER BASED IN WHOLE OR IN PART IN CONTRACT, IN TORT, INCLUDING NEGLIGENCE, STRICT LIABILITY, OR ANY OTHER THEORY OF LIABILITY; PROVIDED, HOWEVER, THAT DAMAGES FOR WHICH A PARTY MAY BE LIABLE TO THE OTHER PARTY UNDER ANOTHER AGREEMENT WILL NOT BE CONSIDERED TO BE SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES HEREUNDER.

10.17 Assignment. This Agreement may be assigned by either Party only with the written consent of the other, which consent will not be unreasonably withheld or delayed; provided that either Party may assign this Agreement without the consent of the other Party to any affiliate of the assigning Party with an equal or greater credit rating and with the legal authority and operational

ability to satisfy the obligations of the assigning Party under this Agreement; and provided further that the Generator shall have the right to assign this Agreement, without the consent of the TSP, for collateral security purposes to aid in providing financing for the Plant, provided that the Generator will require any secured party, trustee or mortgagee to notify the TSP of any such assignment. Any financing arrangement entered into by the Generator pursuant to this Section will provide that prior to or upon the exercise of the secured party's, trustee's or mortgagee's assignment rights pursuant to said arrangement, the secured creditor, the trustee or mortgagee will notify the TSP of the date and particulars of any such exercise of assignment right(s). Any attempted assignment that violates this Section is void and ineffective. Any assignment under this Agreement shall not relieve a Party of its obligations, nor shall a Party's obligations be enlarged, in whole or in part, by reason thereof. Where required, consent to assignment will not be unreasonably withheld, conditioned or delayed. Notwithstanding anything to the contrary in this Agreement, TSP, without approval of Generator, may assign, transfer, mortgage or pledge this Agreement to create a security interest for the benefit of the United States of America, acting through the Administrator of the RUS or its successor or for the benefit of the National Rural Utilities Cooperative Finance Corporation ("CFC") or its successor, or other secured party (directly or through an indenture trustee or other collateral agent), each, including such indenture trustee or other collateral agent, a "Secured Party". Thereafter, a Secured Party, without the approval of Generator, may (a) cause this Agreement (and all obligations hereunder) to be sold, assigned, transferred or otherwise disposed of to a third party pursuant to the terms governing such security interest, or (b) if the RUS or CFC first acquires this Agreement pursuant to 7 U.S.C. §907, or any other Secured Party otherwise first acquires this Agreement, sell, assign, transfer or otherwise dispose of this Agreement (and all obligations hereunder) to a third party; provided, however, that in either case (1) TSP is in default of its obligations that are secured by such security interest and that the applicable Secured Party has given Generator written notice of such default, and (2) the applicable Secured Party has given Generator thirty (30) calendar days' prior written notice of its intention to sell, assign, transfer or otherwise dispose of this Agreement (and all obligations hereunder) indicating the identity of the intended third-party assignee or purchaser. Notwithstanding the foregoing, neither Party may assign this Agreement to any company which meets the criteria of Texas Business & Commerce Code Sec. 113.002, Prohibited Access to

Critical Infrastructure, or which is otherwise prohibited from controlling or accessing critical infrastructure in the State of Texas.

10.18 Severability. If any provision in this Agreement is finally determined to be invalid, void or unenforceable by any court having jurisdiction, such determination shall not invalidate, void or make unenforceable any other provision, agreement or covenant of this Agreement; provided that if the Generator (or any third-party, but only if such third-party is not acting at the direction of the TSP) seeks and obtains such a final determination with respect to any provision of Section 4.1.B, then none of the provisions of Section 4.1.B. shall thereafter have any force or effect and the Parties' rights and obligations shall be governed solely by Section 4.1.A.

10.19 Comparability. The Parties will comply with all applicable comparability and code of conduct laws, rules and regulations, as amended from time to time.

10.20 Invoicing and Payment. Unless the Parties otherwise agree (in a manner permitted by applicable PUCT Rules and as specified in writing in an Exhibit "E" attached hereto), invoicing and payment rights and obligations under this Agreement shall be governed by PUCT Rules or applicable Governmental Authority. Invoices shall be rendered to the paying Party at the address specified on, and payments shall be made in accordance with the requirements of, Exhibit "D".

10.21 Confidentiality.

A. Subject to the exception in Section 10.21.B, any information that a Party claims is competitively sensitive, commercial or financial information under this Agreement ("Confidential Information") shall not be disclosed by the other Party to any person not employed or retained by the other Party, except to the extent disclosure is (i) required by law; (ii) reasonably deemed by the disclosing Party to be required to be disclosed in connection with a dispute between or among the Parties, or the defense of litigation or dispute; (iii) otherwise permitted by consent of the other Party, such consent not to be unreasonably withheld; or (iv) necessary to fulfill its obligations under this Agreement or as a transmission service provider including disclosing the Confidential Information to ERCOT. The Party asserting confidentiality shall notify the other Party in writing of the information it claims is confidential. Prior to any disclosures of the other Party's Confidential Information under this subsection, or if any third party or Governmental Authority makes any request or demand for any of the information described in this subsection, the disclosing Party agrees to promptly notify the other Party in writing and agrees to assert confidentiality and

cooperate with the other Party in seeking to protect the Confidential Information from public disclosure by confidentiality agreement, protective order or other reasonable measures.

B. This provision shall not apply to any information that was or is hereafter in the public domain (except as a result of a breach of this provision).

Exhibit “B” Time Schedule

Interconnection Option chosen by Generator (check one): X Section 4.1.A. or Section 4.1.B.

If Section 4.1.B is chosen by Generator, the In-Service Date(s) was determined by (check one):
(1) good faith negotiations, or (2) Designated by Generator upon failure to agree.

Date by which Generator must provide notice to proceed with design and procurement and provide security, as specified in Section 4.2, so that TSP may maintain schedule to meet the In-Service Date:

Alina Solar Phase: April 1, 2025
Alina BESS Phase: April 1, 2025

Date by which Generator must provide notice to commence construction and provide security, as specified in Section 4.3, so that TSP may maintain schedule to meet the In-Service Date:

Alina Solar Phase: April 1, 2026
Alina BESS Phase: April 1, 2026

In - Service Date(s):

For the TIF associated with each Phase as described in Exhibit “C”, Section 8:

Alina Solar Phase: April 1, 2028
Alina BESS Phase: April 1, 2028

Scheduled Trial Operation Date:

Alina Solar Phase: May 31, 2028
Alina BESS Phase: May 31, 2028

Scheduled Commercial Operation Date:

Alina Solar Phase: June 30, 2028
Alina BESS Phase: June 30, 2028

Due to the nature of the subject of this Agreement, the Parties may mutually agree to change the date and time of this Exhibit B.

TSP agrees that if Generator has achieved Commercial Operation with respect to the Alina Solar Phase of the Plant and Generator (i) notifies the TSP that it does not intend to complete the Alina BESS Phase, or (ii) fails to achieve Commercial Operation of the Alina BESS Phase within 12

months following the scheduled Commercial Operation, then this Agreement shall be amended to remove references to the Alina BESS Phase.

Exhibit “C”

Interconnection Details

1. **Name:** Anila Solar and Storage
2. **Point of Interconnection location:** The Point of Interconnection(s) is located in Wilson County, Texas, at Brazos Electric’s 345 kV Switching Station (“Station”). Specifically, the Point of Interconnection shall be defined as the points where Brazos Electric’s jumpers from Brazos Electric’s 345 kV Disconnect Switch in the Station connect to the 4 hole pad on the first 345 kV dead end structure in the Generator’s Plant Switchyard (“Generator’s Switchyard”). The Station and the Generator’s Switchyard will be located adjacent to each other. The Station is located 0.5 miles north of FM 405, approximately 4.25 miles northeast of Floresville, Texas (See attached one-line diagram).
3. **Delivery Voltage:** 345 kV
4. **Number and size of Generating Units:**

The Plant consists of a solar generation facility and a battery energy storage system (BESS) with one Point of Interconnection to the electric system grid. The Plant rating will be 400 MW of AC power (200 MW solar plus 200 MW BESS) at the Point of Interconnection.

Anila Solar Phase: 59 SMA SC 4200 UP-US inverters each rated at 3.44988 MW with a nameplate of 4.06667 MVA resulting in 203.54292 MW gross at the generator terminals; and

Anila BESS Phase: 72 SMA SCS 3600 UP-XT-US inverters rated at 2.93261 MW (3.822 MVA nameplate) A.C. each resulting in 211.14792 MW gross at the generator terminals
5. **Type of Generating Unit:**

The Plant consists of solar generation and a battery energy storage system (BESS) with one Point of Interconnection to the electric system grid.

Anila Solar Phase: SMA SC 4200 UP-US solar inverter; and

Anila BESS Phase: SMA SCS 3600 UP-XT-US BESS inverter.
6. **Metering and telemetry equipment:** Metering (voltage, location, losses adjustment due to metering location, and other), telemetry, and communications circuits:
 - (a) TSP shall, in accordance with ERCOT Requirements and Good Utility Practice, procure, install, own, operate, inspect, test, calibrate and maintain 345 kV metering accuracy potential and current transformers and associated metering and telemetry equipment (including an RTU) located in the Station, as indicated in the one-line diagram attached to this Exhibit “C”.
 - (b) Generator shall, in accordance with ERCOT Requirements and Good Utility Practice, procure, install, own, operate, inspect, test, calibrate and maintain the metering and telemetry equipment (including an RTU or other equipment acceptable to TSP) to supply all electrical parameters of the Generator’s Plant and GIF, as specified in this Exhibit “C”, to TSP in accordance with item (c) below.

(c) Generator shall, in accordance with ERCOT Requirements and Good Utility Practice, provide communications facilities that are, or may in the future be, necessary for the effective operation of the Generator's Plant and the Transmission System. Generator will directly make arrangements to procure and will bear the procurement, installation, maintenance, and ongoing costs of such facilities.

7. **Generator Interconnection Facilities:** The GIF shall be installed, owned and operated by the Generator at the Generator's expense and consist of the facilities shown in the attached one-line diagram, including the following:

Generator Switchyard Equipment - the following list of major switchyard equipment will be necessary for the operation of the 345 kV switchyard at the Generator's Plant:

- (Lot) Circuit breakers, 345 kV, 2000 amperes, with 2 sets of 2000/5, C800 MRCTs for line current differential relaying.
- (Lot) Switches, air break, 345 kV, 2000, amperes, gang operated, 3 phase.
- (Lot) CCVTs, 345 kV, dual secondary windings as required for Generator metering and relaying
- (2 ea.) Step-up unit transformer to convert generator voltage to 345 kV (1 for Alina Solar and 1 for Alina BESS)
- (2 ea.) Supervisory equipment, SCADA RTU (1 for Alina Solar and 1 for Alina BESS)
- (Lot) Metering, telemetry, and communications equipment
- (4 ea.) Relay panels (differential and line) (2 for Alina Solar and 2 for Alina BESS)
- (Lot) 345 kV bus extension to the Point of Interconnection.
- (Lot) Associated structures, including deadend, buswork, conductor, connectors, grounding, conduit, control cable, foundation work, perimeter fencing, grading/dirt work and any appurtenances necessary for construction of the GIF.

The above list is not intended to be a complete list of all facilities that are part of the GIF.

8. **Transmission Service Provider Interconnection Facilities:** The TIF shall be installed, owned and operated by the TSP at the TSP's expense and include the facilities shown in the attached one-line diagram and shall consist of the following:

Station

- (3 ea.) Circuit breaker, 345 kV, 5000 amperes, 63 kA
- (21 ea.) Switch, air break, 345 kV, 5000 amperes, gang operated, 3 phase
- (12 ea.) CCVTs, 345 kV, dual secondary windings for relaying
- (2 ea.) Power PTs, oil filled, 345 kV, dual core
- (1 lot) Surge arresters, 345 kV
- (1 lot) EPS metering including current and potential transformers for metering and relaying
- (1 lot.) Supervisory equipment, SCADA RTU, radio equipment
- (8 ea.) Breaker control/relay panels
- (1 ea.) Control house w/ battery set and associated indoor accessories
- (1 ea.) Communication tower
- (Lot) 345 kV bus extension from the Station to the Point of Interconnection.
- (1 ea.) Disconnect Switch and associated bus jumpers located near the Point of Interconnection

- (1 lot) All galvanized steel structures, including deadends, switch stands, metering structures, surge arrester supports, CCVT supports, PT supports, static masts, and bus supports necessary for construction and operation of the Station
- (1 lot) Associated buswork, conductor, connectors, grounding, conduit, control cable, foundation work, perimeter fencing, grading/dirt work and any appurtenances necessary for operation of the transmission facilities

Property as needed to accommodate the Station

Existing San Miguel to Elm Creek 345 kV transmission line (“Existing Line”) and any transmission modifications necessary to terminate such Existing Line into the Station.

The above list is not intended to be a complete list of all facilities that are part of the TIF.

9. **Communications Facilities:**

- (a) The TSP shall provide to the Station a phone circuit for the EPS meter data acquisition, a communications circuit for TSP's SCADA RTU, and, if required, a phone circuit for TSP's protective relaying.
- (b) The Generator shall provide necessary communications facilities at Generator's expense, for the effective operation of its facilities as required in Items 6(b) and 6(c) above.

10. **System Protection Equipment:** Refer to Section 5.6 and the following:

- (a) The Generator's Plant and GIF shall be designed to isolate any fault, or to correct or isolate any abnormality that would negatively affect the ERCOT System. Generator shall be responsible for protection of its facilities.
- (b) The Generator's Plant and GIF shall have protective relaying that is consistent with the protective relaying criteria as described in ERCOT Requirements and NERC standards. If requested by TSP, Generator shall, at its expense, provide corrections or additions to existing control and protective equipment required to protect the ERCOT System or to comply with government, industry regulations, or standard changes.
- (c) Generator shall install sufficient digital fault recording equipment to thoroughly analyze all system disturbances of the ERCOT System in the immediate area. This equipment shall monitor the voltages at major nodes of the system, current at major branches, breaker and switch positions, and enough of the dc logic in the relay control scheme to analyze a system disturbance.
- (d) Prior to modifying any relay protection system design or relay setting involving the GIF that may impact the TIF, the Generator shall submit the proposed changes to TSP for review and approval. TSP's review and approval shall be for the limited purpose of determining whether such proposed changes are compatible with the ERCOT System.
- (e) TSP shall determine requirements for protection of the Point of Interconnection and the zone of protection around the Point of Interconnection and shall specify and implement protection and control schemes as necessary to meet such requirements. Generator shall have the right to review and comment on the necessary protection requirements and TSP shall consider Generator's comments when determining such requirements. TSP shall coordinate the relay system protection between Generator and the ERCOT System.
- (f) If the GIF facilitate the interconnection of any of the generators at the Plant to the SPP (or any other reliability council other than ERCOT), Generator will utilize open circuit breakers and air-break switches (which provide visible open indication) as a means of isolating such generators from ERCOT.

- (g) Generator will design, construct, and operate its electrical facilities such that all unit auxiliary power sources will come from the same reliability council as the unit output is connected.
- (h) The solar generation and battery energy storage will have low voltage ride through capability in accordance with the ERCOT Requirements.

11. **Inputs to Telemetry Equipment:**

Each 345 kV breaker: Status indication, three phase megawatts and three phase megavars.
Each 345 kV bus: A, B, C phase voltages


12. **Supplemental Terms and Conditions:**

- (a) The GIF or other Generator facilities may come near, or cross, and require modifications to a TSP's transmission line(s) and/or other distribution service provider's distribution line(s). The Generator will be responsible for the cost of such crossings and/or modifications.
- (b) Metering equipment and telemetry shall at all times be in accordance with ERCOT requirements. Temporary exemptions shall not be allowed.
- (c) Generator will sign electric service agreement with the appropriate designated retail electric service provider prior to Commercial Operation Date.


13. **Special Operating Conditions:**

A special ERCOT-approved operating arrangement such as a Remedial Action Plan or Remedial Action Scheme ("RAS") may be implemented either prior to, or after, Commercial Operation. The terms "Remedial Action Plan" and "Remedial Action Scheme" shall have the meanings as set forth in the ERCOT Requirements. TSP and ERCOT will examine the need and feasibility of these arrangements in cooperation with the Generator. In the event that the ERCOT determines that such an arrangement is permitted, then TSP, ERCOT, and Generator will cooperate to design and install the necessary facilities, to be operational for the duration of the period where such Remedial Action Plan or Remedial Action Scheme may be permitted.


Single Line Diagram (for Generator interconnection to achieve COD)

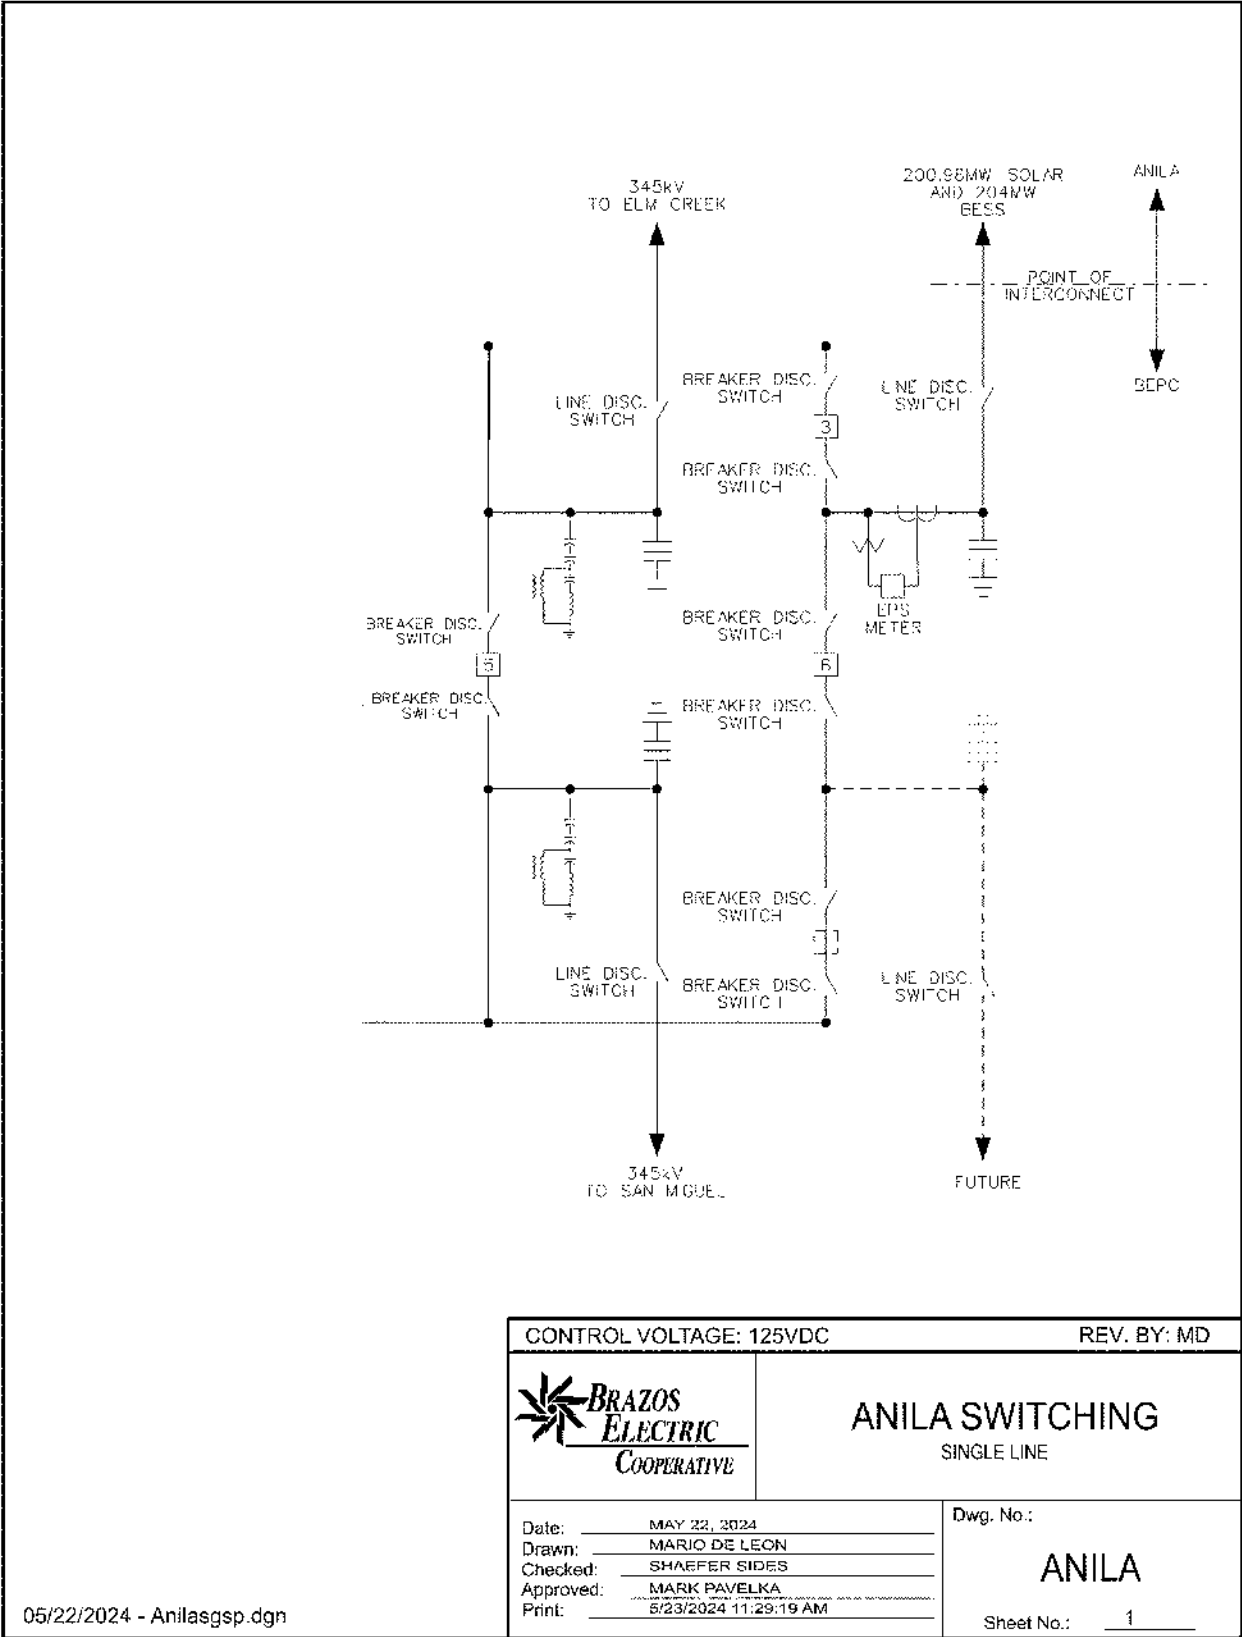


Single Line Diagram (full switchyard build out)

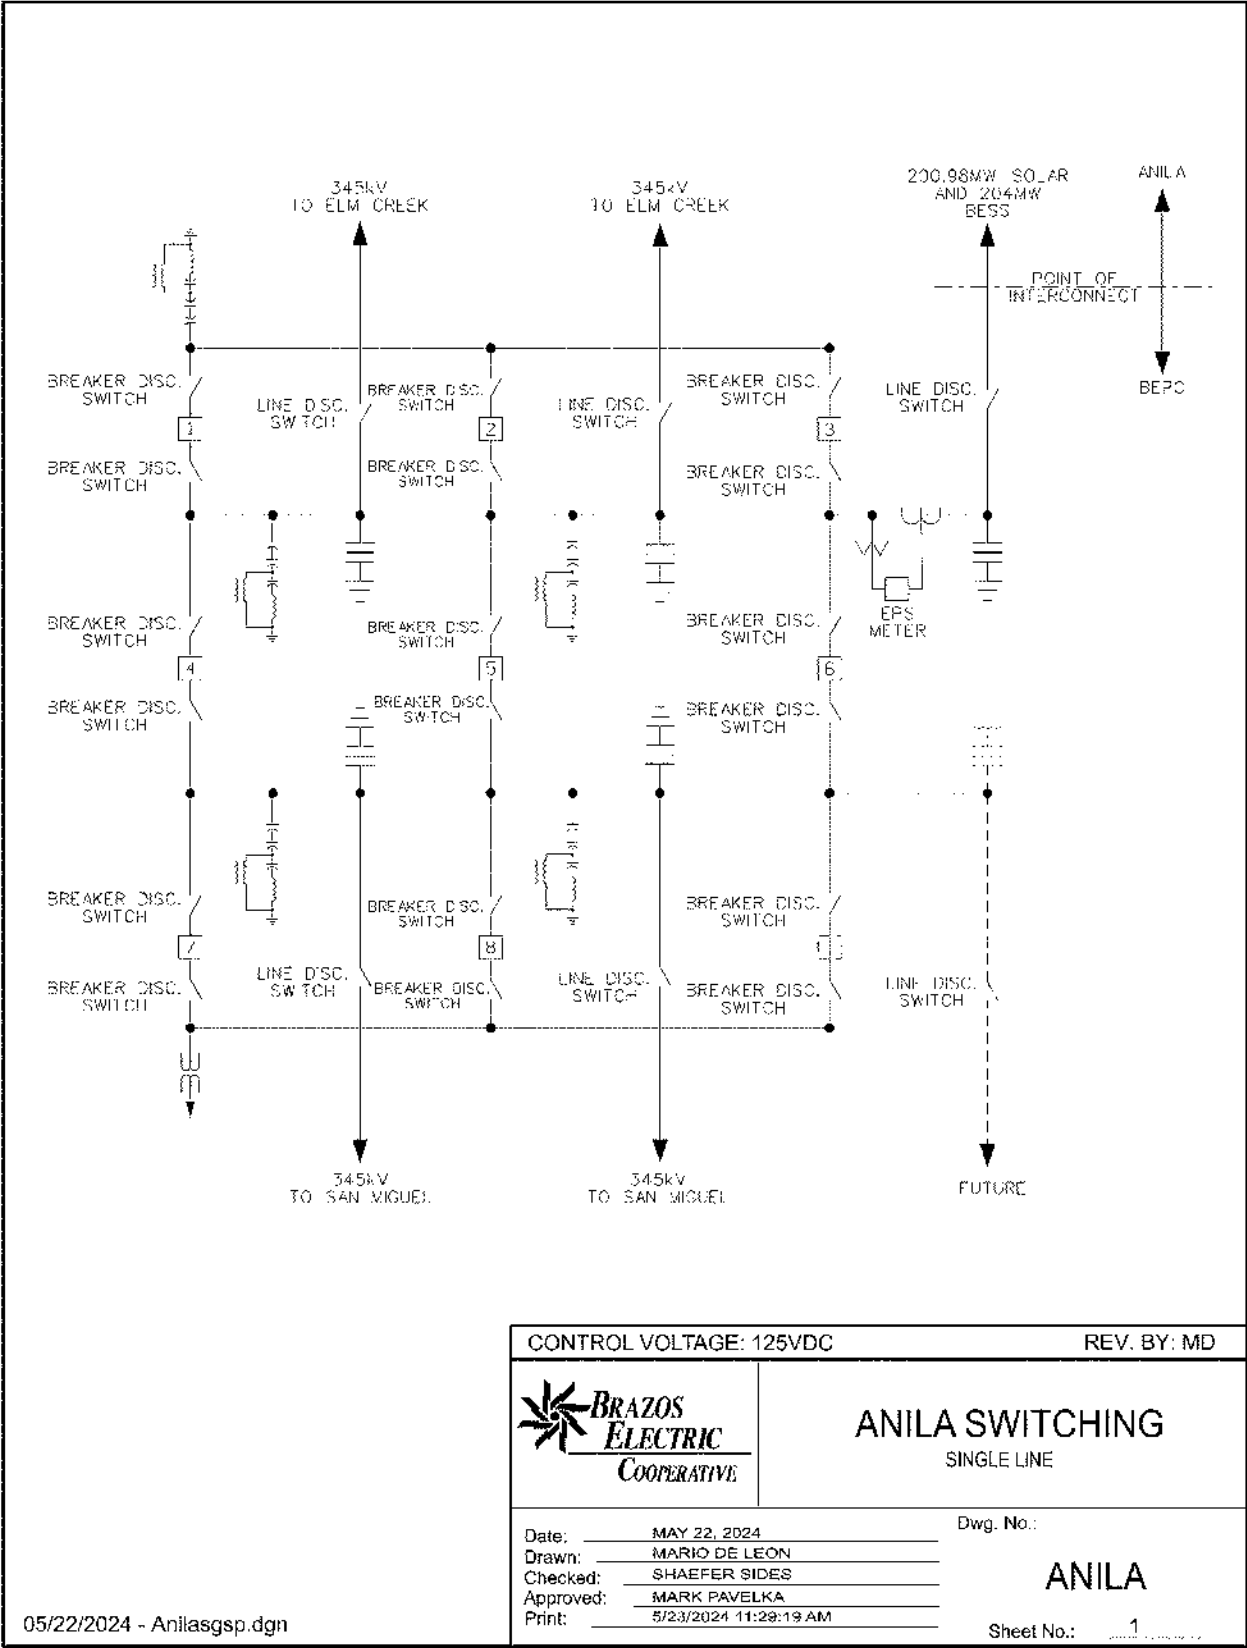

BESS WSL Metering Single Line Diagram:

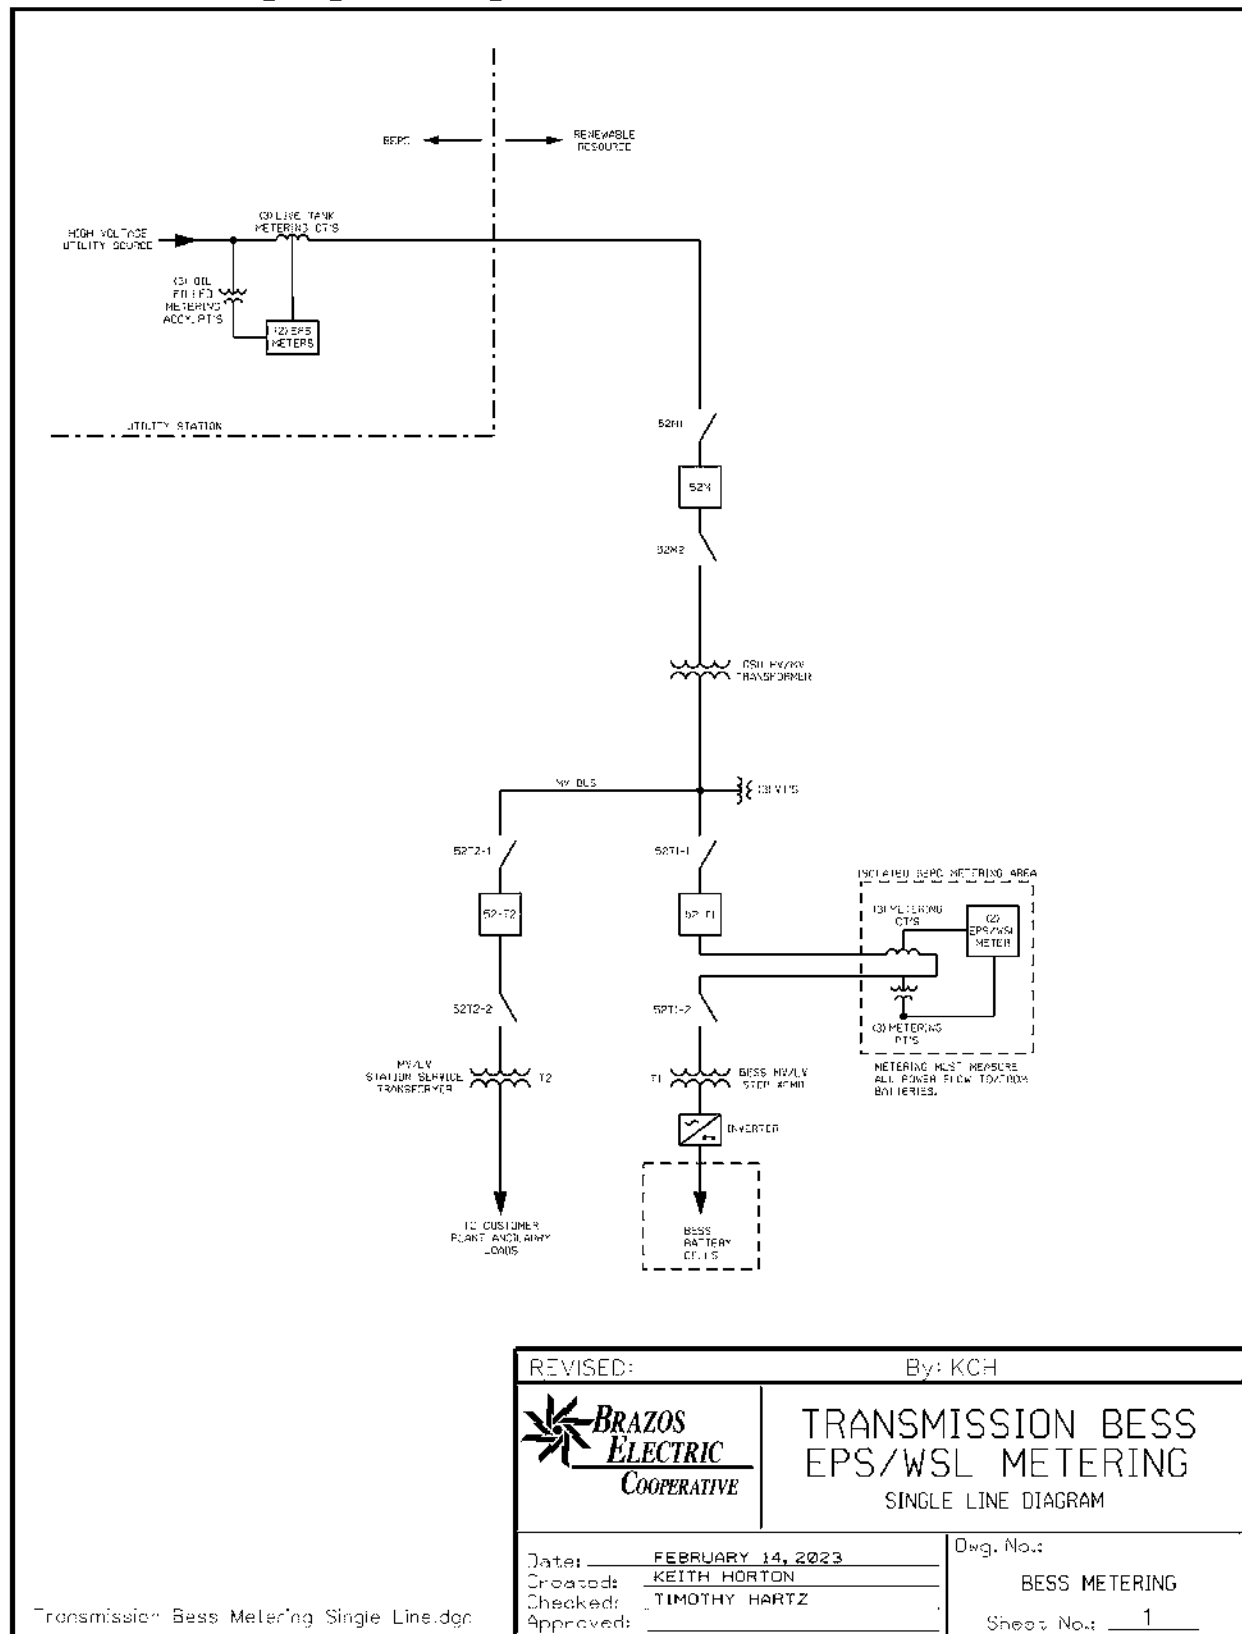

Vicinity Map:

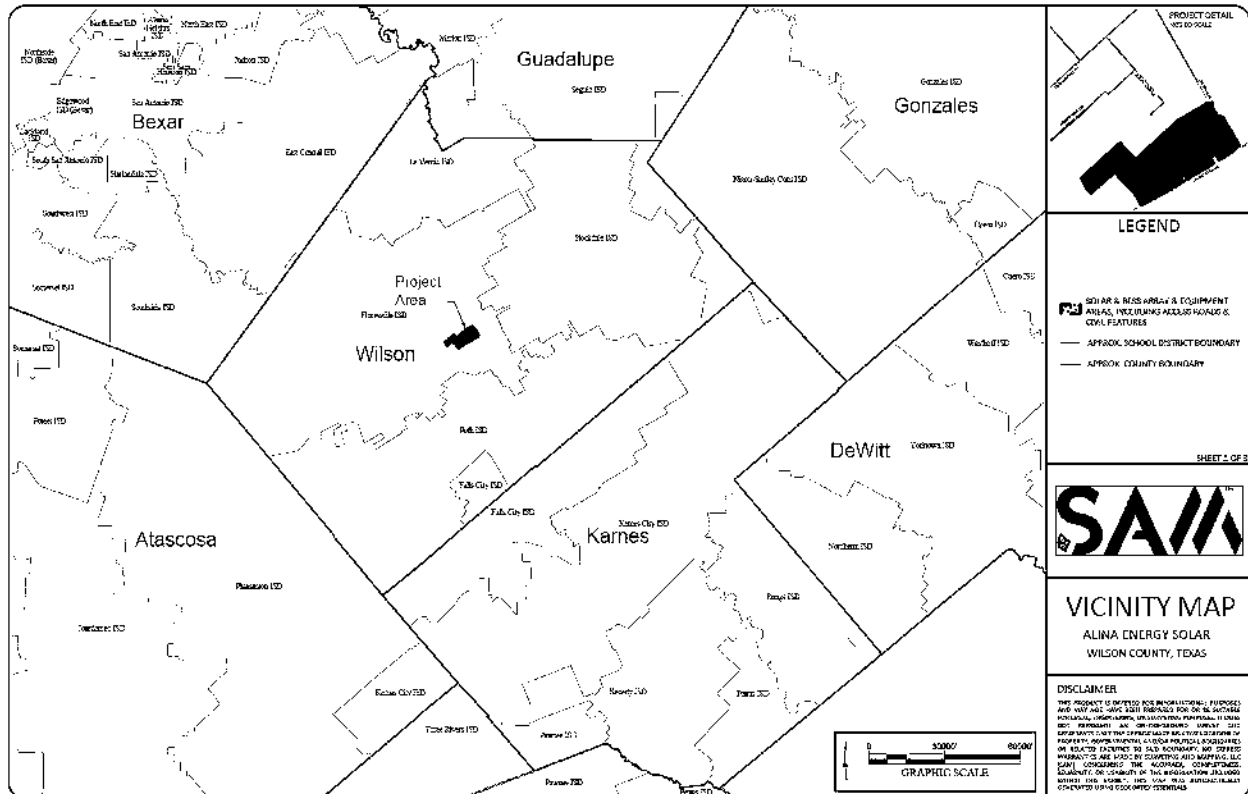

DATE: [2/9/25]

Exhibit "D"
**Notice and EFT Information of the ERCOT Standard Generation
Interconnection Agreement**

(a) All notices of an operational nature shall be in writing and/or may be sent between the Parties via electronic means including facsimile as follows:

If to Brazos Electric

Brazos Electric Power Cooperative, Inc.
Attn: Tony Kroskey
Address: 7616 Bagby Avenue
City, State, Zip: Waco, TX 76712
P.O. Box 2585, Waco, TX 76702-2585
Operational/Confirmation Fax: (254) 750-6288
24 Hour Telephone: (254) 750-6260
E-mail: tkroskey@brazoselectric.com

If to Generator

Alina Energy LLC
Attn: Scott Curry
Address: 155 Federal St., 17th Floor
City, State, Zip: Boston, MA 02110
Operational/Confirmation Fax: 617-456-2201
24 Hour Telephone: 617-416-9931
E-mail: scurry@advanced-power.com

(b) Notices of an administrative nature:

If to Brazos Electric

Brazos Electric Power Cooperative, Inc.
Attn: David Albers
Address: 7616 Bagby Avenue
City, State, Zip: Waco, TX 76712
P.O. Box 2585, Waco, TX 76702-2585
Phone: (254) 750-6358
E-mail: dalbers@brazoselectric.com

If to Generator

Alina Energy LLC
Attn: Scott Curry
Address: 155 Federal St., 17th Floor
City, State, Zip: Boston, MA 02110
Phone: 617-416-9931
E-mail: scurry@advanced-power.com

(c) Notice for statement and billing purposes:

If to Brazos Electric

Brazos Electric Power Cooperative, Inc.
Attn: Brent Fox
Address: 7616 Bagby Avenue
City, State, Zip: Waco, TX 76712
P.O. Box 2585, Waco, TX 76702-2585
Phone: 254-750-6240
E-mail: bfox@brazoselectric.com

If to Generator

Alina Energy LLC
Attn: Accounts Payable, Sean Fisher
Address: 155 Federal St., 17th Floor
City, State, Zip: Boston, MA 02110
Phone: 617-456-2219
E-mail: accountspayable@advancedpowerna.com and
sfisher@advancedpowerna.com

(d) Information concerning Electronic Funds Transfers:

If to Brazos Electric:

Bank Name: Bank of America
City, State: Dallas, TX
ABA No.:
for credit to
Brazos Electric Power Cooperative, Inc.
Account No.:

If to Generator

Alina Energy LLC
Attn: Accounts Payable, Sean Fisher
Address: 155 Federal St., 17th Floor
City, State, Zip: Boston, MA 02110
Phone: 617-456-2219
E-mail: accountspayable@advancedpowerna.com and
sfisher@advancedpowerna.com

Exhibit “E”

Security Arrangement Details

1. Notwithstanding any provisions in the Agreement to the contrary, effective no later than two (2) business days after TSP receives written authorization to proceed with design and procurement and provide security, as specified in Section 4.2, the (“Initial LOC Date”), and shall at all times through the earlier of (i) five (5) business days after the date upon which TSP receives written notification from Generator that Commercial Operation has been achieved, subject to the provisions of Section 8.4, or (ii) forty-five (45) days after the termination of the Agreement in accordance with its terms (the earlier of which shall be the “Final Expiration Date”), cause to be maintained in full force and effect: (a) an “Irrevocable Standby Letter of Credit” for the benefit of TSP in a commercially acceptable form consistent with this Exhibit “E” (substantially in the form shown in Exhibit “E-1” hereto) and otherwise acceptable to TSP, which acceptance shall not be unreasonably withheld, in the amounts and as of the effective dates set forth below; or (b) any of the Alternate Security as defined in Section 3 of this Exhibit “E” below.

2. The Irrevocable Standby Letter of Credit may consist of one or more consecutive terms of at least one (1) year (each a “Term”), the first of which shall have an effective date of the Initial LOC Date; provided, that, the Irrevocable Standby Letter of Credit shall automatically renew from Term to Term without amendment such that there shall be no interruption of the security provided by the Irrevocable Standby Letter of Credit from the Initial LOC Date through the Final Expiration Date. Except to the extent that the Bank, as defined below, has the unilateral right not to renew the Irrevocable Standby Letter of Credit for a successive Term, as described below, the Irrevocable Standby Letter of Credit issued in connection herewith shall have no provision for termination by the Bank or Generator.

The Irrevocable Standby Letter of Credit shall provide security to TSP in the amounts and effective dates as shown below. In the event that Generator does not deliver to TSP an Irrevocable Standby Letter of Credit in the amounts and on the effective dates as shown below, TSP shall have the right to draw under any then outstanding Irrevocable Letter of Credit to cover the all costs incurred in the design of facilities associated with the TIF and any other costs incurred by TSP, and TSP shall have the right to terminate this Agreement. Failure to deliver the Irrevocable Standby Letter of Credit in the specified amounts within the time periods specified below shall be deemed a Default under Section 10.6 of the Agreement, notwithstanding any cure period otherwise provided for in Section 10.6.

To the extent that the Bank has the unilateral right not to renew the Irrevocable Standby Letter of Credit for a successive Term, the Bank shall give notice to TSP and Generator in writing by certified mail, return receipt requested or via courier service, of the exercise of its right not to renew the Irrevocable Standby Letter of Credit for a successive Term (an “Expiring Term”) not less than sixty (60) days prior to the expiration date of any Expiring Term. Generator hereby agrees that in the event that the Bank gives such notice and Generator does not provide TSP with a substitute Irrevocable Standby Letter of Credit in substantially the same form as the expiring Irrevocable Standby Letter of Credit within thirty (30) days after the date of such notice, TSP shall

have the right to draw on the entire amount of security from the expiring Irrevocable Standby Letter of Credit to cover the costs incurred (or committed to be incurred) by TSP as of the date of retention of such security in planning, licensing, procuring equipment and materials for, and constructing the TIF, and TSP shall have the right to terminate this Agreement. Any excess proceeds over and above TSP's costs shall be held as a cash deposit subject to Section 8.3. The substitute Irrevocable Standby Letter of Credit shall meet the requirements of this Exhibit "E" and be otherwise acceptable to TSP, which acceptance shall not be unreasonably withheld. Failure to provide a substitute Irrevocable Standby Letter of Credit within the time period specified above shall be deemed a Default under Section 10.6 of the Agreement, notwithstanding any cure period otherwise provided for in Section 10.6. "Irrevocable Standby Letter of Credit" shall mean an irrevocable, transferable letter of credit, issued by a Generator-selected and TSP-approved (which approval shall not be unreasonably withheld), major U.S. commercial bank with a credit rating of at least "A-" by Standard & Poor's or "A3" by Moody's Investor Service ("Bank").

If at any time during the term of this Agreement, the TSP-approved Bank, which has issued the then current Irrevocable Standby Letter of Credit, suffers a credit rating reduction to less than "A-" by Standard & Poor's or "A3" by Moody's Investor Service, Generator shall replace that Irrevocable Standby Letter of Credit with another Irrevocable Standby Letter of Credit of the same amount and with the same beneficiary from another TSP-approved Bank of Generator's choice within fifteen (15) business days of the date of such reduction in rating ("Required LOC Replacement Date"). Failure to deliver a replacement Irrevocable Standby Letter of Credit by the Required LOC Replacement Date, the reduction in rating shall be deemed a Default under Section 10.6 of the Agreement, notwithstanding any cure period otherwise provided for in Section 10.6.

The Irrevocable Standby Letter of Credit shall provide security to TSP (for recovery of its engineering, design, equipment procurement, and construction costs for the TIF described in Exhibit C) as follows:

- A. An Irrevocable Standby Letter of Credit in an amount totaling One Million Six Hundred Fifty Thousand Dollars (\$1,650,000) to be provided concurrently with execution of this Agreement.
- B. An Irrevocable Standby Letter of Credit in an amount totaling Two Million Dollars (\$2,000,000) to be provided concurrently with the Initial LOC Date.
- C. An Irrevocable Standby Letter of Credit in an amount totaling Sixteen Million Six Hundred Fifty Thousand (\$16,650,000) to be provided concurrently with the TSP receiving written authorization to proceed with construction of either Phase from the Generator as required under Section 4.3 of Exhibit "A" ("Subsequent LOC Date")

Any time after the Subsequent LOC Date, TSP may, by written notice to Generator, require Generator to increase or replenish the security from time to time if TSP determines in its reasonable discretion that the remaining security amount is not adequate to cover the costs that TSP then reasonably estimates could become payable pursuant to this Agreement; provided, however, that TSP may not require additional security amounts for costs that are caused by TSP's failure to comply with its obligations under this Agreement. Generator will tender any such increase or

replenishment of the security to TSP within thirty (30) days of the date of TSP's written notice to Generator of a necessary increase or replenishment.

Failure to deliver, maintain, replace, increase or replenish the security within the time periods noted in this Exhibit "E" shall be deemed a Default under Section 10.6 of the Agreement, notwithstanding any cure period otherwise provided for in Section 10.6. No forbearance or delay on the part of TSP in requiring an increase, replenishment, or replacement of the security will be considered a waiver of TSP's right to do so.

3. Generator may elect to provide all or a portion of the security in the form of a cash deposit. Payments by Generator to TSP under this Agreement shall be made in immediately available funds payable to TSP pursuant to wire transfer instructions to be provided by TSP to Generator, or other form of payment acceptable to TSP.

Generator may replace a cash deposit with an Irrevocable Letter of Credit after review and acceptance of a Letter of Credit from a bank acceptable to TSP. TSP shall return the cash deposit to Generator, as per Section 8.3, in exchange for the Irrevocable Letter of Credit once the Letter of Credit is fully acceptable to TSP.

EXHIBIT "E-1"

FORM OF IRREVOCABLE STANDBY LETTER OF CREDIT FORMAT

DATE OF ISSUANCE: _____

[Address]

Re: Credit No. _____

We hereby establish our Irrevocable Transferable Standby Letter of Credit in your favor for the account of _____ (the "Account Party"), for the aggregate amount not exceeding _____ United States Dollars (\$ _____), available to you at sight upon demand at our counters at (Location) on or before the expiration hereof against presentation to us of one or more of the following statements, dated and signed by a representative of the beneficiary:

"The beneficiary is entitled to draw on this Letter of Credit in accordance with the ERCOT Standard Interconnection Agreement between the Account Party and beneficiary dated _____. Wherefore, the undersigned does hereby demand payment of \$ _____ USD. [Beneficiary fills in the amount not to exceed the full value of the letter of credit]"

This Letter of Credit shall expire on _____.

The amount which may be drawn by you under this Letter of Credit shall be automatically reduced by the amount of any drawings paid through the Issuing Bank referencing this Letter of Credit No. _____. Partial drawings are permitted hereunder. All commissions, expenses and charges incurred with this Letter of Credit are for the account of the Account Party.

We hereby agree with you that documents drawn under and in compliance with the terms of this Letter of Credit shall be duly honored upon presentation as specified.

Except as far as otherwise expressly stated herein, this irrevocable Transferable Standby Letter of Credit is subject to the International Standby Practices ("ISP98"), International Chamber of Commerce Publication No. 590, and as to matter not governed by the ISP98, shall be governed by and construed in accordance with the laws of the State of New York and applicable U.S. federal law.

In the event of an Act of God, riot, civil commotion, insurrection, war or any other cause beyond our control that interrupts our business (collectively, an "Interruption Event") and causes the place for presentation of this Letter of Credit to be closed for business on the last day for presentation, the expiry date of this Letter of Credit will be automatically extended without amendment to a date thirty (30) calendar days after the place for presentation reopens for business.

This Letter of Credit is transferable, and we hereby consent to such transfer, but otherwise may not be amended, changed or modified without the express written consent of the beneficiary, the Issuing Bank and the Account Party.

[BANK SIGNATURE]