



Control Number: 35077



Item Number: 221

Addendum StartPage: 0

Project No. 35077

First Amendment to

INTERCONNECTION AGREEMENT

Between

City of Mason

and

LCRA Transmission Services Company

11/13/13 01:16:13
AMERICAN

January 20, 2010

**FIRST AMENDMENT TO
INTERCONNECTION AGREEMENT**

This First Amendment ("Amendment") is made and entered into this 20th day of January, 2009, between the City of Mason ("City") and the LCRA Transmission Services Corporation ("Corporation") collectively referred to hereinafter as the Parties.

WHEREAS, the Corporation and the City entered into that certain Interconnection Agreement executed August 19, 2008 and

WHEREAS, the City will replace the leased distribution breaker FM-120 with a City owned distribution breaker FM-120

WHEREAS, the City will replace the grandfathered distribution breaker FM-130 with a City owned distribution breaker FM-130

NOW, THEREFORE, in consideration of the mutual promises and undertakings herein set forth, the Parties agree to amend the Agreement as follows:

1. Exhibit "A" attached to the Agreement is deleted in its entirety and the Exhibit "A" attached to this First Amendment is hereby added to the Agreement in lieu thereof.
2. Facility Schedule No. 1 (including the diagrams attached thereto) is deleted in its entirety and Facility Schedule No. 1 attached to this First Amendment is hereby added to the Agreement in lieu thereof.
3. Facility Schedule No. 1 (including the diagrams attached thereto) attached to this First Amendment will become effective upon execution of this First Amendment by the Parties.

Except as otherwise expressly provided for herein, the Agreement will continue in full force and effect in accordance with its terms.

IN WITNESS WHEREOF, the Parties have caused this First Amendment to be executed in several counterparts, each of which shall be deemed an original but all shall constitute one and the same instrument.

CITY OF MASON

By: _____

Name: Brent Hinckley

Title: Mayor

Date: 12/24/09

LCRA TSC - The City of Mason Amendment No. 1

LCRA TRANSMISSION SERVICES
CORPORATION

By: _____

Name: Ray Pfefferkorn, P.E.

Title: LCRA Transmission Engineering
Manager

Date: 1/20/10

EXHIBIT A
First Amendment

[illegible]

FACILITY SCHEDULE NO. 1
First Amendment

1. **Name:** Ft. Mason Substation
2. **Facility Location:** The Ft. Mason Substation is located at 1459 Post Hill St., Mason, Mason County, Texas 76856.
3. **Points of Interconnection:** There are six (6) Points of Interconnection in the Ft. Mason Substation generally described as:
 - where the incoming distribution line connects to the tubular bus between switches FM-121 and FM-123 at breaker FM-120.
 - where the jumper from breaker FM-120, passing through CT-2, connects to the 4 hole pad on switch FM-119.
 - where the jumper from breaker FM-120 connects to the 4 hole pad on switch FM-121.
 - where the incoming distribution line connects to the tubular bus between switches FM-131 and FM-133 at breaker FM-130.
 - where the jumper from breaker FM-130, passing through CT-3, connects to the 4 hole pad on switch FM-129.
 - where the jumper from breaker FM-130 connects to the 4 hole pad on switch FM-131.
4. **Transformation Services Provided by LCRA TSC:** Yes
5. **Metering Services Provided by LCRA TSC:** Yes
6. **Delivery Voltage:** 12.5 kV
7. **Metered Voltage and Location:** The metered voltage is 12.5 kV. The metering current transformer is located in the regulator bay. The metering potential transformer is located on the 12.5 kV operating bus.
8. **One Line Diagram Attached:** Yes
9. **Description of Facilities Owned by Each Party:**

City of Mason owns:

 - Two (2) distribution circuits including dead-end insulators that attach to the dead-end structure, conductor, and hardware
 - Two (2) distribution circuit breakers FM-120 and FM-130, including foundations, jumpers, and protective relay packages

LCRA TSC owns:

The Ft. Mason Substation including, but not limited to, the following items:

- One (1) power transformer PWT-1, T-1 with associated surge arresters
- Three (3) single phase regulators REG-1
- One (1) disconnect switch 2812 on 69 kV bus
- One (1) fuse F-1 on 69 kV bus
- Five (5) distribution and regulator bays including A-frames, trusses, insulators, disconnect switches, surge arresters, 12.5 kV operating and transfer bus, bus potential transformers, and metering current transformers
- Station Service equipment
- Control house with battery

10. Operational Responsibilities of Each Party:

- The City will be responsible for the operation of the two (2) distribution circuit breakers serving the City feeders.
- LCRA TSC will be responsible for the operation from the low voltage bus through the power transformer to the high voltage equipment.


11. Maintenance Responsibilities of Each Party: Each Party will be fully responsible for the maintenance of the equipment it owns.

12. Other Terms and Conditions:

- The City and LCRA TSC are to share access to the substation by LCRA TSC locks in the gate and in the control house doors.

---The remainder of this page has intentionally been left blank---

First Amendment

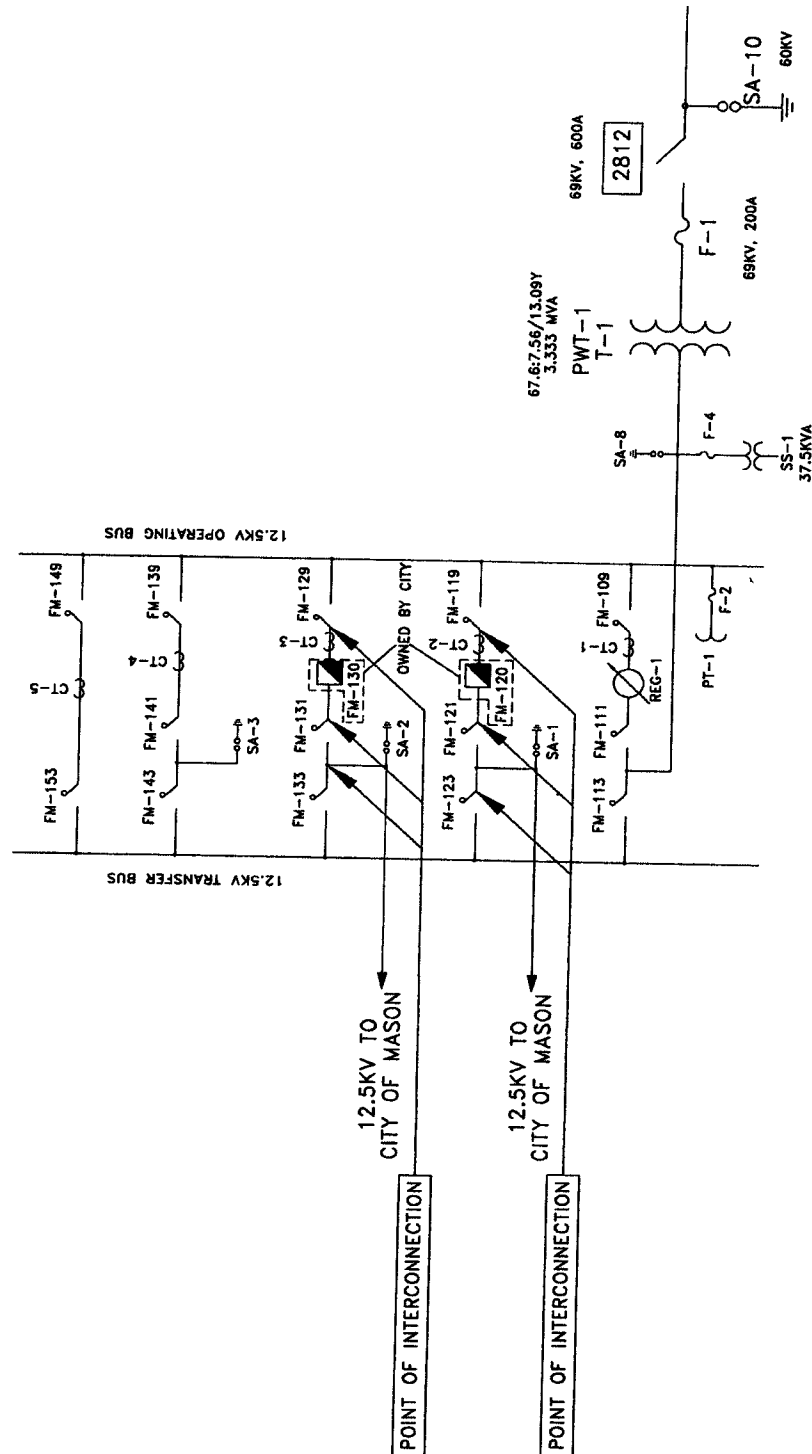

FT. MASON SUBSTATION

THIS IS NOT A COMPLETE ONE-LINE DIAGRAM.

FOR A COMPLETE ONE-LINE DIAGRAM OF THIS SUBSTATION, REFER TO DRAWING S222-E-4.