



Control Number: 35077



Item Number: 249

Addendum StartPage: 0

**Project No. 35077**

**First Amendment to**

**INTERCONNECTION AGREEMENT**

**Between**

**City of Burnet**

**and**

**LCRA Transmission Services Corporation**

**September 30, 2008**

RECEIVED  
11 AUG 19 PM 4:48  
UTILITY COMMISSION  
FILING CLERK

249

**FIRST AMENDMENT TO  
INTERCONNECTION AGREEMENT**

This First Amendment ("Amendment") to the Interconnection Agreement, dated September 30, 2008 between The City of Burnet ("City") and the LCRA Transmission Services Corporation ("LCRA TSC") (the "Agreement") is made and entered into this 8th day of March, 2011, between the City and LCRA TSC, collectively referred to hereinafter as the Parties.

**WHEREAS**, the City has purchased breakers BU-200, BU-300, BU-400 and BU-500 from the LCRA TSC, and;

**WHEREAS**, changes are being approved in the this First Amendment in advance of the work being completed and energized, and;

**WHEREAS**, LCRA TSC will add a mobile disconnect in distribution bay #11

**NOW, THEREFORE**, in consideration of the mutual promises and undertakings herein set forth, the Parties agree to amend the Agreement as follows:

1. Section 1.1 of the Interconnection Agreement is modified to include a statement that addresses items which have been included in an Interconnection Agreement or Amendment prior to their completion.
2. Exhibit "A" attached to the Agreement is deleted in its entirety and the Exhibit "A" attached to this First Amendment is hereby added to the Agreement in lieu thereof.
3. Facility Schedule No. 1 (including the diagrams attached thereto) is deleted in its entirety and Facility Schedule No. 1 attached to this First Amendment is hereby added to the Agreement in lieu thereof.
4. Facility Schedule No. 1 (including the diagrams attached thereto) attached to this First Amendment will become effective upon execution of this First Amendment by the Parties.
5. Amended Section 1.1 attached to this First Amendment will become effective upon execution of this First Amendment by the Parties.

Except as otherwise expressly provided for herein, the Agreement will continue in full force and effect in accordance with its terms.

---- The remainder of this page has intentionally been left blank ----

IN WITNESS WHEREOF, the Parties have caused this First Amendment to be executed in several counterparts, each of which shall be deemed an original but all shall constitute one and the same instrument.

CITY OF BURNET

By: Alan Smith

Name: Alan Smith

Title: Mayor

Date: 3-08-11

LCRA TRANSMISSION SERVICES  
CORPORATION

By: Ray Pfefferkorn

Name: Ray Pfefferkorn, P.E.

Title: LCRA Transmission Engineering  
Manager

Date: 3/29/11



**INTERCONNECTION AGREEMENT  
BETWEEN  
THE CITY OF BURNET, TEXAS  
AND  
LCRA TRANSMISSION SERVICES CORPORATION**

This Agreement is made and entered into this 30 day of September, 2008, by and between the City of Burnet ("City") and LCRA Transmission Services Corporation ("LCRA TSC") each sometimes hereinafter referred to individually as "Party" or both referred to collectively as "Parties".

**WITNESSETH**

WHEREAS, each Party is the owner and operator of transmission and/or distribution facilities and is engaged in the business of transmitting electric energy to the general public within the Electric Reliability Council of Texas; and

WHEREAS, the Parties desire to interconnect their respective transmission and/or distribution systems in the respects, and under the terms and conditions set forth below.

NOW, THEREFORE, in consideration of the premises and of the mutual covenants and conditions herein set forth, the Parties agree as follows:

**ARTICLE I – EFFECTIVE DATE AND TERM**

1.1 This Agreement and any subsequent addendum to this Agreement shall become effective on the date of execution by both Parties. Items, which are executed in advance, will become effective when they are completed and energized. Unless otherwise mutually agreed, this Agreement shall remain in effect initially until June 25, 2041, the current expiration of the existing Wholesale Power Agreement, and shall continue in effect thereafter for periods of five (5) years each unless canceled after such initial period or any subsequent period either by mutual agreement or by either Party upon at least thirty-six (36) months written notice to the other party.

**ARTICLE II – OBJECTIVE AND SCOPE**

2.1 It is the intent of the Parties, by this Agreement, to state the terms and conditions under which the Parties' transmission and/or distribution systems will be interconnected and to identify the facilities and equipment provided by each Party at the Points of Interconnection between their systems.

## Amendment #1

[illegible]

**FACILITY SCHEDULE NO. 1**  
**Amendment #1**

1. **Name:** Burnet Substation
2. **Facility Location:** The Burnet Substation is located at 711 Hamilton Creek Dr., Burnet, Burnet County, Texas 78611.
3. **Points of Interconnection:** There are twelve (12) Points of Interconnection in the Burnet Substation generally described as:
  - where the incoming distribution line connects to the tubular bus between switches BU-201 and BU-203 at breaker BU-200.
  - where the jumper from breaker BU-200 connects to the 4 hole pad on switch BU-199.
  - where the jumper from breaker BU-200 connects to the 4 hole pad on switch BU-201.
  - where the incoming distribution line connects to the tubular bus between switches BU-301 and BU-303 at breaker BU-300.
  - where the jumper from breaker BU-300 connects to the 4 hole pad on switch BU-299.
  - where the jumper from breaker BU-300 connects to the 4 hole pad on switch BU-301.
  - where the incoming distribution line connects to the tubular bus between switches BU-401 and BU-403 at breaker BU-400.
  - where the jumper from breaker BU-400 connects to the 4 hole pad on switch BU-399.
  - where the jumper from breaker BU-400 connects to the 4 hole pad on switch BU-401.
  - where the incoming distribution line connects to the tubular bus between switches BU-501 and BU-503 at breaker BU -500.
  - where the jumper from breaker BU-500 connects to the 4 hole pad on switch BU-499.
  - where the jumper from breaker BU-500 connects to the 4 hole pad on switch BU-501.
4. **Transformation Services Provided by LCRA TSC:** Yes
5. **Metering Services Provided by LCRA TSC:** Yes
6. **Delivery Voltage:** 12.5 kV
7. **Metered Voltage and Location:** The metered voltage is 12.5 kV. The metering current transformers are located in the distribution bays and inside T-2. The metering potential transformer is located on the 12.5 kV operating bus.

**8. One Line Diagram Attached: Yes**

**9. Description of Facilities Owned by Each Party:**

City of Burnet owns:

- Four (4) distribution circuits including dead-end insulators that attach to the dead-end structure, conductor, and hardware
- Four (4) distribution circuit breakers BU-200, BU-300, BU-400, and BU-500 including foundations, jumpers and protection packages

LCRA TSC owns:

The Burnet Substation including, but not limited to, the following items:

- One (1) power transformer T-2 with associated surge arresters
- One (1) circuit switcher CS-3015
- Seven (7) distribution and total bays including A-frames, trusses, insulators, disconnect switches, mobile disconnect, surge arresters, 12.5 kV operating and transfer bus, bus potential transformers, and metering current transformers
- One (1) total circuit breaker BU-600
- Underfrequency relay panel
- Station Service equipment
- Control house with battery

**10. Operational Responsibilities of Each Party:**

- The City will be responsible for the operation of the four (4) distribution circuit breakers serving the City feeders.
- LCRA TSC will be responsible for the operation from the low voltage total breaker through the power transformer to the high voltage equipment.


**11. Maintenance Responsibilities of Each Party:** Each Party will be fully responsible for the maintenance of the equipment it owns.

**12. Other Terms and Conditions:** The City and LCRA TSC are to share access to the substation by LCRA TSC locks in the gate and in the control house doors.



# BURNET ONE-LINE DIAGRAM

Amendment #1

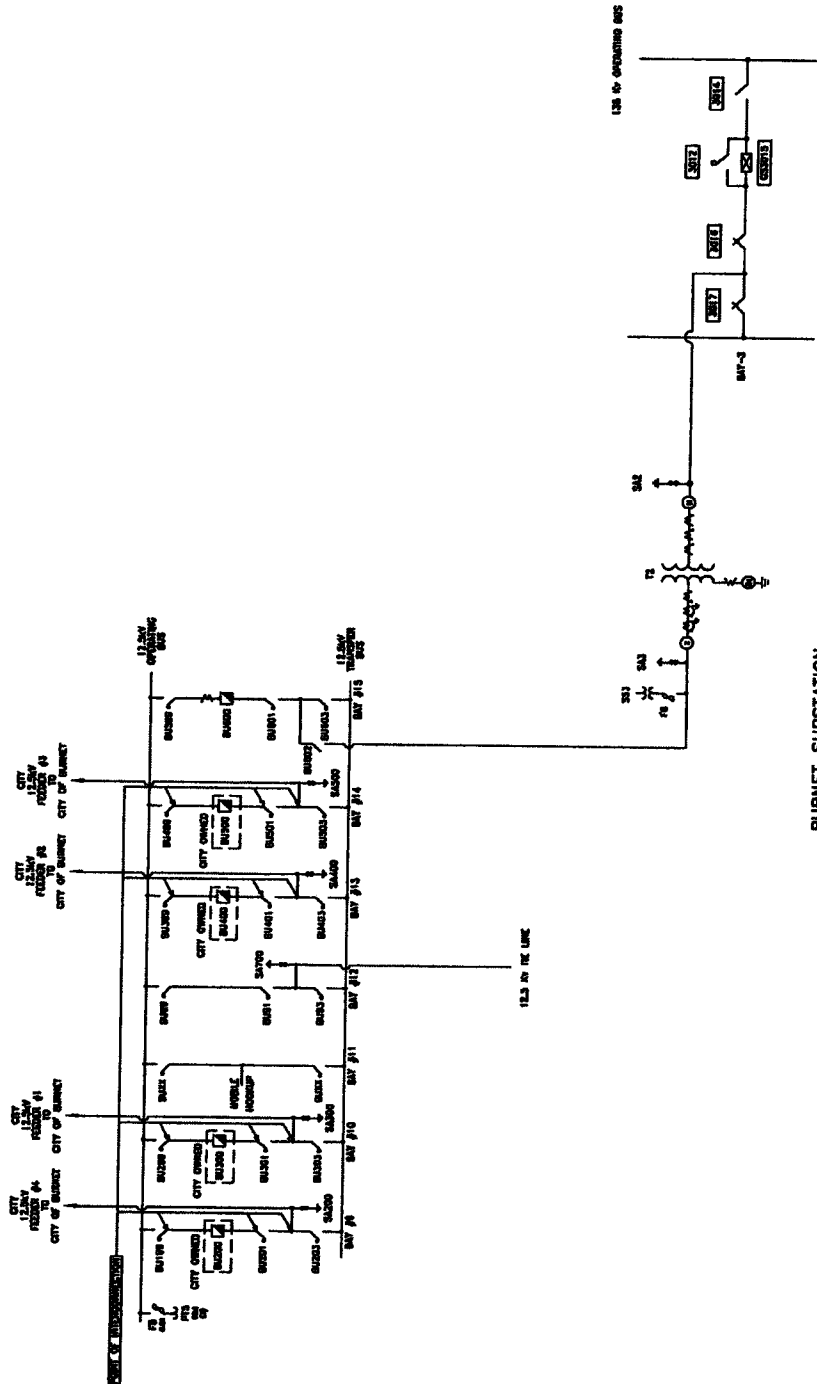

## BURNET SUBSTATION

THIS IS NOT A COMPLETE ONE-LINE DIAGRAM  
FOR A COMPLETE ONE-LINE DIAGRAM OF THIS  
SUBSTATION, REFER TO DWG S109-E-0001-01 AND S109-E-0001-02.  
THIS ONE-LINE DIAGRAM CONTAINS PORTIONS OF BOTH.