


Control Number: 35077



Item Number: 362

Addendum StartPage: 0

PROJECT NO. 35077

2013 MAR 26 AM 9:58

INFORMATIONAL FILING OF ERCOT § PUBLIC UTILITY OF COMMISSION  
INTERCONNECTION AGREEMENTS §  
PURSUANT TO SUBST. R. §25.195(e) § OF TEXAS

DeAnn Walker  
CenterPoint Energy, Inc.  
1005 Congress Avenue, Suite 650  
Austin, Texas 78701  
Tel No: (512) 397-3032  
Fax: (512) 397-3050  
Email: deann.walker@CenterPointEnergy.com

March 26, 2013

TABLE OF CONTENTS

<u>Description</u>	<u>Page</u>
March 14, 2013 Amendment Two to the ERCOT Interconnection Agreement, effective March 20, 2013 between Deer Park Energy Center, LLC and CenterPoint Energy Houston Electric, LLC. ....	2-102



AMENDMENT TWO TO  
ERCOT STANDARD GENERATION  
INTERCONNECTION AGREEMENT

Between

Deer Park Energy Center, LLC

and

CenterPoint Energy Houston Electric, LLC

for

Deer Park Energy Center  
Deer Park, Texas

March 14, 2013

## AMENDMENT TWO TO ERCOT STANDARD GENERATION INTERCONNECTION AGREEMENT

This Amendment Two ("Amendment Two") to the Deer Park Energy Center Electric Reliability Council of Texas Standard Generation Interconnection Agreement, (the "SGIA") that was originally entered into between Deer Park Energy Center, L.P. and Reliant Energy HL&P a division of Reliant Energy, Incorporated, dated August 8, 2001, subsequently amended by Amendment One To ERCOT Standard Generation Interconnection Agreement between Deer Park Energy Center, LLC, a Delaware limited liability company, as successor in interest to Deer Park Energy Center, L.P. ("Deer Park or Generator"), and CenterPoint Energy Houston Electric, LLC, a Texas limited liability company, as successor in interest to Reliant Energy HL&P ("Centerpoint Energy or TSP"), dated December 20, 2012, is made between **DEER PARK** and **CENTERPOINT ENERGY** (collectively, "the Parties"), on this 20<sup>th</sup> day of March, 2013. In consideration of the mutual promises and undertakings herein set forth, DEER PARK and CenterPoint Energy agree as follows and to amend the SGIA as stated below:

1. Amendment One to ERCOT Standard Generation Interconnection Agreement between Deer Park Energy Center, LLC and CenterPoint Energy Houston Electric, LLC, dated December 20, 2012, is repealed and no longer has any force and effect.
2. This Amendment Two is to reflect the changes to the existing DEER PARK Plant facilities to accommodate the interconnection of an additional generating unit ("GT5").
3. One new generator lead between Plant and the TIF will be used for a connection for the new GT5.
4. The new generator lead will be installed, owned, operated, and maintained by DEER PARK.
5. One new duct bank between Plant and the TIF will be used for the new GT5. The new duct bank will also contain Generator's control cables for GT5.
- 6.
7. A new Exhibit "B - GT5", attached to this Amendment Two, is incorporated into the SGIA.
8. Exhibit "C" is amended as follows:
  - a. The following sections of Exhibit "C" are replaced in their entirety as follows:
    - i) Paragraph C)2)A): TSP's high voltage cable "pothead" terminating devices on the TSP System side of Generator's disconnect devices at the Plant adjacent to TSP's CENTER Substation, located at the Shell Chemical Complex, Highway 225, Deer Park, Harris County, Texas 77536, except the Generator's GT5 interconnection location will be Generator's high voltage connecting hardware between Generator's and TSP's gas insulated cable potheads as referenced in sketch # 800096A-SKO-17001 in Exhibit "J -GT5".
    - ii) Paragraph C)4)A): Plant will be comprised of six (6) generators with a total rating of approximately 1236 MW.
    - iii) Paragraph C)5)A)1): Four (4) Siemens-Westinghouse 501F natural gas fired combustion turbine generators rated at approximately 185 MW each, one (1)

Siemens-Westinghouse natural gas fired combustion turbine generator rated at approximately 215 MW, and one (1) steam turbine generator rated at approximately 300 MW. GT1 – GT4 electric generating units shall have a 15 - 345 KV step-up (main power) transformer, GT5 and the steam turbine shall have 18 – 345 KV step-up (main power) transformers. Each step-up transformer shall have a low voltage generator breaker and a high voltage manually controlled and operated disconnect switch for isolation from the TSP System.

- iv) Paragraph C)5)B)1): Electrical characteristics of Plant's generating units shall be in accordance with the most recent version of Generator's ERCOT Resource Asset Registration Form ("RARF") on file with ERCOT for Plant.
- v) Paragraph C)7)A): Generator shall furnish, operate, and maintain a complete generation facility including, but not limited to, all generators, power system stabilizers (if required to meet ERCOT Requirements), generator step-up transformers, protective devices, and other transformers and associated foundations, the terminating structures, all relays necessary for the protection, synchronization and coordination of the generators, generator auxiliary equipment and the disconnect switches, foundations and 345 kV underground cable, pothead, pothead structure, and connecting hardware for GT5 at the Points of Interconnection.
- vi) Paragraph C)7)E): Generator shall provide disconnect switches and support structures including, insulators and wire conductors, (including primary connection jumpers to TSP's surge arresters located at TSP's high voltage cable potheads), for connection to TSP System at TSP's high voltage cable pothead terminating devices for GT1 through GT4 and ST5.
- vii) Paragraph C)7)F): Generator shall provide NEMA four-hole pads on the end of Plant's high voltage wire conductor for connection to NEMA four-hole pads on TSP's high voltage cable pothead devices for GT1 through GT4 and ST5.
- viii) Paragraph C)8)B): TSP shall furnish, own, and maintain the connection from TSP's equipment to the Generator's NEMA four hole pad on Generator's high voltage wire conductors, including underground cable phase conductors, associated duct banks, surge arresters located adjacent to TSP's high voltage cable potheads, and associated hardware for GT1 through GT4 and ST5.
- ix) Paragraph C)8)E): TSP shall obtain ground and aerial easements in a form acceptable to TSP from the Plant's high-side disconnecting devices for GT1 through GT4 and ST5 to the CENTER Substation, for the CENTER Substation, and from the CENTER Substation to the Plant property line.
- x) Paragraph C)8)F): TSP shall provide conduits within TSP's High Voltage and Control Duct Bank for communication, instrumentation and control, and

protective relaying circuits for GT1 through GT4 and ST5 as shown on the CENTER Substation Development Plan.

- xi) Paragraph C)8)H)1): The TSP System Upgrades for GT1 through GT4 and ST5 that are expected at the time of execution of this Agreement are identified in the March 27, 2001 version of the System Security Study report, which is attached as Exhibit "I", and for GT5, expected at the time of execution of Amendment Two are identified in the February 25, 2013 version of the Full Interconnection Study Report for New Generation, which is attached as Exhibit "H - GT5". TSP shall be under no obligation to construct, operate, and maintain the specific additions, modifications, or upgrades to its transmission system identified in Exhibit "I" and "H - GT5", so long as TSP uses alternative means to meet its responsibilities under Good Utility Practice and the PUCT Rules.
  - xii) Heading for paragraph C)11)A)1): Analog Signals From Plant.
  - xiii) Heading for paragraph C)11)B)1): Analog Signals From Substation.
  - xiv) Heading for paragraph C)11)D)1): Analog Signals From Substation.
  - xv) Heading for paragraph C)11)D)2): Status Signals From Substation.
- b. The following sections are added to Exhibit "C" as follows:
- i) Paragraph C)7)M): Generator shall provide disconnect switches and support structures, including insulators, wire conductors (including primary connection jumpers to Generator's surge arresters located at Generator's high voltage cable potheads), pothead terminating structure, and 345kV underground cable for connection to TSP System at TSP's GIS high voltage cable pothead terminating structure for ST5.
  - ii) Paragraph C)7)N): Generator shall provide connecting hardware including terminal connector on the end of Plant's high voltage 345kV cable for connection to terminal connector on TSP's GIS high voltage cable pothead terminating structure for GT5.
  - iii) Paragraph C)7)O): Generator shall provide conduits within Generator's High Voltage and Control Duct Bank for communication, instrumentation, control, and protective relaying circuits for GT5.
  - iv) Paragraph 11)A)1)v): Data from each of the Plant EPS primary meters (instantaneous Watts, VARs, MWh, MVARh).
  - v) Paragraph 11)B)1)iv): Data from each of the Plant EPS backup meters (instantaneous Watts, VARs, MWh, MVARh).

- vi) Paragraph 11)D)1)v): Data from each of the Plant EPS backup meters (instantaneous Watts, VARs, MWh, MVARh).
- 9. A new Exhibit "E - GT5", attached to this Amendment Two is incorporated into the SGIA.
- 10. Exhibit "F" dated November 1, 1999 is replaced in its entirety with Exhibit "F GT5" dated April 18, 2012.
- 11. Exhibit "H" dated August 8, 2001 is replaced in its entirety with Exhibit "G - GT5" dated March 26, 2012.
- 12. The Full Interconnection Study Report for New Generation; Deer Park Energy Center, LLC; Deer Park Expansion, dated February 25, 2013, is attached as new Exhibit "H - GT5".
- 13. The following drawings are added to Exhibit "J":
  - a. CenterPoint Energy drawing - Relay & Metering Drawing
    - i) 345 kV CenterPoint Energy One Line Relaying & Metering Diagram for Deer Park Energy Center GT5 Project Standard Generation Interconnection Agreement dated 12/18/2012.
- 14. All provisions and references within this agreement to Exhibits "B", "E", "F", and "H" shall apply equally and in full force to Exhibits "B - GT5", "E - GT5", "F - GT5", "G - GT5", and "H - GT5" respectively.


Except as modified by Amendment Two the provisions of the SGIA will continue in full force and effect in accordance with its terms.

IN WITNESS WHEREOF, the Parties have executed Amendment Two as of the date of last signature below.

*DPRE*

**CENTERPOINT ENERGY HOUSTON  
ELECTRIC, LLC**

**DEER PARK ENERGY CENTER, LLC**

By: 

By:  SM

Name: John R. Kellum Jr.

Name: DAVID PLAUCK

Title: V.P. - High Voltage Power Delivery

Title: VICE PRESIDENT

Date: 3/20/2013

Date: 03/18/2013

**Exhibit B – GT5  
Time Schedule**

Interconnection Option chosen by Generator (check one):  Section 4.1.A. or  Section 4.1.B

If Section 4.1.B is chosen by Generator, the In-Service Date(s) was determined by (check one):  
(1)  N/A good faith negotiations, or (2)  N/A designated by Generator upon failure to agree.

Date by which Generator must provide notice to proceed with design and procurement and provide security, as specified in Section 4.2, so that TSP may maintain schedule to meet the In-Service Date:

**With the execution of Amendment Two, TSP is authorized to proceed with design and procurement. Generator will provide security in accordance with the terms of Amendment Two concurrent to the execution of the amendment.**

Date by which Generator must provide notice to commence construction and provide security, as specified in Section 4.3, so that TSP may maintain schedule to meet the In-Service Date:

**Effective on the date of execution of Amendment Two, TSP is authorized to commence with construction. Generator will provide security in accordance with the terms of Amendment Two concurrent to the execution of the amendment.**

In - Service Date(s): **For interconnection of GT5: The later of: January 1, 2014; or ten months after Generator provides security in accordance with the terms of this agreement.**

(Notes: (1) In the event that it is not necessary for all facilities associated with the TIF to be completed on the same date, this entry may consist of multiple dates to reflect the staged completion of the TIF to meet those needs. (2) In-Service Date(s) can be expressed as either a specific date or expressed as a defined number of months after all conditions under Sections 4.2 and 4.3 have been satisfied.)

Scheduled Trial Operation Date: **January 1, 2014** for the GT5

Scheduled Commercial Operation Date: **June 1, 2014** for the GT5

The designated In-Service Date, Scheduled Trial Operation Date, and Scheduled Commercial Operation Date will be extended day for day for:



- 1 each day after March 20, 2013 ("Execution Deadline") that Amendment Two has not been fully executed by both Parties; or
- 2 each day after Execution Deadline that Generator has not provided financial security in accordance with Exhibits "A" and "E – GT5".

Due to the nature of the subject of the Agreement, the Parties may mutually agree to change the dates and times of this Exhibit "B – GT5".

**Exhibit E – GT5**  
**Security Arrangement Details**

- 1) Securitization of Project:
  - A) The total estimated project cost to construct the Transmission Interconnection Facilities for interconnection of GT5, as described in Exhibit C, is approximately \$840,000 (“Secured Cost”) and includes the cost of TSP System Upgrades.
  - B) The total project cost of the Transmission Interconnection Facilities shall be the responsibility of TSP.
  - C) In accordance with Exhibit A, Article 8, Paragraph 8.3 Financial Security Arrangements, Generator shall provide to TSP, either:
    - 1) by wire transfer or other mutually agreeable method, a cash deposit, in the form of U.S. dollars, in the amount of the Secured Cost to secure Generator’s obligations outlined in Exhibit “A”, Article 2; or
    - 2) a financial security instrument in the form of an irrevocable letter of credit in favor of TSP in the amount of the Secured Cost in a form and substance acceptable to TSP to secure Generator’s obligations outlined in Exhibit A, Article 2. Such letter of credit shall be with a financial institution reasonably acceptable to TSP having a long term debt rating by Moody’s Investor Services of “A2” or better, or Standard & Poor’s of “A” or better.
  - D) Generator’s obligation to pay amounts in Amendment One will survive any termination of this Agreement.
  
- 2) Authorization to Proceed:

Generator authorizes TSP to begin work on any required transmission system additions, modifications, and upgrades.





# Transmission & Substation Outage And Clearance Coordination Procedures

Real Time Operations Department

Revised April 18, 2012

# Telephone Numbers

## Real Time Operations Department (RTO)

**RTO HOTLINE** 281-894-1625 (24 hours)

RTO System Controller 281-894-0491 (24 hours)

**Outage Schedulers:** 713-207-2196

Mike Nunn (Outage Scheduler) 713-207-2714  
[michael.nunn@centerpointenergy.com](mailto:michael.nunn@centerpointenergy.com)

Larry Pilcik (Outage Scheduler) 713-207-2730  
[larry.pilcik@centerpointenergy.com](mailto:larry.pilcik@centerpointenergy.com)

RTO Outage Schedulers (FAX) 713-207-2571

RTO System Coordinators:

Steve McNeill 713-207-2497  
[steve.mcneill@centerpointenergy.com](mailto:steve.mcneill@centerpointenergy.com)

Michael Hall 713-207-2766  
[michael.hall@centerpointenergy.com](mailto:michael.hall@centerpointenergy.com)

## Metering Department

High Voltage Metering 713-945-6689

Metering Engineering 713-207-7507

## Transmission Accounts Representatives

Gary Dwyer 713-207-3621

Rick Ferrell 713-207-3512

Henry French 713-207-2789

Gary Shadwell 713-207-3538

<b>TELEPHONE NUMBERS.....</b>	<b>1</b>
<b>1 INTRODUCTION.....</b>	<b>4</b>
<b>1.1 APPLICABILITY.....</b>	<b>4</b>
<b>1.2 PURPOSE.....</b>	<b>4</b>
<b>1.3 PROCEDURE COPIES.....</b>	<b>4</b>
<b>1.4 OWNERSHIP OR NAME CHANGES.....</b>	<b>4</b>
<b>1.5 PROCEDURE CONFLICTS.....</b>	<b>4</b>
<b>1.6 MAINTENANCE RESPONSIBILITY.....</b>	<b>4</b>
<b>1.7 EQUIPMENT CHANGES.....</b>	<b>5</b>
<b>1.8 GENERATION INSTALLATION AND OPERATION.....</b>	<b>5</b>
<b>1.9 POWER FACTOR.....</b>	<b>5</b>
<b>1.10 VOLTAGE FLUCTUATIONS.....</b>	<b>5</b>
<b>1.11 EMERGENCY RESPONSE.....</b>	<b>5</b>
<b>2 CNP ACCESS TO CUSTOMER FACILITIES.....</b>	<b>6</b>
<b>2.1 AUTHORIZED REPRESENTATIVE OF CNP.....</b>	<b>6</b>
<b>3 COMMUNICATIONS WITH CNP.....</b>	<b>6</b>
<b>3.1 REAL TIME OPERATIONS DEPARTMENT.....</b>	<b>6</b>
<b>3.2 SCHEDULING TRANSMISSION EQUIPMENT OUTAGES.....</b>	<b>6</b>
<b>3.3 TRANSMISSION ACCOUNTS DIVISION.....</b>	<b>7</b>
<b>3.4 SUBSTATION AND EQUIPMENT IDENTIFICATION.....</b>	<b>8</b>
<b>3.5 TELEPHONE LINES AND DATA COMMUNICATION.....</b>	<b>8</b>
<b>3.6 ALARM RESPONSE.....</b>	<b>8</b>
<b>4 SWITCHING, CLEARANCES, GROUNDING.....</b>	<b>10</b>
<b>4.1 BILLABLE COSTS.....</b>	<b>10</b>
<b>4.2 SWITCHING.....</b>	<b>10</b>
<b>4.3 CLEARANCES.....</b>	<b>11</b>
<b>4.4 GROUNDING.....</b>	<b>11</b>
<b>4.5 SWITCHING 345KV FACILITIES EQUIPPED WITH FERRORESONANCE PROTECTION.....</b>	<b>12</b>
<b>4.6 TERMINOLOGY FOR SWITCHING ORDERS.....</b>	<b>13</b>
<b>4.7 SWITCHING ORDER.....</b>	<b>14</b>
<b>4.8 TRANSMISSION SWITCHING CHECK LIST.....</b>	<b>15</b>
<b>5 OUTAGE SCHEDULING CHECK LIST.....</b>	<b>16</b>
<b>5.1 OUTAGE SCHEDULING CHECK LIST.....</b>	<b>16</b>
<b>6 UNPLANNED OUTAGES.....</b>	<b>17</b>
<b>6.1 UNPLANNED OUTAGES.....</b>	<b>17</b>
<b>6.2 UNPLANNED OUTAGES OF 345KV FACILITIES EQUIPPED WITH FERRORESONANCE PROTECTION.....</b>	<b>17</b>
<b>6.3 EMERGENCY SWITCHING.....</b>	<b>18</b>

6.4	EMERGENCY SWITCHING CHECK LIST.....	19
6.5	OTHER EMERGENCY CONDITIONS.....	19
<b>7</b>	<b>GENERATION OPERATION .....</b>	<b>20</b>
7.1	APPLICABILITY .....	20
7.2	UNIT OPERATION .....	20
<b>8</b>	<b>PROTECTIVE RELAYING AND CONTROLS .....</b>	<b>20</b>
8.1	SETTINGS FOR RELAYS INSTALLED FOR THE PROTECTION AND AUTOMATIC RECLOSING OF CNP TRANSMISSION LINES.....	20
8.2	APPLICABLE RELAY SETTINGS .....	21
8.3	COMMUNICATIONS CONNECTIONS TO ELECTRONIC DEVICES .....	21
<b>9</b>	<b>EQUIPMENT ADDITIONS, REPLACEMENT, UPGRADES AND REMOVAL .....</b>	<b>21</b>
9.1	NOTIFY CNP OF EQUIPMENT CHANGES .....	21
9.2	MODIFICATION, REPAIR, AND REPLACEMENT OF CUSTOMER EQUIPMENT .....	21
<b>10</b>	<b>EQUIPMENT MAINTENANCE .....</b>	<b>24</b>
10.1	CNP MAINTENANCE .....	24
10.2	CUSTOMER MAINTENANCE .....	24
10.3	MONTHLY INSPECTIONS .....	25
10.4	QUARTERLY, SEMI-ANNUAL TESTING AND INSPECTION .....	25
10.5	DC BATTERY SYSTEM .....	25
10.6	FUNCTIONAL TESTING.....	26
10.7	SPECIAL INSPECTION AND TESTING .....	26
<b>11</b>	<b>PLANT DESIGN CONSIDERATIONS.....</b>	<b>27</b>
11.1	EMERGENCY SYSTEMS .....	27
11.2	AUTOMATIC RECLOSING .....	27
11.3	SYSTEM VOLTAGE .....	27
11.4	ELECTRICAL PROTECTION COORDINATION STUDIES .....	27
11.5	SUBSTATION DESIGN SPECIFICATIONS .....	27

## **1 Introduction**

### **1.1 Applicability**

1.1.1 These procedures apply to entities ("Customers") who own high voltage transmission and/or generation facilities interconnected to CenterPoint Energy's 69kV, 138kV, or 345kV transmission system. Customer, as used in this document, includes Customer's authorized contractors or agents. The Customer is responsible for ensuring that the provisions in this document are applied to facilities that may be owned by others and that are interconnected to the Customer's facility at the same voltage at which the Customer's facility is interconnected to CenterPoint Energy's (CNP) transmission system. CNP, as used in this document, refers to CenterPoint Energy.

### **1.2 Purpose**

1.2.1 The purpose of this document is to facilitate the coordinated operation, outage coordination, maintenance, design and modification of Customer high voltage transmission and or generation facilities with CNP facilities.

### **1.3 Procedure Copies**

1.3.1 The Customer will keep copies of these procedures in applicable Customer substation control houses and plant operating centers. These procedures, including forms, may be reproduced.

### **1.4 Ownership or Name Changes**

1.4.1 The Customer will inform CNP of any change in ownership or name of their interconnected facilities or facilities owned by others that are interconnected to their facilities.

### **1.5 Procedure Conflicts**

1.5.1 Any conflicts between these procedures and the Customer's procedures should be thoroughly discussed with appropriate CNP representatives and resolved before beginning any work.

### **1.6 Maintenance Responsibility**

1.6.1 The Customer is responsible for the operation and periodic preventive maintenance of all substation facilities owned by the Customer except for equipment designated by CNP to be maintained by CNP. The Customer will not perform preventive maintenance on equipment maintained by CNP.



## 1.7 Equipment Changes

- 1.7.1 The Customer is responsible for providing all equipment, in accordance with CNP specifications, whenever changes in CNP transmission system, including monitoring and protection devices, require changes in the Customer's interconnected facilities to maintain compatibility.
- 1.7.2 The Customer will provide sufficient notice to CNP of any proposed changes to their facilities as specified in Section 9. This notification will include providing necessary details so that CNP can provide comments based upon a general, functional, and compliance review. The Customer will not procure any equipment or materials or begin any work until all CNP comments are incorporated or resolved.

## 1.8 Generation Installation and Operation

- 1.8.1 Customers desiring to connect generation that will operate in parallel to CNP's transmission system shall file an application with the Electric Reliability Council of Texas (ERCOT) requesting interconnection in accordance with ERCOT's Generation Interconnection Procedure.
- 1.8.2 The Customer's generation facility must be operated in accordance with the ERCOT Protocols and Operating Guides available at:
- 1.8.3 <http://www.ercot.com/mktrules/nprotocols/current>  
<http://www.ercot.com/mktrules/guides/noperating/cur>

## 1.9 Power Factor

- 1.9.1 The Customer is responsible for providing suitable apparatus to maintain power factor consistent with the requirements of CNP's Tariff for Retail Delivery Service.

## 1.10 Voltage Fluctuations

- 1.10.1 The Customer is responsible for providing suitable apparatus to mitigate voltage fluctuations to reasonable limits should the Customer's equipment cause voltage fluctuations that interfere with CNP's transmission system.

## 1.11 Emergency Response

- 1.11.1 In an emergency, the Customer will switch substation equipment, reduce MW output, change reactive output, or perform other measures as directed by ERCOT or CNP's Real Time Operations Division ("RTO"), to help alleviate the emergency.
- 1.11.2 CNP may interrupt transmission service to and deliveries from the Customer in the event of an emergency.

## **2 CNP Access to Customer Facilities**

### **2.1 Authorized Representative of CNP**

- 2.1.1 An authorized representative of CNP shall have access to the Customer's premises for the purpose of inspecting CNP's wiring and apparatus, repairing, erecting, removing, or replacing CNP owned equipment, reading CNP meters, and for all other purposes related to the interconnection including switching CNP equipment. The Customer will provide necessary equipment outages to allow CNP to perform periodic maintenance on equipment that CNP owns or to repair or replace equipment that CNP owns.

## **3 Communications with CNP**

### **3.1 Real Time Operations Department**

- 3.1.1 CNP's Real Time Operations Department ("RTO") is responsible for operating CNP's transmission system and coordinating the operation of interconnected high voltage facilities. RTO provides routine and emergency switching instructions, issues clearances, and dispatches CNP personnel in response to electrical outages and problems. The Customer will schedule planned outages with RTO and obtain from RTO switching instructions for any equipment at the customer substation that is directly interconnected with CNP's transmission system. Switching in the customer's facilities that are remote to the customer's substation that is directly interconnected with CNP's transmission system does not need to be scheduled. CNP will notify customers one or more days in advance if switching is required in a customer substation for planned transmission line outages or if a customer substation will be placed in a single-ended condition.

### **3.2 Scheduling Transmission Equipment Outages**

- 3.2.1 CenterPoint Energy's substation equipment outage scheduling and reporting requirements have been developed to support ERCOT Protocol requirements for scheduling outages on circuit breakers, bus sections, transmission lines and transformers which have an operating voltage of 60kV and higher and to support requirements for scheduling outages of ERCOT Polled Settlement (EPS) metering equipment.
- 3.2.2 The Customer will contact the RTO Outage Scheduler as shown in Table 1 at the end of this section to coordinate outages in the substation that is directly interconnected with CNP's transmission system. Requests are considered in the order they are received.
- 3.2.3 Switching Orders, Clearances - The Customer will follow switching instructions, provided by the RTO System Controller, prior to initiating any switching to remove equipment from service or return equipment to service in the Customer's facilities. The Customer will request a clearance from the RTO System Controller when required. A "Switching Order" form and a

"Transmission Switching Check List" form are included in this document. The RTO System Controller can be contacted at 281-894-0491.

- 3.2.4 **Unplanned Outages, Emergencies** - The Customer will contact the RTO System Controller as soon as possible whenever any unplanned tripping of any circuit breaker operating at a voltage of 60kV and higher occurs. A "Forced Outage Check List" form is included in this document. In the event of an unplanned generation outage, the Customer or his designated representative will advise CNP's RTO System Controller as soon as possible. In emergency situations, switching may be performed by a qualified person, authorized by the Customer, based upon switching instructions provided by the RTO System Controller. An "Emergency Switching Check List" form is included in this document. The RTO System Controller can be contacted at 281-894-0491, or at the RTO HOTLINE 281-894-1625.
- 3.2.5 **ERCOT Approvals** - The RTO System Scheduler will coordinate a review and notify the Customer whether or not the outage can be scheduled for the desired day. Transmission line outages and the energization of new equipment require the approval of ERCOT. The Customer will notify the RTO System Scheduler as soon as possible if an outage is canceled prior to the outage date. The Customer will immediately notify the RTO System Controller if an outage is canceled on the day of the outage. CNP will endeavor to notify the Customer as soon as possible when it is deemed necessary to cancel an outage.
- 3.2.6 **Customer Substation Evacuations** - During emergencies requiring evacuation of a customer's facility, the customer shall contact RTO prior to the evacuation and provide information regarding the operational status of their substation and associated support facilities (i.e. substation station service power, battery & battery charger, ability for CenterPoint Energy to access substation, etc). Customer substations are an integral part of the interconnected transmission system and disabling them has an impact on the electrical grid.
- 3.3 **Transmission Accounts Division**
- 3.3.1 CNP's Transmission Accounts division is responsible for coordinating the Customer's service needs within CNP. Transmission Accounts representatives will endeavor to inform Customer's of long range planned switching and projects which may affect the Customer's facility
- 3.3.2 The Customer will notify the Transmission Accounts representative as specified in Section 9 when equipment additions or removals are planned or when high voltage equipment 60kV and higher or associated equipment requires modification or replacement. The Customer will contact a Transmission Accounts representative to request current CNP specifications and applicable bills of material for substation equipment additions and replacement.
- 3.3.3 Transmission Accounts representatives may be contacted for any questions concerning the operation of the Customer's substation. The Transmission Accounts representatives are listed on Page 1 of this document.

### 3.4 Substation and Equipment Identification

- 3.4.1 CNP assigns a Substation name (Substation ID) of six characters or less, to identify the Customer's substation facility. The Substation ID is also referred to as the six character mnemonic name in which some characters may be blank. CNP will mount signs with the Substation ID on a substation control house door and on a substation entrance gate at the Customer's facility.
- 3.4.2 The Customer's high voltage circuit breakers switches, transformers, and certain low side equipment will be identified with CNP's assigned numbers. CNP will develop a substation basic one-line diagram that includes these assigned numbers. CNP or the Customer will mark these numbers on the substation equipment. CNP may stencil identification numbers on substation equipment and mount signs, labels, drawings, telephone numbers, and instructions on the Customer's facilities.
- 3.4.3 The Customer will use CNP's assigned Substation name, or Substation ID, and equipment identification numbers in discussions with the RTO System Controller and the RTO System Scheduler.

### 3.5 Telephone Lines and Data Communication

- 3.5.1 The Customer will maintain a telephone in the substation control house connected to an outside telephone line independent from the Customer's telephone system.
- 3.5.2 The Customer will maintain data acquisition equipment to provide real-time data to RTO when it has been installed at electric generating facilities.
- 3.5.3 CNP will maintain a communication circuit for real time data if CNP Supervisory Control and Data Acquisition (SCADA) equipment is installed at the Customer's facility.

### 3.6 Alarm Response

- 3.6.1 CNP will respond to alarms for communication equipment installed to protect CNP transmission circuits.
- 3.6.2 The Customer should report substation alarms to the RTO System Controller and respond to alarms pertaining to their equipment. A "Loss of DC" alarm should be immediately reported to the RTO System Controller and investigated by the customer.

## Transmission Control / Real Time Operations Outage Scheduling, Metering and Forced Outage Requirements

Per ERCOT and CenterPoint Energy outage reporting requirements, planned outages on circuit breakers, transmission lines and autotransformers rated 60kV and higher must be submitted to the ERCOT Outage Coordinators by the CenterPoint Energy Real Time Operations Outage Coordinator.

Per ERCOT Protocols, planned outages on ERCOT Polled Settlement (EPS) meters and/or the equipment to which they are connected require a 5 day minimum notice. A 10 calendar-day minimum notice is required for any modifications to approved EPS equipment.

**Table 1 Planned Outages**

Equipment Being Requested	Minimum Advance Notice	Contact
69kV & 138kV lines, single load transformers, individual breakers and bus outages of no more than one day in duration.	No later than 1200 hours Wednesday two weeks before the Planned Outage is to take place.	Outage Scheduler @ 713-207-2196 or 713-207-2714
All transmission line outages and equipment outages, including busses, of up to four contiguous days duration (daily or continuous outages).	35 Calendar Days notice	Outage Scheduler @ 713-207-2196 or 713-207-2714
Any transmission line outages and/or equipment outages, including busses, of 5 days or longer duration (daily or continuous)	90 Calendar Days notice	Outage Scheduler @ 713-207-2196 or 713-207-2714

### Forced Outages

Forced outages due to equipment emergencies will be handled by CenterPoint Energy - Real Time Operations and ERCOT System Operations on a case-by-case basis by the Customer contacting the Real Time Operations Security Desk at 713-207-2203.

Per ERCOT requirements, forced outage on EPS meters with no back-up or check meters must be corrected within 12 hours. Forced outages on EPS meters with back-up or check meters must be corrected within 5 days.

## **4 Switching, Clearances, Grounding**

### **4.1 Billable Costs**

4.1.1 Grounding and switching requested by Customer to be performed during other than normal working hours is billable to the Customer.

4.1.2 Grounding and switching charges will be waived under the following conditions:

4.1.2.1 The party requesting switching and/or grounding activities by CenterPoint Energy is a transmission voltage service Customer who is interconnected to CenterPoint Energy's transmission system through a customer owned substation; and

4.1.2.2 The requested activities are to allow the Customer to perform maintenance activities or equipment upgrades on its transmission voltage facilities within the Customer's substation; and

4.1.2.3 The switching and grounding field activities are requested to occur on a normal CenterPoint Energy work day, with outages commencing no earlier than 0800, and outages concluding no later than 1600.

4.1.3 Outages extending beyond the timeframes identified in Section 4.1.2.3 on a forced basis may result in billing for associated switching and grounding activities, as determined on a case-by-case basis.

4.1.4 Outages with switching and/or grounding activities requested for more than two consecutive days may be subject to charges for each additional consecutive day, even if the outages occur within the timeframes identified in Section 4.1.2.3, unless early/intermittent outage restoration is required by ERCOT or for CNP system requirements.

4.1.5 Questions regarding charges should be directed to the Transmission Accounts representative.

### **4.2 Switching**

4.2.1 CNP will provide all necessary switching at the remote end of a CNP transmission line for outages at a Customer substation which require switching of CNP transmission lines. CNP will provide switching instructions for the high voltage devices in the Customer substation that is directly interconnected with CNP's transmission system. Switching instructions are not provided for remote facilities interconnected to the customer substation that is directly interconnected with CNP's transmission system. A "Switching Order" form and a "Transmission Switching Check List" form are included in this document.

4.2.2 The Customer will follow switching instructions, provided by the RTO System Controller, prior to initiating any switching to remove equipment from service or return equipment to service in the Customer's facilities. The Customer will implement specific procedures for the switching of its facilities. These procedures will include a visual check that all phases have fully opened or

closed. A device bearing a Hold Tag will not be operated under any circumstances.

#### 4.3 Clearances

- 4.3.1 A clearance is required for applicable work on high voltage apparatus connected to CNP transmission lines when switching at the remote end of a CNP transmission line is necessary. Clearances are also issued when the Customer and CNP will be working on apparatus within the same isolated area at the Customer's facilities. Each party will be issued an individual clearance.
- 4.3.2 The Customer will request a clearance from the RTO System Controller when required. Personnel authorized by CNP will perform either "trip & hold" or "check for trip & hold" on necessary devices before a clearance will be issued.
- 4.3.3 A clearance cannot be released by anyone other than the person to whom it was issued unless uncontrollable circumstances make that impossible. In this situation, the person's supervisor may, after informing each member of the crew that such action is being taken, contact the RTO System Controller to release the clearance. For field personnel shift changes, the person assuming the leadership of the work will be issued a new clearance and the person to whom the clearance was originally issued will then release the clearance.

#### 4.4 Grounding

- 4.4.1 CNP issues clearances indicating that high voltage devices have been opened, locked, and tagged to prevent the devices from operating. The Customer will verify that the apparatus is de-energized before protective grounding is attached or work on high voltage facilities begins.
- 4.4.2 The Customer is responsible for assuring that protective grounds are installed on all de-energized electrical apparatus before applicable work is performed on it. When more than one party (e.g., the Customer and CNP) will be working on apparatus within the same isolated area at the Customer's facilities, each party will install their own individual grounds before applicable work is performed.
- 4.4.3 Work may be performed on the control circuits and mechanisms of a device without grounding the apparatus - if such work can be performed without risk of contact with primary voltages. Grounds may be temporarily removed if required by testing procedures.
- 4.4.4 Before a grounding device is attached to any conductor, that conductor will first be tested to confirm that it is de-energized. Grounds will be placed such that the operation of a switching device cannot remove their protection.
- 4.4.5 The clamps and conductors of grounding devices will be designed for the available fault current. Grounding devices must be inspected for broken strands and loose connections. The surface of the ground clamps must be clean of corrosion and oxides.
- 4.4.6 Grounding devices for transmission voltage conductors must be installed and removed with the use of applicable live line tools. Grounding devices must

always be securely connected at the ground end before connection is made to the conductor. Grounds must always be removed by first detaching the connection at the conductor and, then, detaching the connection at the ground end. When grounding to a steel structure, the ground must not be applied to a flat surface unless an appropriate flat surface clamp is used.

4.4.7 CNP does not ground Customer-owned substation equipment except for work being performed by CNP.

#### 4.5 Switching 345kV Facilities Equipped with Ferroresonance Protection

4.5.1 Ferroresonance protection is installed whenever a wound potential transformer (PT) is connected to 345kV and the possibility of a ferroresonance condition occurring exists. If applicable, the Customer will implement specific procedures for switching 345kV equipment that has ferroresonance protection installed.

**Procedures will include the following:**

Place the sync handle in position for the last breaker that will be opened.  
Monitor the potential lights on all three phases before and after the last breaker is opened.

1. If one or more of the lights do not dim immediately but gets brighter:
  - immediately close the last breaker opened to reenergize the bus
  - investigate the ferroresonance protection
2. If all three lights dim immediately:
  - reset the targets (flags) on the ferroresonance protection relays
3. If relay targets did not operate:
  - investigate the ferroresonance protection circuit



#### 4.6 Terminology for Switching Orders

Time - Military time, or 24 hour clock, based on prevailing Central Time.

Check Ring for Close - Verify by visual inspection that all devices in the ring are in the closed position.

Remove / Roll Loads - Remove all loads connected to a power transformer. This may be done by tripping applicable low side breakers or by rolling load to an adjacent transformer and tripping applicable low side breakers.

Trip - Initiate and complete an opening operation on a device.

Close - Initiate and complete a closing operation on a device.

Hold Tag - A tag placed on a device to indicate it shall not be operated. The tag will indicate the party who placed the tag.

Trip and Hold - Trip device, physically or mechanically (e.g., affix padlock) disable device from closing, and place a Hold Tag on the device.

Check for Trip and Hold - Verify by visual inspection that a device is in the trip position and place a Hold Tag on the device.

Secure Against Operation (SAO) - Physically, mechanically, and/or electrically disable a device (e.g., a motor operated disconnect switch) to prevent it from operating.

Secondary Potential Fuse (SPF) - Remove and tag fuses on the secondary side of potential devices to prevent the possibility of back energizing isolated equipment.



#### 4.8 Transmission Switching Check List

4.8.1 The following basic procedures are for the day of the switching after the outage has been scheduled with and authorized by the RTO System Scheduler (713-207-2196). This applies to the customer substation that is directly interconnected with CNP's transmission system.

- Call the RTO System Controller at 281-894-0491 and request a Switching Order
  - Provide name, company affiliation, and telephone number
  - Provide Substation ID
  - Describe reason for request
  - Fill out Switching Order
    - Record the Switching Order number
    - Record start time provided by the RTO System Controller
    - Record the RTO System Controller's name
    - Record the instructions to take equipment OUT
    - Repeat the instructions
- Execute the Switching Order placing Hold Tags where appropriate
- Call the RTO System Controller when the instructions have been completed
  - Report the actual completion time
  - Record the completion time provided by the RTO System Controller on Switching Order
  - Request a Clearance if necessary
    - Provide the number of personnel in the crew
    - Provide the number of and location of grounds
- Verify apparatus is de-energized with a hot line indicator
- Install protective grounds when required
- Perform work
- Remove protective grounds if installed
- Call the RTO System Controller to request to RESTORE equipment
  - Report whether more than one Hold Tag is on any device
  - Provide Clearance number if applicable
    - Provide the number of personnel in the crew clear of the apparatus
    - Provide the number of grounds removed
  - Provide the Switching Order number
  - Fill out Switching Order
    - Record start time provided by the RTO System Controller
    - Record the RTO System Controller's name
    - Discuss performing Switching Order instructions in reverse order
- Alert all personnel to move to a safe distance from apparatus being energized
- Execute the Switching Order removing Hold Tags where appropriate
- Call the RTO System Controller when restoration has been completed
  - Report the actual completion time
  - Record the completion time provided by the RTO System Controller on Switching Order



## 6 Unplanned Outages

### 6.1 Unplanned Outages

- 6.1.1 ERCOT Protocols require that CNP notify ERCOT of all unplanned transmission outages.
- 6.1.2 The Customer will contact the RTO System Controller as soon as possible whenever any unplanned tripping of any high voltage (60kV and higher) circuit breaker occurs. CNP crews will be dispatched when high voltage circuit breakers remain open in the customer substation that is directly interconnected with CNP's transmission system. CNP crews will reset relay targets except in emergency situations. A "Forced Outage Check List" form is included in this document.
- 6.1.3 CNP crews are not dispatched when high voltage circuit breakers remain open in a remote, non-CNP, substation connected to a Customer's substation but not directly interconnected with the CNP system. In such a case, the Customer will discuss and evaluate the event with the RTO System Controller. The Customer will notify the RTO System Controller prior to any switching.
- 6.1.4 In the event of an unplanned generation outage, the Customer or his designated representative will advise CNP's RTO System Controller as soon as possible.

### 6.2 Unplanned Outages of 345kV Facilities Equipped with Ferroresonance Protection

- 6.2.1 Ferroresonance protection is installed whenever a wound potential transformer (PT) is connected to a 345kV and the possibility of a ferroresonance condition occurring exists. If applicable, the Customer will implement specific procedures for unplanned tripping of 345kV equipment that has ferroresonance protection installed. Procedures will include the following.

- Visually inspect the potential transformer lights on all three phases
- If one or more of the lights are bright and not dim
  - Open all the breaker disconnect switches to isolate the potential transformers
  - Disconnect/Remove the PT(s) from service on the phases with the bright lights
- If one or more of the lights are dark and not dim
  - Open all the breaker disconnect switches along the affected bus
  - Disconnect/Remove the PTs from service on the phases with the dark lights
- If remote monitoring of potential transformer voltages indicated a ferroresonance condition occurred
  - Open all the breaker disconnect switches to isolate the potential transformers
  - Disconnect/Remove the PT(s) from service on the phases that indicated ferroresonance
- If all three lights are dim
  - Reset the targets on the ferroresonance protection relays
- If relay targets do not indicate proper action
  - Investigate the ferroresonance protection circuit

### 6.3 Emergency Switching

6.3.1 In emergency situations, switching may be performed prior to a CNP crew arriving at a Customer's incoming substation. A qualified person, authorized by the Customer, may operate breakers and switches based upon switching instructions provided by the RTO System Controller. Prior to switching, all relay trip targets will be reset after the Customer has recorded them and reported them to the RTO System Controller. All personnel will move to a safe distance from apparatus being energized prior to switching. An "Emergency Switching Check List" form is included in this document.

#### 6.3.2 UNPLANNED OUTAGE CHECK LIST

6.3.3 The following basic procedures are for whenever any unplanned tripping of any transmission service voltage breaker occurs.

- Call the RTO System Controller Hot Line at 281-894-1625
- Provide the following information to the RTO System Controller
  - Your name, company affiliation, and telephone number
  - Substation ID
  - Nature of the problem
  - Time of outage
  - Status of all breakers and switches (i.e., open, closed, tagged)
  - Cause of the event if known
  - Fault location and faulted equipment if known
  - Fires and their proximity to energized equipment
  - Plant and substation entry constraints (e.g., chemical releases)
- Record the RTO System Controller's name
- Investigate and provide the following information to the RTO System Controller
  - Cause of the event if found during investigation
  - Fault location and faulted equipment if found during investigation
  - Number of trip operations for each breaker (i.e., change in breaker veeder reading)
  - Relay trip targets - Do not reset targets
- Discuss outage with CNP crews
- CNP crews record and reset relay trip targets
- CNP crews record breaker veeder readings
- Resolve outage and complete any necessary corrective action
  - Call the RTO System Controller at 281-894-0491 to request to RESTORE equipment
  - Record the instructions to RESTORE equipment
  - Repeat the instructions
- Execute the instructions
- Call the RTO System Controller when instructions have been completed

BY: \_\_\_\_\_ DATE: \_\_\_\_\_

#### 6.4 EMERGENCY SWITCHING CHECK LIST

6.4.1 The following basic procedures are for emergency situations. Contact the RTO System Controller at one of the following telephone numbers.

- Call the RTO System Controller Hot Line at 281-894-1625
- Provide the following information to the RTO System Controller
  - Your name, company affiliation, and telephone number
  - Substation ID
  - Nature of the problem
  - Time of outage
  - Status of all breakers and switches (i.e., open, closed, tagged)
  - Cause of the event if known
  - Fault location and faulted equipment if known
  - Fires and their proximity to energized equipment
  - Plant and substation entry constraints (e.g., chemical releases)
  - Relay trip targets
- Record the RTO System Controller's name
- Record the instructions to RESTORE equipment
- Reset relay trip targets
- Execute the instructions
- Call the RTO System Controller at 281-894-0491 when instructions have been completed

BY: \_\_\_\_\_ DATE: \_\_\_\_\_

#### 6.5 Other Emergency Conditions

6.5.1 Customer substations are an integral part of the interconnected transmission system and disabling them has an impact on the electrical grid. In certain emergency situations, Customer's may evacuate or shut down their facility. In such cases, the Customer shall endeavor to keep the portion of their substation that is directly connected to the transmission grid in service, unless specifically directed otherwise by ERCOT or CNP's RTO System Controller or other responsible personnel.

## 7 Generation Operation

### 7.1 Applicability

- 7.1.1 This section applies only if the Customer operates electric generating facilities and participates in the wholesale transmission market. The Customer will follow the ERCOT Operating Guides and ERCOT Protocols or other regulatory requirements that apply to their facilities

### 7.2 Unit Operation

- 7.2.1 Where CNP owns the interconnecting substation and there is not an in-line breaker to synchronize a generating unit, the Customer will have control of CNP's substation breakers that are functioning as generator breakers. CNP will have operational control of the disconnect switches associated with these breakers.
- 7.2.2 The Customer will have generation control personnel on duty at the generating unit site at all times that the generating units are on-line.
- 7.2.3 The Customer or Customer's representative will notify the RTO System Controller (281-894-0491) immediately before a unit is synchronized and connected to CNP's transmission system. The Customer will report forced unit outages.
- 7.2.4 The Customer will operate units to support the transmission system voltage by regulating reactive power output up to levels demonstrated in the ERCOT tests as required in the ERCOT Protocols. The Customer will maintain the ERCOT specified voltage level unless otherwise directed by the RTO System Dispatcher or ERCOT. If ERCOT specifies a maximum voltage in addition to the recommended level, the Customer will maintain the maximum voltage only during light system load conditions. If the ERCOT does not specify a voltage level, the Customer will provide reactive support based on instructions provided by ERCOT or the RTO System Dispatcher.
- 7.2.5 The Customer's voltage regulators, speed governors and power system stabilizers, if required by ERCOT, will be in service whenever generating units are on-line. The Customer will immediately notify the ERCOT Real Time Desk whenever a voltage regulator, speed governor or power system stabilizer is taken out of service or placed back in service. The Customer will maintain settings as close as practical to five percent speed regulation.
- 7.2.6 The Customer will maintain generating units on-line during system under-frequency conditions to the standards set forth in Section 2.6.2 of the current ERCOT Operating Guides: [www.ercot.com/mktrules/guides/noperating/cur](http://www.ercot.com/mktrules/guides/noperating/cur).

## 8 Protective Relay Settings

### 8.1 Settings for Relays Installed for the Protection and Automatic Reclosing of CNP Transmission Lines

- 8.1.1 CNP will calculate and implement all settings for customer owned relays installed for the protection and automatic reclosing of CNP transmission lines and for customer owned relays installed to prevent back-energizing CNP's system from



generation installed on the low side of Customer power transformers. On a case-by-case basis, CNP may issue settings for other Customer owned relays. The relay settings implemented by CNP for the Customer's owned relays will be provided to the Customer upon request.

## 8.2 Applicable Relay Settings

8.2.1 The Customer will provide CNP with the settings of Customer owned relays that trip or close any Customer owned high voltage (60kV and higher) circuit breakers. The Customer will provide to the Transmission Accounts representative any proposed settings changes for such relays for CNP's review.

## 8.3 Communications Connections to Electronic Devices

8.3.1 An electronic device that can directly or indirectly trip a circuit breaker connected to a CenterPoint Energy transmission circuit is not allowed to be monitored via routable protocol communication (i.e. Ethernet) or dial-up communication. Monitoring of this electronic device for metering data or event data (or any communications processor connected to this electronic device) is only allowed via a serial port (Modbus, DNP3 or SEL Fast Meter). Control command(s) are not allowed through the serial port.

# 9 Equipment Additions, Replacement, Upgrades and Removal

## 9.1 Notify CNP of Equipment Changes

9.1.1 The Customer must notify the Transmission Accounts representative with sufficient notice to meet the timeline and data reporting requirements in Table 2 below when equipment additions or removals are planned or when high voltage equipment or associated equipment requires modification or replacement.

9.1.2 The Customer will provide equipment and installation per applicable CNP specifications and bill of materials. The Customer will provide necessary details (e.g., drawings, specifications, and manufacturer type and catalog number) for CNP's review. All CNP comments must be incorporated or resolved before any equipment or materials are procured or any work is begun.

9.1.3 ERCOT Protocols require that all changes to equipment rated at 60 kV and above be communicated by CNP to ERCOT prior to the in-service date as specified in Table 2 below.

9.1.4 ERCOT shall only approve energization requests when the transmission element is satisfactorily modeled in the ERCOT Network Operations Model.

## 9.2 Modification, Repair, and Replacement of Customer Equipment

9.2.1 CNP will notify the Customer of problems in their facilities of which CNP becomes aware. The Customer will provide any needed equipment modifications, repairs, or replacement within an appropriate time frame. The Customer will replace equipment that CNP demonstrates is no longer maintainable. On a case-by-case basis, the Customer and CNP will develop the responsibilities for the modification, repair, and replacement of this equipment.



9.2.2 Industry experience may dictate that certain equipment be modified, repaired, or replaced due to manufacturing defects or unacceptable failure rates and consequences. The Customer will, within an appropriate time frame, modify, repair, or replace equipment based on manufacturer issued product service advisories or CNP issued advisories.

### Customer Substation Equipment Additions, Relocations, Upgrades and/or Removals

When installing, relocating, or upgrading transmission system equipment, Customers must contact their appropriate CenterPoint Energy Transmission Accounts representative with sufficient notice to meet the timelines and data requirements shown below. ERCOT Nodal Protocols section 3.10.1 requires that all changes to transmission equipment energized at 60 kV and above be communicated by CNP to ERCOT using the Network Operations Model Change Request (NOMCR) process as summarized below:

Table 2

Target Physical Equipment In-Service Month	Deadline to Submit to RTO	Timeline to Submit initial information to Transmission Accounts Rep
Month of January	Sept. 1	June 1 (prior year)
Month of February	Oct. 1	July 1 (prior year)
Month of March	Nov. 1	August 1 (prior year)
Month of April	Dec. 1	September 1 (prior year)
Month of May	Jan. 1	October 1 (prior year)
Month of June	Feb. 1	November 1 (prior year)
Month of July	Mar. 1	December 1 (prior year)
Month of August	Apr. 1	January 1
Month of September	May 1	February 1
Month of October	June 1	March 1
Month of November	July 1	April 1
Month of December	Aug. 1	May 1

(1) CNP will require the following information to meet the deadlines shown above. The NOMCR data requirements include, but are not limited to (per Nodal Protocol 3.3.2.1):

- Completed project expected in-service date
- equipment ratings
- device nomenclature will be provided by CNP
- Engineering drawings showing the final configuration.
- Construction sequence with expected energization dates for each piece of equipment.
- Identification of SCADA data points
- Additional data as may be determined by ERCOT



## Transmission & Substation Outage and Clearance Coordination Procedures

- (2) Known outage requests must be submitted by Real Time Operations with the NOMCR's for each expected energization date.
- (3) **ERCOT shall only approve energization requests when the Transmission Element is satisfactorily modeled in the ERCOT Network Operations Model.**

## 10 Equipment Maintenance

### 10.1 CNP Maintenance

- 10.1.1 CNP will perform periodic testing of certain Customer equipment if the equipment is installed for the protection of CNP transmission lines. This includes power line carrier tuning and testing of wave traps, tuners, and carrier sets and calibration and testing of relays and fiber optic communication equipment. CNP will perform periodic calibration and testing of SCADA (Supervisory Control and Data Acquisition) transducers that provide real time data to CNP. CNP may designate additional Customer equipment for maintenance by CNP. CNP will label equipment maintained by CNP.
- 10.1.2 CNP will endeavor to coordinate CNP maintenance with the Customer's maintenance outages.
- 10.1.3 CNP transmission line outages are required for CNP to perform testing of applicable Customer wave traps.
- 10.1.4 Outages of approximately ten hours duration for certain Customer facilities are required for CNP's periodic maintenance of any CNP high voltage metering instrument transformers. Transformer outages are required for metering instrument transformers installed on the high side of transformers. A total separation from CNP's system may be required for certain substation configurations.

### 10.2 Customer Maintenance

- 10.2.1 The Customer will perform periodic inspections and preventive maintenance on all structures and equipment owned by the Customer except for equipment designated by CNP for maintenance by CNP. The Customer will not perform preventive maintenance on the equipment maintained by CNP. The Customer will maintain equipment logs and test reports, which will be provided to CNP upon request.
- 10.2.2 Depending upon ownership, equipment maintained by the Customer may include the following: line surge arresters, potential and current transformers not owned by CNP, coupling capacitors, coupling capacitor potential devices, switches (including auxiliary contacts and motors if installed), breakers (bushings, mechanism, tanks), transformers (bushings, surge arresters, main tank, load tap changer, alarms), relays not tested by CNP, and DC Battery system equipment.
- 10.2.3 The Customer will notify the RTO System Scheduler at least ten (10) working days in advance before performing maintenance on potential or current transformers connected to CNP meters.

### 10.3 Monthly Inspections

10.3.1 The Customer will perform monthly inspections to include the following as applicable.

- Visual inspection of outdoor equipment including inside control cabinets
- Verify oil levels
- Verify transformer nitrogen blanket pressure
- Verify transformer fan operation
- Verify breaker compressor or hydraulic pump operation
- Drain condensate from breaker mechanism air tanks
- Verify operation of control house heating and air conditioning

### 10.4 Quarterly, Semi-annual Testing and Inspection

10.4.1 CNP recommends Total Combustible Gas (TCG) testing once every three months on transformers equipped with a nitrogen blanket.

10.4.2 Infrared thermography of high voltage equipment is recommended once every six months.

### 10.5 DC Battery System

10.5.1 The Customer will perform periodic DC battery system equipment inspections and maintenance to include the following as applicable.

- Every Month
  - Visually inspect batteries (corroded connections, leaks, cracked cases)
  - Visually inspect chargers
  - Verify and correct water levels
  - Record and verify float voltage
  - Record and verify ground reference voltage
- Every Six Months
  - Clean battery surfaces
  - Check charger ventilation
  - Record and verify cell voltages
  - Perform cell impedance testing
  - Measure connection resistance
  - Record and verify specific gravity reading on a single pilot cell
  - Verify float and equalize voltage settings
  - Verify proper operation of chargers and alarms
  - Verify proper operation of high voltage shutdown circuits

## 10.6 Functional Testing

10.6.1 The Customer and/or CNP will perform functional trip testing following substation additions or modifications. Each high voltage breaker will be tripped and closed from the breaker control switch at least once every year. This breaker tripping, as well as functional trip testing, may be coordinated with the switching required for maintenance outages. The Customer will notify the RTO System Scheduler, by Noon Wednesday of the week prior to the planned maintenance before performing functional testing and allow CNP to witness the testing.

10.6.2 High voltage circuit breakers equipped with dual trip coils that use a common actuating shaft (e.g., Allis Chalmers, Westinghouse) require special functional testing. The Customer will perform a test on each breaker by applying trip voltage simultaneously to both trip coils. If the breaker does not immediately trip, the voltage must be quickly removed to avoid damaging the coils. After verifying the wiring, the Customer will appropriately label the control wiring. The Customer's maintenance procedures will include tagging and properly reconnecting trip coil wiring. The Customer will perform this test whenever a trip coil is replaced or breaker control wiring is modified.

## 10.7 Special Inspection and Testing

10.7.1 Industry experience may dictate that certain equipment requires special inspection and testing due to manufacturing defects or unacceptable failure rates and consequences. The Customer will perform special inspection and testing based on manufacturer issued product service advisories and CNP issued advisories.

## 11 Plant Design Considerations

### 11.1 Emergency Systems

11.1.1 Continuous electric service from utility power systems cannot be guaranteed even for facilities that are connected to a large number of transmission lines. The possibility exists that a total power outage or separation from the utility system may occur. It is important to consider this when plant emergency systems are designed.

### 11.2 Automatic Reclosing

11.2.1 CNP utilizes automatic reclosing of high voltage circuit breakers following unplanned tripping of CNP transmission lines. CNP endeavors to intentionally delay the initial reclose attempt by at least one second. The Customer is responsible for the separation of necessary motors or other equipment within one second of the tripping.

### 11.3 System Voltage

11.3.1 Electric service from a utility power system cannot be guaranteed against fluctuations. A common fluctuation is a voltage sag that occurs during the time of a fault. The large majority of faults on a utility transmission system are single line-to-ground faults. With automatic reclosing of circuit breakers, several voltage sags can occur within a one-minute period. Most voltage sags from faults on transmission systems have a very short duration of less than ten cycles with high-speed fault clearing. Another common fluctuation is a transient voltage oscillation that occurs each time a capacitor bank is energized. Equipment, such as motor contractors, adjustable speed drives, programmable logic controllers, and high intensity discharge lamps, can be sensitive to these short duration voltage sag and transient voltage oscillation.

11.3.2 It is important to consider voltage sag "ride-through" for equipment applied to critical processes where nuisance tripping can cause a whole process to shut down. Plant power systems and equipment control systems can be designed or modified to ride-through the most common voltage sags and transient voltage oscillations on utility power systems. CNP will provide additional information upon request.

### 11.4 Electrical Protection Coordination Studies

11.4.1 Customers typically perform plant electrical protection coordination studies from time to time. The Customer may contact a Transmission Accounts representative to request the available CNP system fault current and system impedance at the Customer's facility.

### 11.5 Substation Design Specifications

11.5.1 The Customer can contact a Transmission Accounts representative to request current CNP specifications and applicable bills of material for new substations and substation equipment additions and replacement.

**Exhibit G – GT5  
Telemetry Specification**



# SPECIFICATION

FOR

REMOTE TELEMETRY OF A CUSTOMER OWNED FACILITY



ELECTRIC ENGINEERING DEPARTMENT

P.O. BOX 1700 HOUSTON, TEXAS 77251

**REFERENCE DRAWINGS:** Latest Revisions of  
 CenterPoint Energy, CNP Drawing No.BSC-007-400-01 SH.3.  
 CenterPoint Energy, CNP Drawing No.BSC-564-500-01 SH.1, 2.

**REFERENCE SPECIFICATIONS:** Latest Revisions of  
 CenterPoint Energy, CNP Specification No. 007-231-14, Customer 138kV Substation Design.

**REFERENCE DOCUMENTS:** Latest Revisions of  
 CenterPoint Energy Transmission & Substation Outage and Clearance Coordination Procedures.

<b>CenterPoint Energy</b>					
Houston Electric					
	<b>WRITTEN</b>	12/30/03	C.W. Mogannam		
	<b>CHECKED</b>	12/30/03	R.M. Secrest		
	<b>APPROVED</b>	12/30/03	M.W. Furnish		
	Page 1 of 12				
	<b>SPC</b>	<b>007</b>	<b>400</b>	<b>02</b>	
NO	DATE	REVISION	BY	CH	APP
6	3/26/2012	Revised Sec.2, 3, 5, 7, Fig 1,2	CWM	WAC	MDB
5	2/30/2004	Revised for EPS METER Communication	CWM	CWM	MWF
				CH	APP

# CONTENTS

TITLE	PAGE NO.
SCOPE	3
GENERAL	3
SCADA SYSTEM	4
DESIGN, LAYOUT, AND PHYSICAL CRITERIA	5
COMMUNICATION LINES	6
CALIBRATION AND MAINTENANCE	6
CURRENT TRANSFORMERS AND POTENTIAL TRANSFORMERS	7
DRAWING APPROVAL	7
TABLE 1 – APPROVED TRANSDUCERS & TEST SWITCHES	8
LIST OF ABBREVIATIONS USED IN FIGURES	9
FIGURE 1 – CUSTOMER COMMUNICATION BLOCK DIAGRAM	10
FIGURE 2 – GENERATOR COMMUNICATIONS BLOCK DIAGRAM	11
FIGURE 3 – BREAKER CONTROL AND STATUS WIRING	12
ATTACHMENT - SCADA RTU CABINET DETAIL	

<b>CenterPoint Energy</b>			
Houston Electric			
WRITTEN	12/30/03	C.W. Mogannam	
CHECKED	12/30/03	R.M. Secrest	
APROVED	12/30/03	M.W. Furnish	
Page 2 of 12			
<b>SPC</b>	<b>007</b>	<b>400</b>	<b>02</b>

## 1. SCOPE

- 1.1. This specification defines the requirements for the engineering, installation, calibration, and commissioning of a Supervisory Control and Data Acquisition (SCADA) Remote Terminal Unit (RTU) and Metering Telemetry, as applicable, at a customer owned facility on the CenterPoint Energy (CNP) transmission system.

## 2. GENERAL

- 2.1. Installation of a CNP SCADA RTU in customer-owned facilities is typically required for all new transmission substations that have a circuit breaker that sectionalizes a CNP transmission line.
- 2.2. At tap substations CNP typically uses the high voltage revenue meters for telemetry of real time data.
- 2.3. All equipment and work covered by this specification shall be designed, constructed, and tested in accordance with the latest revisions or editions of industry requirements in effect at the time of fabrication. Industry requirements include the applicable codes, standards, specifications, regulations, tests, and procedures of all federal, state and local laws, and include (but are not limited to) the following:
- 2.3.1. American National Standards Institute (ANSI)
  - 2.3.2. IEEE formerly the Institute of Electrical and Electronics Engineers, Inc.
  - 2.3.3. National Electrical Manufacturers Association (NEMA)
  - 2.3.4. Occupational Safety and Health Administration (OSHA)
  - 2.3.5. Federal Communications Commission (FCC)
- 2.4. In the event of conflicting requirements, the order of precedence shall be this specification, other referenced CNP specifications, and the standards referenced in section 2.2.
- 2.5. CNP will specify the SCADA RTU and associated SCADA equipment. The SCADA RTU will be in a standalone cabinet to be installed in the Customer substation control building. The customer must provide interface equipment such as transducers, status and alarm contacts, cabling, terminal blocks, and conduit. Communication equipment must also be installed and wired by Customer in the Customer substation control building. Metering Cabinets will be installed in accordance with the CNP Customer 138KV Substation Design Specification.
- 2.6. Communications between substation devices shall be serial. Routable protocol communication (i.e., Ethernet) or dial-up communication shall not be used for the CNP transmission system protection devices.
- 2.7. Equipment specified may be substituted with written approval from CNP Substation Projects, System Operations.
- 2.8. All equipment, engineering and installation shall be furnished by the Customer unless otherwise noted in this specification or separate agreements.
- 2.9. Generating facilities will provide CNP additional generator data via Modbus or DNP3 communications protocol from the Plant control system or RTU to the CNP RTU located in the substation. Selected substation data from the CNP RTU is available to the plant. See Figure 2 for typical communications diagram.

CenterPoint Energy				
Houston Electric				
WRITTEN	12/30/03	C.W. Mogannam		
CHECKED	12/30/03	R.M. Secrest		
APPROVED	12/30/03	M.W. Furnish		
		Page 3 of 12		
	SPC	007	400	02

### 3. SCADA SYSTEM

- 3.1. The SCADA RTU is composed of three subsystems: (1) analog, (2) status, and (3) control.
- 3.2. Analog Subsystem: Analog Data is typically gathered from Intelligent Electronic Devices (IEDs) or transducers. IEDs include Electronic Meters and microprocessor relays. Communication to various IEDs shall be serial, via DNP3 or Modbus protocols. If transducers are used, CNP will determine the transducer electrical requirements. See Table 1 for acceptable transducer models. Meter test switches are required for the transducer current and voltage connections. The Customer shall provide an electrical relaying and metering one-line diagram of the proposed Customer-owned substation for review by CNP.
- 3.2.1. Customer Substation Analog Telemetry Requirements
- 3.2.1.1. Kilovolts for each substation bus,  $A\emptyset$
  - 3.2.1.2. Megawatts for each line position,  $3\emptyset$
  - 3.2.1.3. Megavars for each line position,  $3\emptyset$
  - 3.2.1.4. Megawatts for each substation load,  $3\emptyset$
  - 3.2.1.5. Megavars for each substation load,  $3\emptyset$
- 3.2.2. CNP will require the following additional analog data from a Generating facility:
- 3.2.2.1. Generator terminal voltage for each generator bus, A phase only
  - 3.2.2.2. Megawatts (net preferred) for each generator unit,  $3\emptyset$
  - 3.2.2.3. Megavars (net preferred) for each generator unit,  $3\emptyset$
  - 3.2.2.4. Frequency for each generator unit
  - 3.2.2.5. Data from the plant electrical load EPS meters (watts, vars, watt-hour from each meter)
- 3.3. Status Subsystem: The status subsystem of the SCADA RTU shall consist of the following.
- 3.3.1. Status of selected transmission voltage circuit breakers or other devices directly affecting the CNP electrical system, as determined by CNP RTO. Status shall be derived from either an isolated auxiliary "a" contact in the breaker or monitoring a trip coil of the breaker. Refer to Figure 3 for Breaker Status Connections.
  - 3.3.2. Indication of low voltage and battery charger failure is required for the 130 VDC battery system(s). Typical charger alarms include the following: low voltage, high voltage, loss of AC input, and loss of charger. All these indications shall be combined so that an occurrence of any one of these shall cause a single battery alarm (normally open contact) to the SCADA RTU.
  - 3.3.3. SCADA Close Inhibit (SCI) indication is required of breakers controlled by SCADA whenever a lockout relay can inhibit breaker closure by SCADA. A dry, normally open, contact from that relay shall be supplied for SCI indication. Indication contacts from all lockout relays shall be wired in parallel for a single indication in the SCADA cabinet, see Figure 1.
  - 3.3.4. Indication of Carrier Tester (CAR) or Pilot (PIL) relaying failure.
  - 3.3.5. Indication for the loss of a potential to a line relay (PT1) that could cause a misoperation of the zone relaying under high load conditions. This alarm is typically generated by a contact from the line relay. Indications from separate relays will be combined for a single alarm.
  - 3.3.6. Indication of a failed self check diagnostic of a microprocessor based relay. Designated Relay CPU Fail (RCPU). This alarm is typically generated by a contact from the line relay. Indications from separate relays will be combined for a single alarm.

CenterPoint Energy Houston Electric			
WRITTEN	12/30/03	C.W. Mogannam	
CHECKED	12/30/03	R.M. Secrest	
APPROVED	12/30/03	M.W. Furnish	
Page 4 of 12			
SPC	007	400	02

3.3.7. CNP will require the following additional status signals from the Generating facility:

3.3.7.1. Generator Breaker for each unit

3.3.7.2. Motor operated switches for each unit

3.3.7.3. Generator automatic voltage regulator status (Automatic/Manual).

3.4. Control Subsystem: The control subsystem of the SCADA RTU shall consist of the following:

3.4.1. CNP shall have remote control of all transmission (69kV, 138kV, 345kV) circuit breakers that directly affect the CNP transmission system. Dual remote control (control of a breaker by both the Customer's control system and CNP RTO) is not permitted. Figure 3 illustrates how SCADA control will interface with a typical breaker control scheme.

3.4.2. CNP shall have remote control, automatic carrier removal (ATCR), of each pilot relaying scheme. A control contact from the SCADA RTU shall be installed in each pilot circuit. See Figure 3 for typical carrier control circuit.

#### 4. DESIGN, LAYOUT, AND PHYSICAL CRITERIA

4.1. SCADA Set Designation: The type of SCADA RTU installed by CNP will depend on the number of controlled breakers.

4.1.1. A free-standing cabinet typically 24" wide by 18" deep and 72" tall, with front access. Clearance of 30" in front of the door shall be reserved for maintenance access. Substations with more than four transmission breakers may require a larger cabinet(s). Refer to latest Customer RTU drawing submitted by CNP at the project kick-off.

4.2. Connections to the RTU: The Construction Contractor shall install all interconnections between the SCADA RTU and the substation panels.

4.2.1. The Customer shall provide a 120 VAC, fifteen (15) amp, dedicated AC power circuit, protected by a fifteen (15) amp circuit breaker, to the SCADA RTU Cabinet for lighting and a convenience outlet.

4.2.2. The Customer shall provide a 130 VDC, fifteen (15) amp, dedicated DC power circuit, protected by a fifteen (15) amp circuit breaker, to the SCADA RTU Cabinet for the main RTU power.

4.2.3. All cable shields shall be grounded at a location other than the SCADA RTU Cabinet. Cable shields shall be grounded at one end only.

4.3. Cabling: The Customer shall size and install all conduit or cable troughs in accordance with ANSI/NFPA 70 (National Electrical Code).

4.3.1. Polyethylene Polyvinylchloride (PEPVC) insulated shielded 2/C #16 cable with stranded copper conductors shall be used for terminations for all transducer outputs.

4.3.2. Breaker controls shall use seven conductor (#12) PEPVC insulated cable with stranded copper conductors for terminations.

4.3.3. Two conductor (#10 or larger) PEPVC insulated cable with stranded copper conductors shall be used for terminations of the AC and DC power circuit.

4.3.4. Status and alarms shall be terminated with two conductor (#16) PEPVC insulated cable with stranded copper conductors.

4.3.5. The Customer shall install the necessary conduit or cable management between the SCADA RTU and the relay panels.

CenterPoint Energy			
Houston Electric			
WRITTEN	12/30/03	C.W. Mogannam	
CHECKED	12/30/03	R.M. Secrest	
APROVED	12/30/03	M.W. Furnish	
Page 5 of 12			
SPC	007	400	02

4.4. Every breaker with 130 VDC SCADA control circuits shall have breaker coil surge suppression. A one hundred (100) ohm, eleven (11) watt resistor (Ohmite style 995-10A) and a zener diode (Motorola type IN3051A) or equivalent shall be used for this suppression. The series combination of the zener diode and the resistor shall be parallel to each breaker trip and breaker close coil. States slider-link terminal blocks shall be installed in the breakers for terminating the resistors and zener diodes. CNP will verify breaker coil surge suppression. See Figure 3.

**5. COMMUNICATION LINES**

- 5.1. The Customer shall provide and maintain a full business (IFB) phone line and telephone for voice communications terminating inside the substation control house. This phone shall be direct dial and not go through the Customer's main switchboard or extension. This phone shall have a cord extendable such that the front of the relay panels and SCADA RTU are visible from the phone. This line may also be used by CNP for remote interrogation of meters.
- 5.2. CNP shall provide additional IFB communication line(s) from the telephone company for EPS Generation metering, as required, terminating at the Customer's telephone demarcation point.
- 5.3. CNP shall provide a separate 4 wire data communication line(s) from the telephone company, terminating at the Customer's telephone demarcation point. This communication line will be used for the SCADA RTU to transmit real time data to CNP RTO. The Customer shall supply the name and telephone number of a representative for purposes of co-ordinating the installation of these line(s). See Figure 1 for a typical Customer Substation Communications Block Diagram. For generator substations, CNP will install two SCADA communication lines. The second line shall be for a back up RTU for redundant generator data. See Figure 2 for a typical generator substation Communications Block Diagram.
- 5.4. For new substations the Customer shall provide and install a communication cable with multiple pairs between the telephone service provider demarcation point and the substation control house. These communication circuits will terminate at the SCADA RTU cabinet and metering cabinet(s). At existing customer substations it may be necessary to install additional cable if there are no existing spares available.
- 5.5. CNP, at its option, may use SCADA Radio (952/928 MHz FM) for the SCADA communication circuit specified in section 5.3. The requirements of the radio, antenna, and associated equipment will be determined by CNP. The Customer shall provide a location for this equipment less than fifty feet from the SCADA RTU.
- 5.6. The telephone communication circuit(s) shall be specified to operate in the event of power failure. The communication line shall remain operational in the event a line conditioner or loopback device fails.

**6. CALIBRATION AND MAINTENANCE**

- 6.1. After all equipment necessary for remote telemetry has been installed, CNP personnel will calibrate and verify operation of all equipment installed per this specification.
- 6.2. The RTU and transducers installed per this specification will be maintained by CNP unless otherwise noted in an agreement with the Customer. Maintenance will include accuracy checks, recalibration and replacement/repair of equipment when needed.

<b>CenterPoint Energy</b>			
Houston Electric			
WRITTEN	12/30/03	C.W. Mogannam	
CHECKED	12/30/03	R.M. Secrest	
APPROVED	12/30/03	M.W. Furnish	
Page 6 of 12			
<b>SPC</b>	<b>007</b>	<b>400</b>	<b>02</b>

6.3. CNP shall furnish locks that will remain in series with Customer locks to permit access to all switchyard gates, substation control house door(s), and disconnect switches.

**7. CURRENT TRANSFORMERS AND POTENTIAL TRANSFORMERS**

- 7.1. The current transformers (CTs) and potential transformers (PTs) necessary for transducers and meter circuits itemized in this specification shall be provided according to CNP specification 007-231-14. If a particular application is not covered by this specification, then CNP will designate the necessary PT(s) and CT(s) on the substation one-line diagram that the Customer submits for comment and approval.
- 7.2. For some substation layouts a potential rollover circuit shall be needed. If a potential rollover circuit is needed, it will be designated by CNP on the one-line diagram that the Customer submits for comment and approval.

**8. DRAWING APPROVAL**

- 8.1. The Contractor shall provide electronic and paper copies of all drawings showing equipment connections and structural details of all equipment associated with SCADA installation as follows.
  - 8.1.1. IFA – Issued For Approval and comment to CNP Substation Projects. These can be submitted electronically or with paper copies. CNP will review the drawings and make corrections, comments or changes as required. PDF (Adobe Acrobat V5 or greater) is the preferred format for IFA.
  - 8.1.2. IFC – Issued For Construction to CNP Substation Projects. These shall be 7 sets of 11 x 17 paper copies for CNP Engineering, CNP Substation Construction Coordinators and Substation Performance. Additionally, the Contractor shall supply a CD with a complete set of prints saved in Microstation ver. J(7) and PDF format for additional copies.
  - 8.1.3. As Built – The Contractor shall make any reasonable corrections to the drawings that result from installation and commissioning of the SCADA RTU. These shall be completed within 30 days of the construction completion. CNP Substation Projects shall approve as-built drawings for final issue.
  - 8.1.4. Final Issue – the Contractor shall issue all SCADA prints to the CNP drawing management system in Microstation Version J(7) Format. All drawings (Customer and SCADA) shall be saved on a compact disc (CD) for CNP records. Customer drawing(s) shall be in the PDF format. The CD shall be labelled with the Project name, Contractor name, Contractor project number, CNP contract number and date.
  - 8.1.5. The Customer shall be copied on these drawings as specified by the Customer.

8.2. Drawings required by this specification include:

- 1. Substation one-line relaying and metering diagrams illustrating the overall telemetry scheme,
- 2. Substation control house layout(s) and floor plan(s),
- 3. Conduit and cable lists
- 4. Conduit Layout or Plan and Profile
- 5. RTU manufacturers prints and Customer connections
- 6. AC Schematics for all power and control circuits,
- 7. AC Relaying Schematics (Electrical Three-Line),
- 8. Relay panel layouts,
- 9. Bill of material for items required by this specification,

<b>CenterPoint Energy</b>			
Houston Electric			
WRITTEN	12/30/03	C.W. Mogannam	
CHECKED	12/30/03	R.M. Secrest	
APROVED	12/30/03	M.W. Furnish	
Page 7 of 12			
	SPC	007	400 02

- 10. Battery charger alarm relay(s) schematics,
- 11. AC & DC Distribution Panels,
- 12. Communication cable and conduit routing through Customer facility,
- 13. Customer Facility Plot Layout,

**Table 1 ACCEPTABLE TRANSDUCERS AND TEST SWITCHES**

DESCRIPTION	MANUFACTURER	MODEL NO.	MONITORING POINTS
VOLTAGE TRANSDUCER	AMETEK SCIENTIFIC COLUMBUS	VT110A4	ONE PER SUBSTATION BUS
TEST SWITCH SINGLE PHASE	DURHAM	2-1022F-03	ONE PER EACH TRANSDUCER
WATT/VAR TRANSDUCER SINGLE PHASE	AMETEK SCIENTIFIC COLUMBUS	XLWV5C5	ONE PER EACH LINE OR LOAD
WATT/VAR TRANSDUCER THREE PHASE	AMETEK SCIENTIFIC COLUMBUS	XLWV342K5A4	ONE PER EACH LINE, GENERATOR OR LOAD
TEST SWITCH THREE PHASE	DURHAM	2-1058F-00	ONE PER EACH TRANSDUCER

CenterPoint Energy Houston Electric		
WRITTEN	12/30/03	C.W. Mogannam
CHECKED	12/30/03	R.M. Secrest
APPROVED	12/30/03	M.W. Furnish
Page 8 of 12		
SPC	007	400 02



**LIST OF ABBREVIATIONS AND SYMBOLS USED IN FIGURES**

aN4, aN14 = TYPICAL WIRE NAMES IN CNP CARRIER RELAYING SCHEMES

ATCR = AUTOMATIC CARRIER REMOVAL

C = CLOSE

CS = CONTROL SWITCH

CVE = SYNCRO-VERIFIER RELAY

ICR = INDICATION CONTROL RELAY

N 11, N21 = TYPICAL WIRE NAMES IN CNP RECLOSE REMOVAL SCHEMES

NO = NORMALLY OPEN

OC = BREAKER CLOSE COTL

RC = AUTOMATIC RECLOSING RELAY

RR = RECLOSE REMOVAL LATCHING RELAY

T = TRIP

TC = BREAKER TRIP COIL

X, Y = AUXILIARY COILS OF RC RELAY


SSS = SLIDER-LINK TERMINAL

R = RESISTOR

DDD = ZENER DIODE

AMS = AUTOMATIC / MANUAL THROWOVER SWITCH

<b>CenterPoint Energy</b>			
Houston Electric			
WRITTEN	12/30/03	C.W. Mogannam	
CHECKED	12/30/03	R.M. Secret	
APROVED	12/30/03	M.W. Furnish	
Page 9 of 12			
	<b>SPC</b>	<b>007</b>	<b>400 02</b>

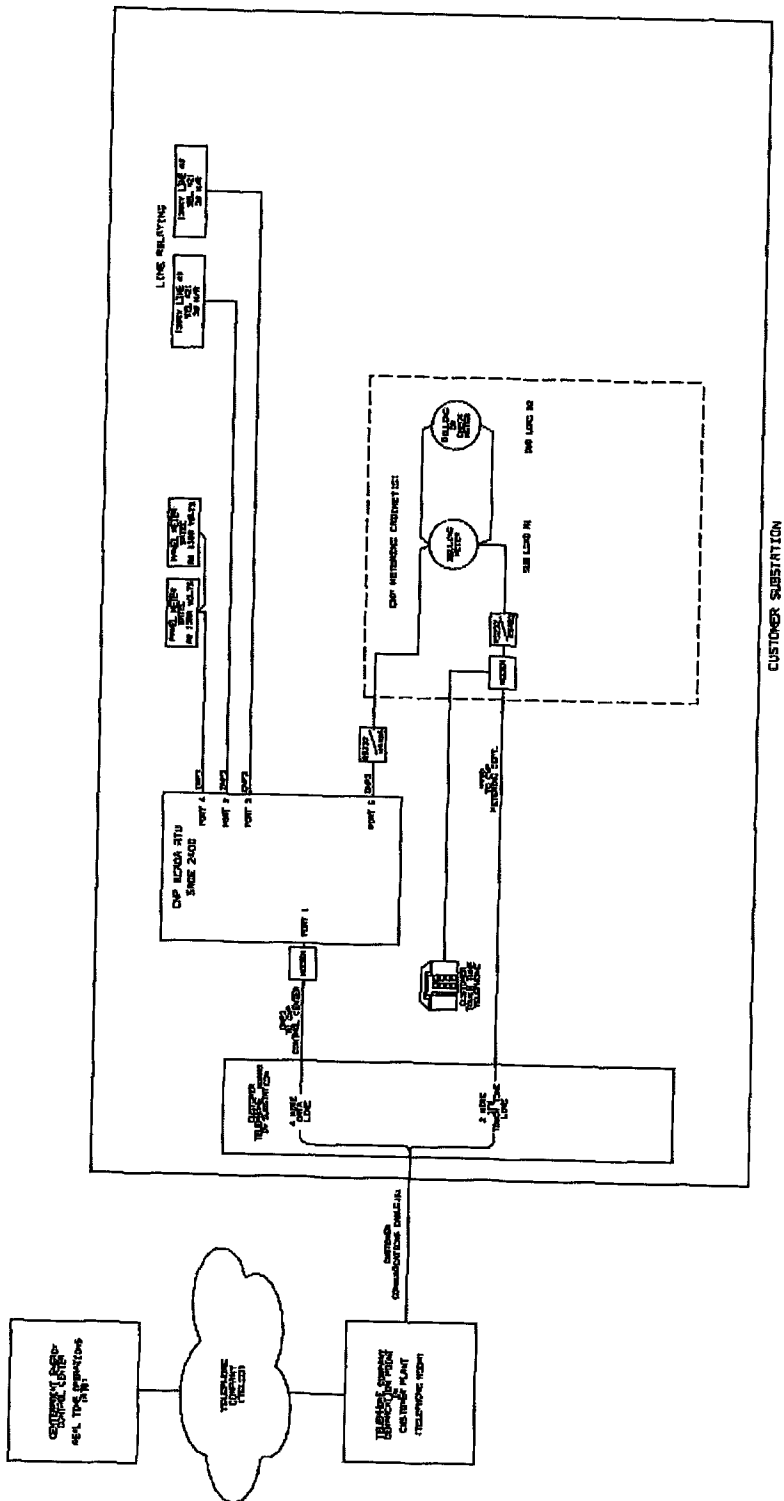

CNP Drawing: BSC-564-500-01 sh.1  
 Customer Substation Communications Block Diagram  
 Figure 1

<b>CenterPoint Energy</b>			
Houston Electric			
WRITTEN	12/30/03	C.W. Mogannam	
CHECKED	12/30/03	R.M. Secrest	
APPROVED	12/30/03	M.W. Furnish	
Page 10 of 12			
SPC	007	400	02