






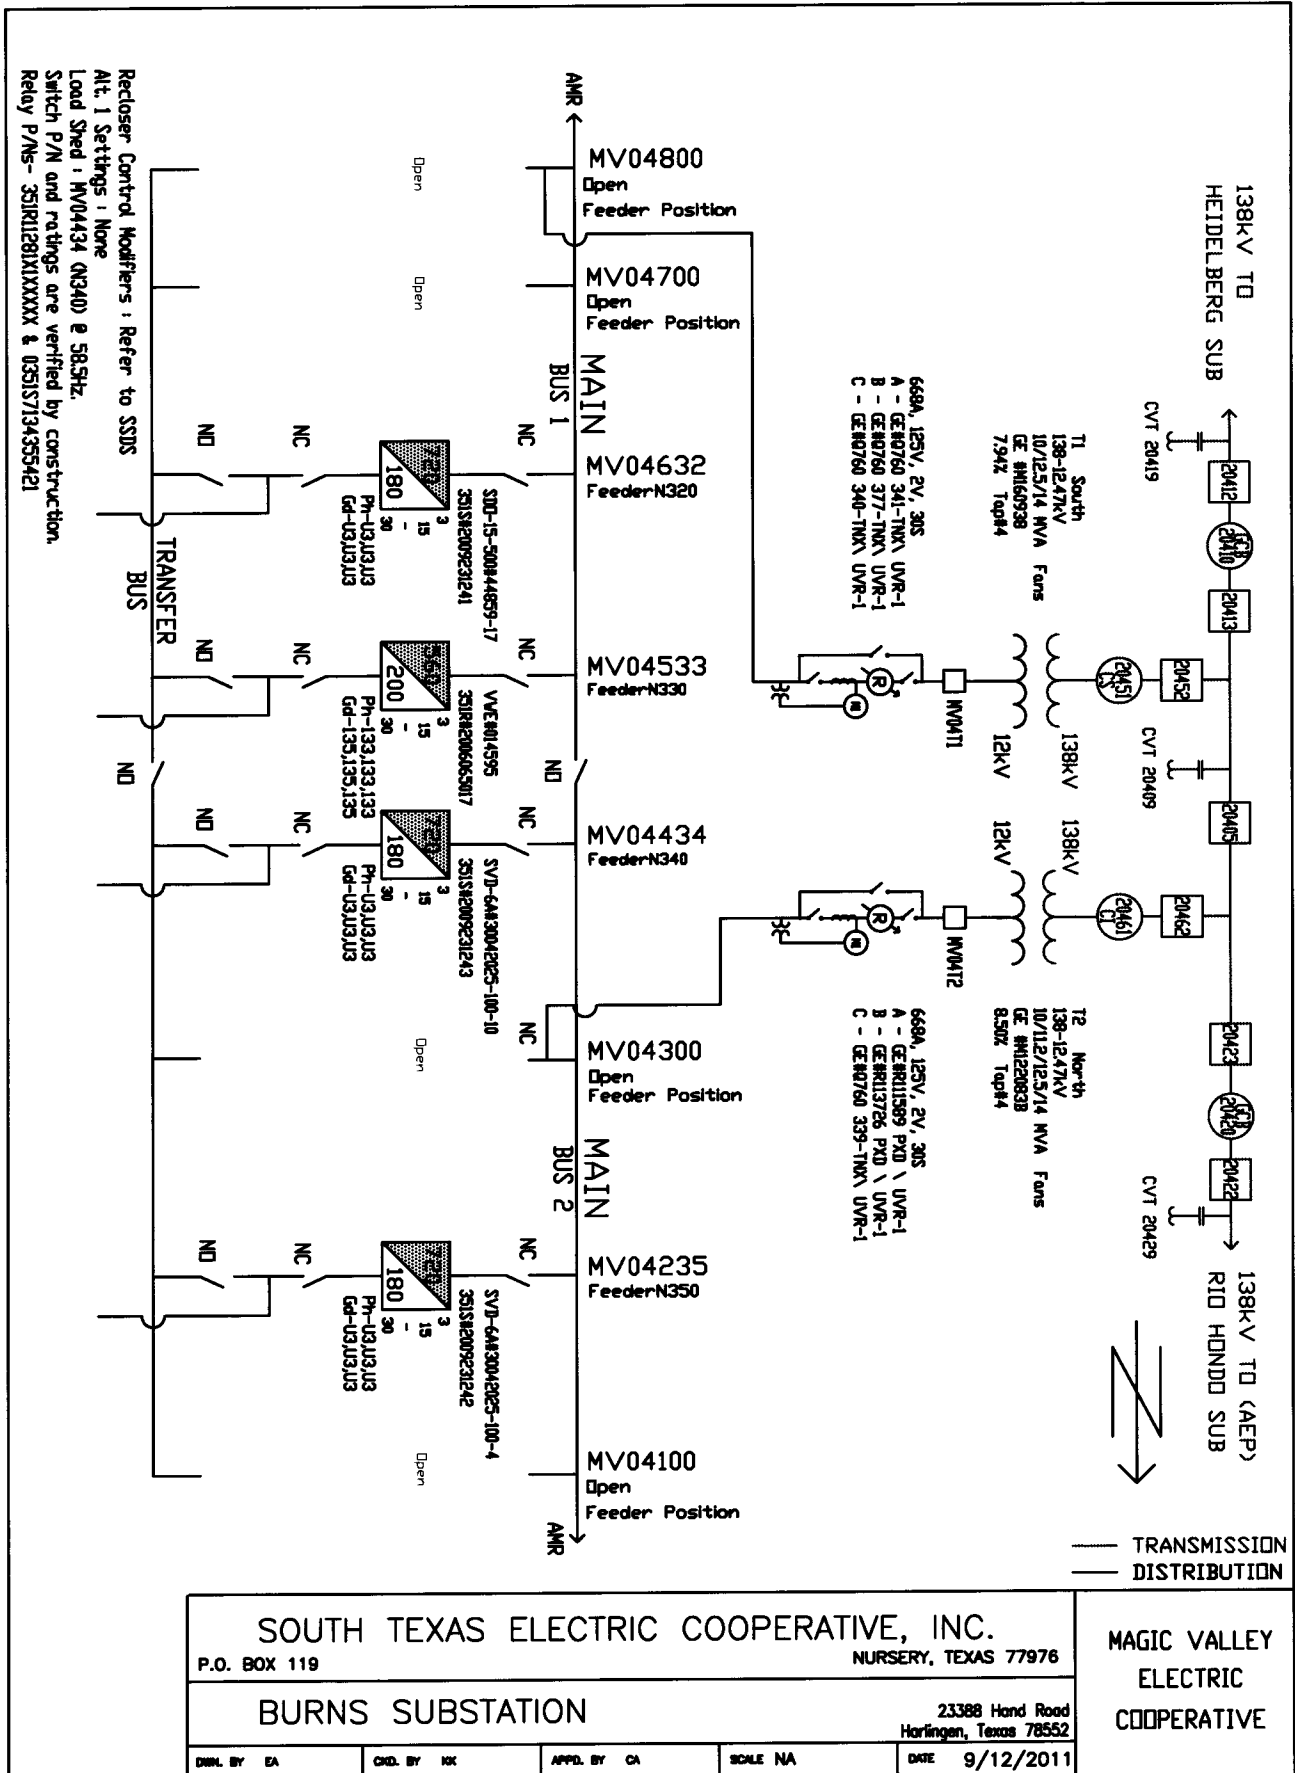


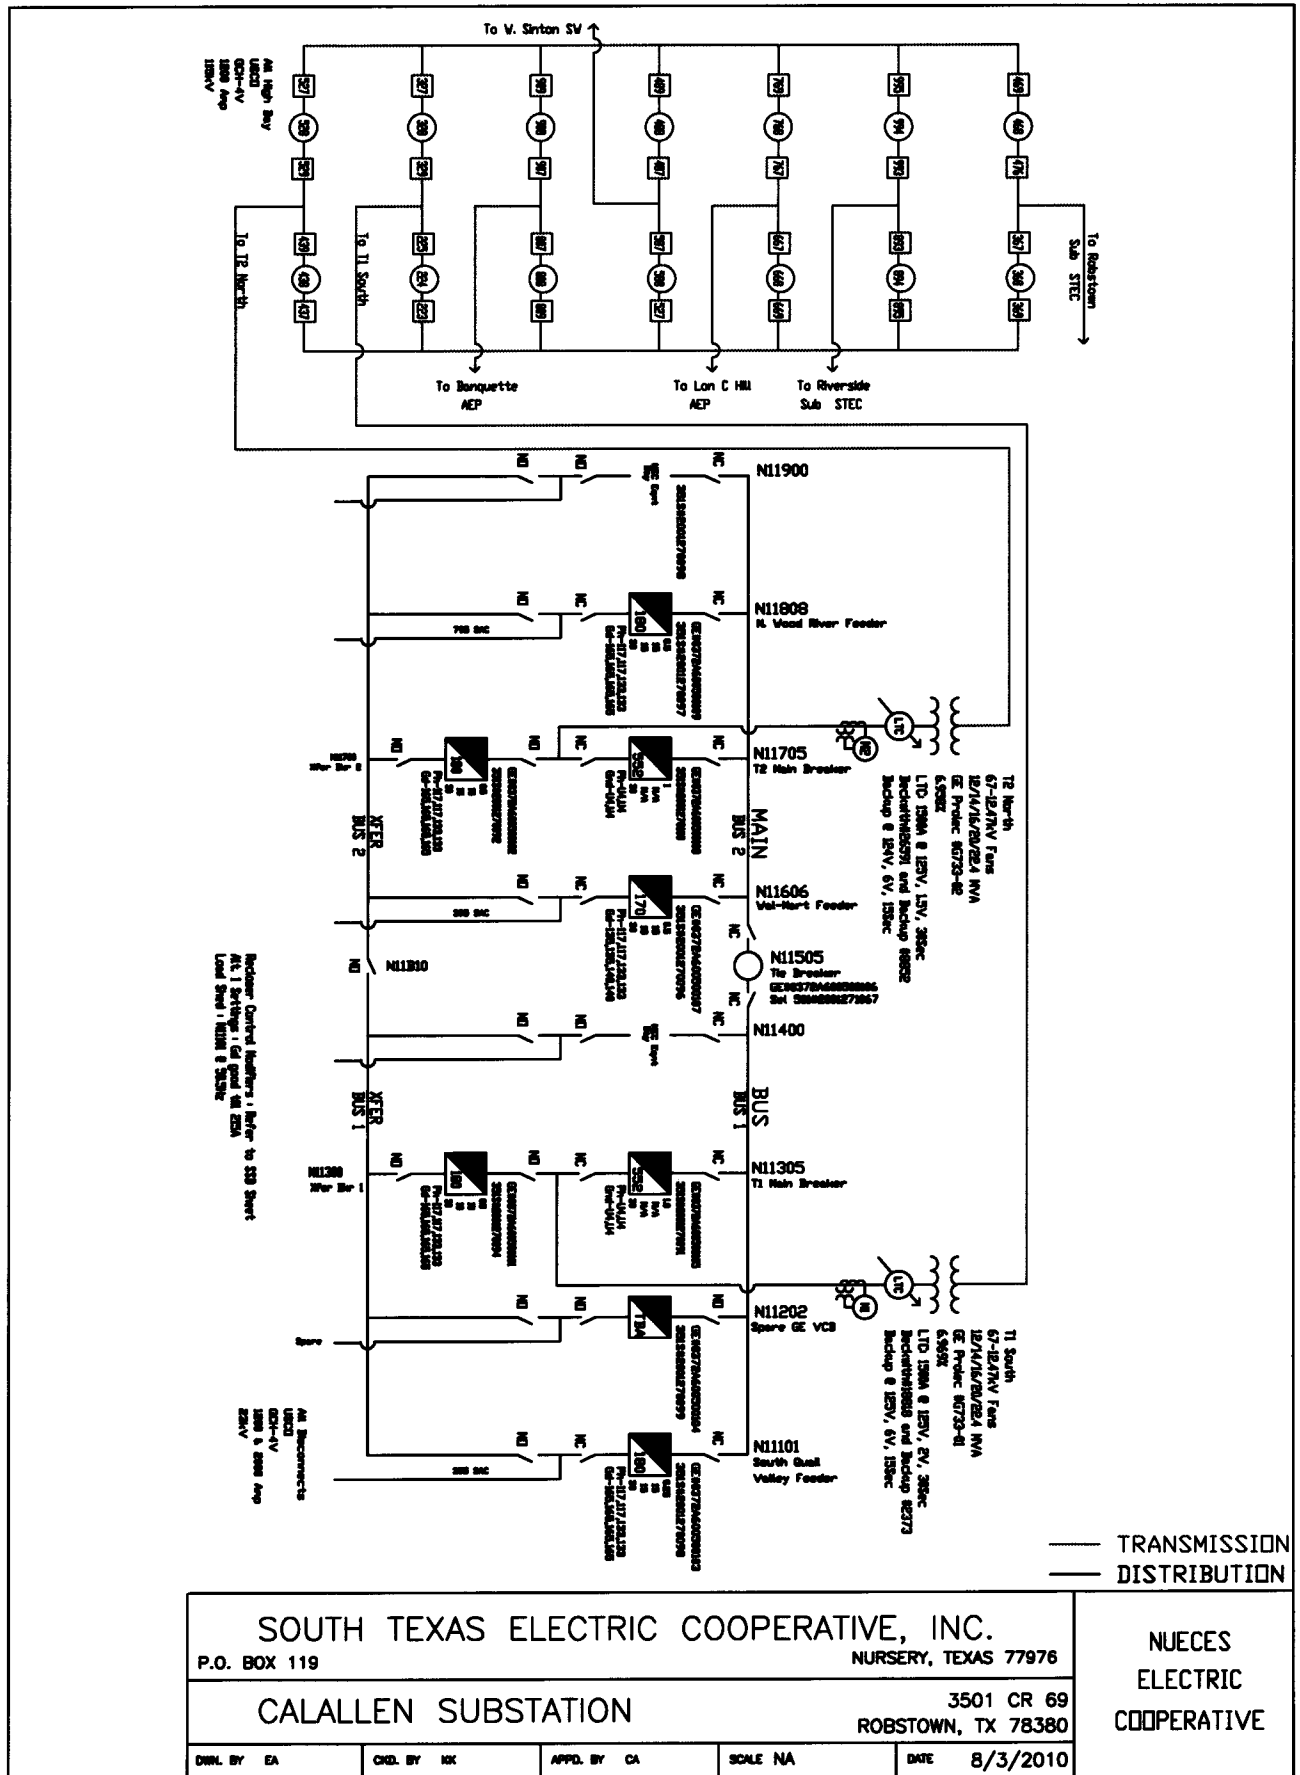

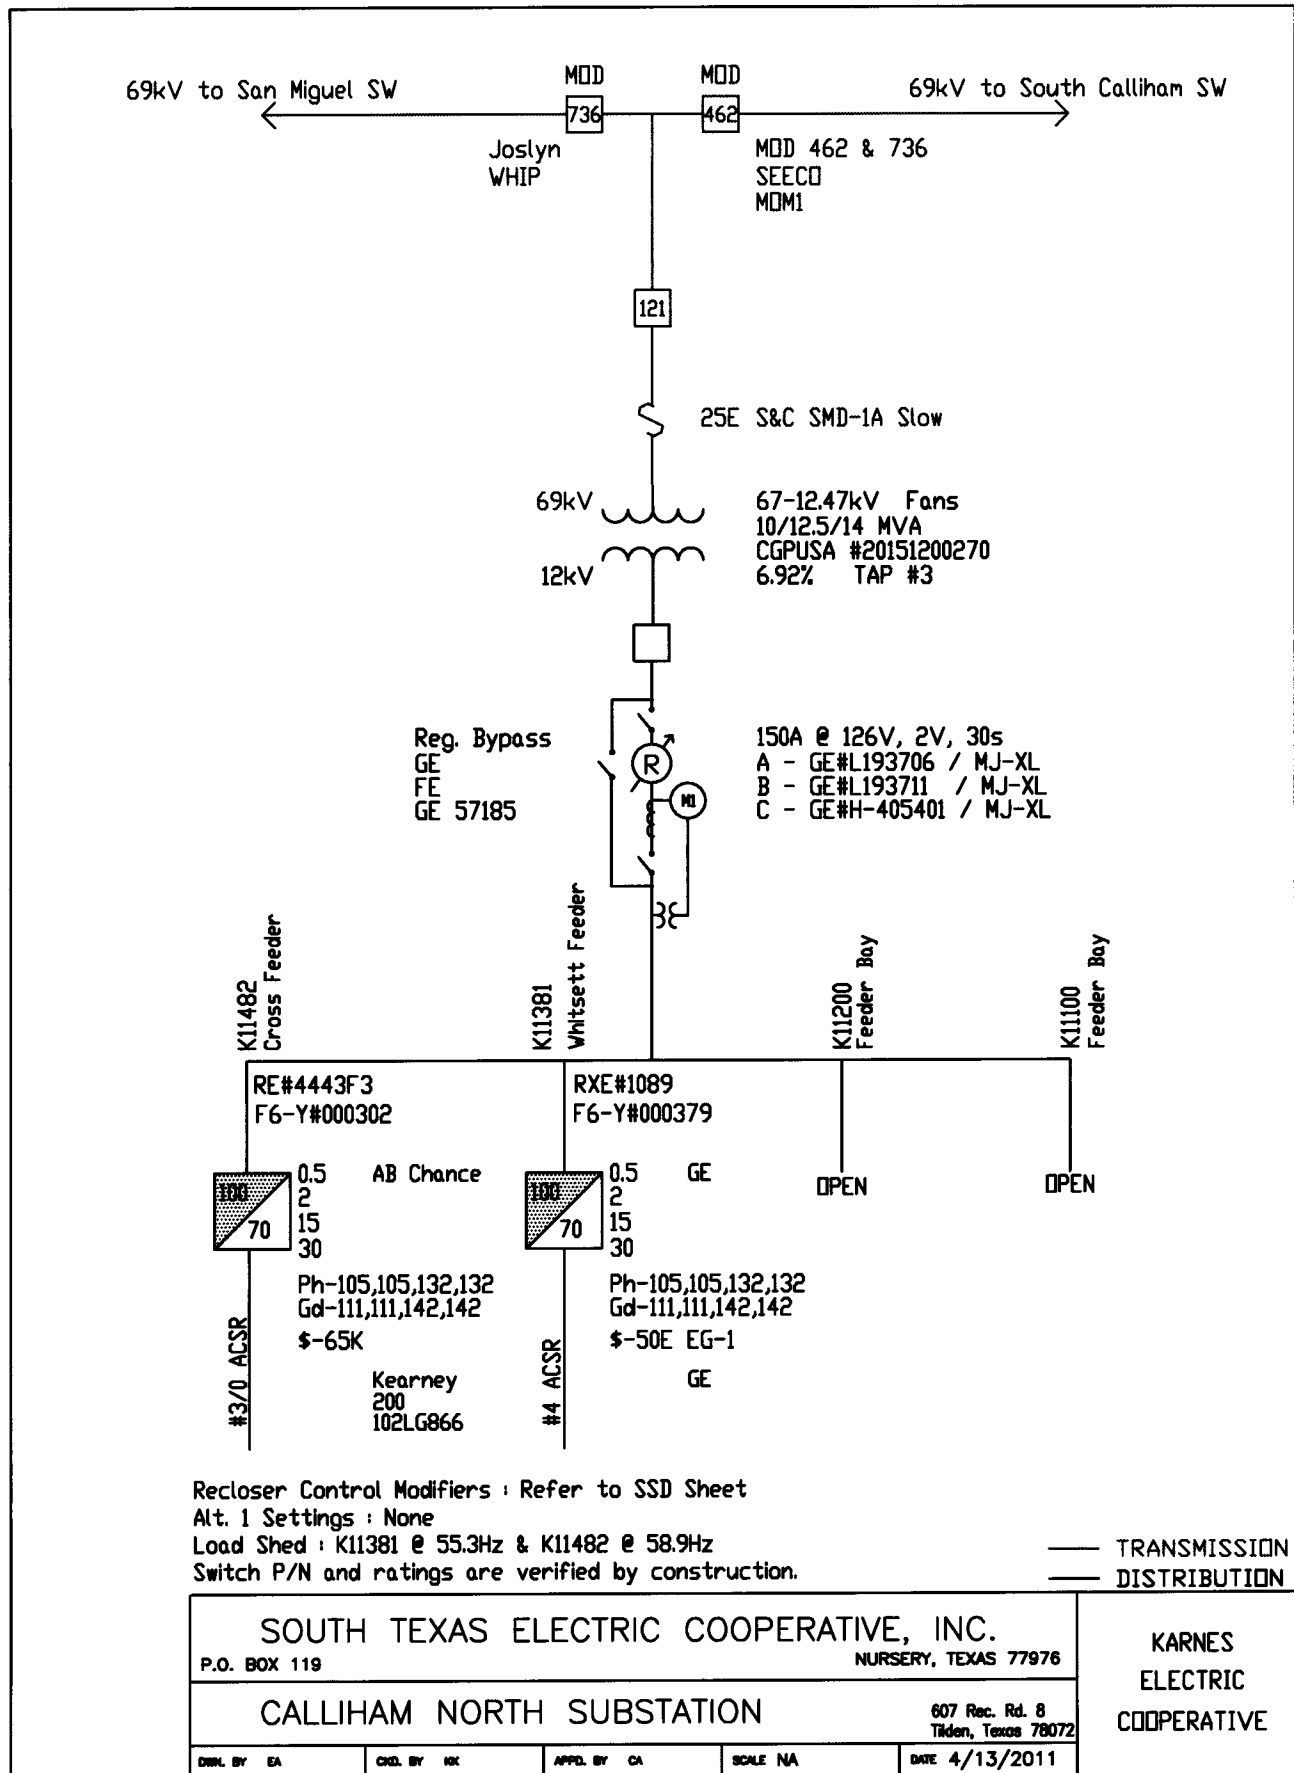

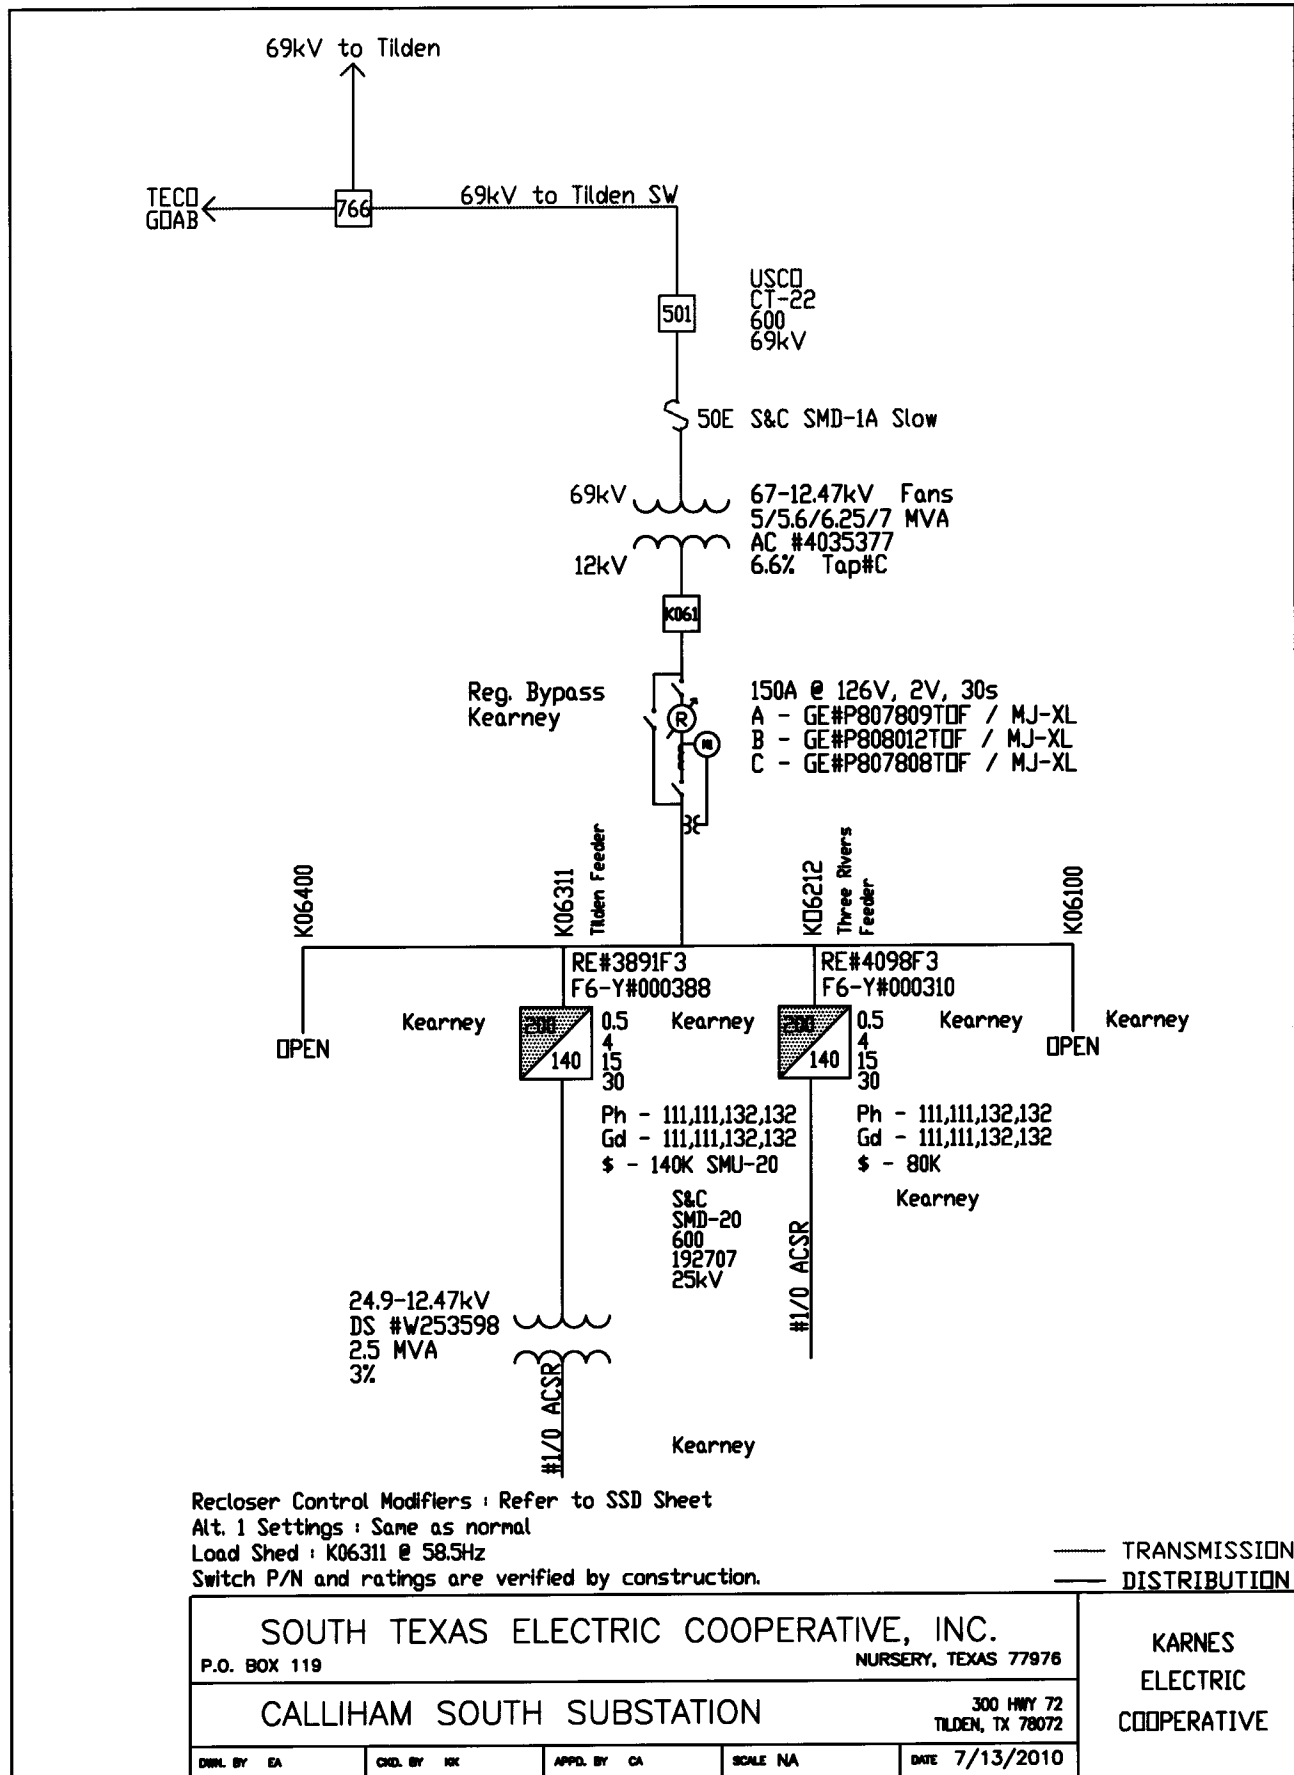

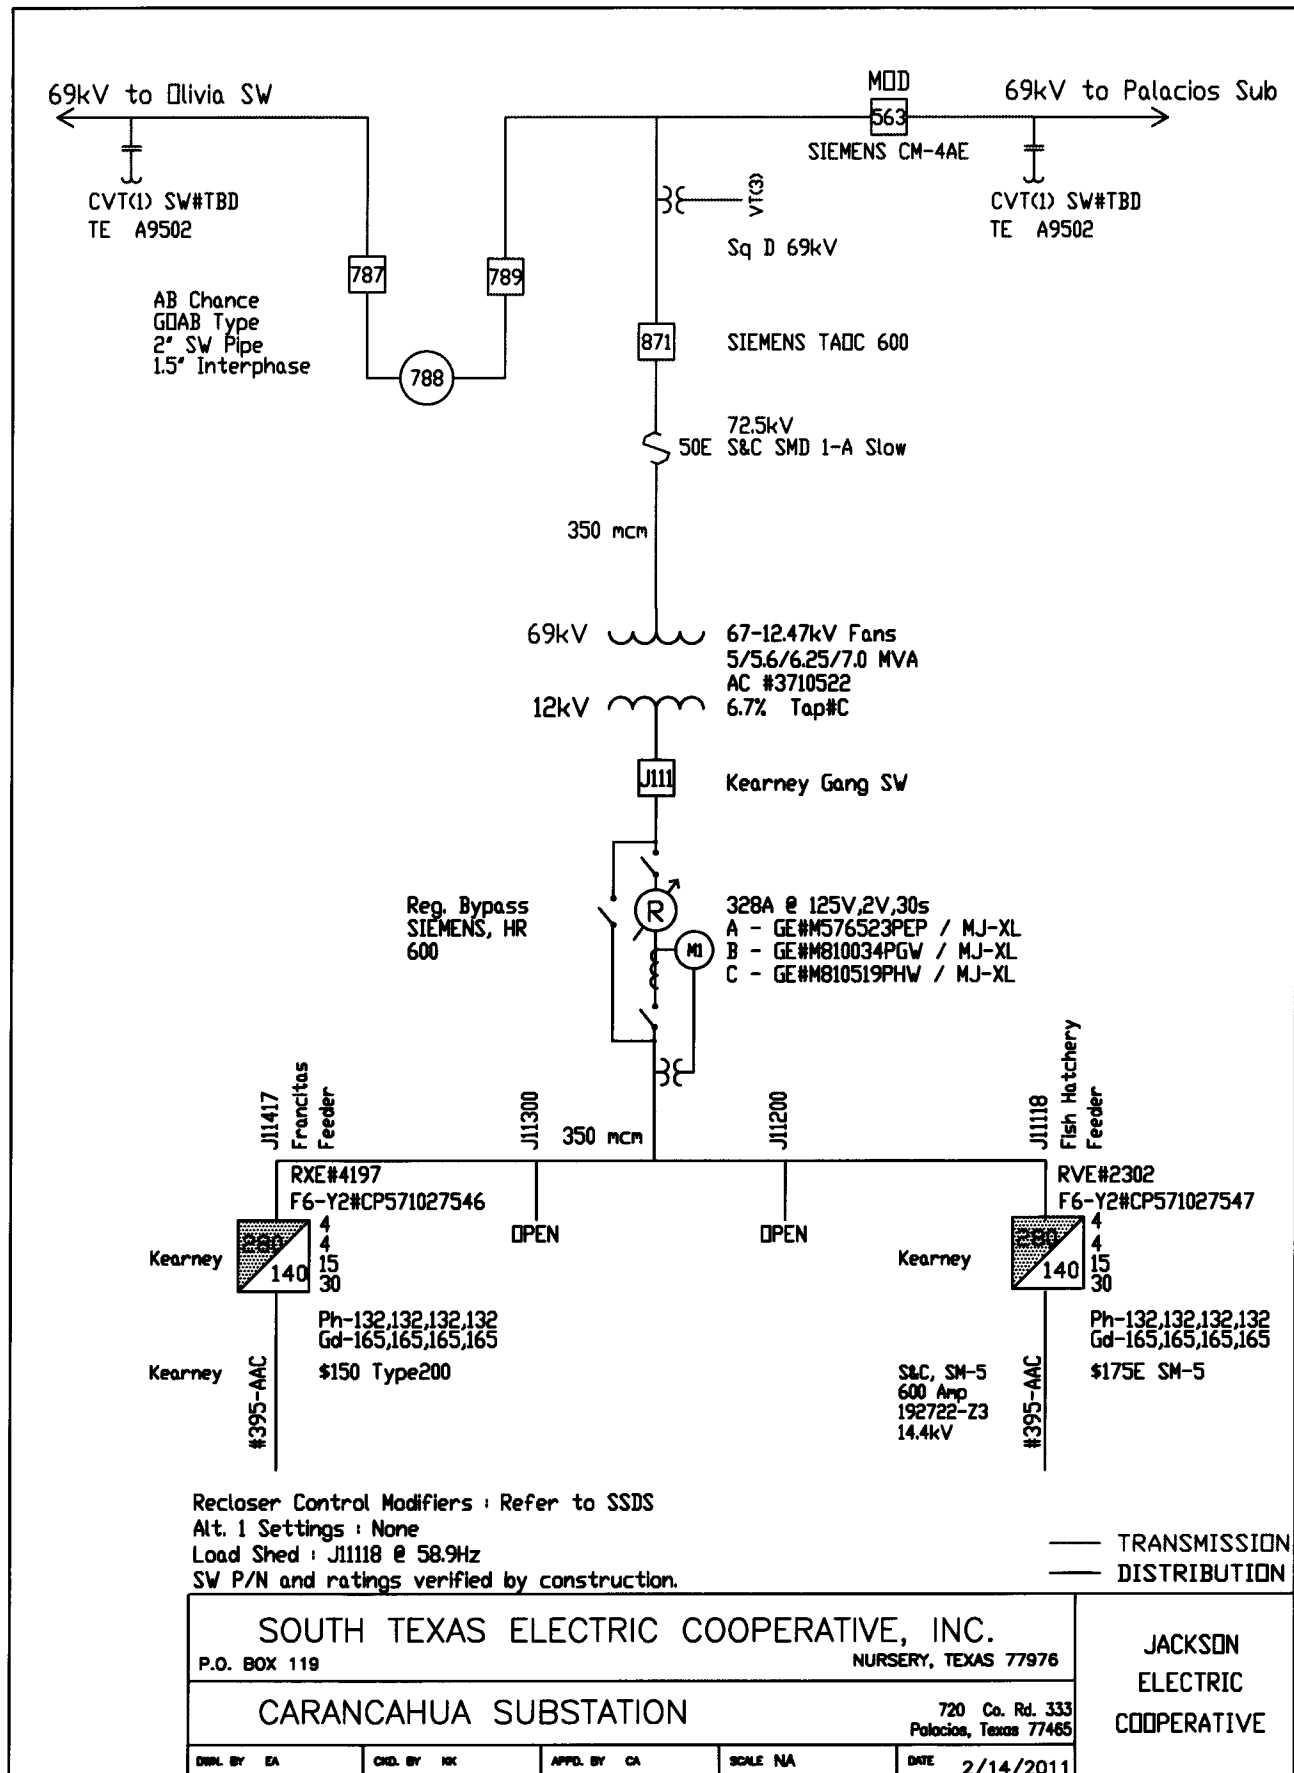


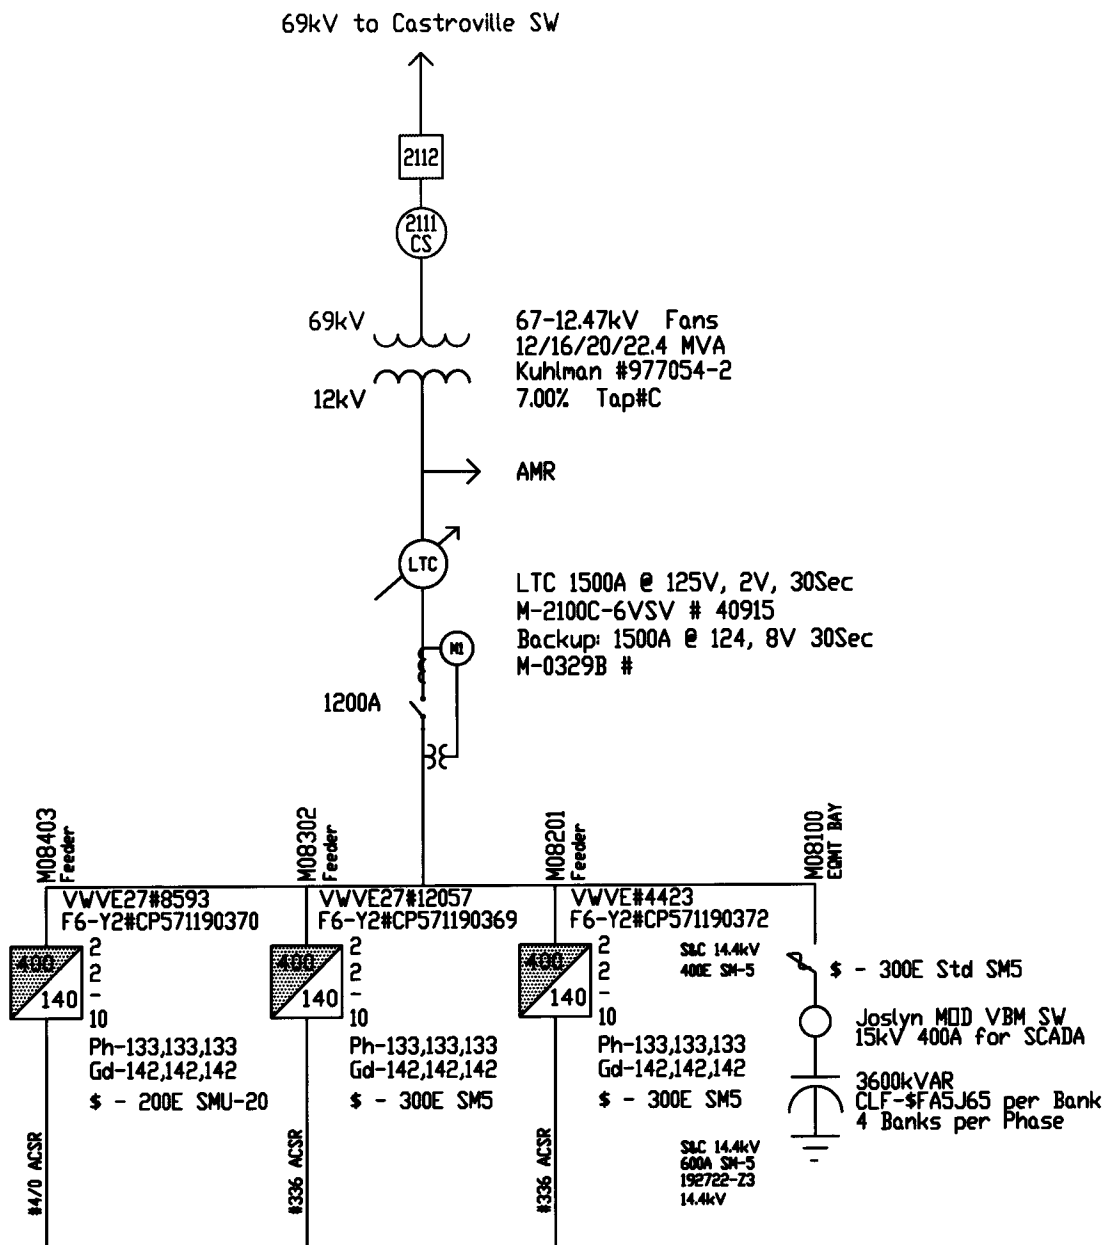



Recloser Control Modifiers : Refer to SSD Sheet
Alt. 1 Settings : None
Load Shed : M08403 @ 59.3Hz
Switch P/N and ratings are verified by construction.


— TRANSMISSION
— DISTRIBUTION


SOUTH TEXAS ELECTRIC COOPERATIVE, INC.					MEDINA ELECTRIC COOPERATIVE
P.O. BOX 119			NURSERY, TEXAS 77976		
CASTROVILLE SUBSTATION					
1601 FM 471 N Castroville, TX 78009					
DRN. BY EA	CHD. BY KK	APPD. BY CA	SCALE NA	DATE 11/08/2011	

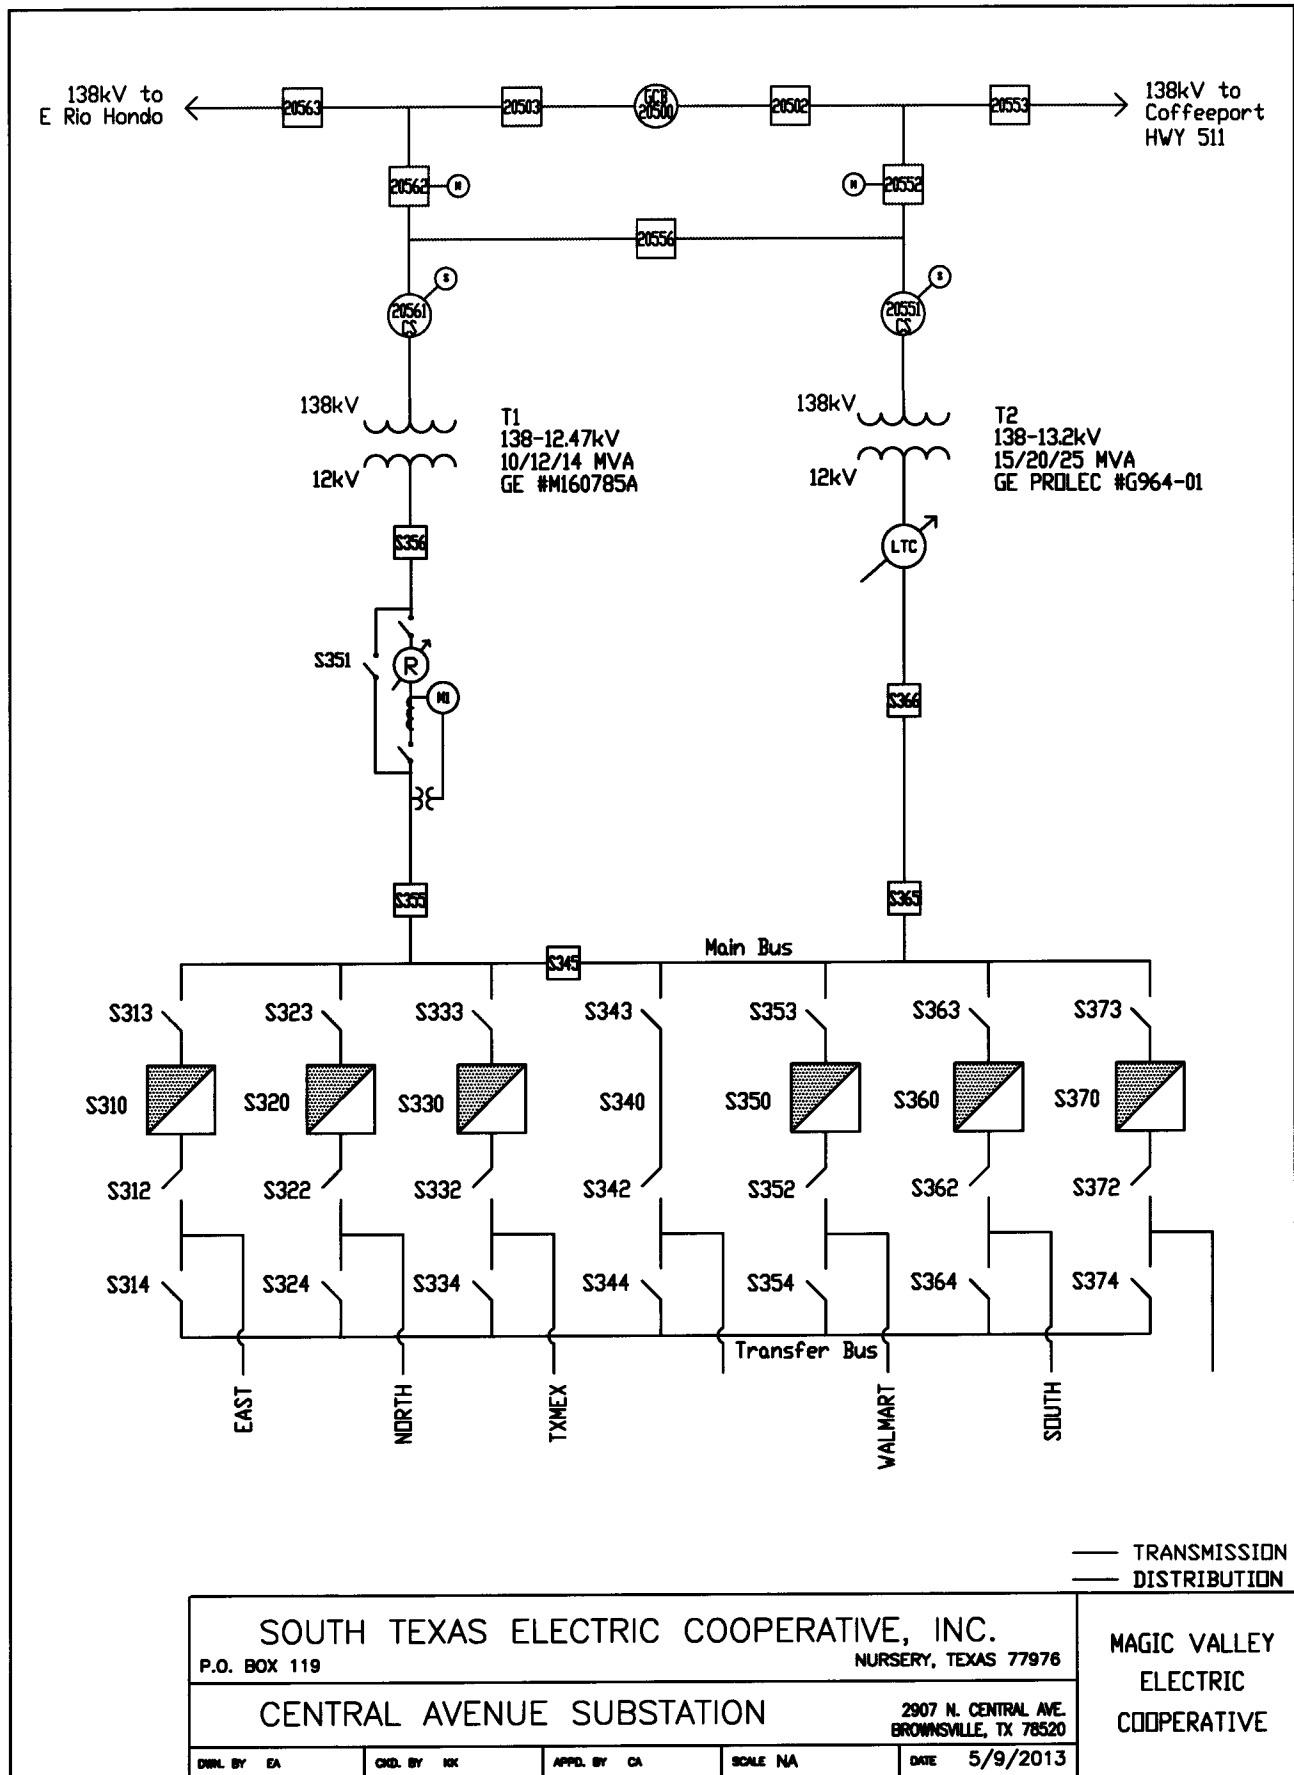


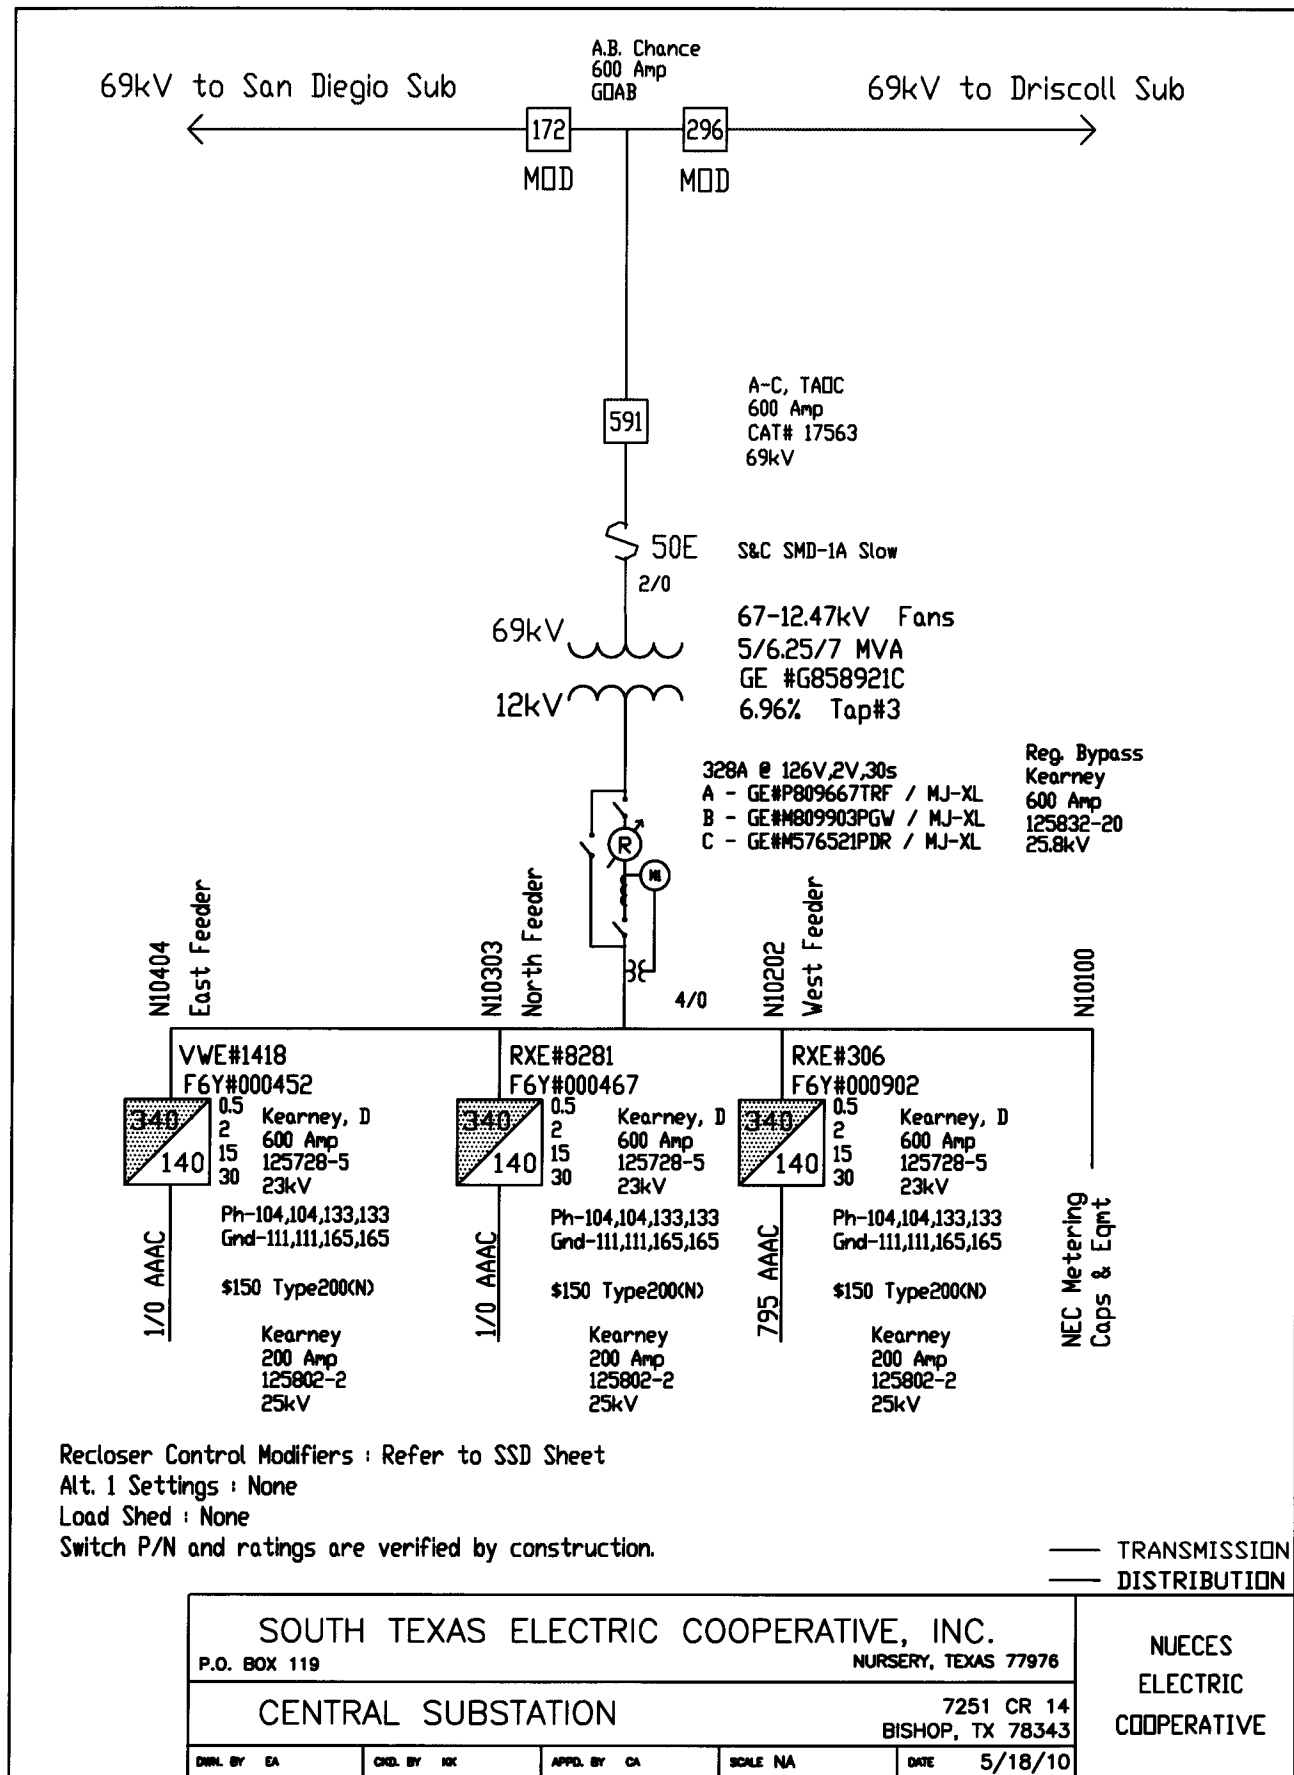


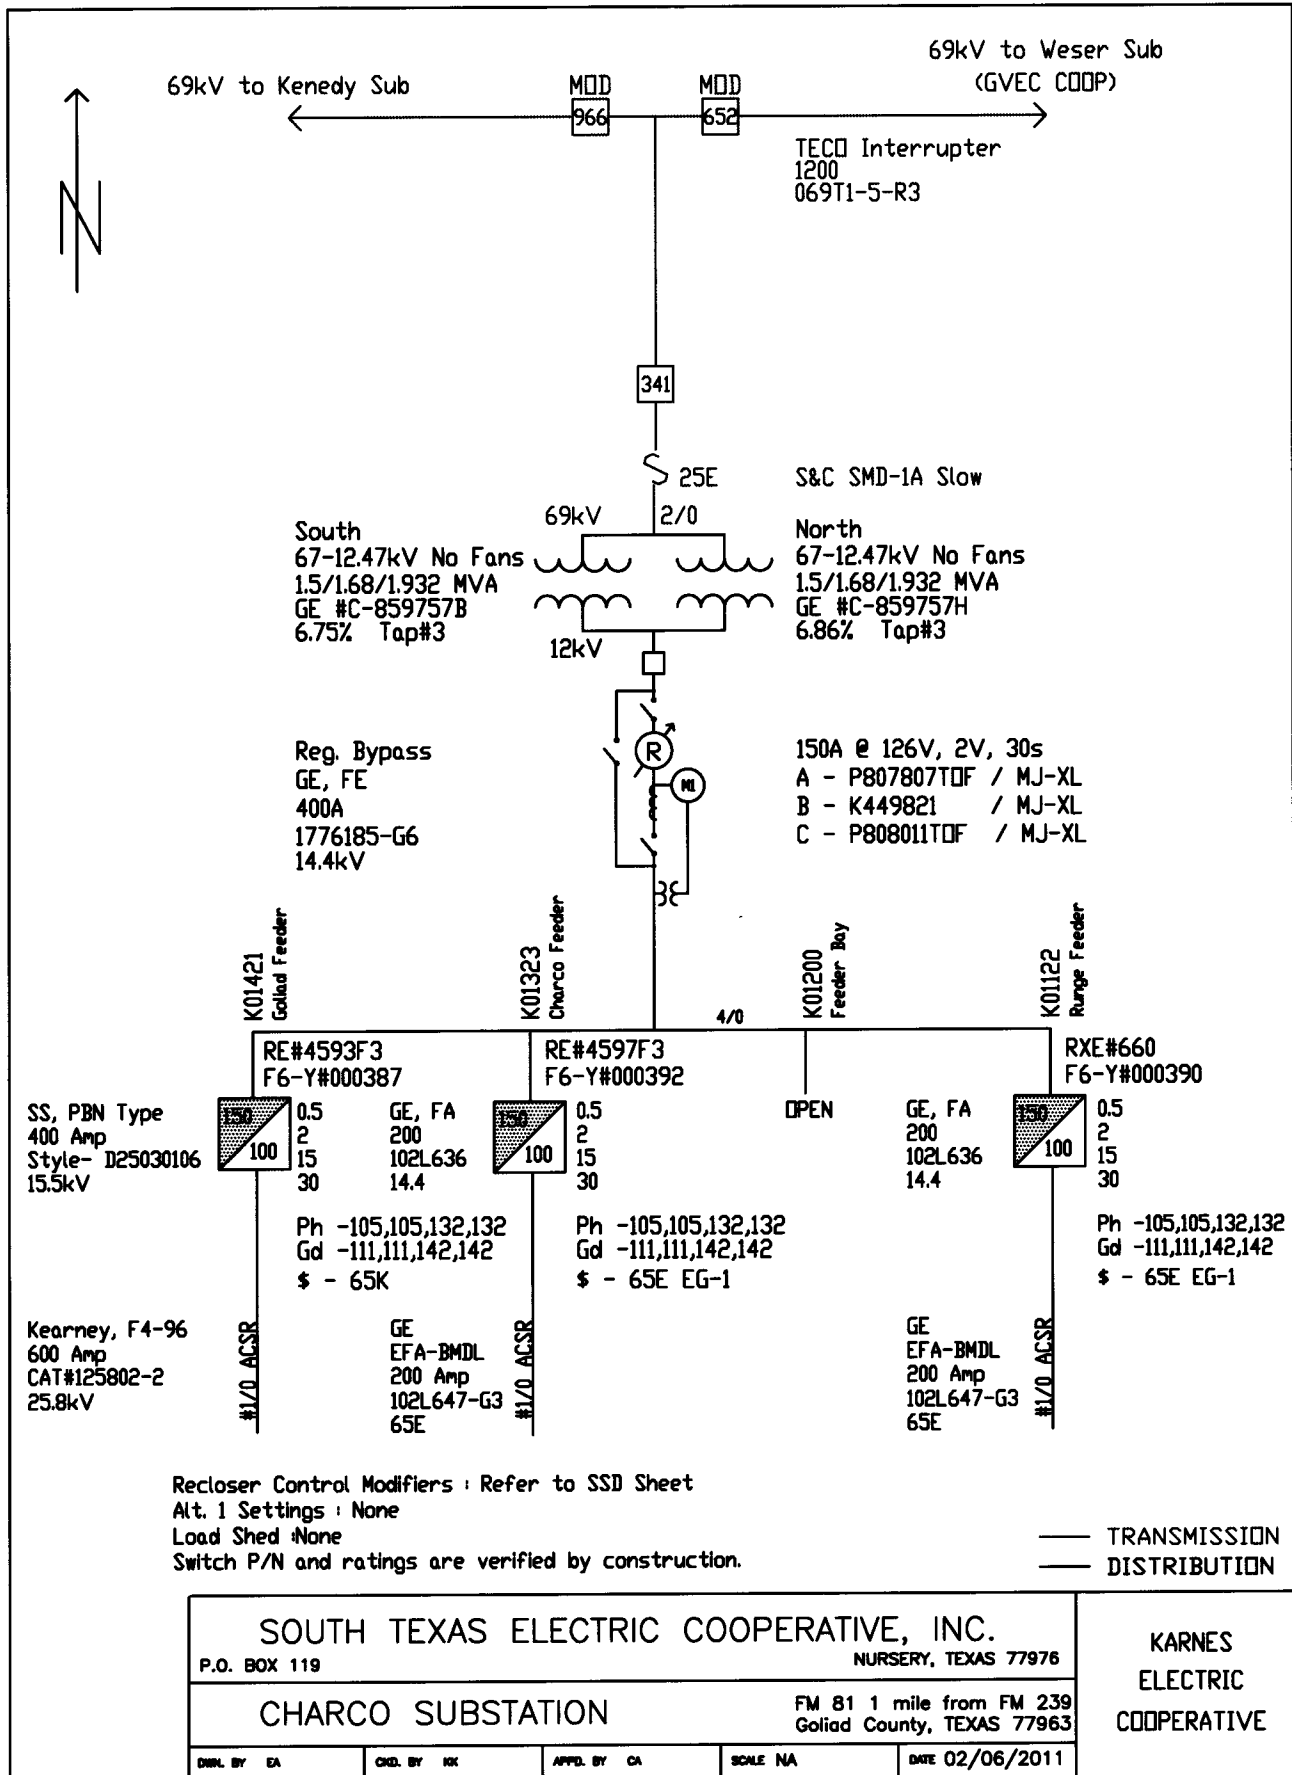


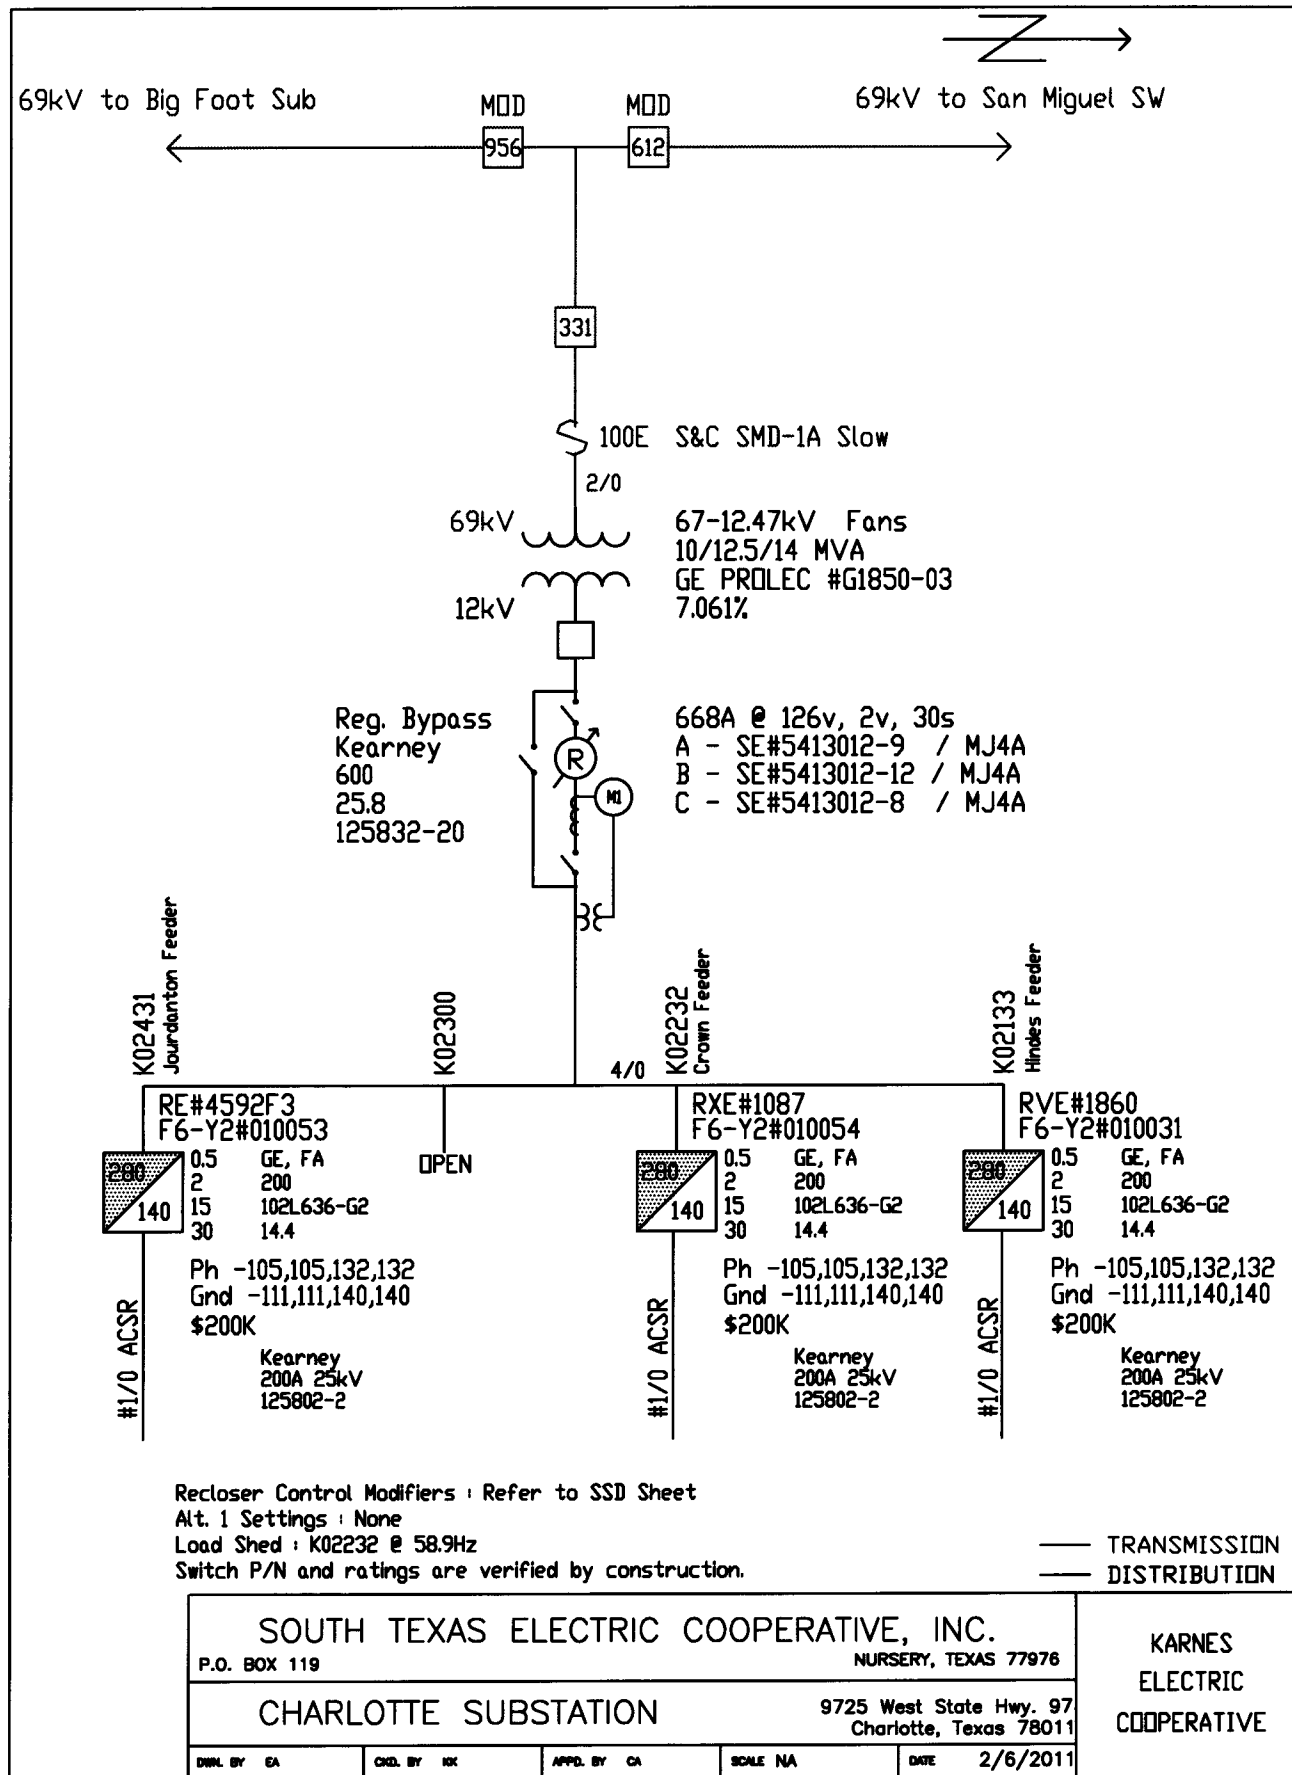


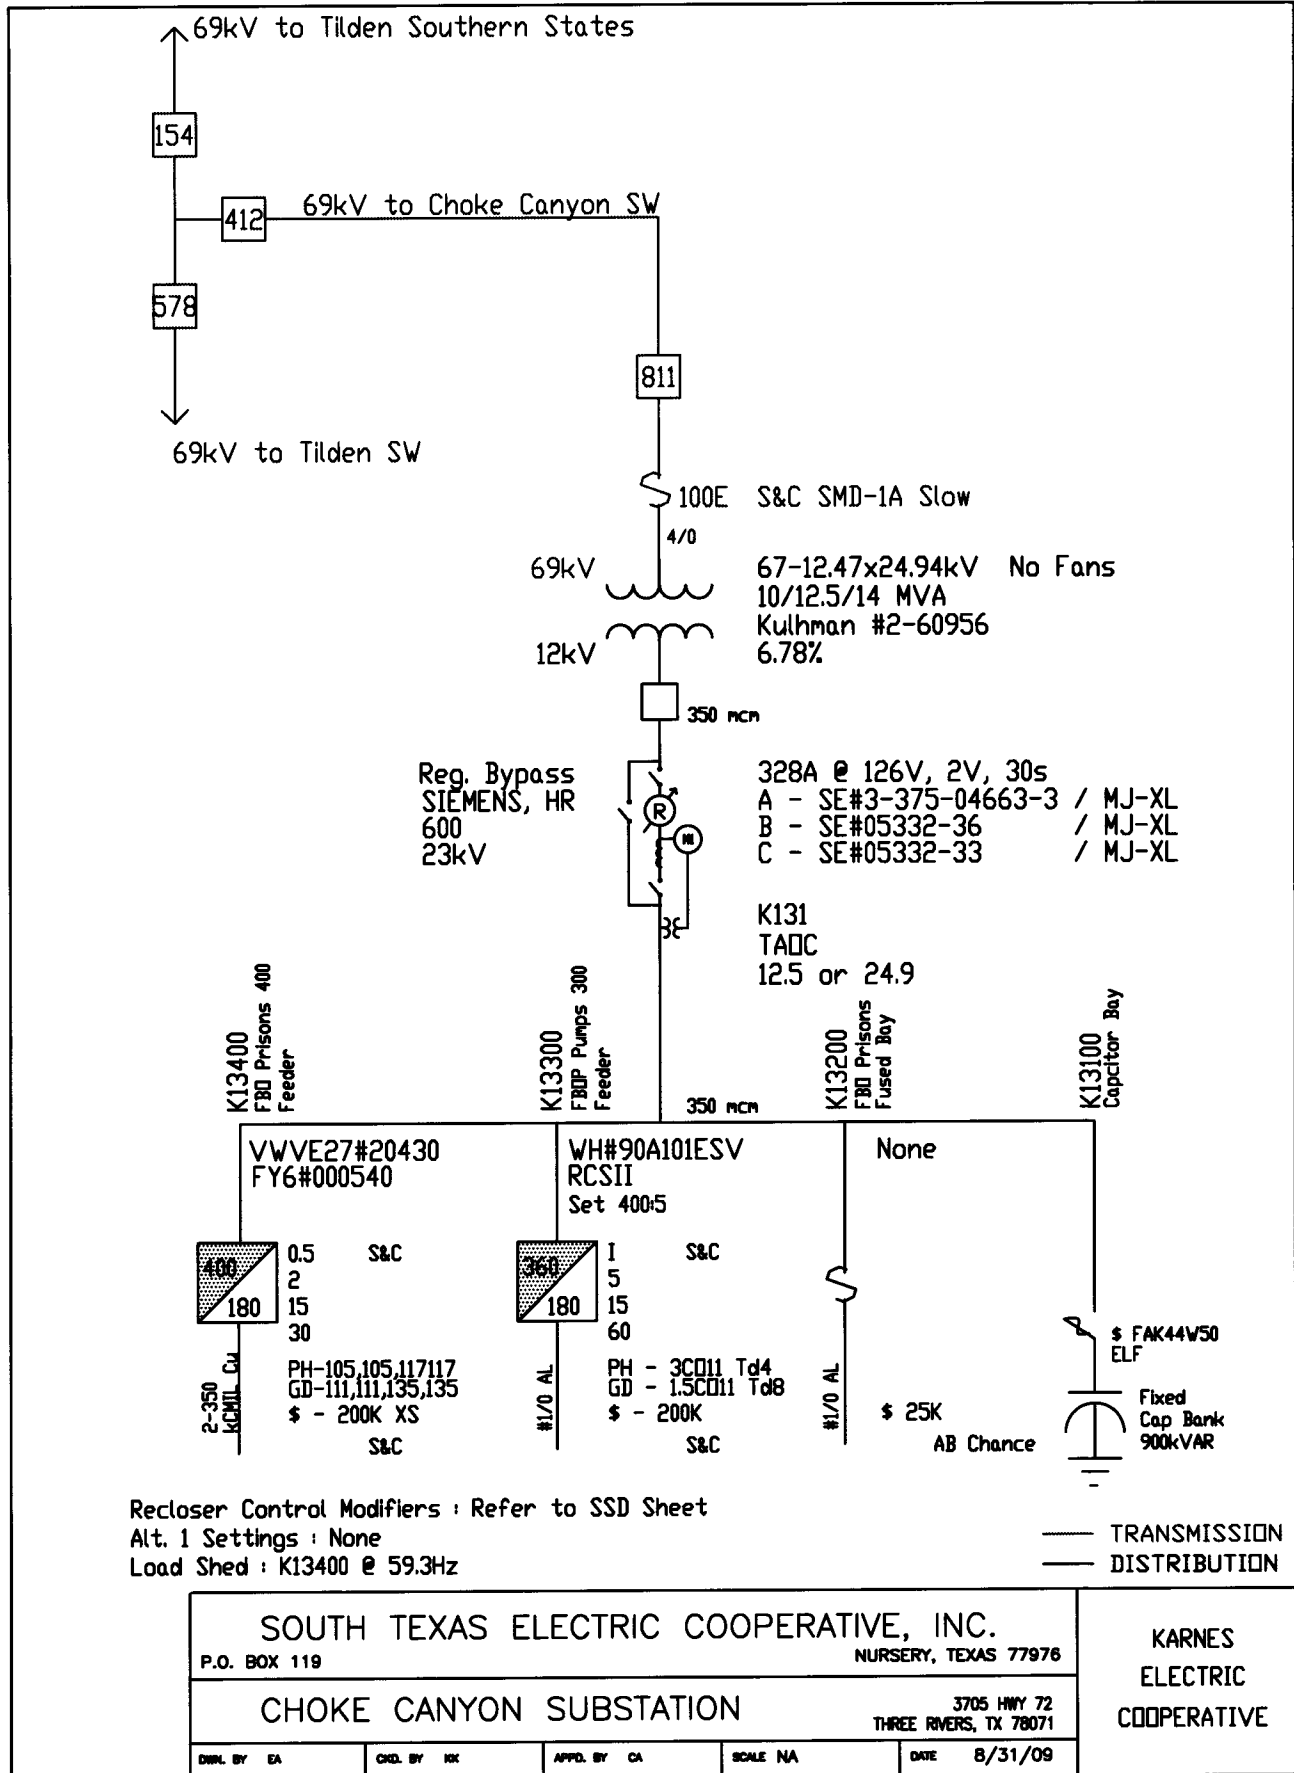


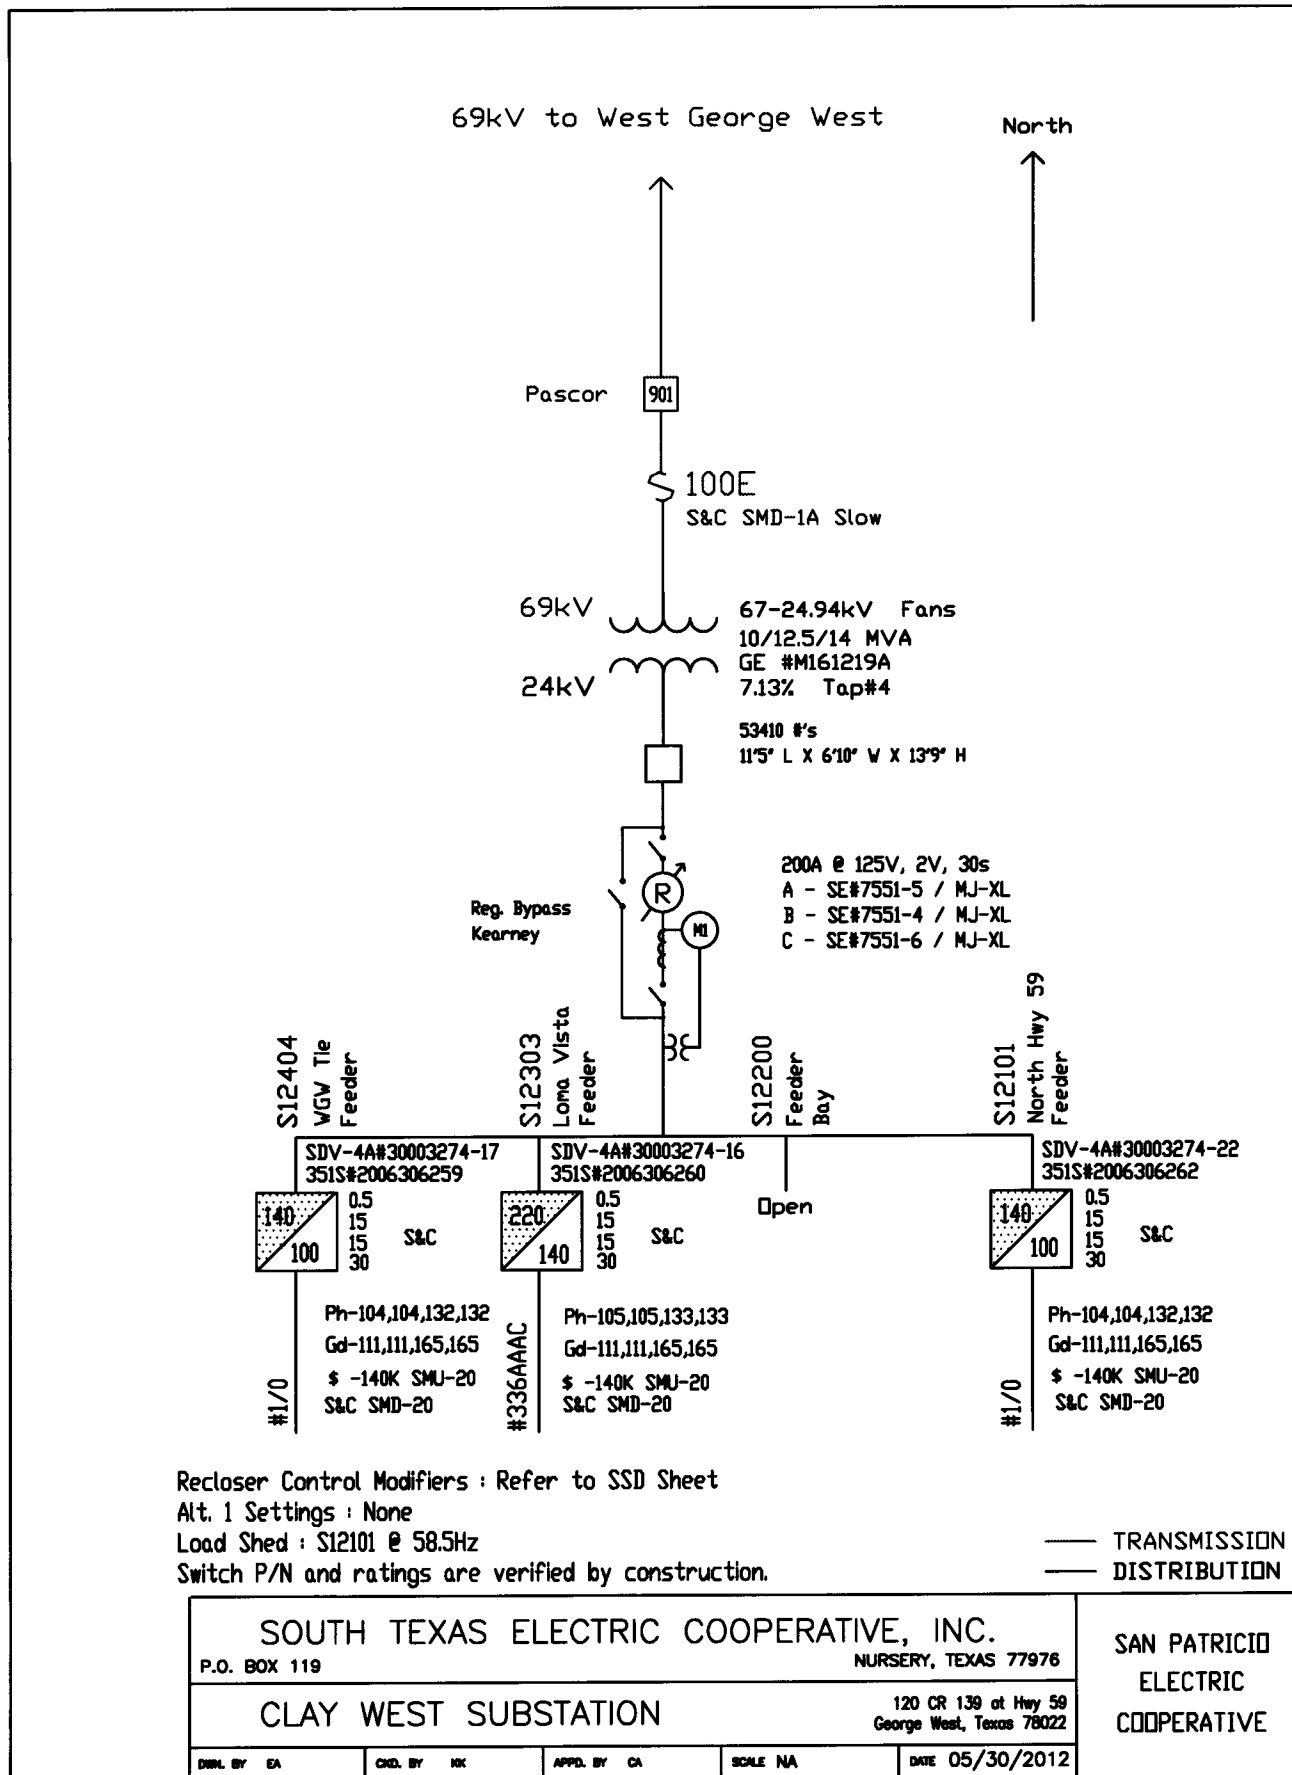

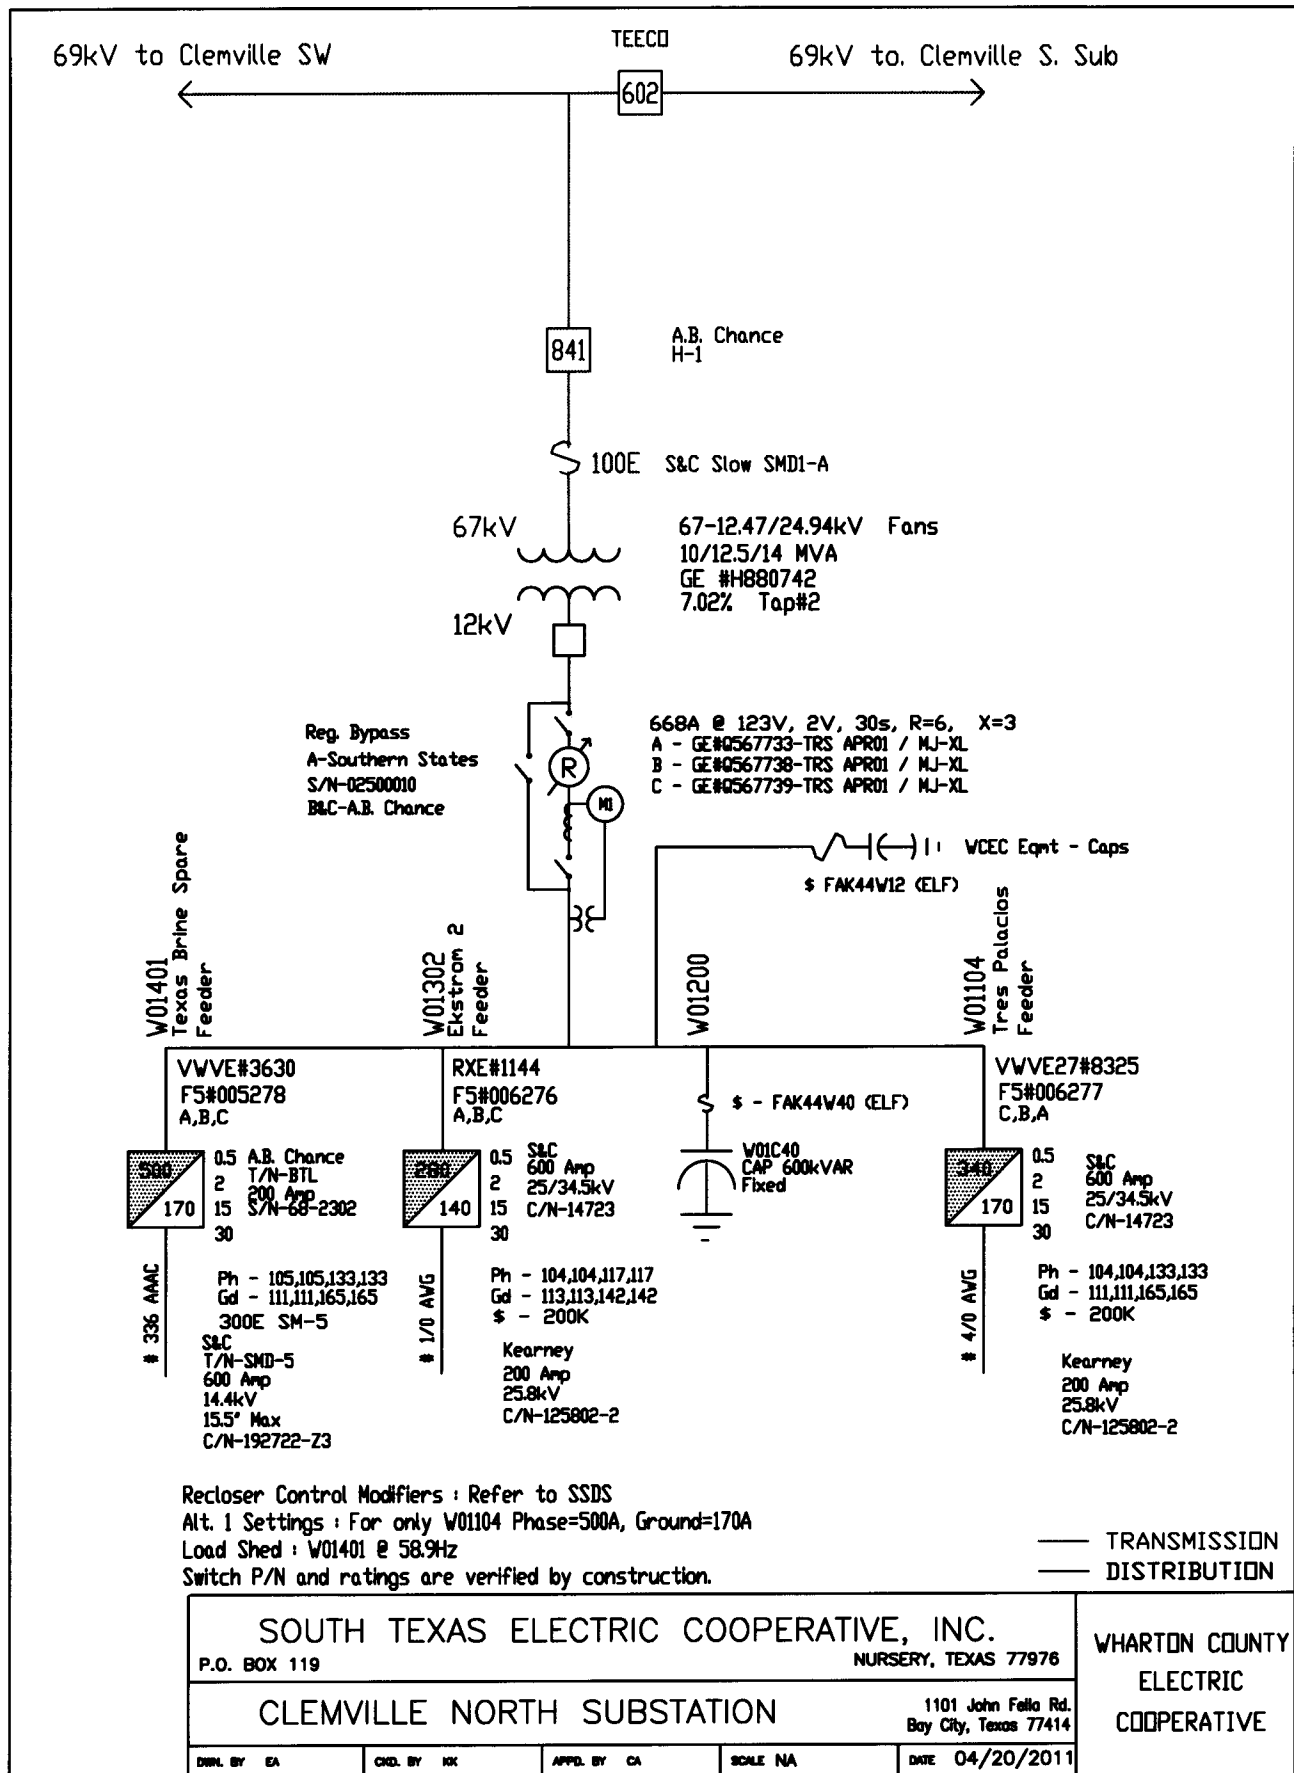

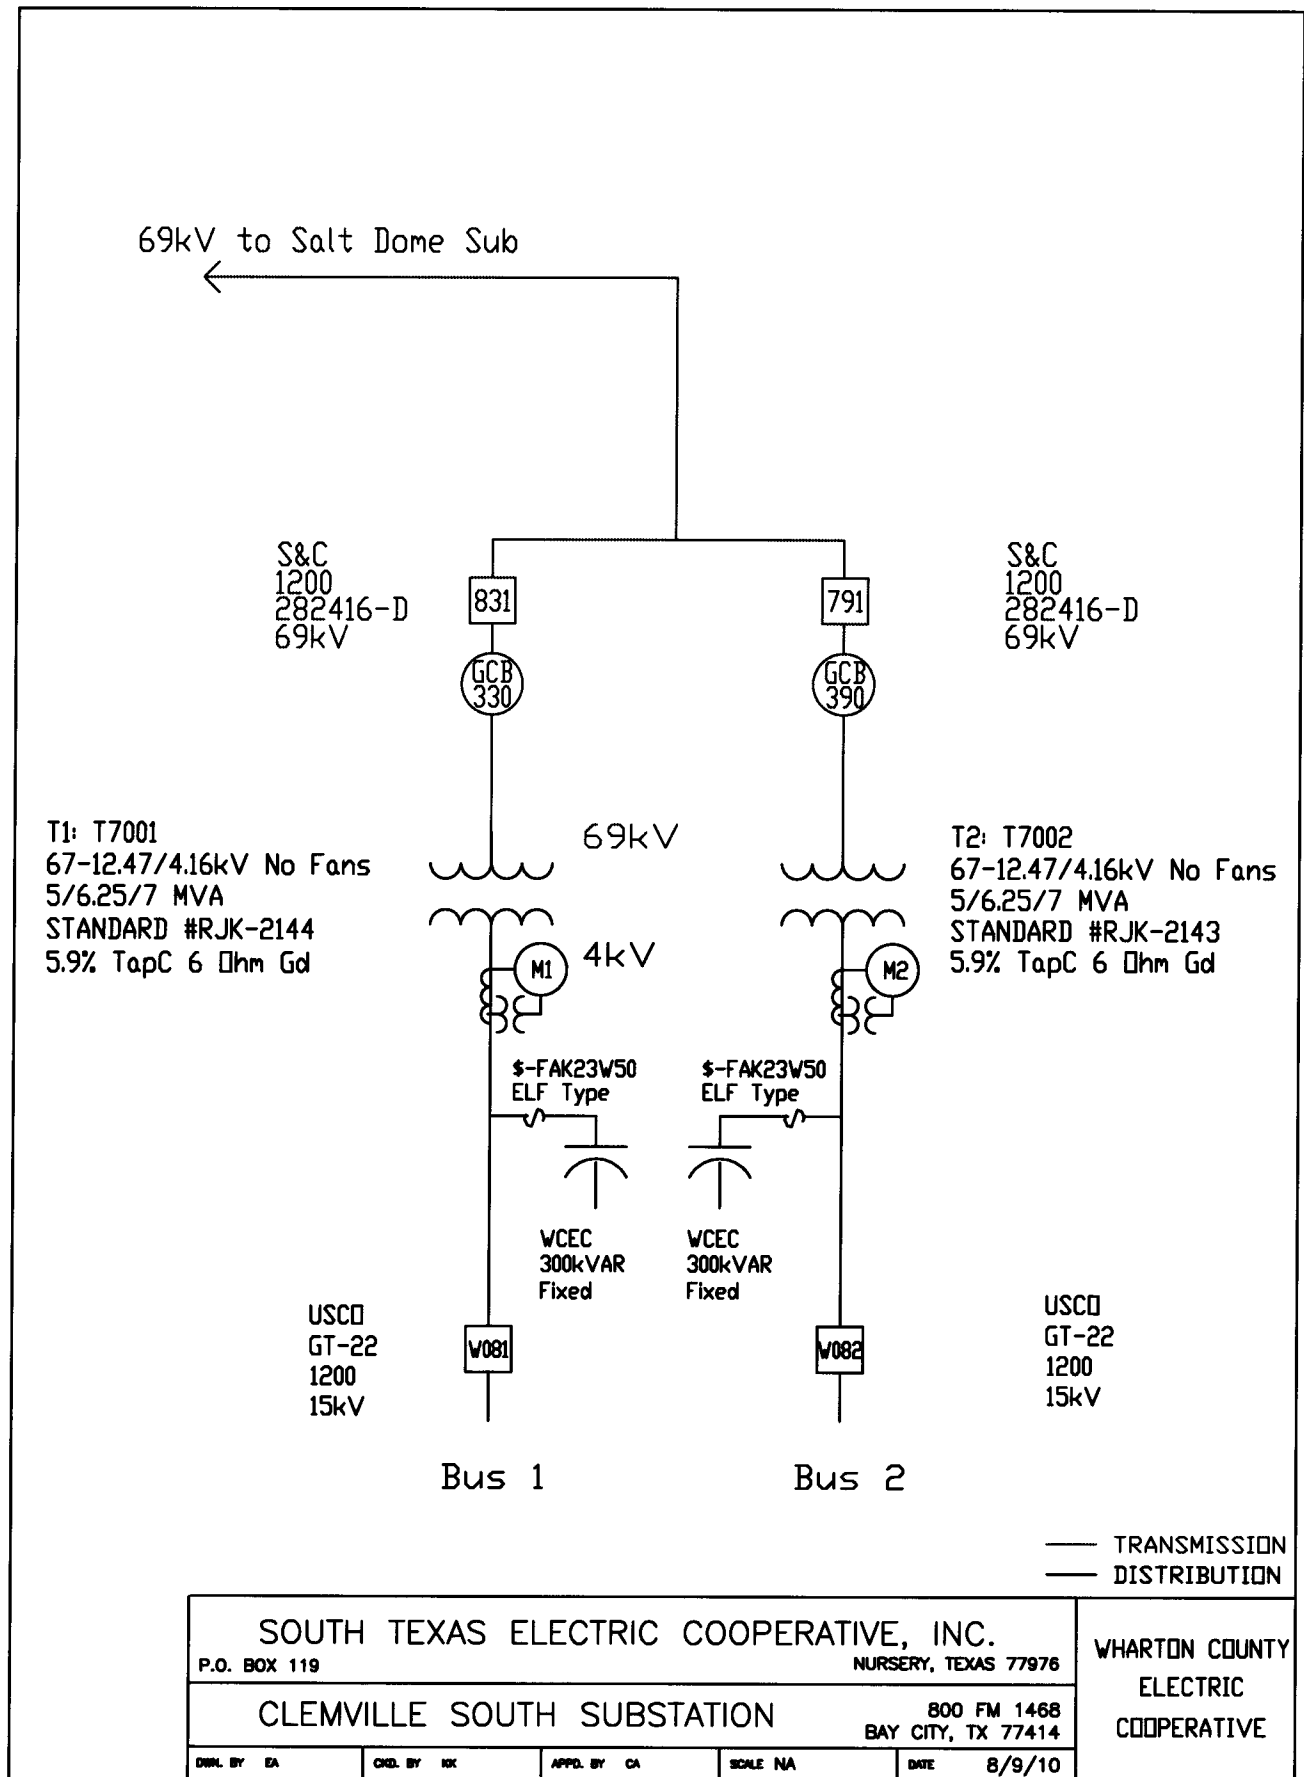


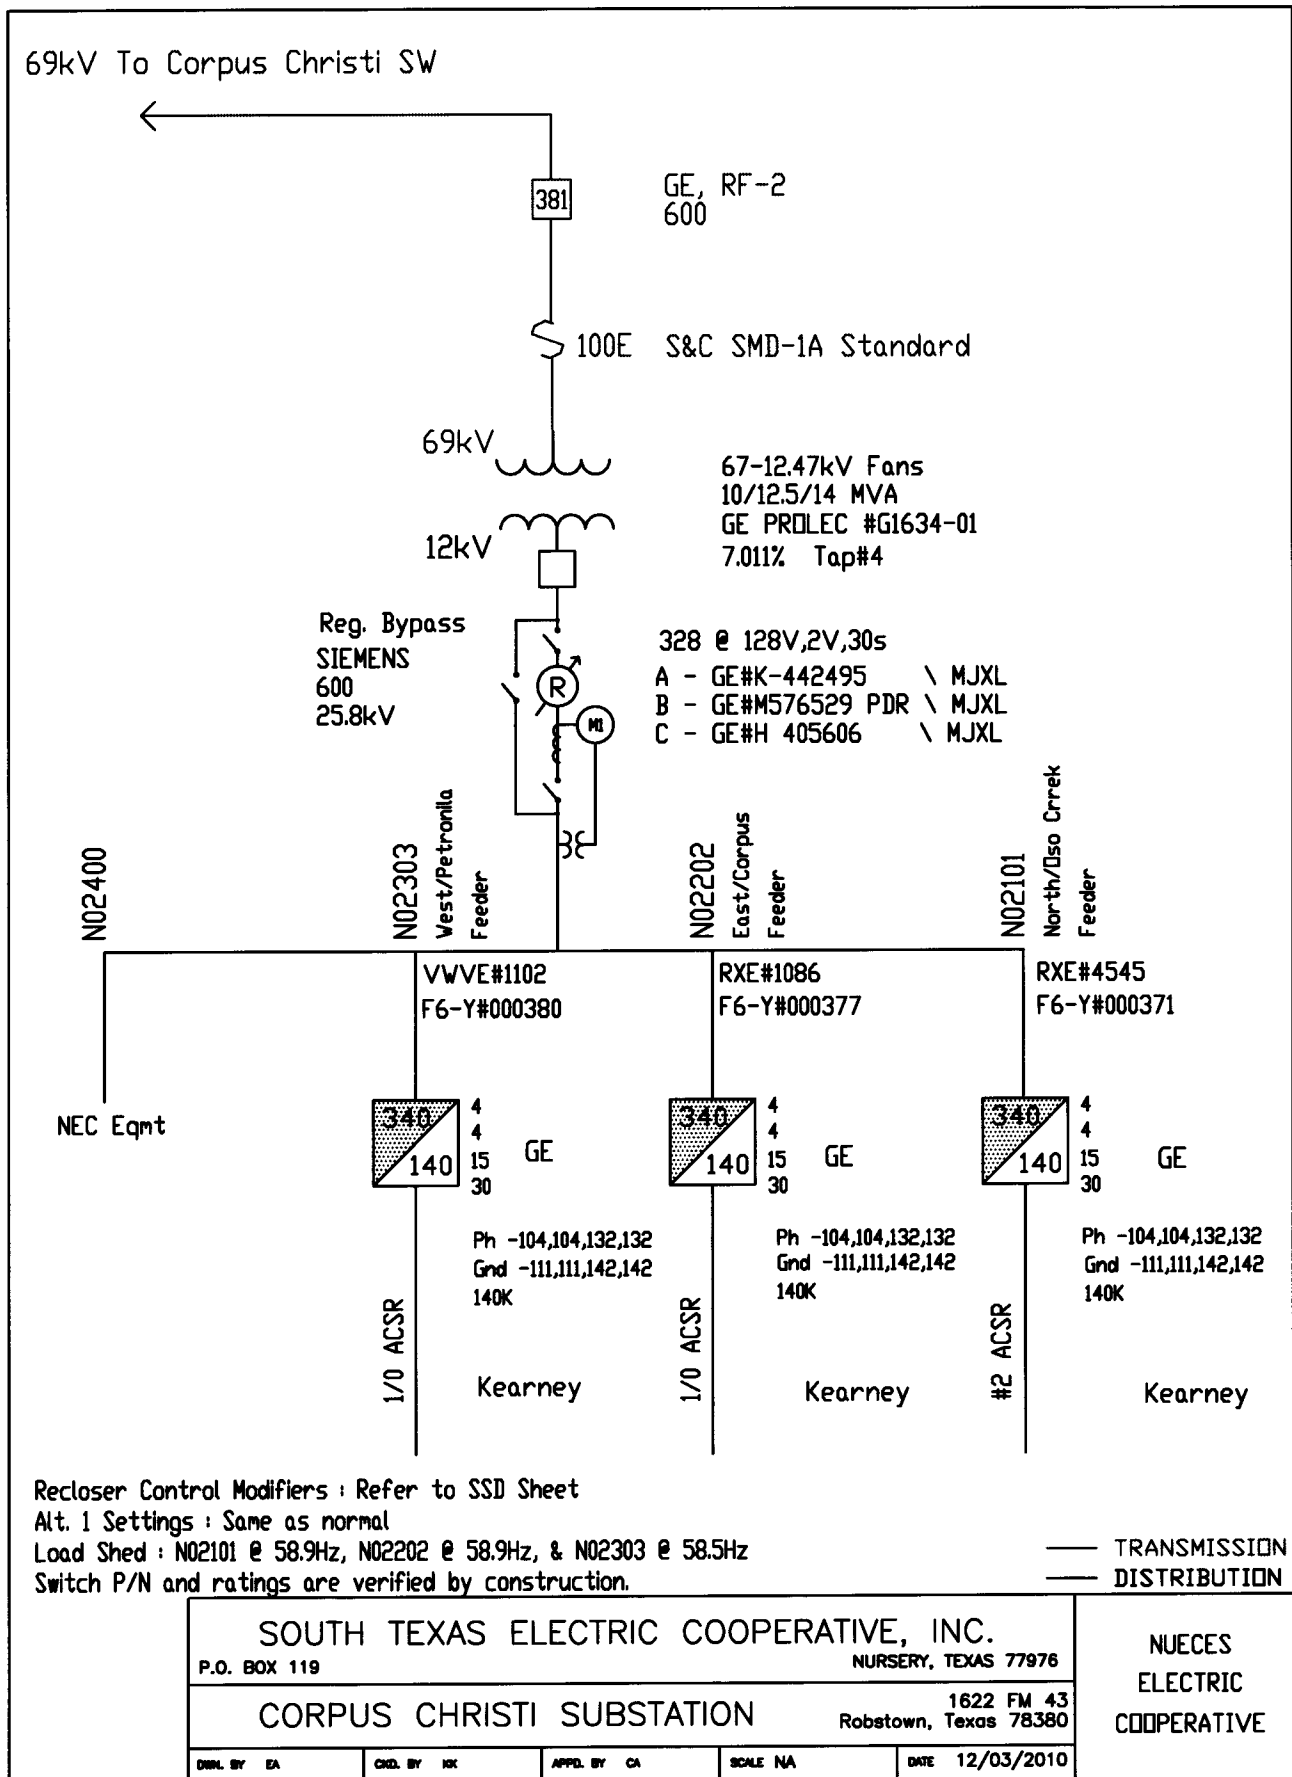


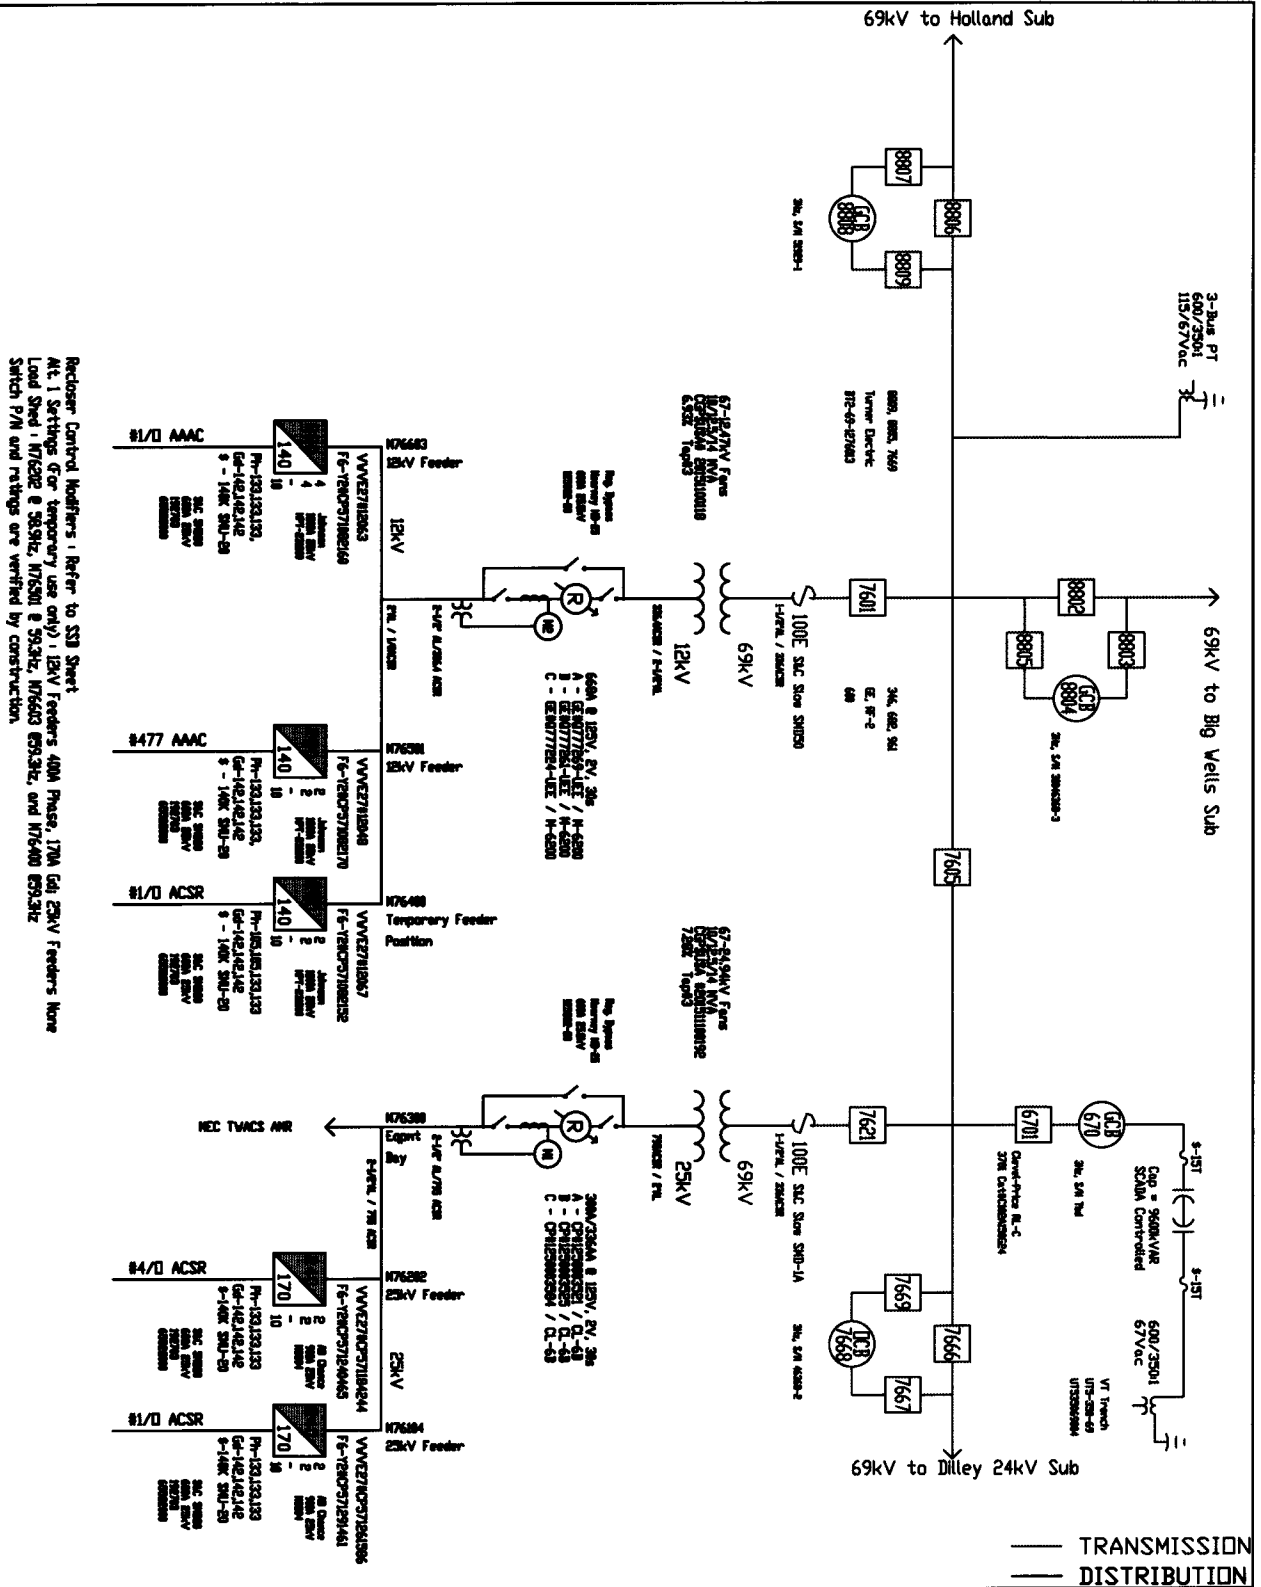



SOUTH TEXAS ELECTRIC COOPERATIVE, INC.				NURSERY, TEXAS 77976	
P.O. BOX 119					
COTULLA SUBSTATION				1227 Pena Road Cotulla, Texas 78014	
DWG. BY SA		CRD. BY IKK		APPD. BY CA	
				SCALE NA	
				DATE 4/25/2013	


MEDINA
ELECTRIC
COOPERATIVE

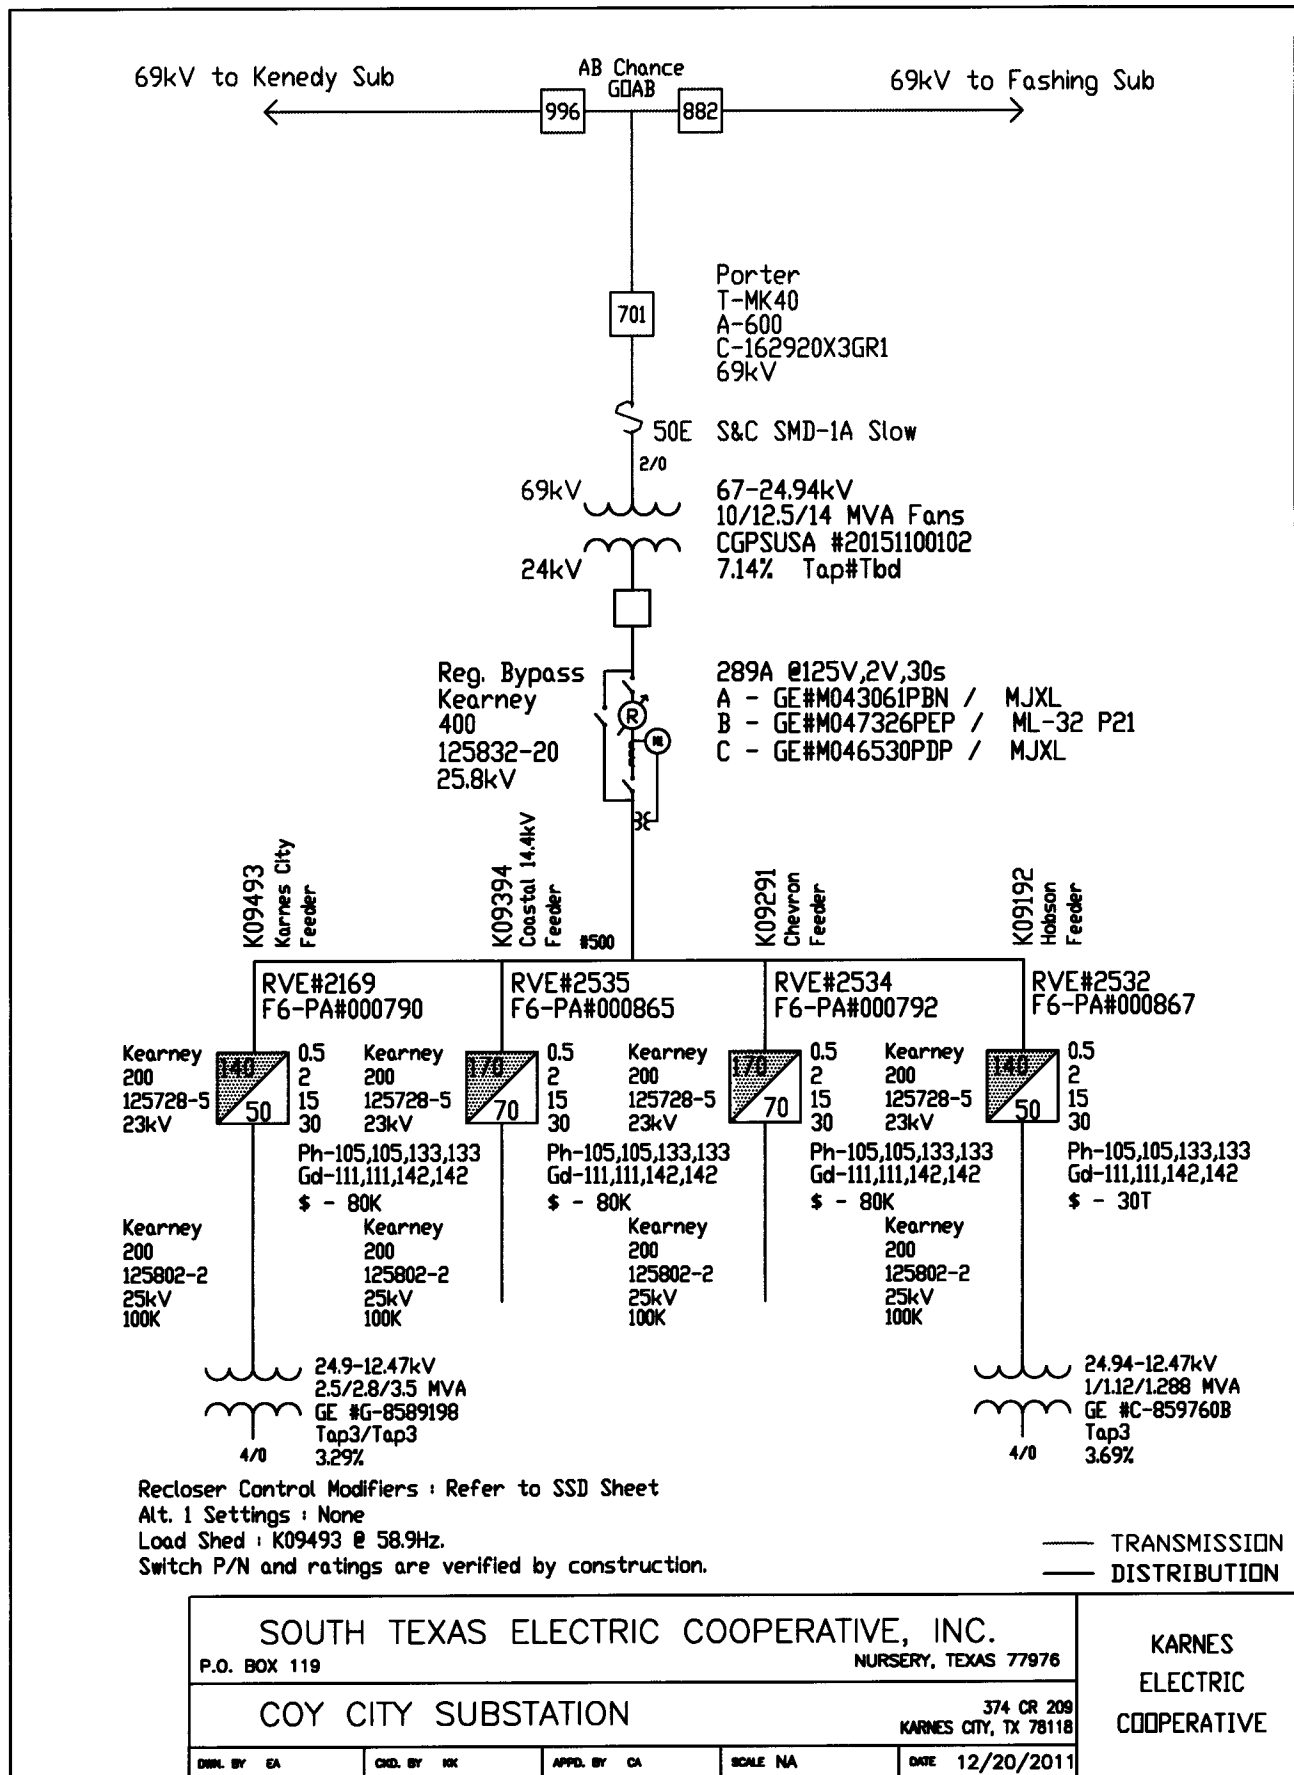


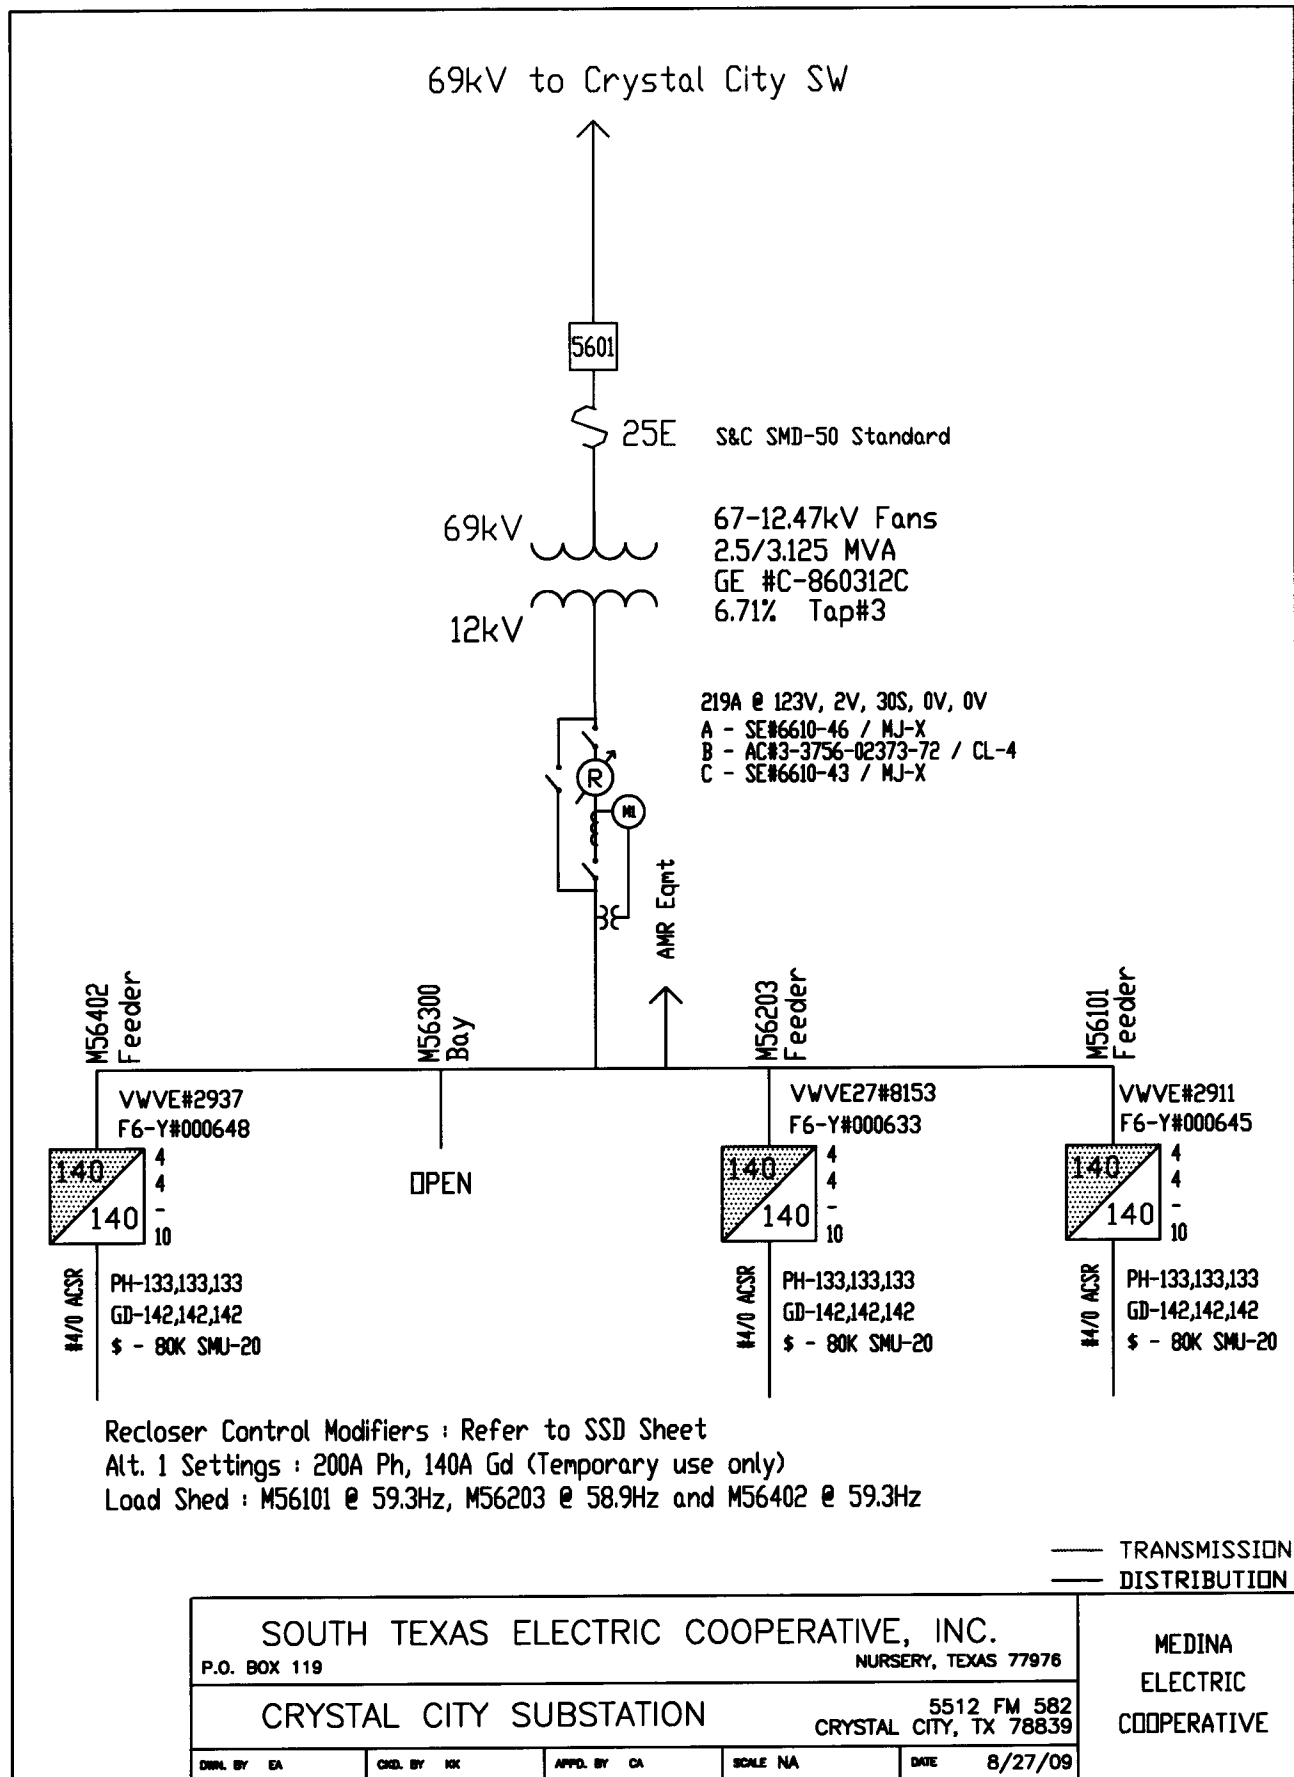

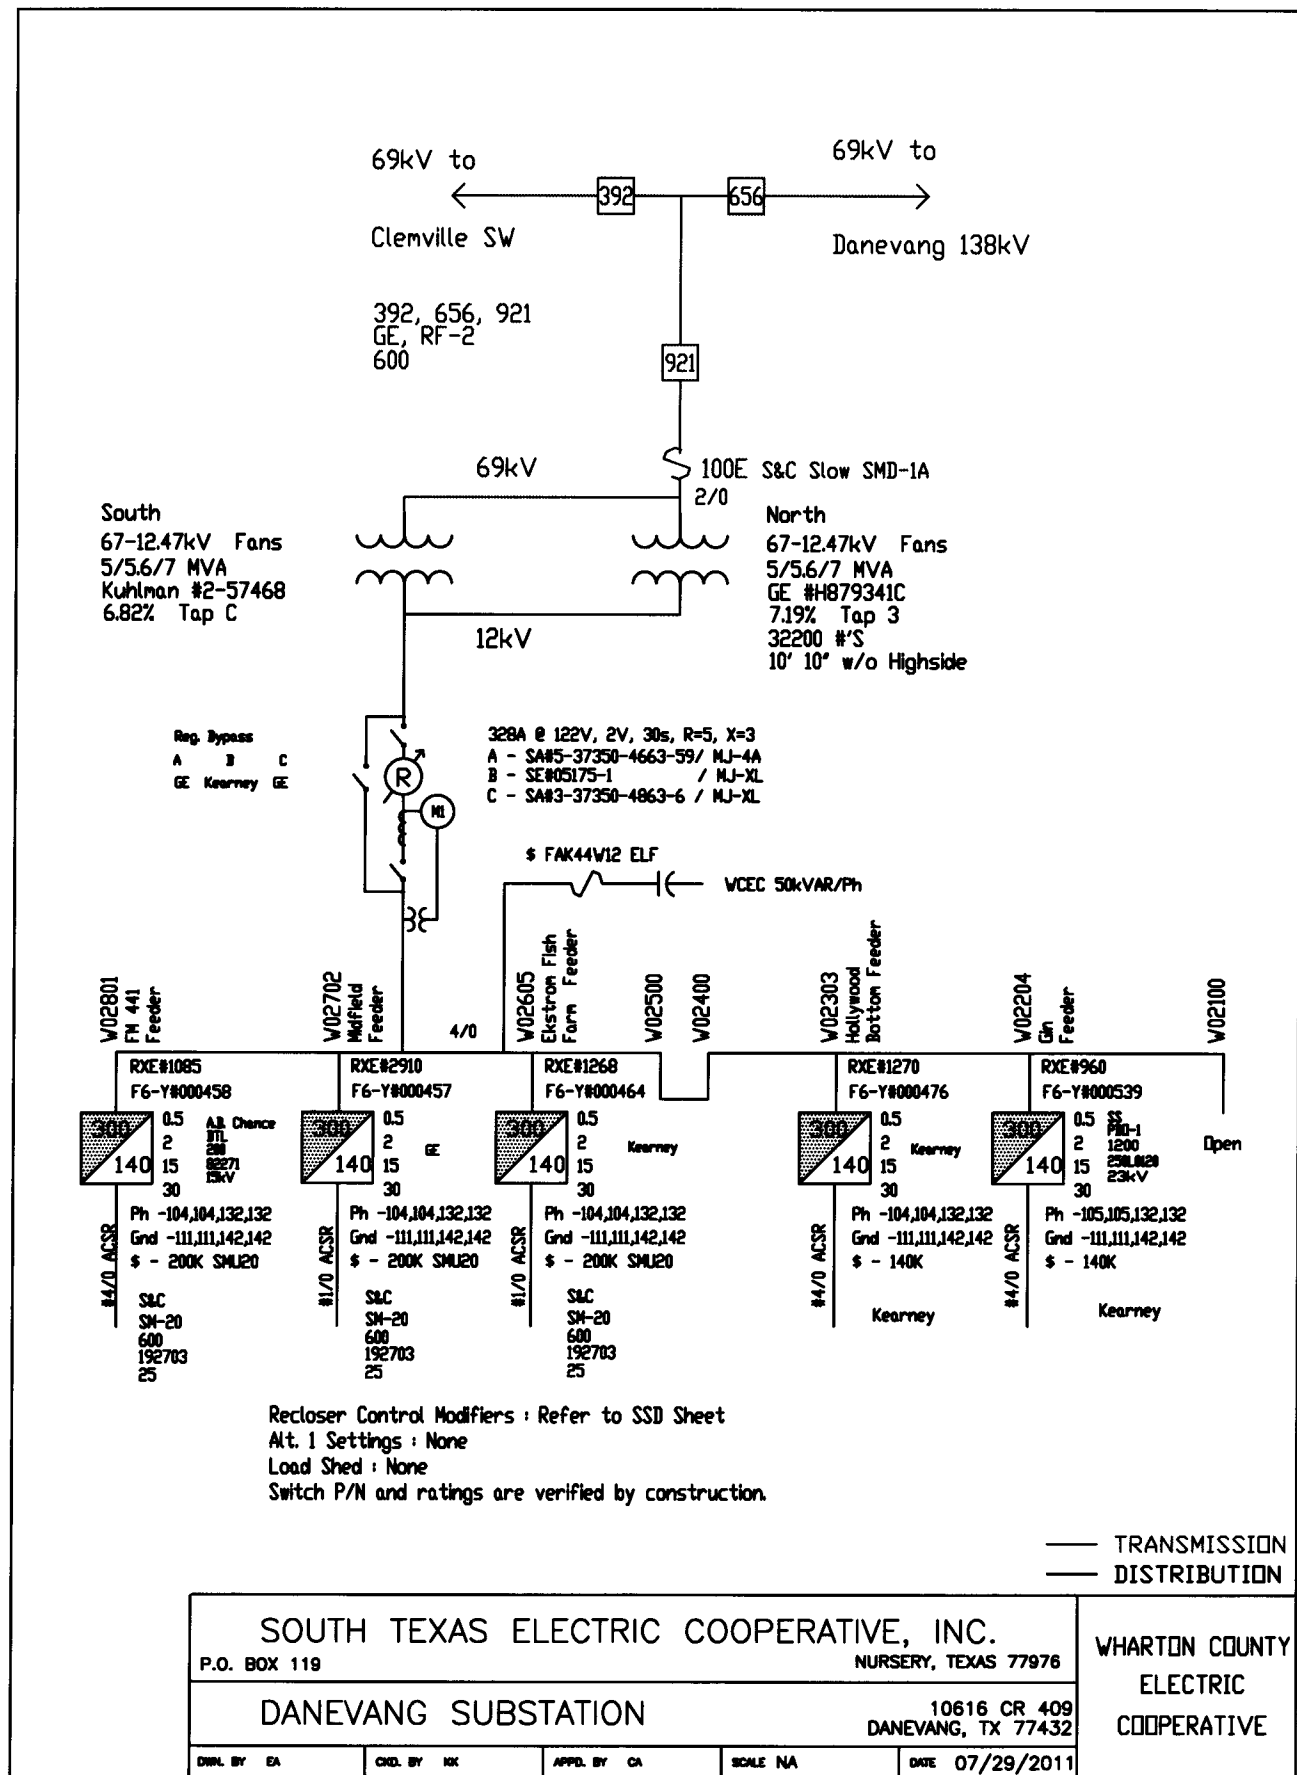

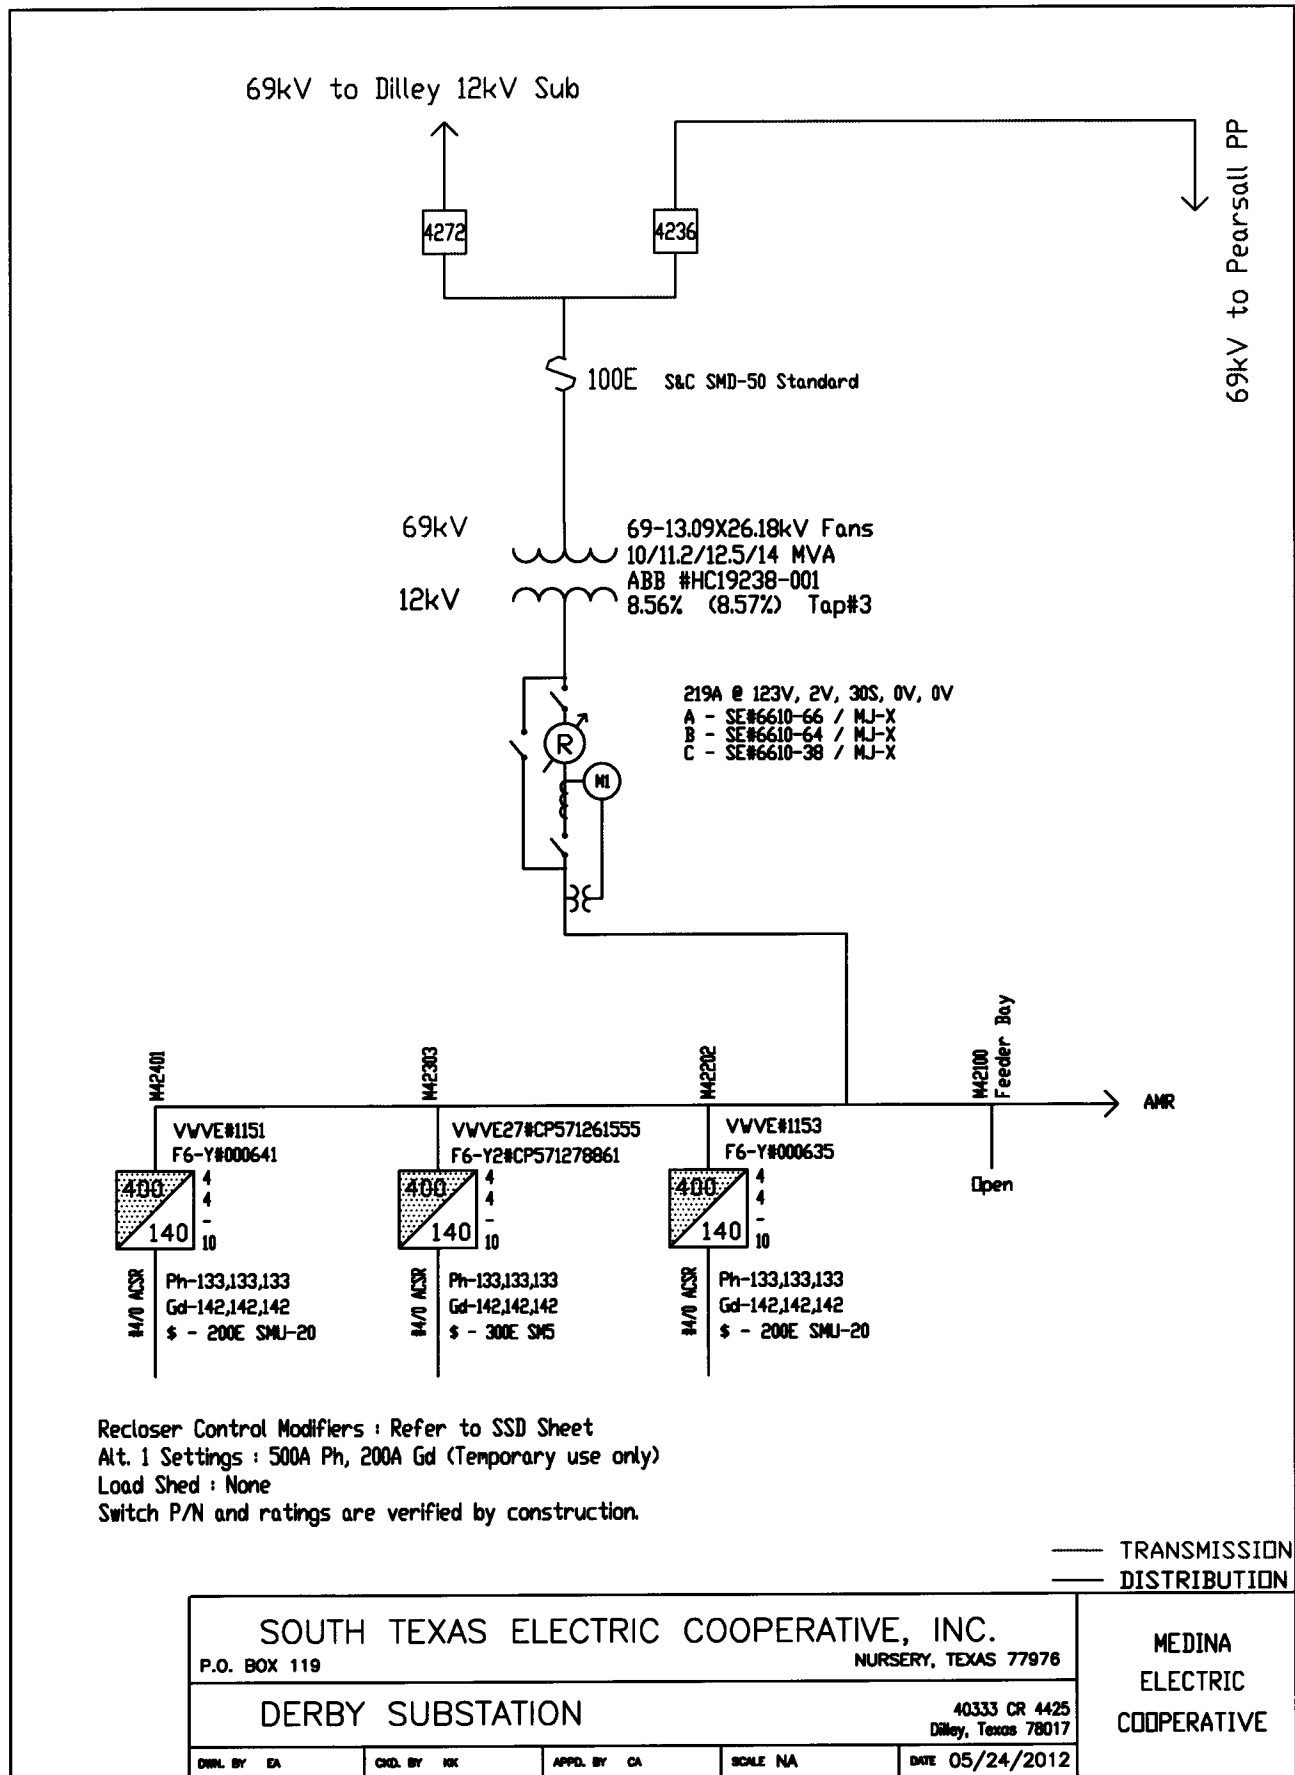

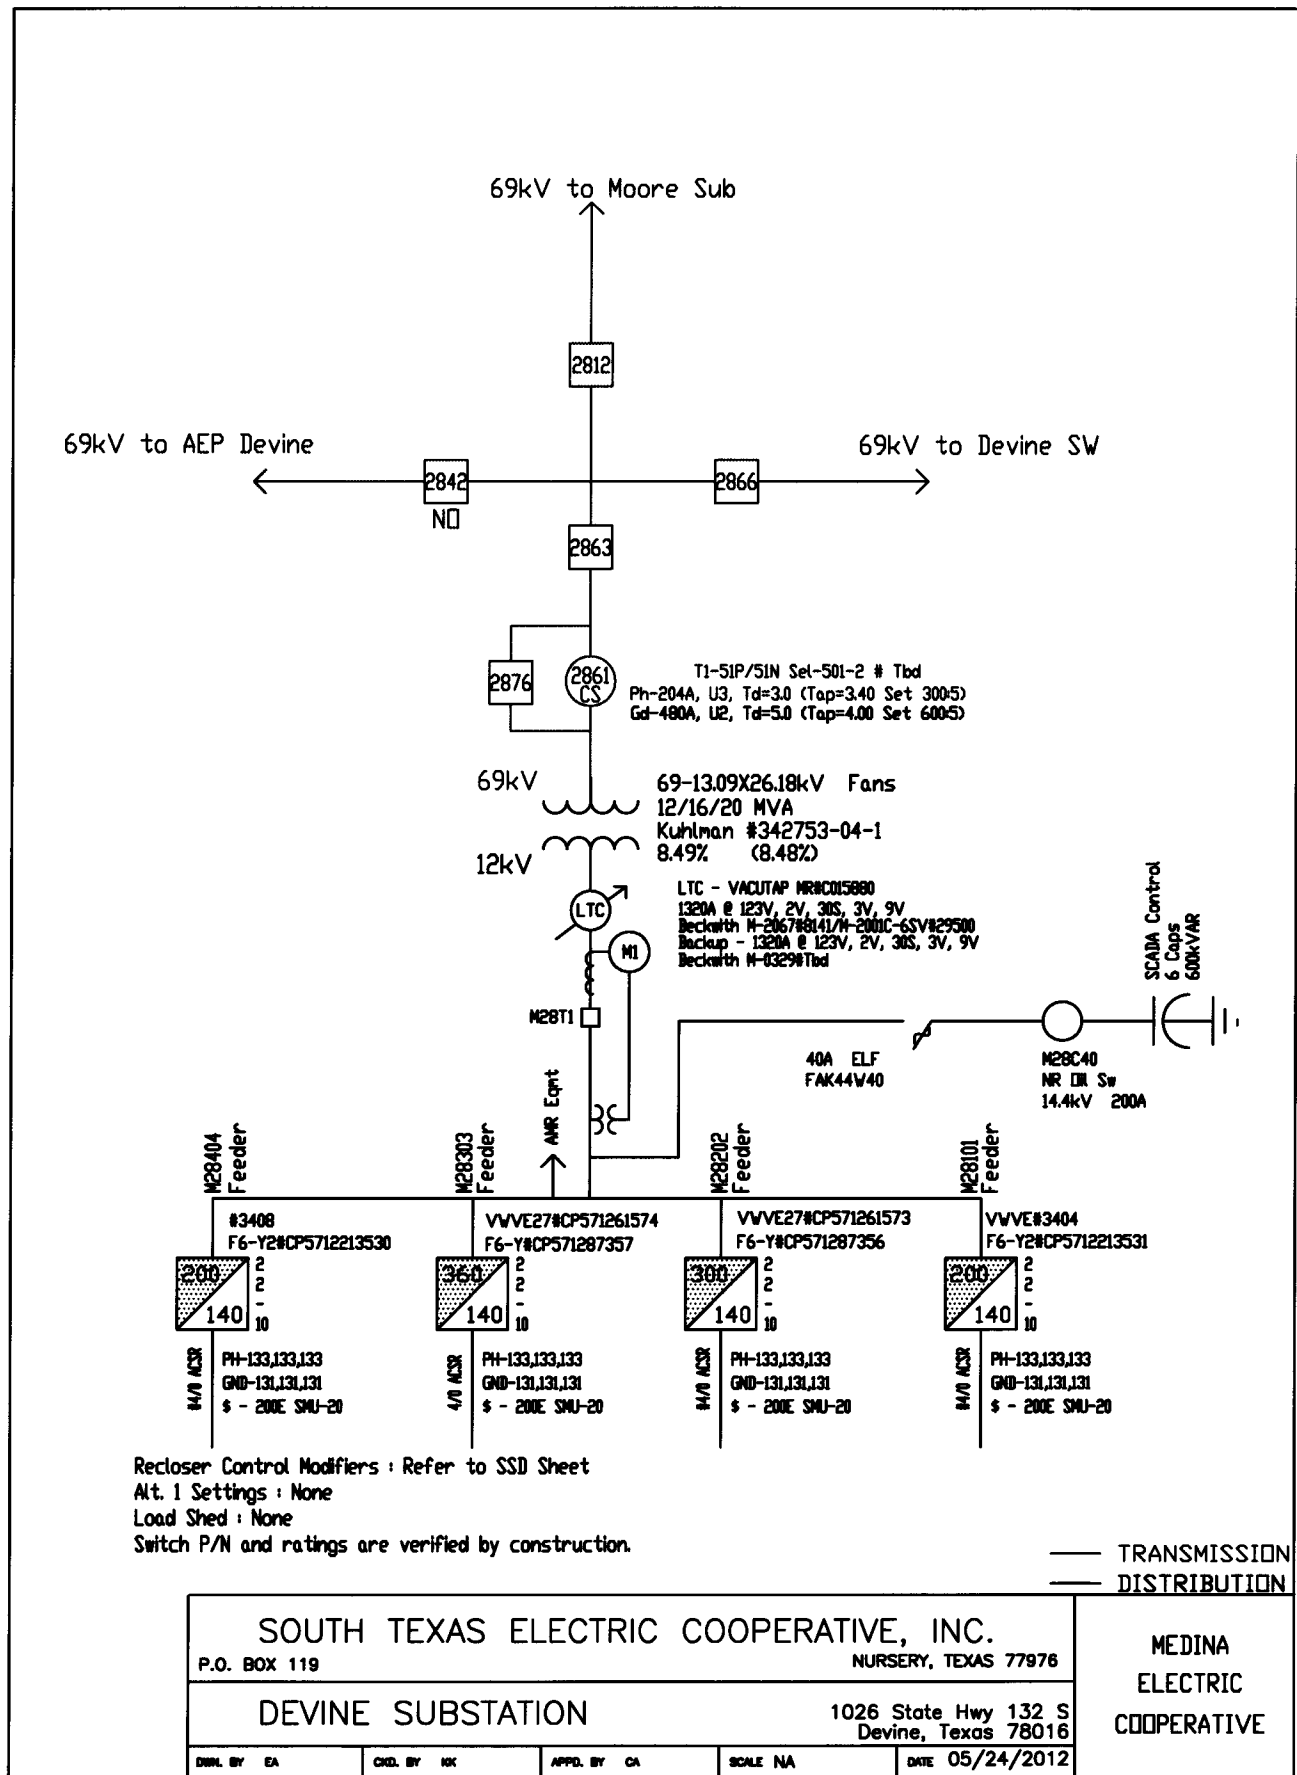


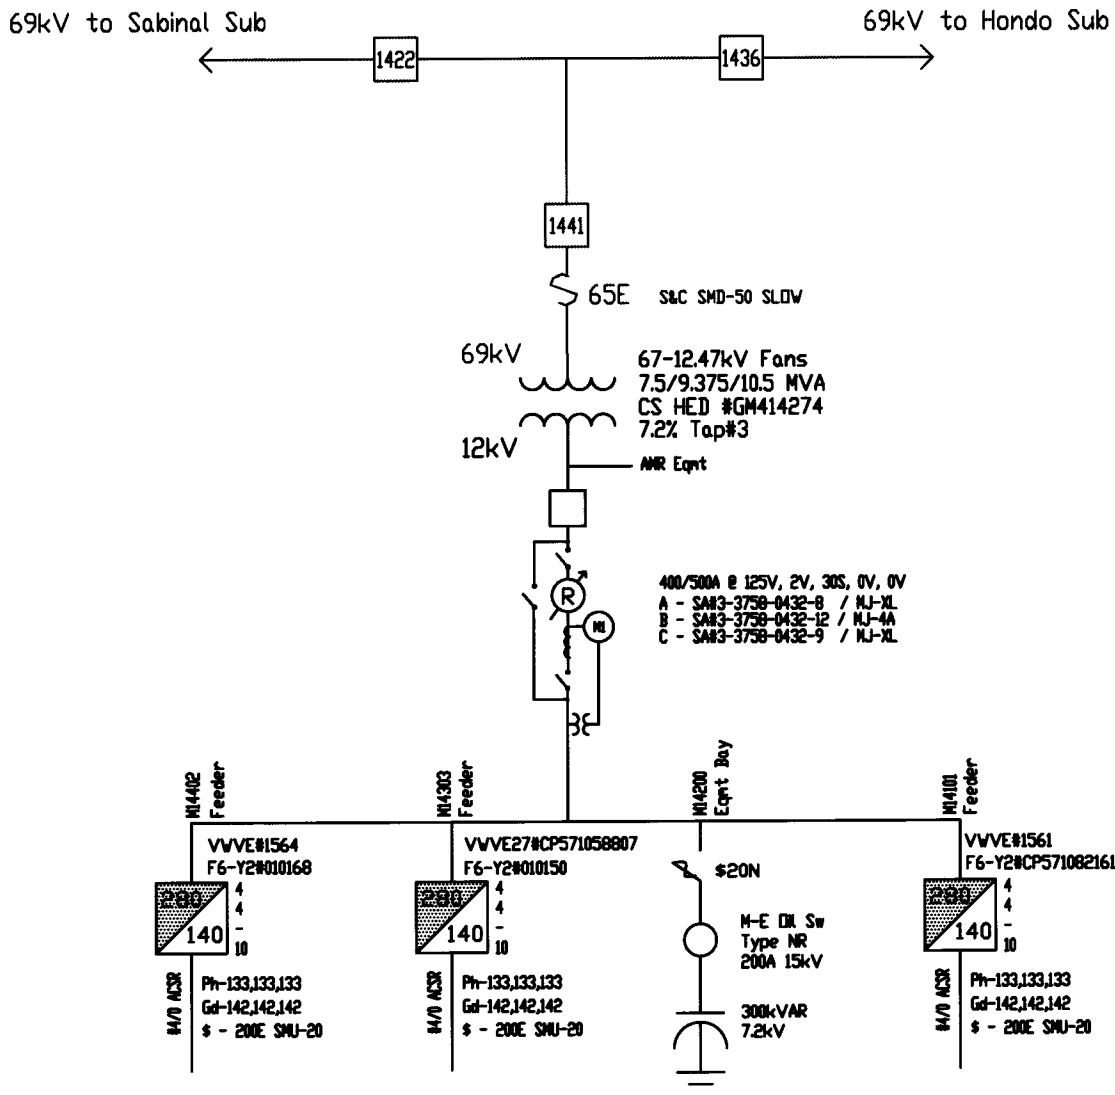



Recloser Control Modifiers : Refer to SSD Sheet
Alt. 1 Settings : None
Load Shed : None
Switch P/N and ratings are verified by construction.

— TRANSMISSION
— DISTRIBUTION

SOUTH TEXAS ELECTRIC COOPERATIVE, INC.				MEDINA ELECTRIC COOPERATIVE	
P.O. BOX 119		NURSERY, TEXAS 77976		7201 CR 5224 D'Hanis, Texas 78850	
D'HANIS SUBSTATION					
DRWN. BY EA	CHKD. BY KK	APPD. BY CA	SCALE NA	DATE 4/25/2013	

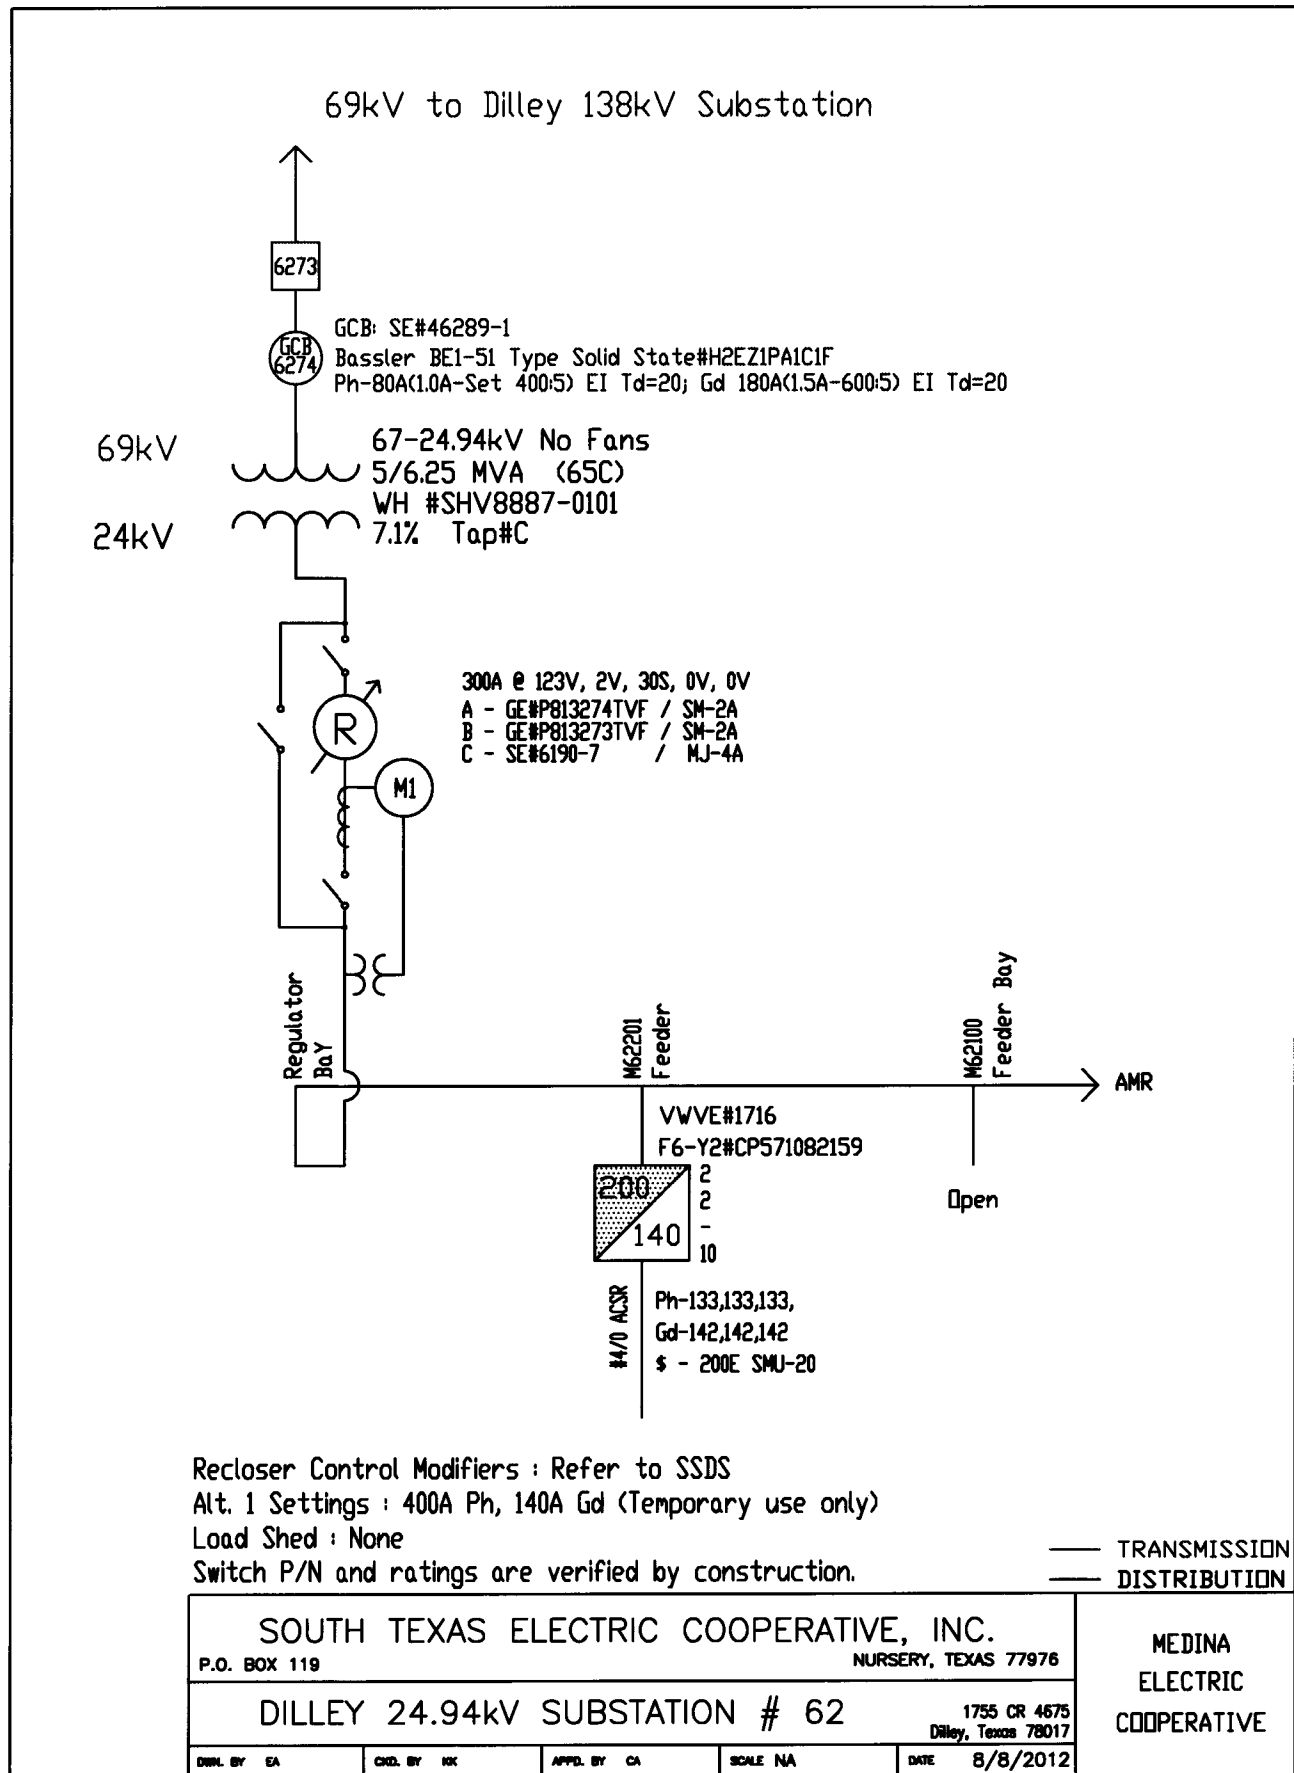

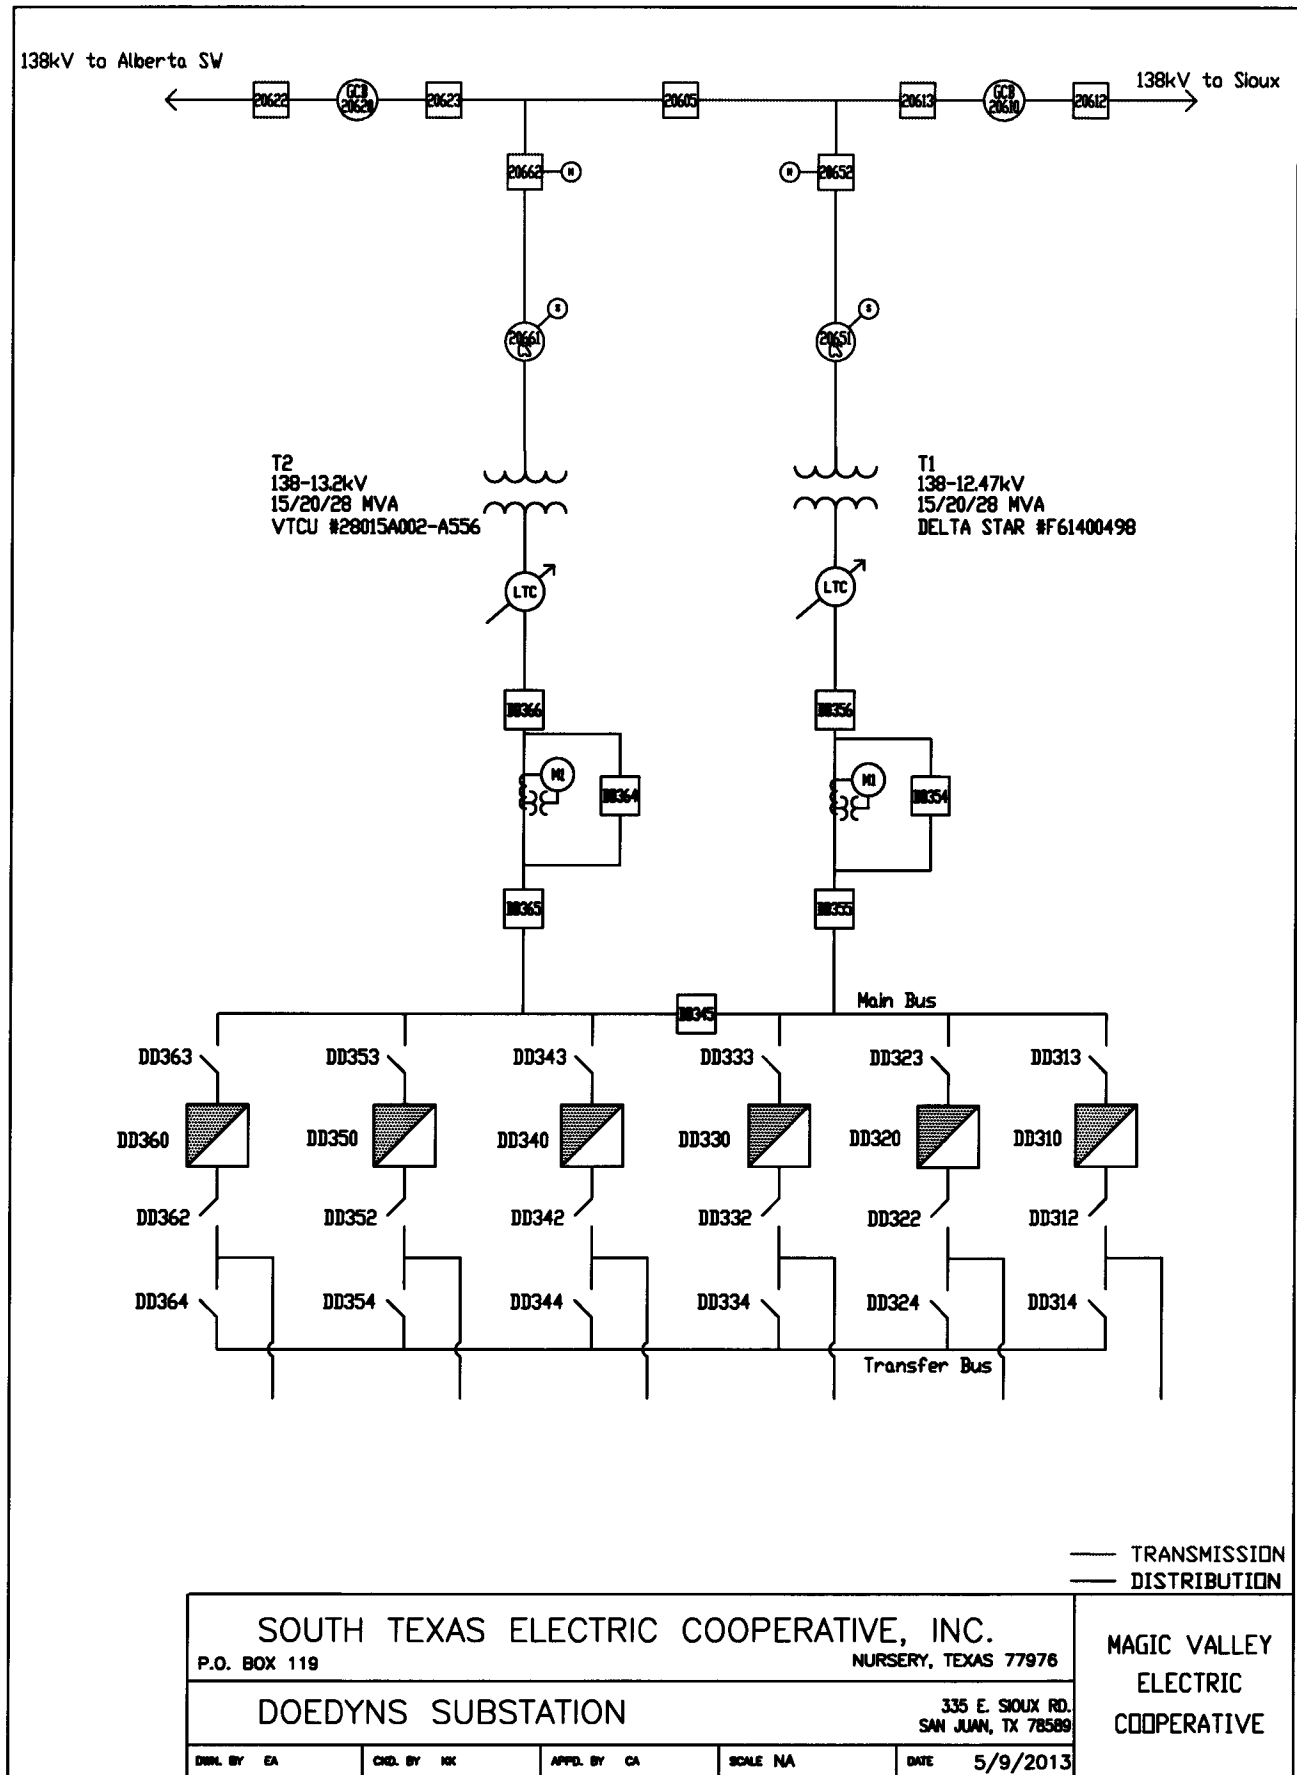

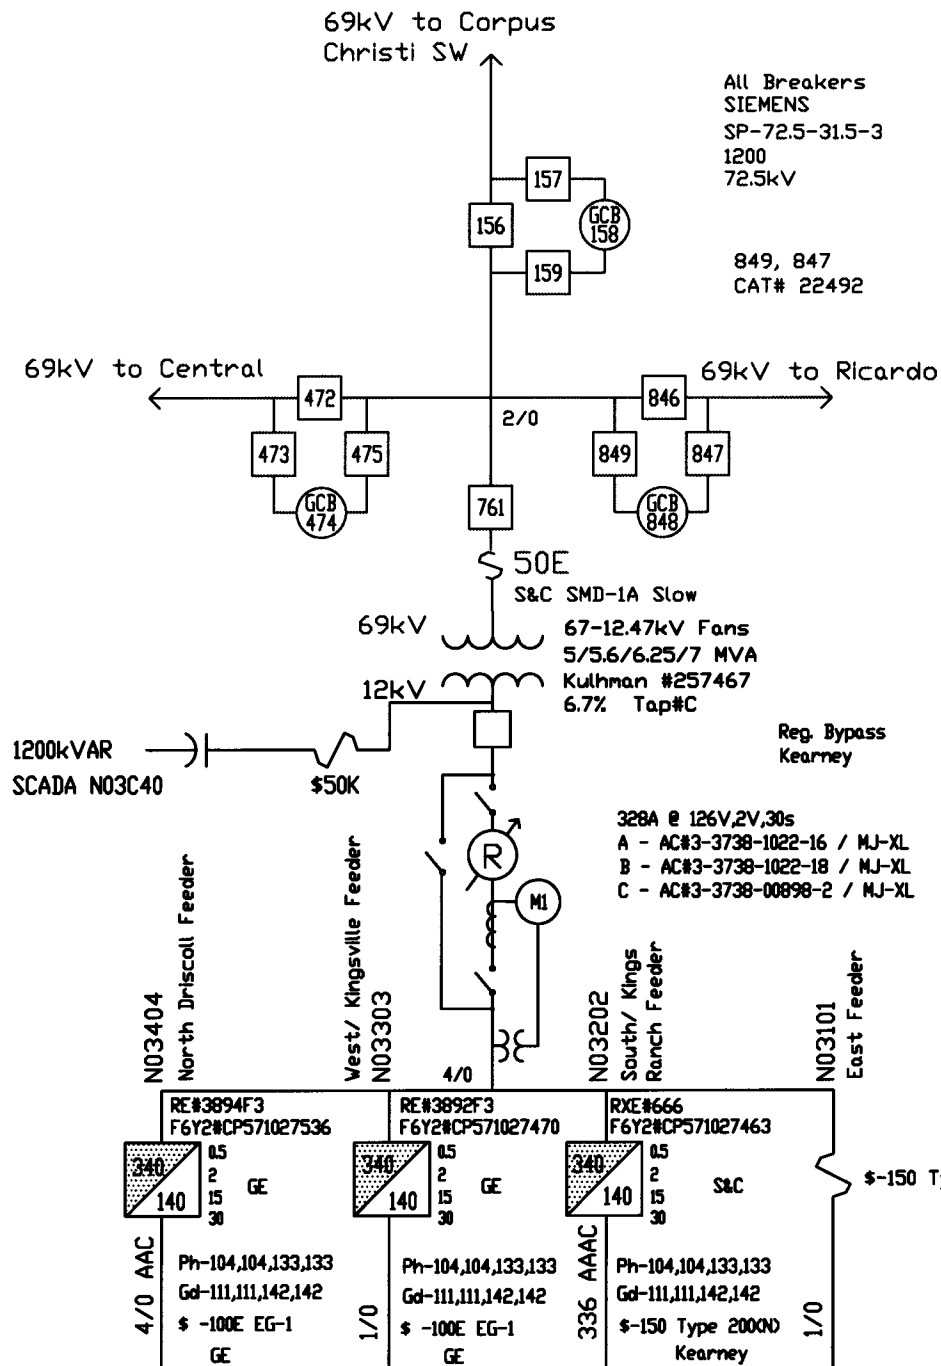



Recloser Control Modifiers : Refer to SSD Sheet
Alt. 1 Settings : None
Load Shed : N03202 @ 58.9Hz and N03404 @ 58.5Hz
Switch P/N and ratings are verified by construction.


— TRANSMISSION
— DISTRIBUTION


SOUTH TEXAS ELECTRIC COOPERATIVE, INC.				
P.O. BOX 119			NURSERY, TEXAS 77976	
DRISCOLL SUBSTATION				
			1624 CR 14 Bishop, Texas 78343	
DRAWN BY EA	CHKD BY HK	APPRD BY CA	SCALE NA	DATE 3/18/2013


NUECES
ELECTRIC
COOPERATIVE

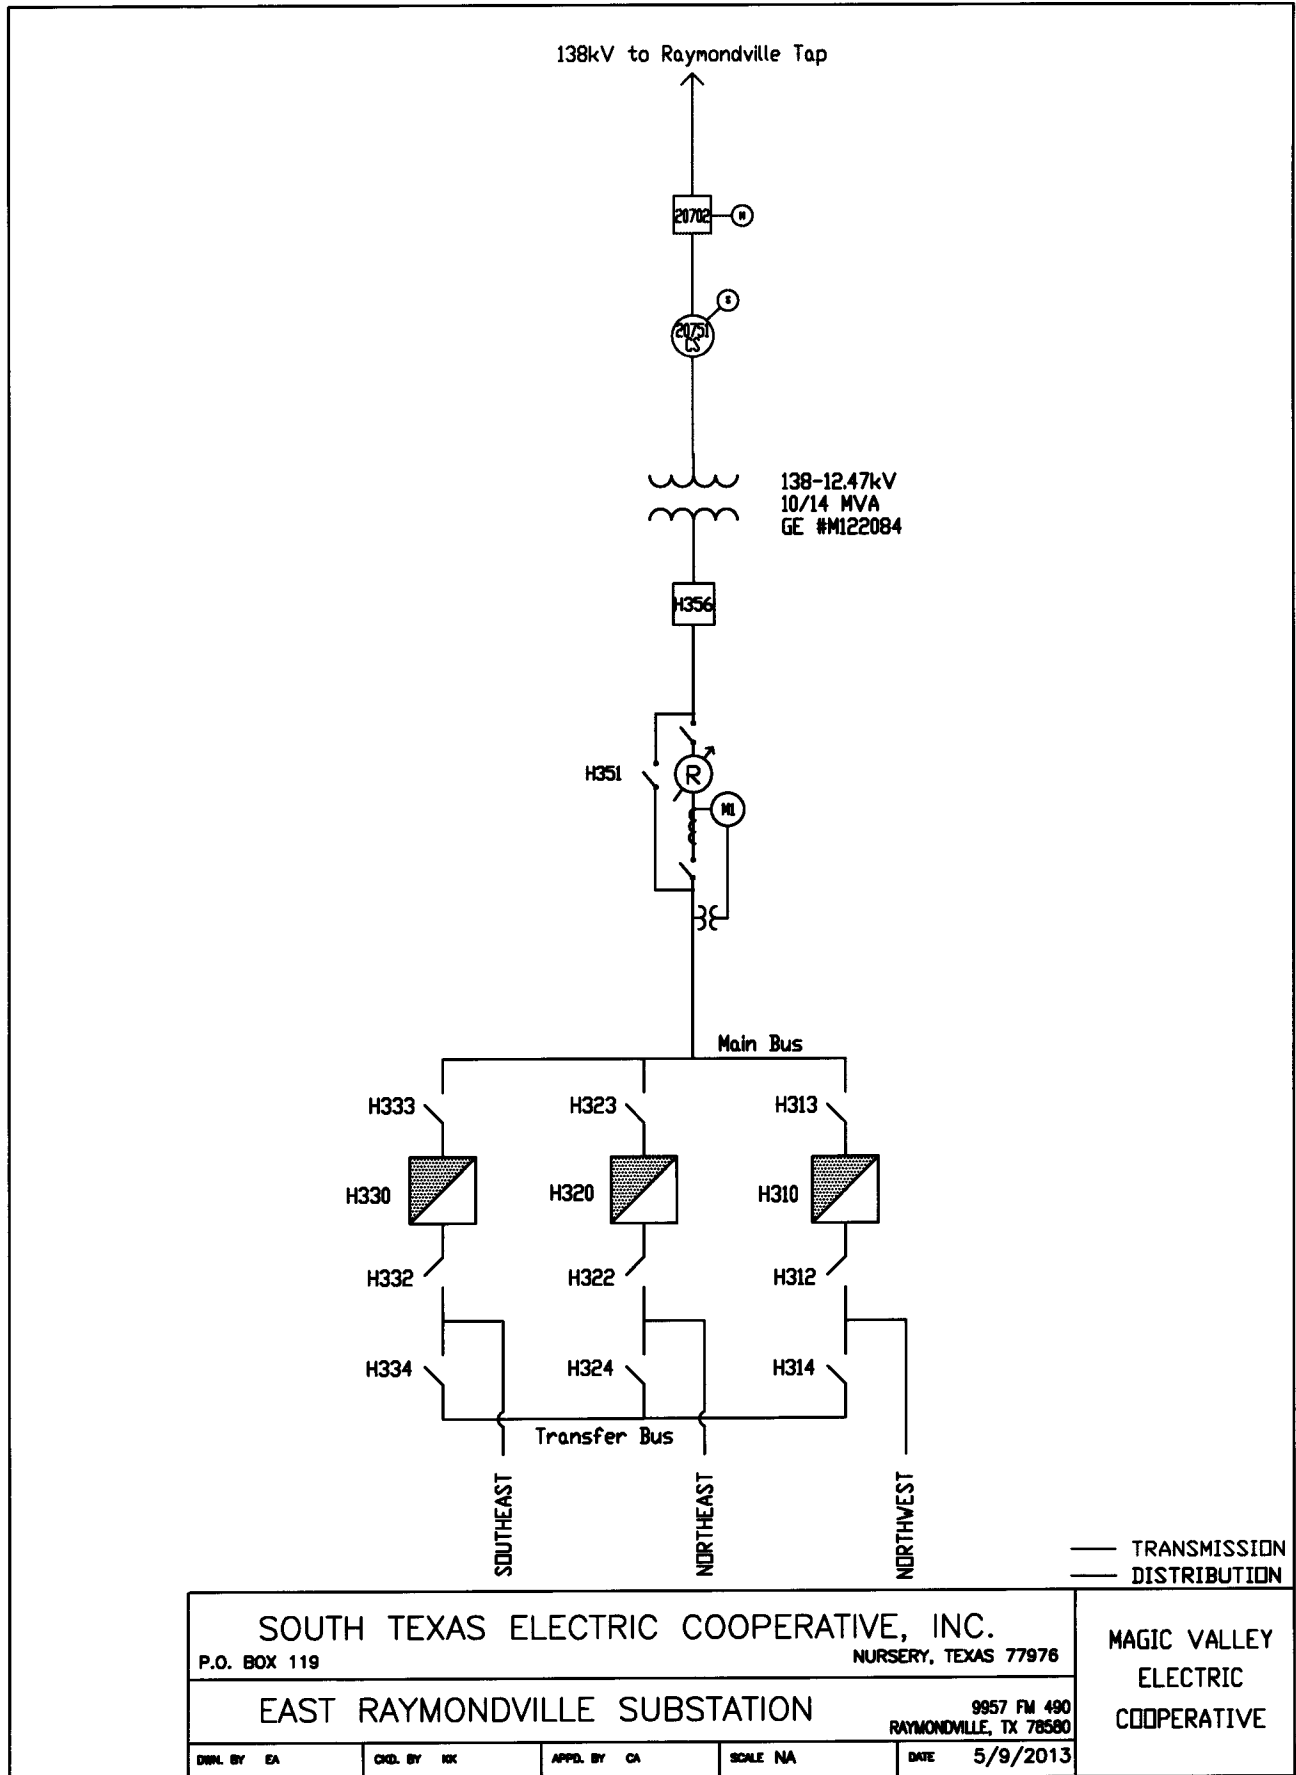


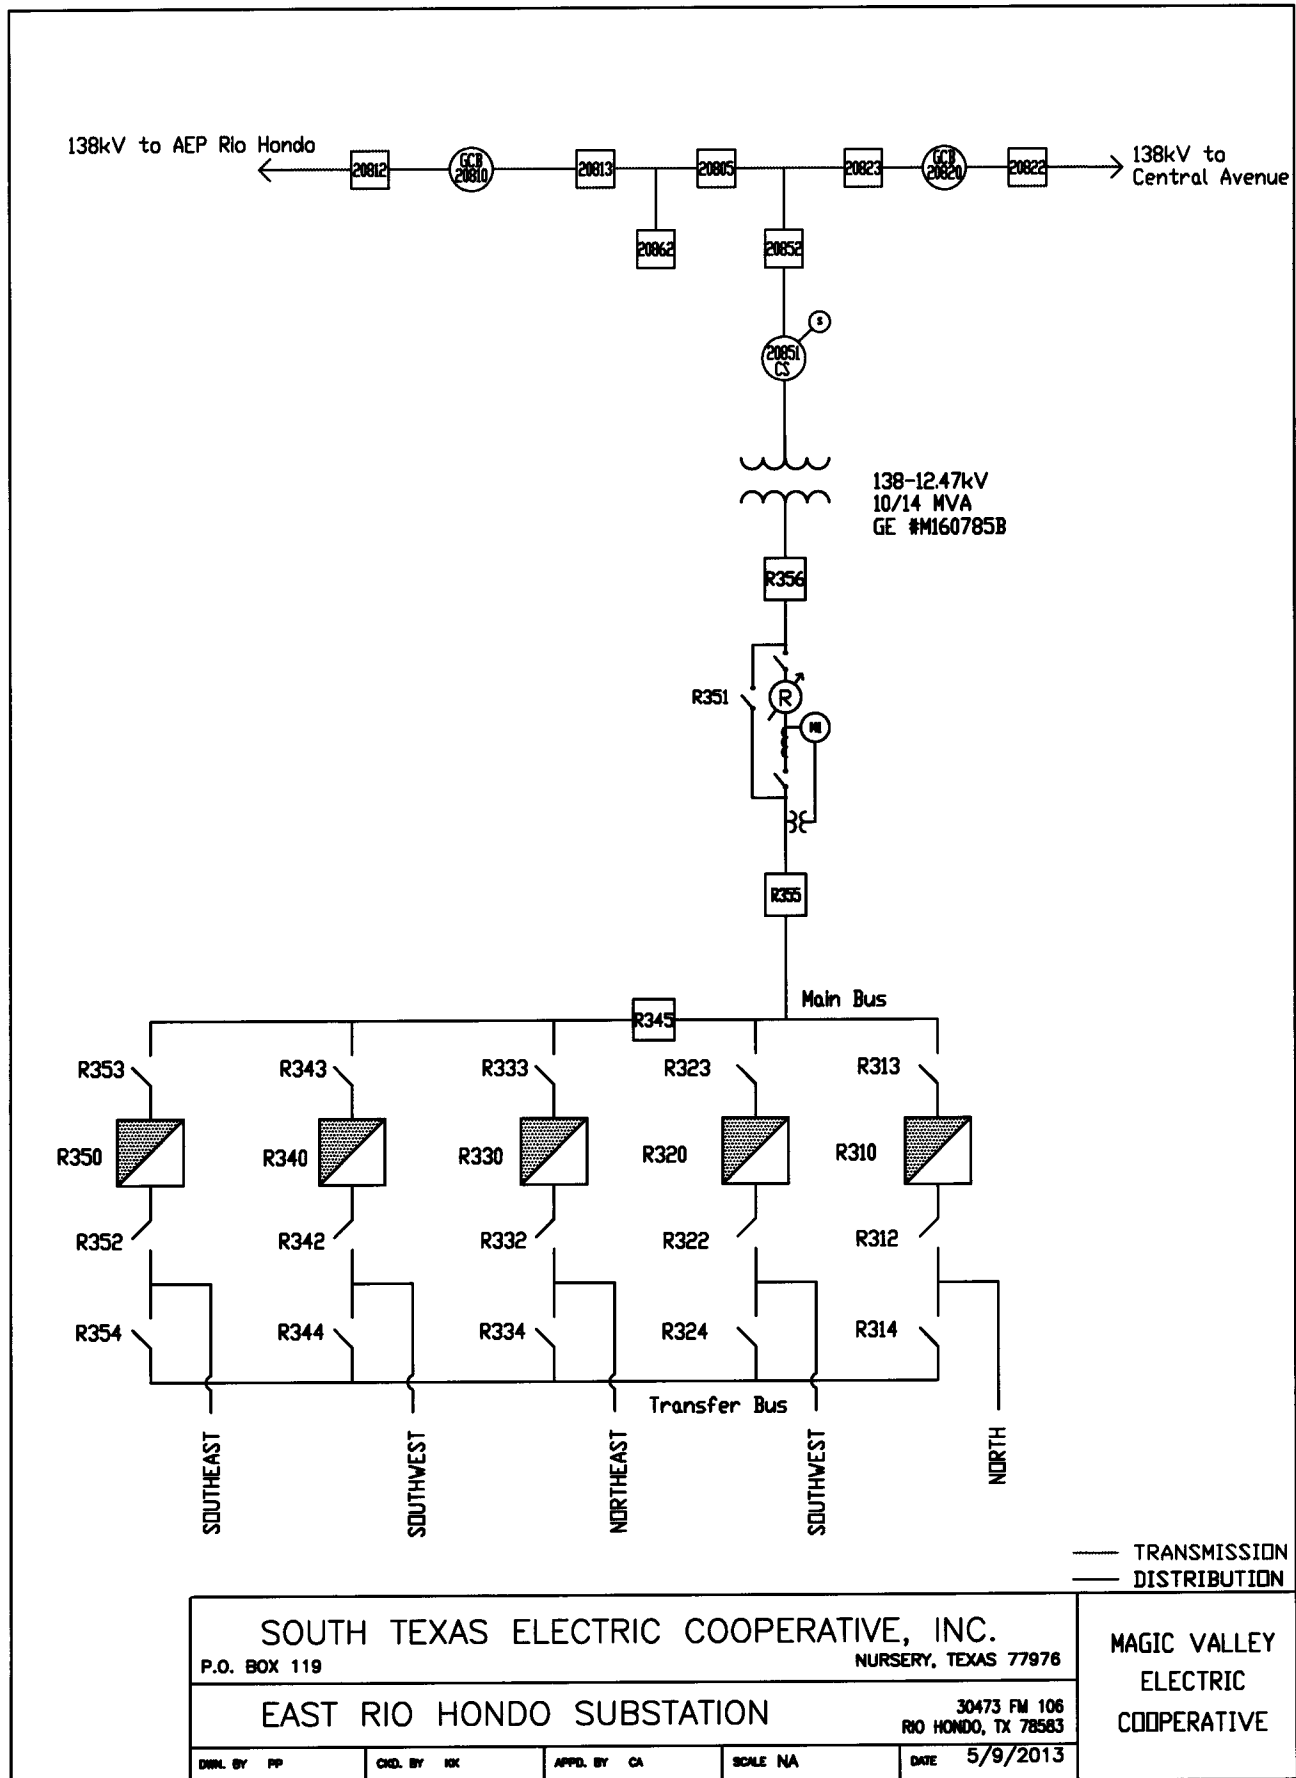


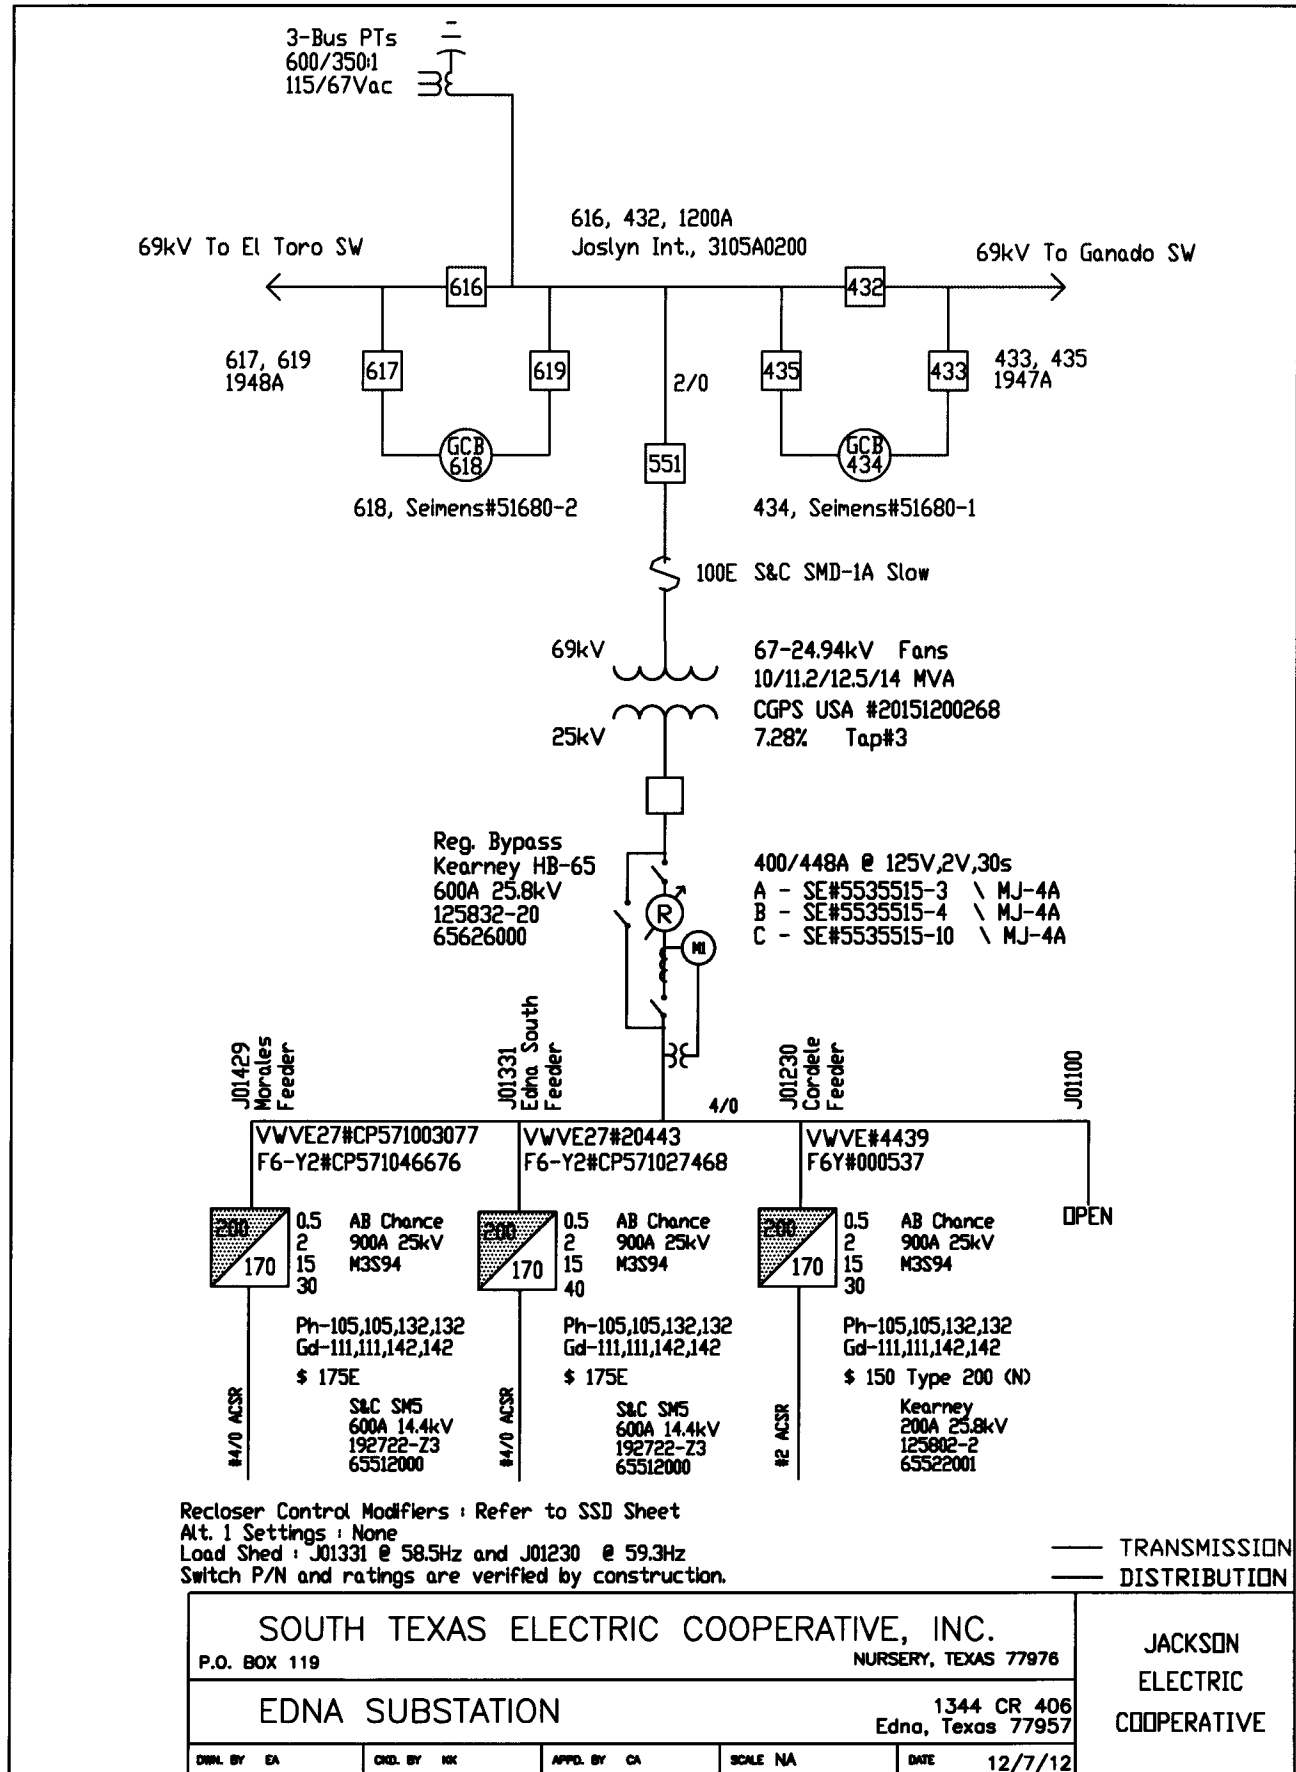


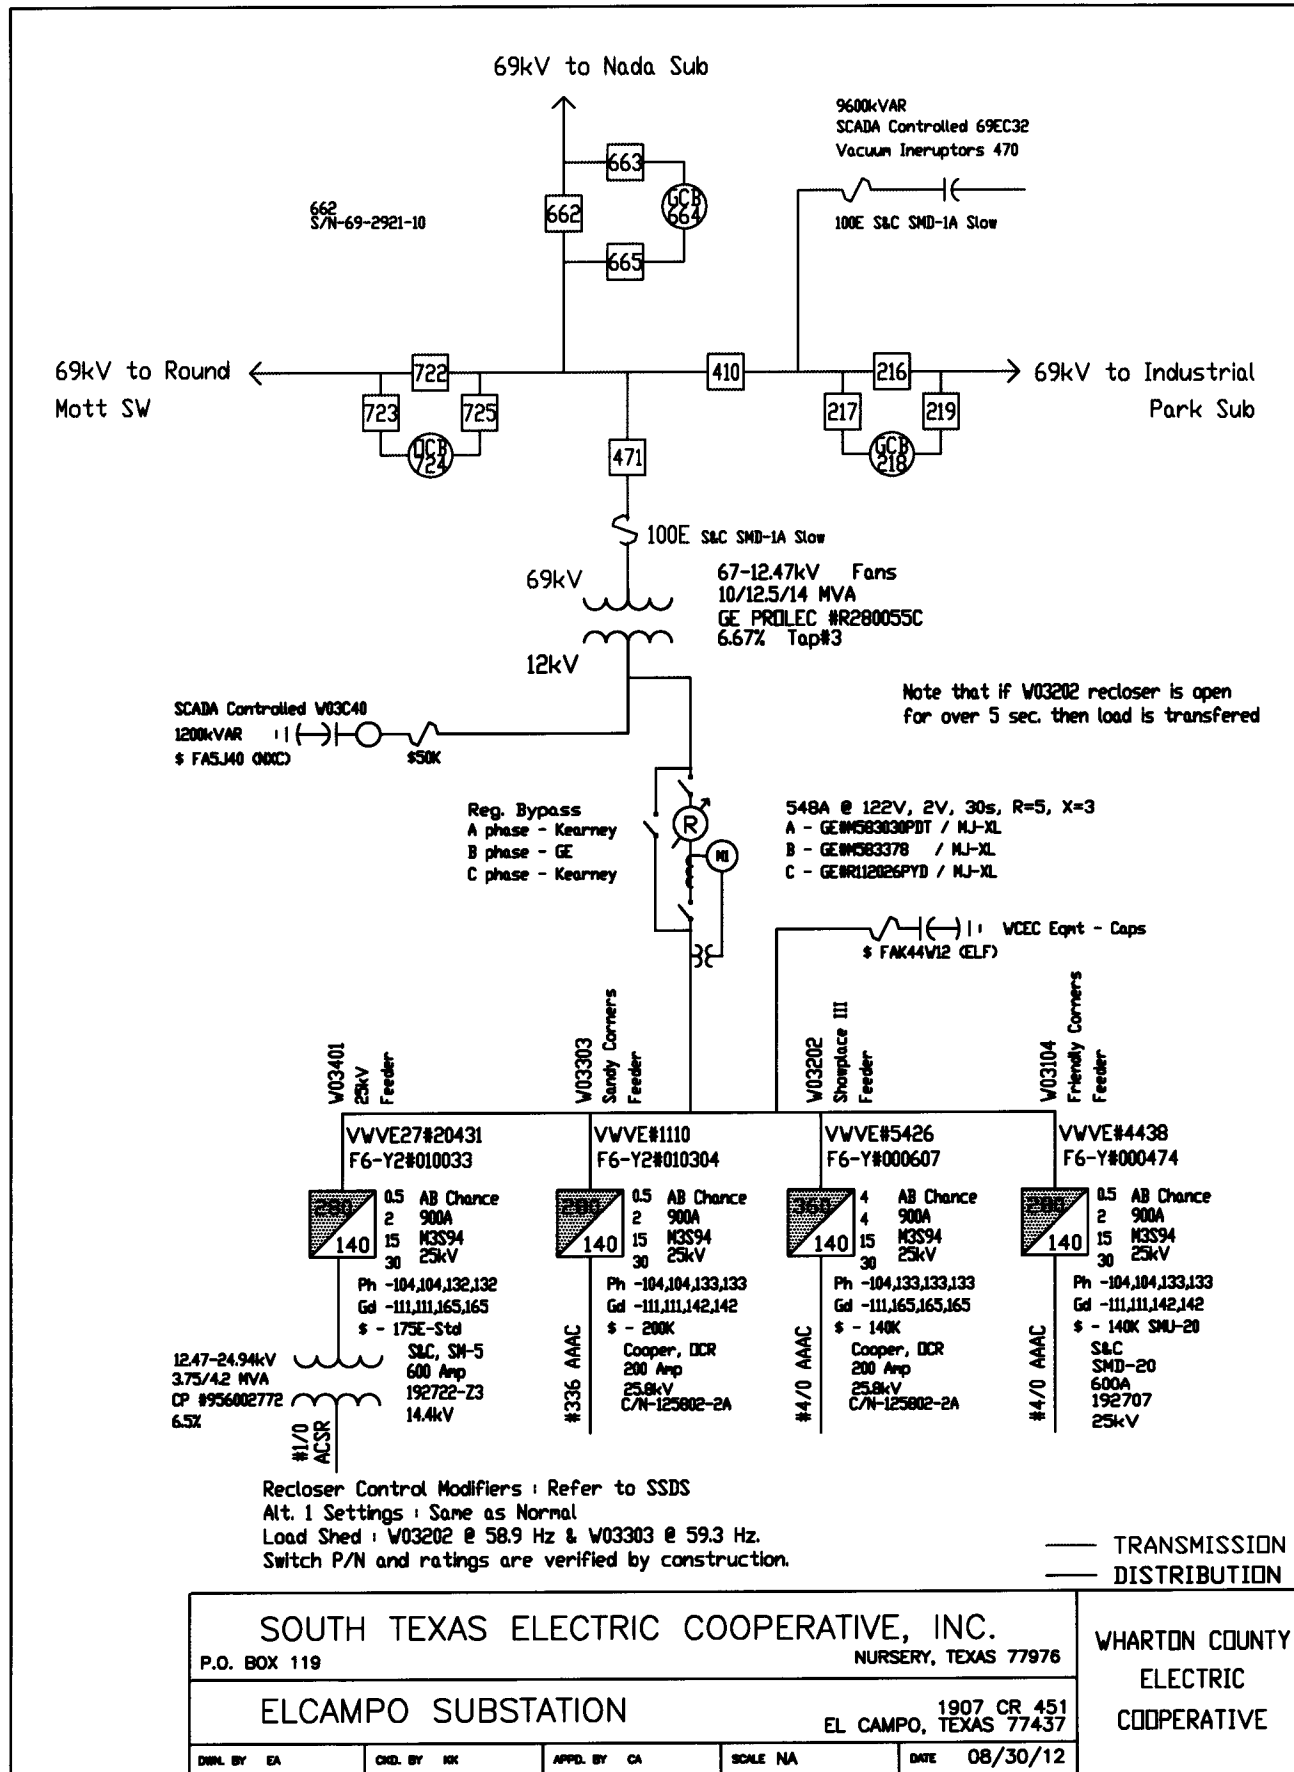


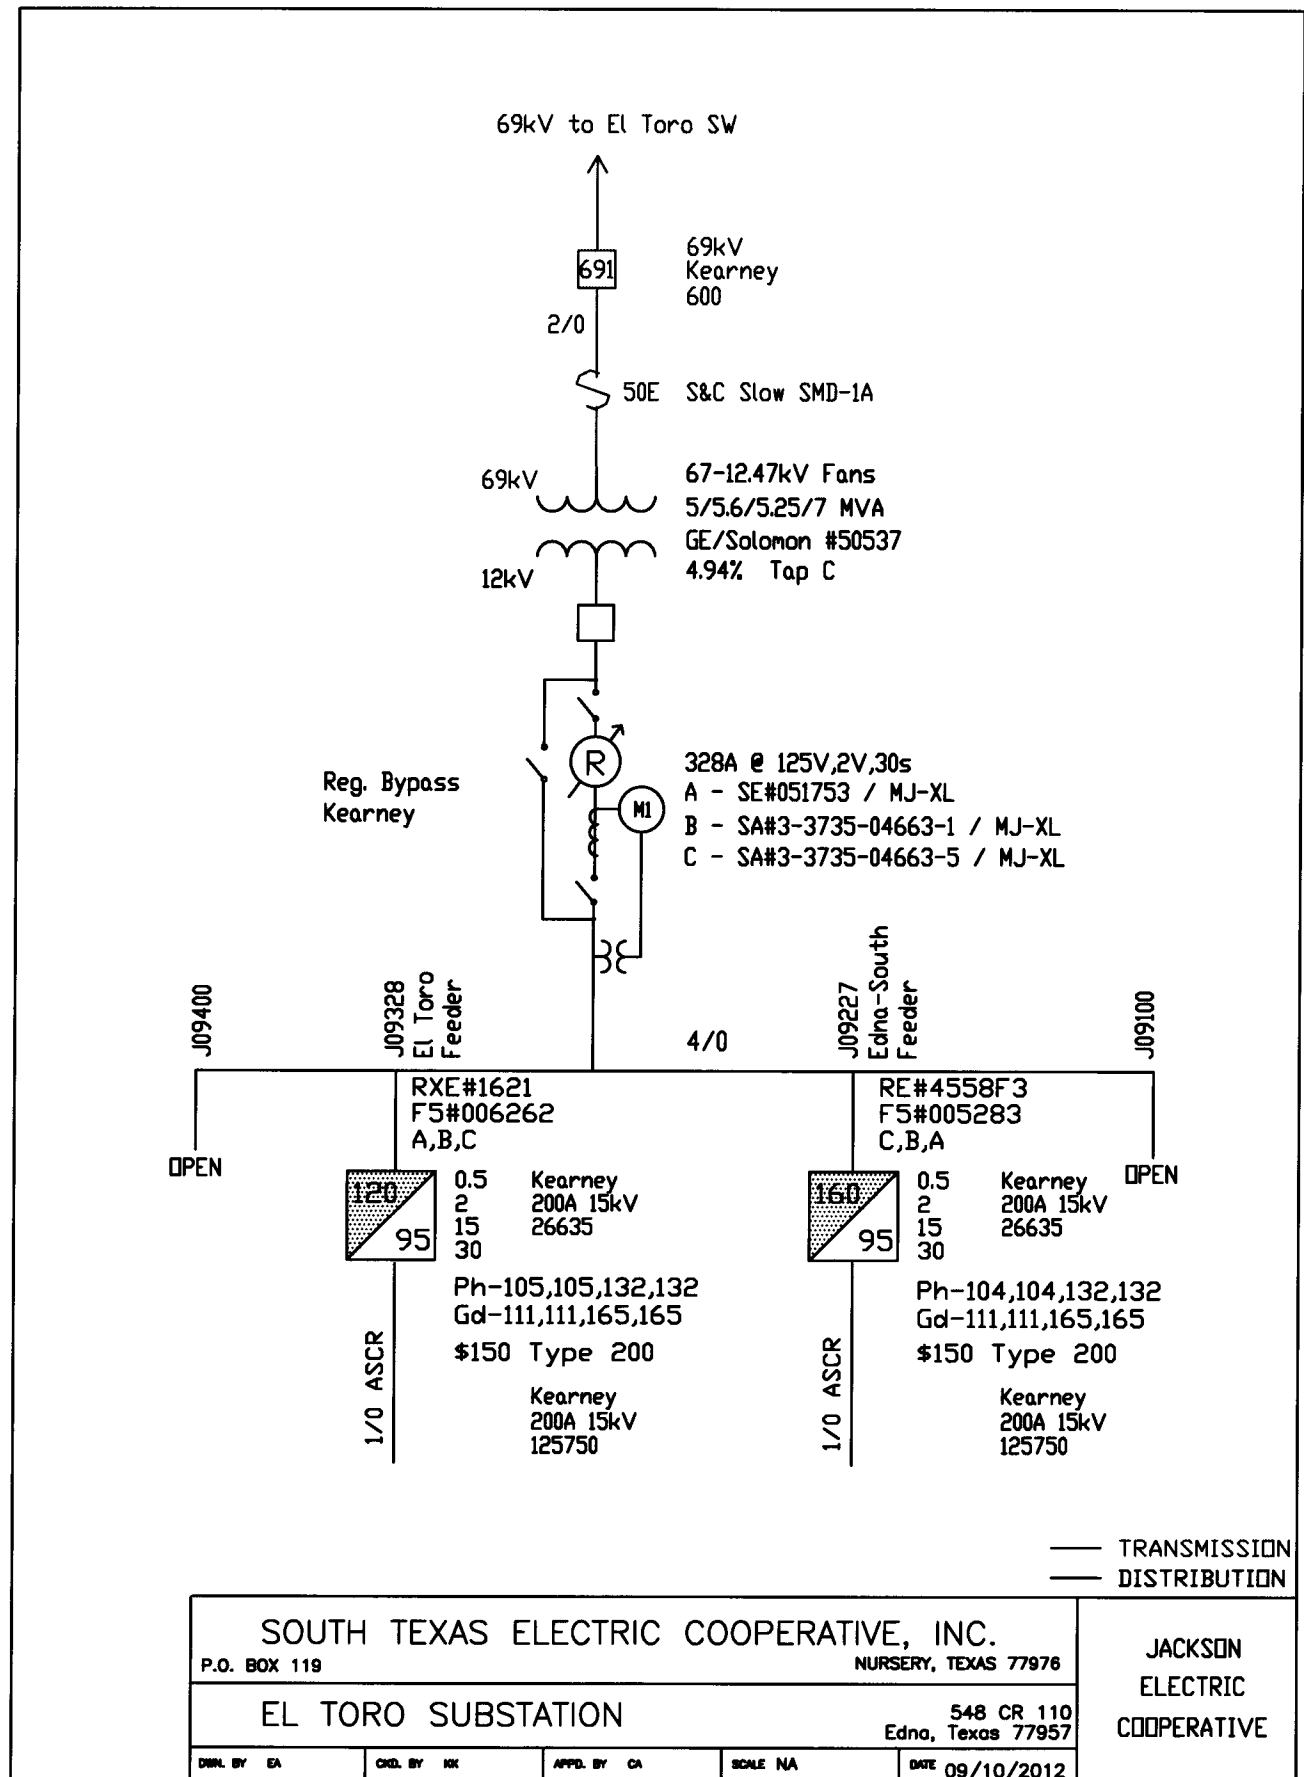


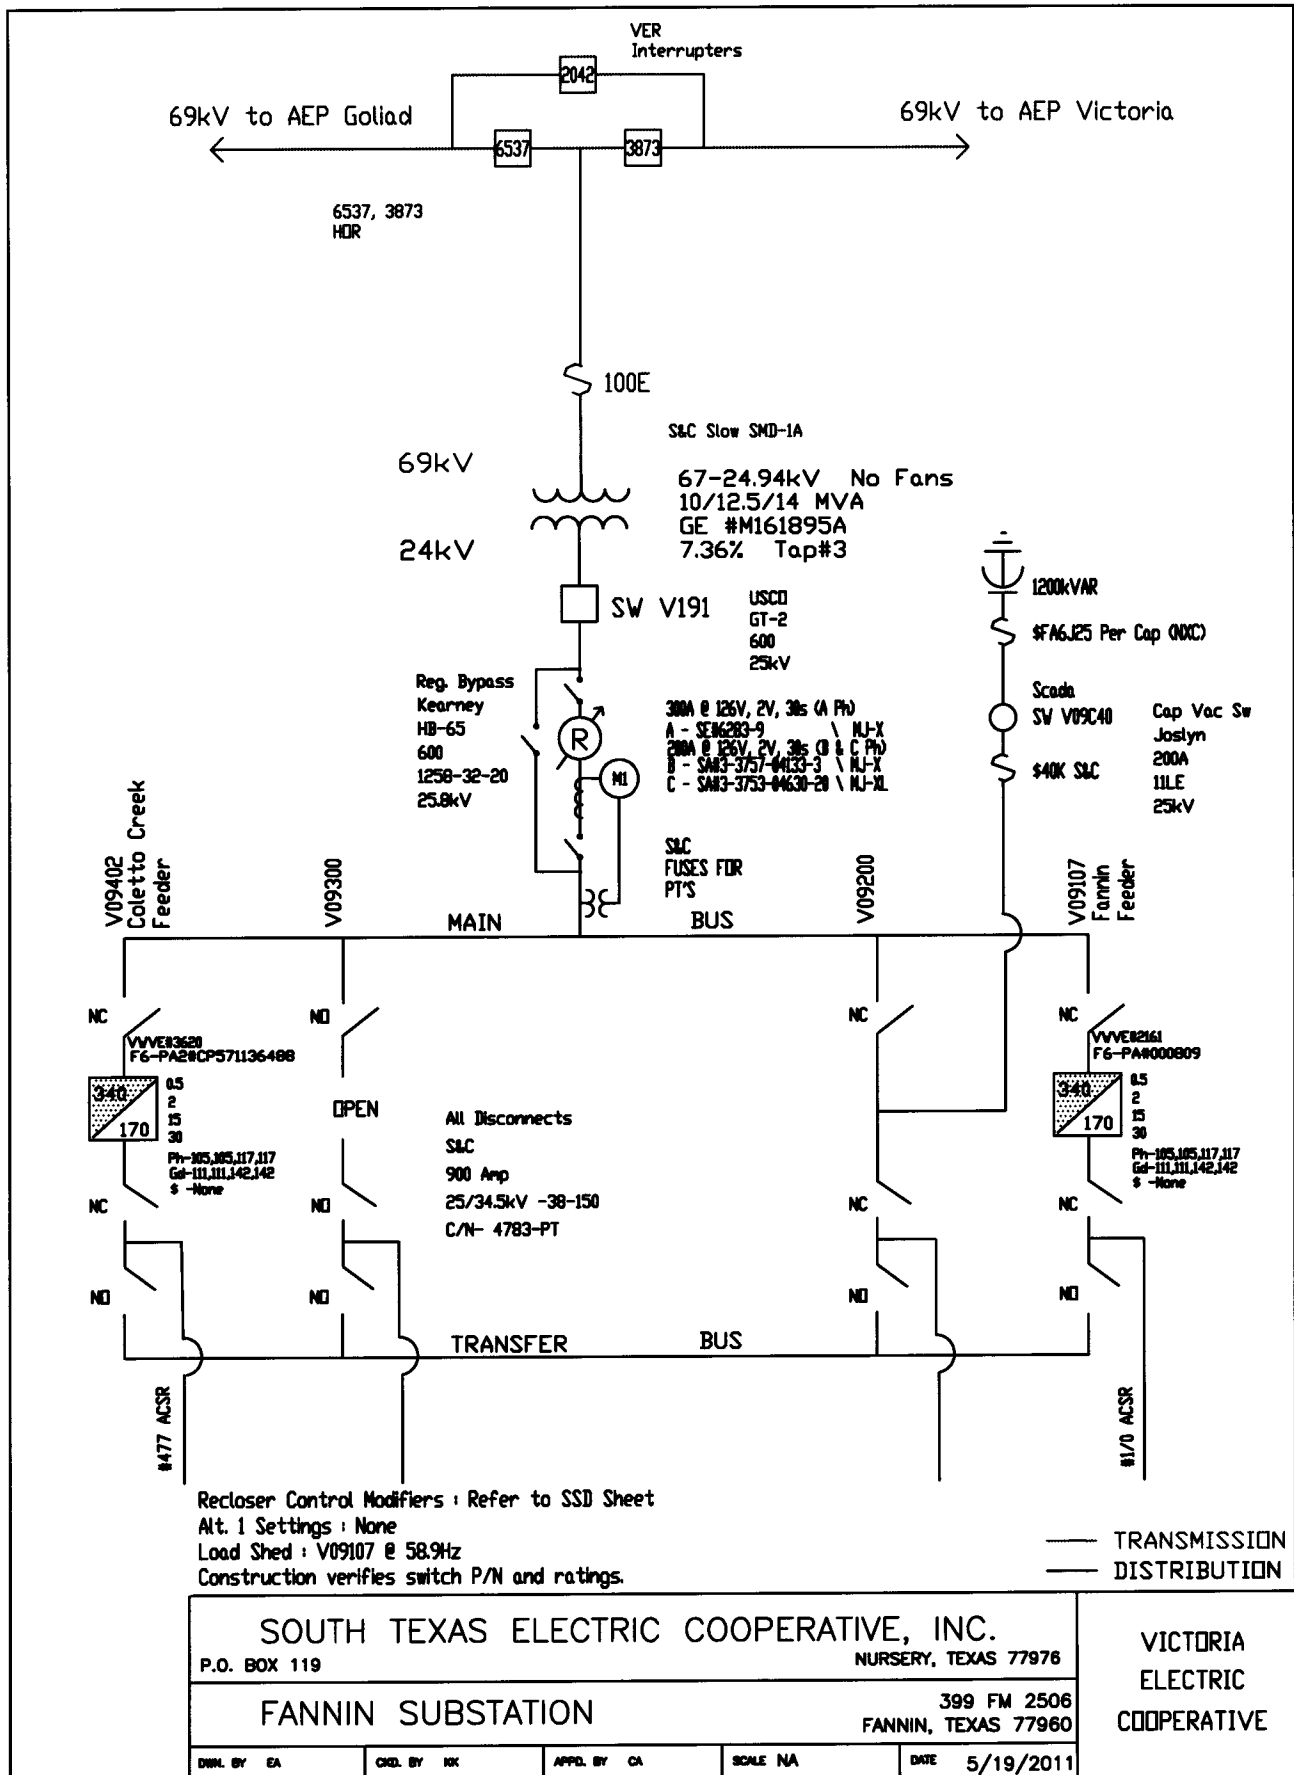


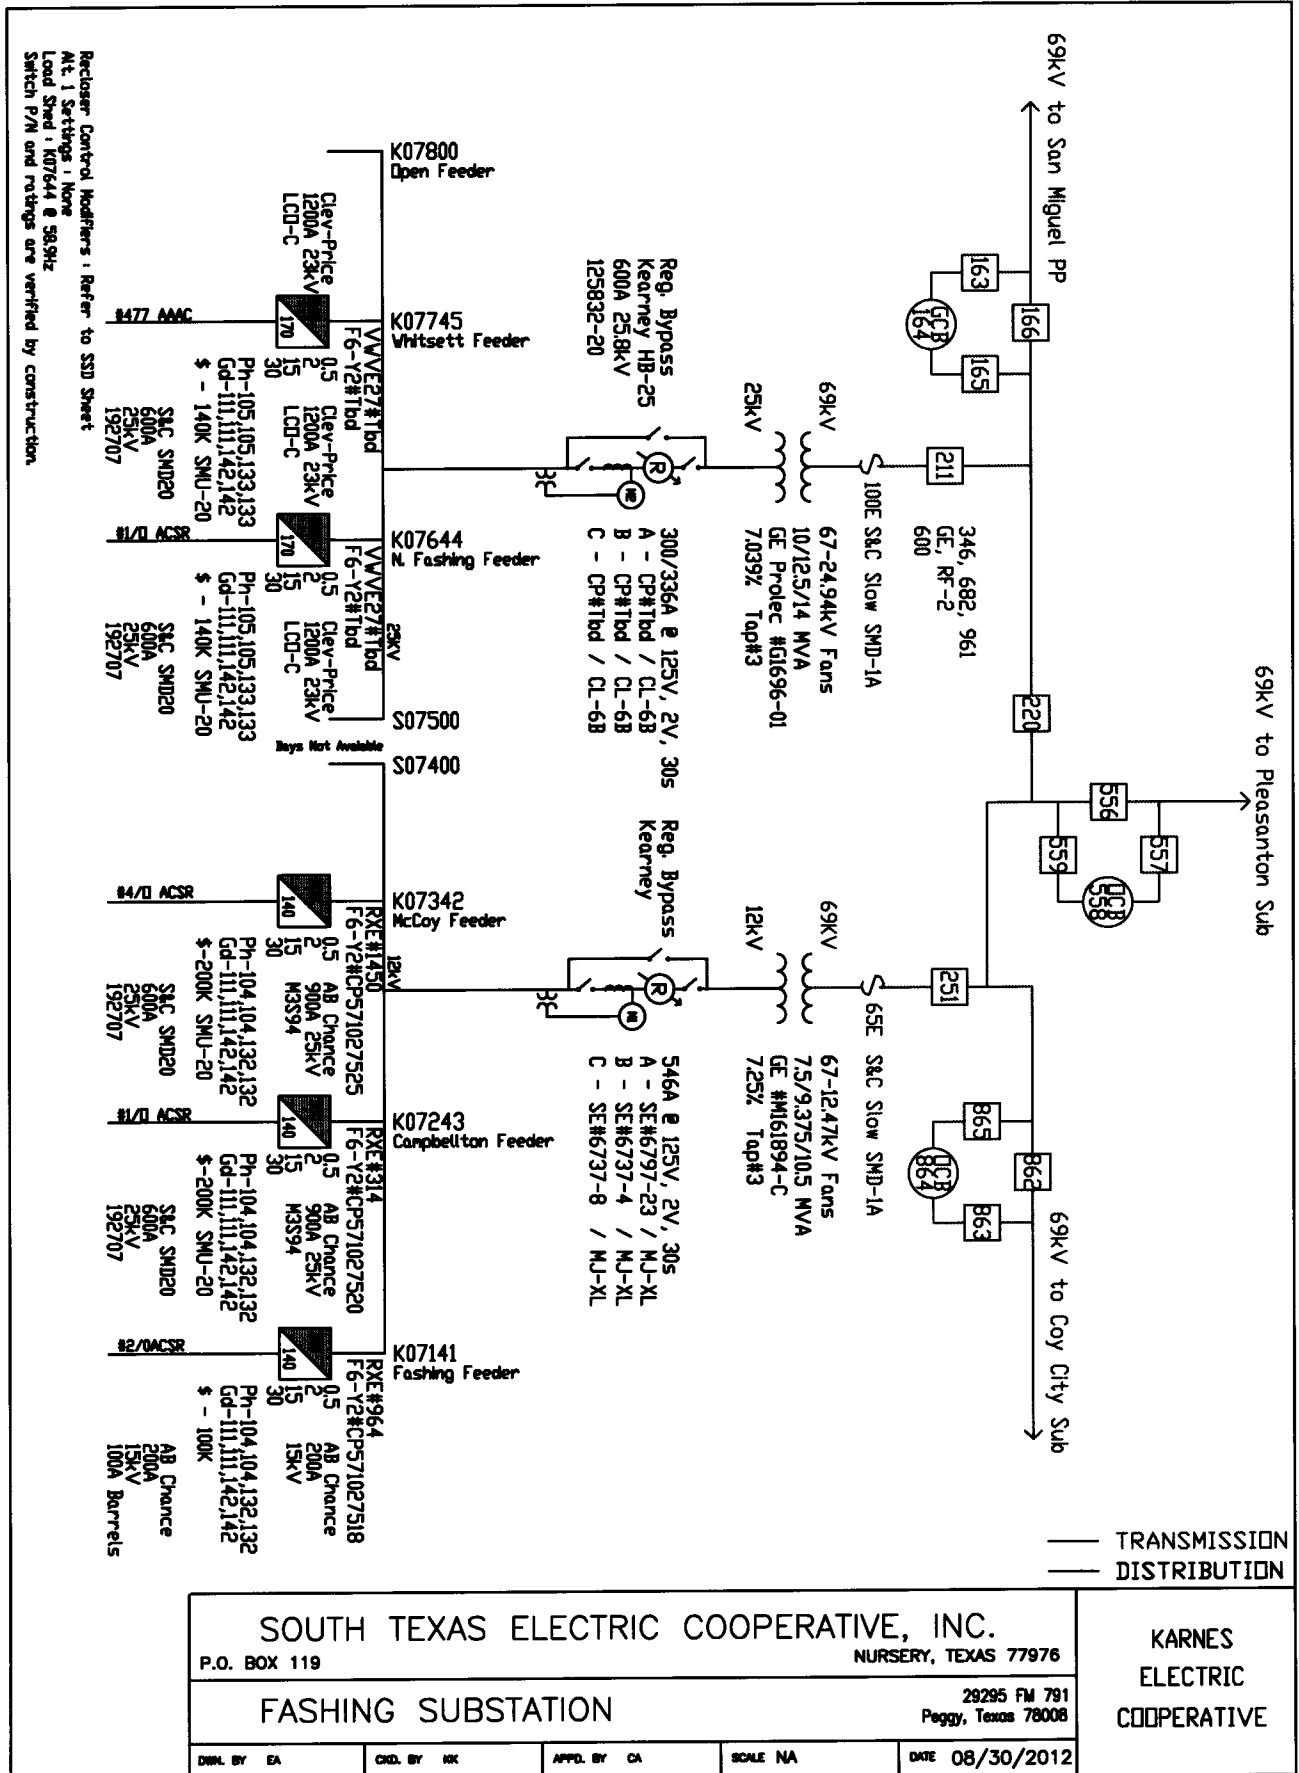


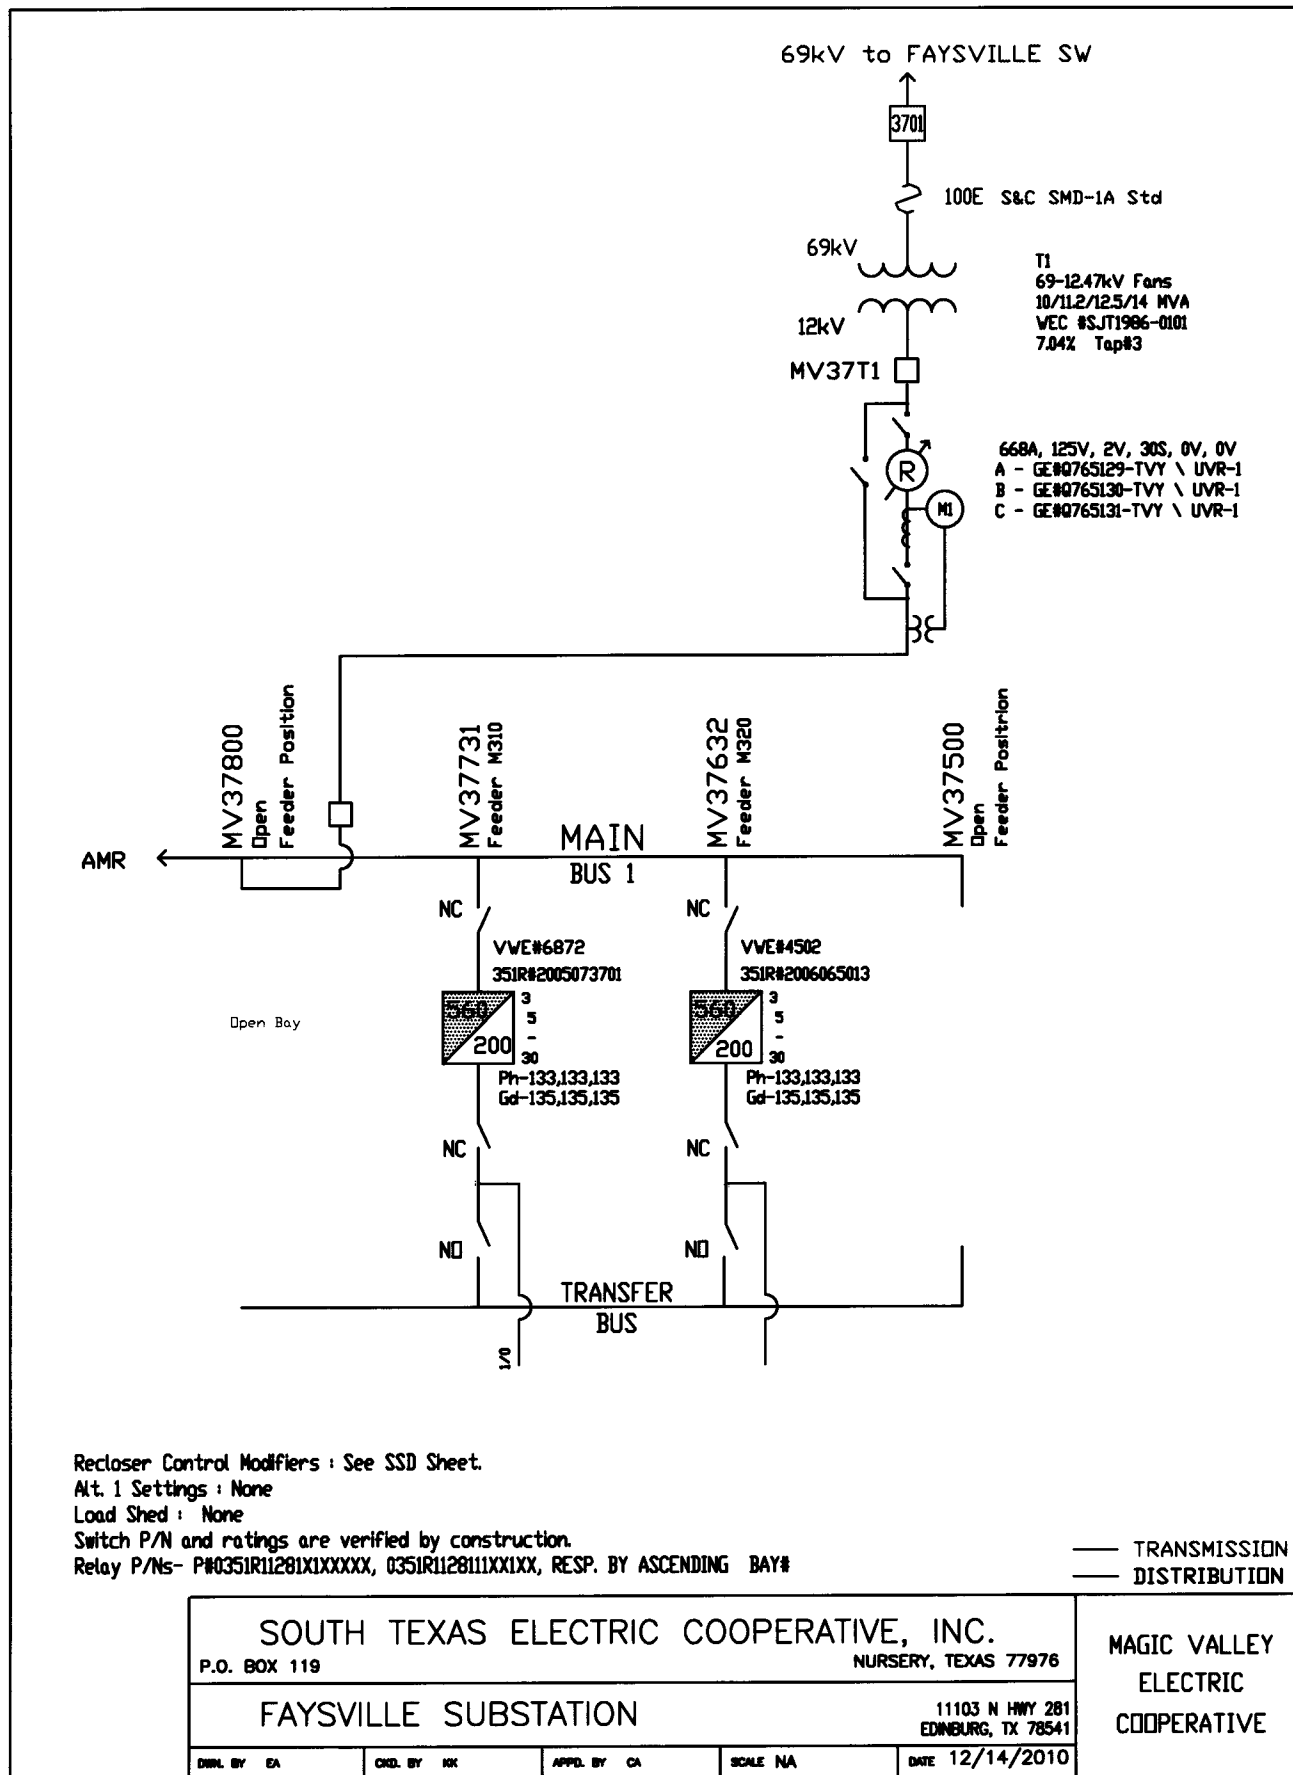


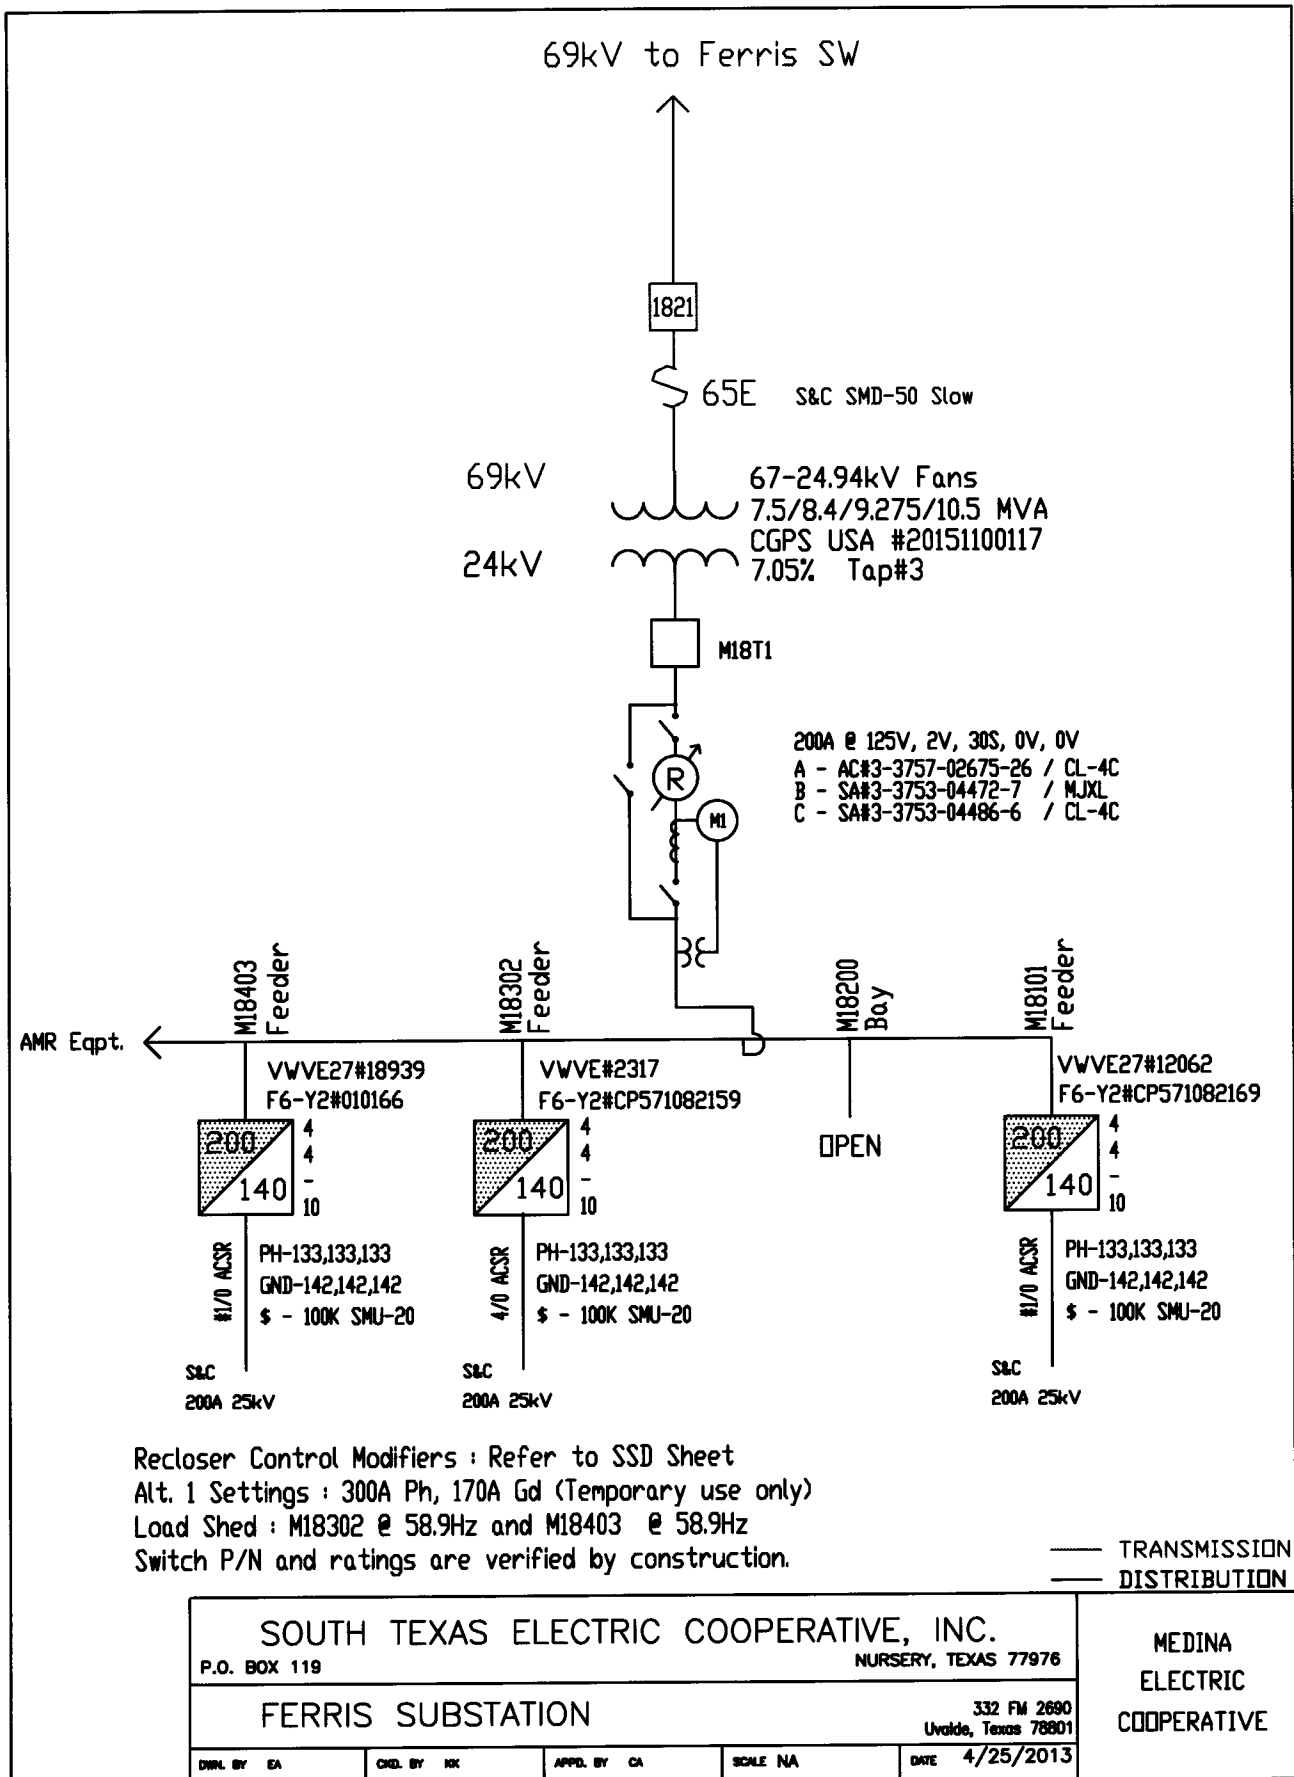


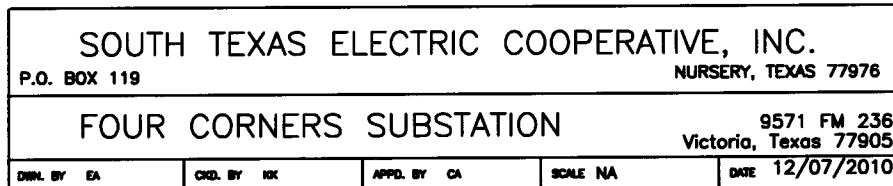


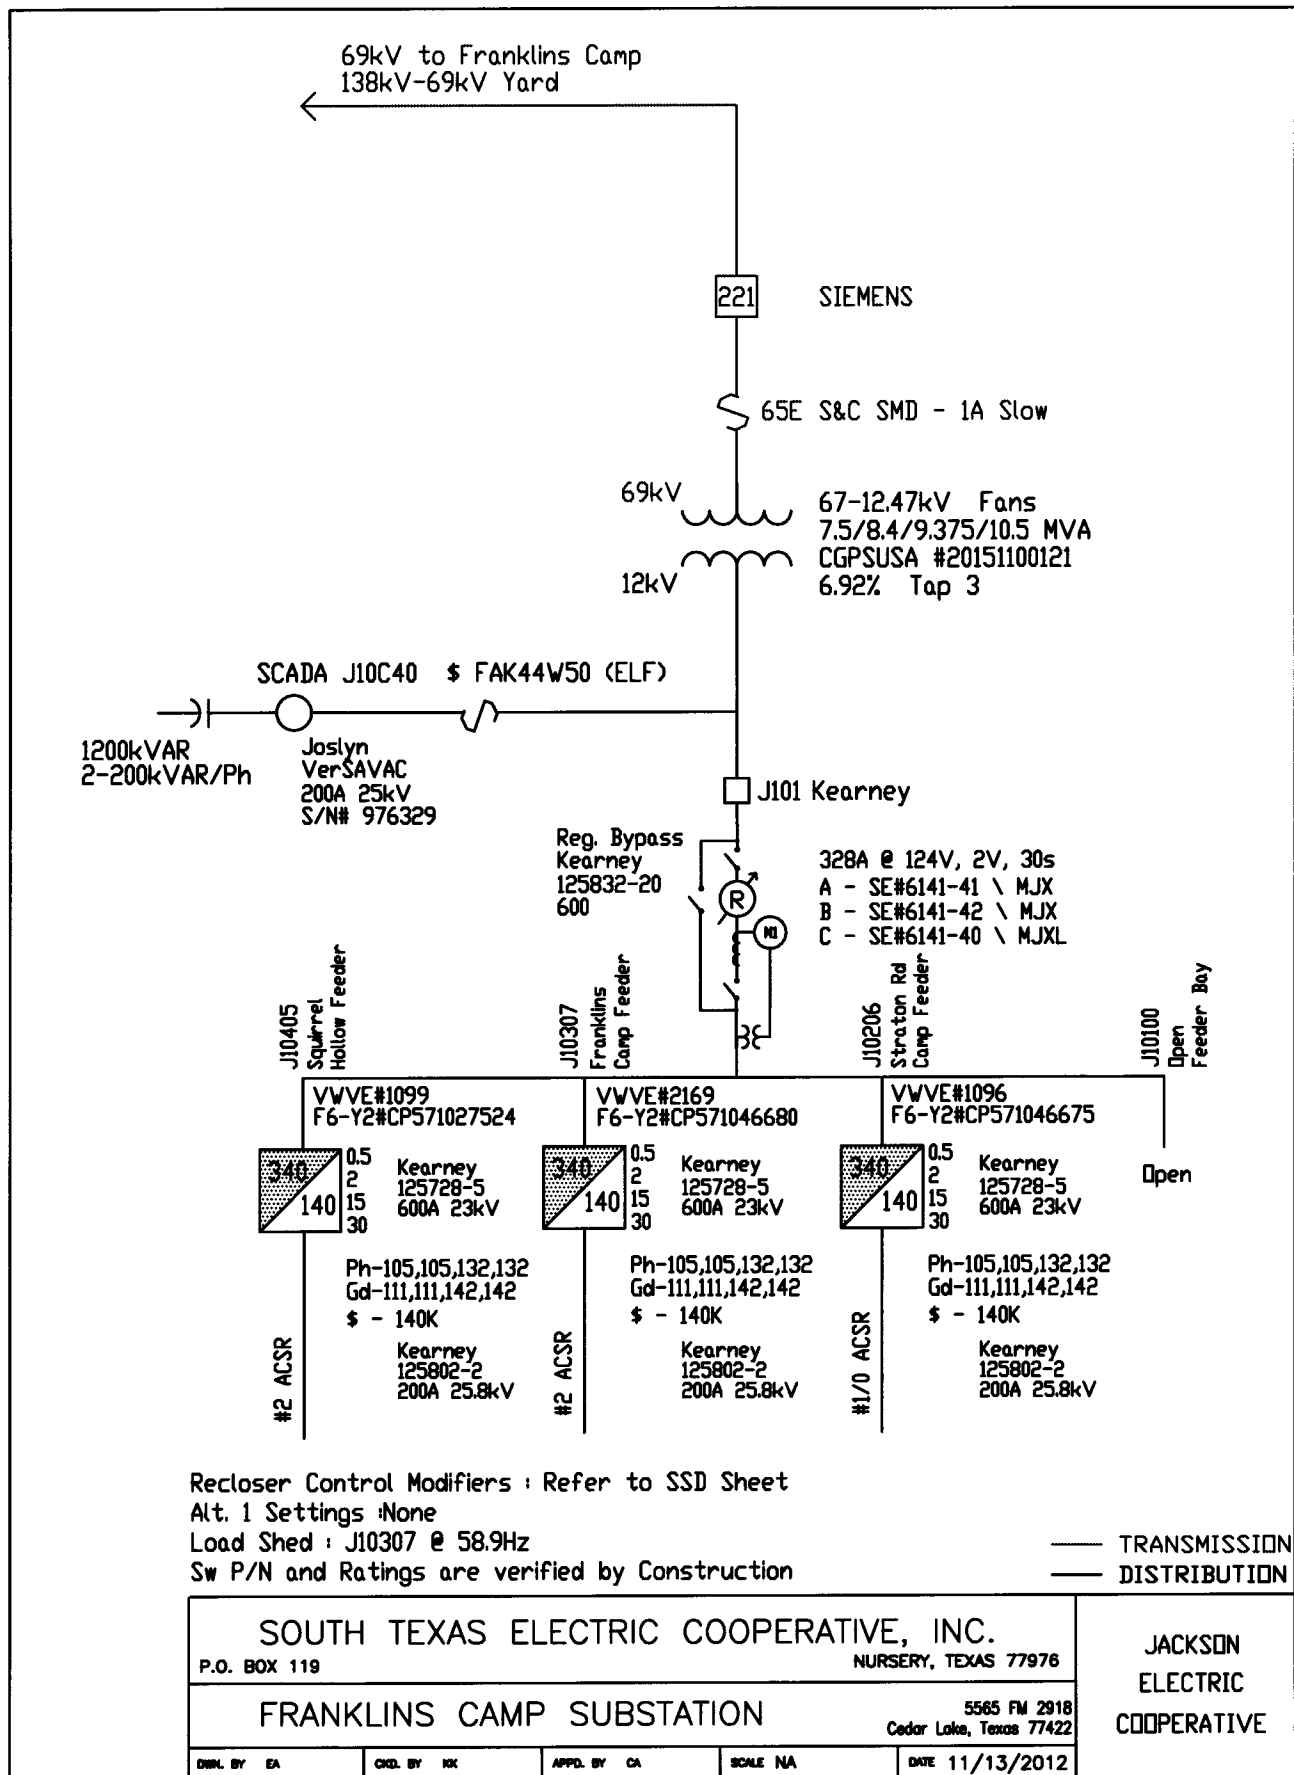


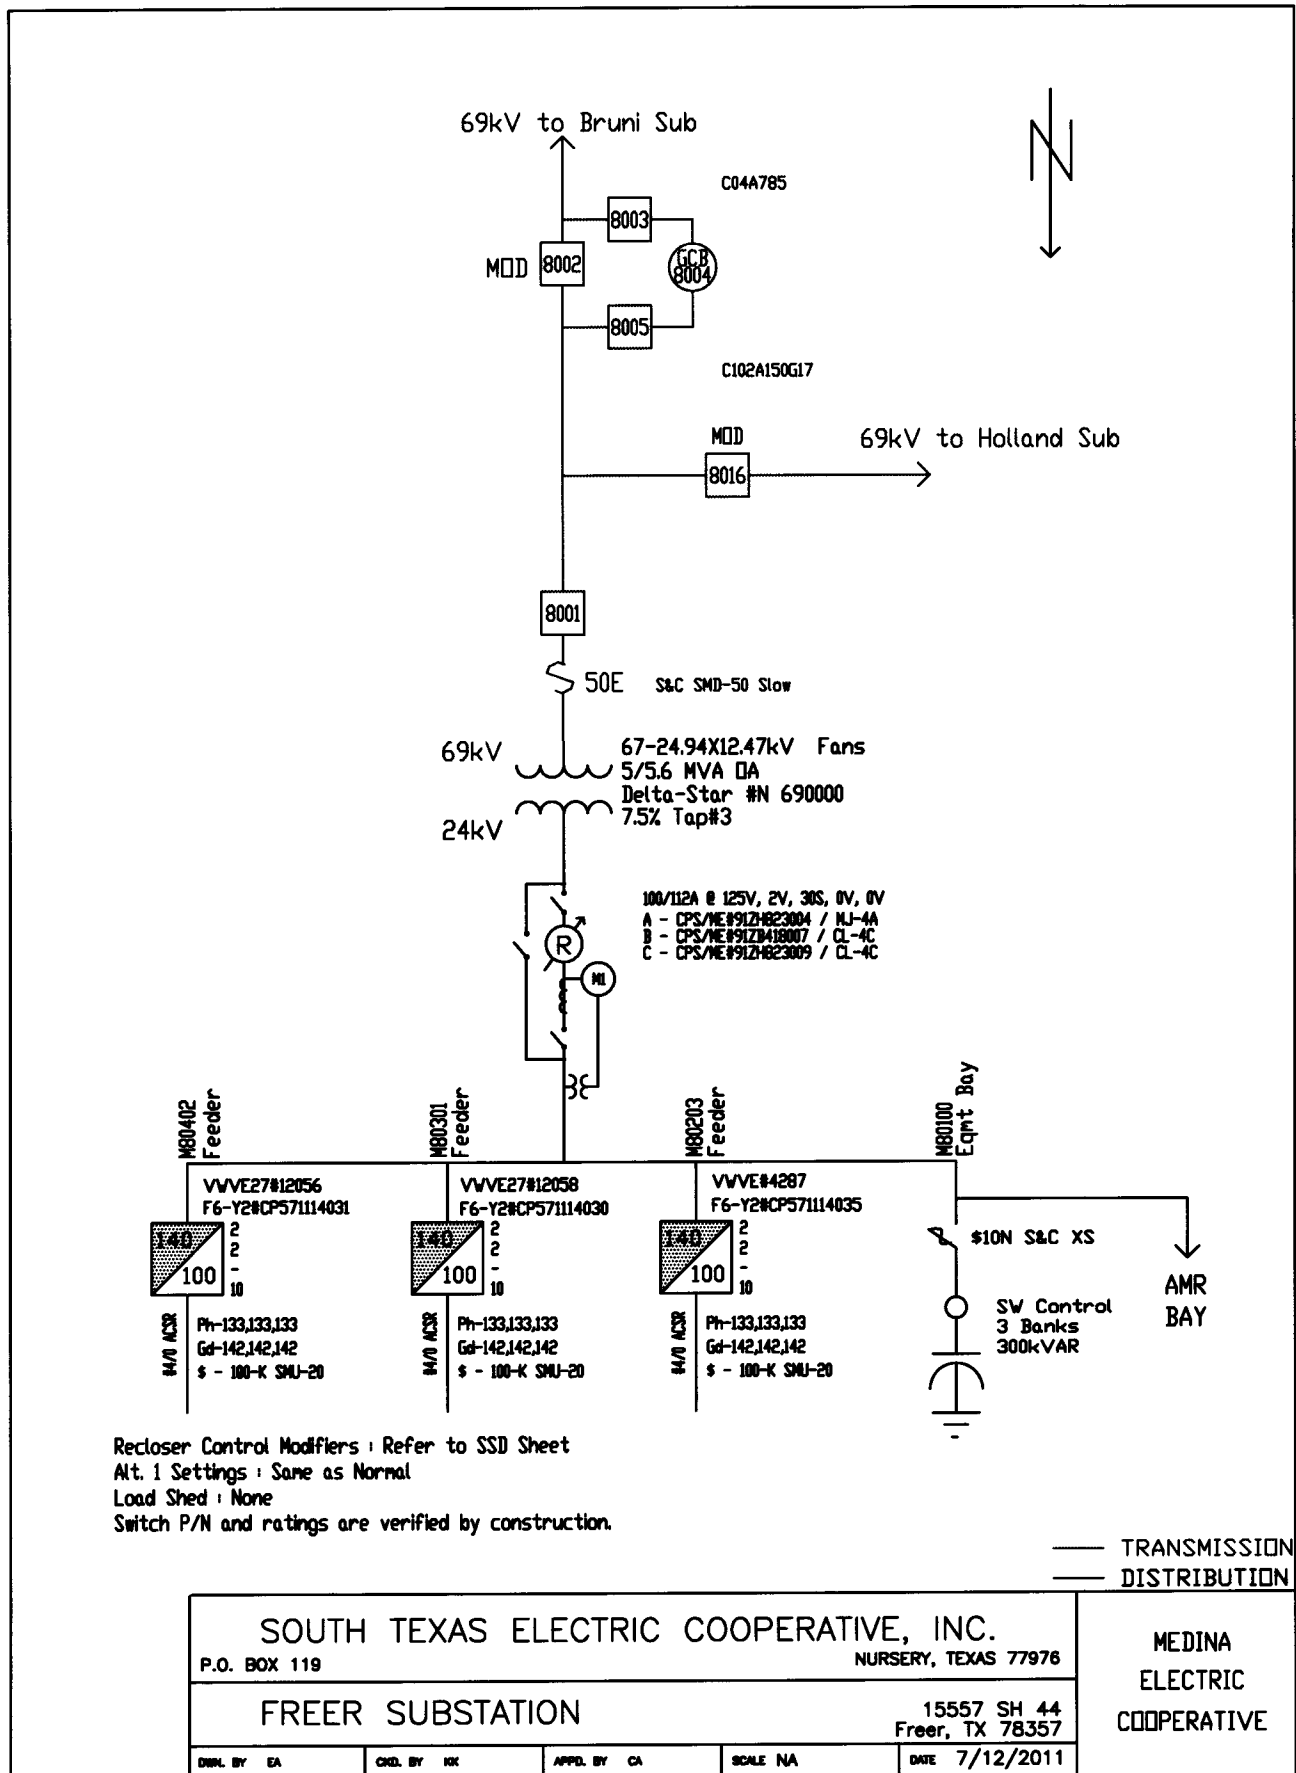


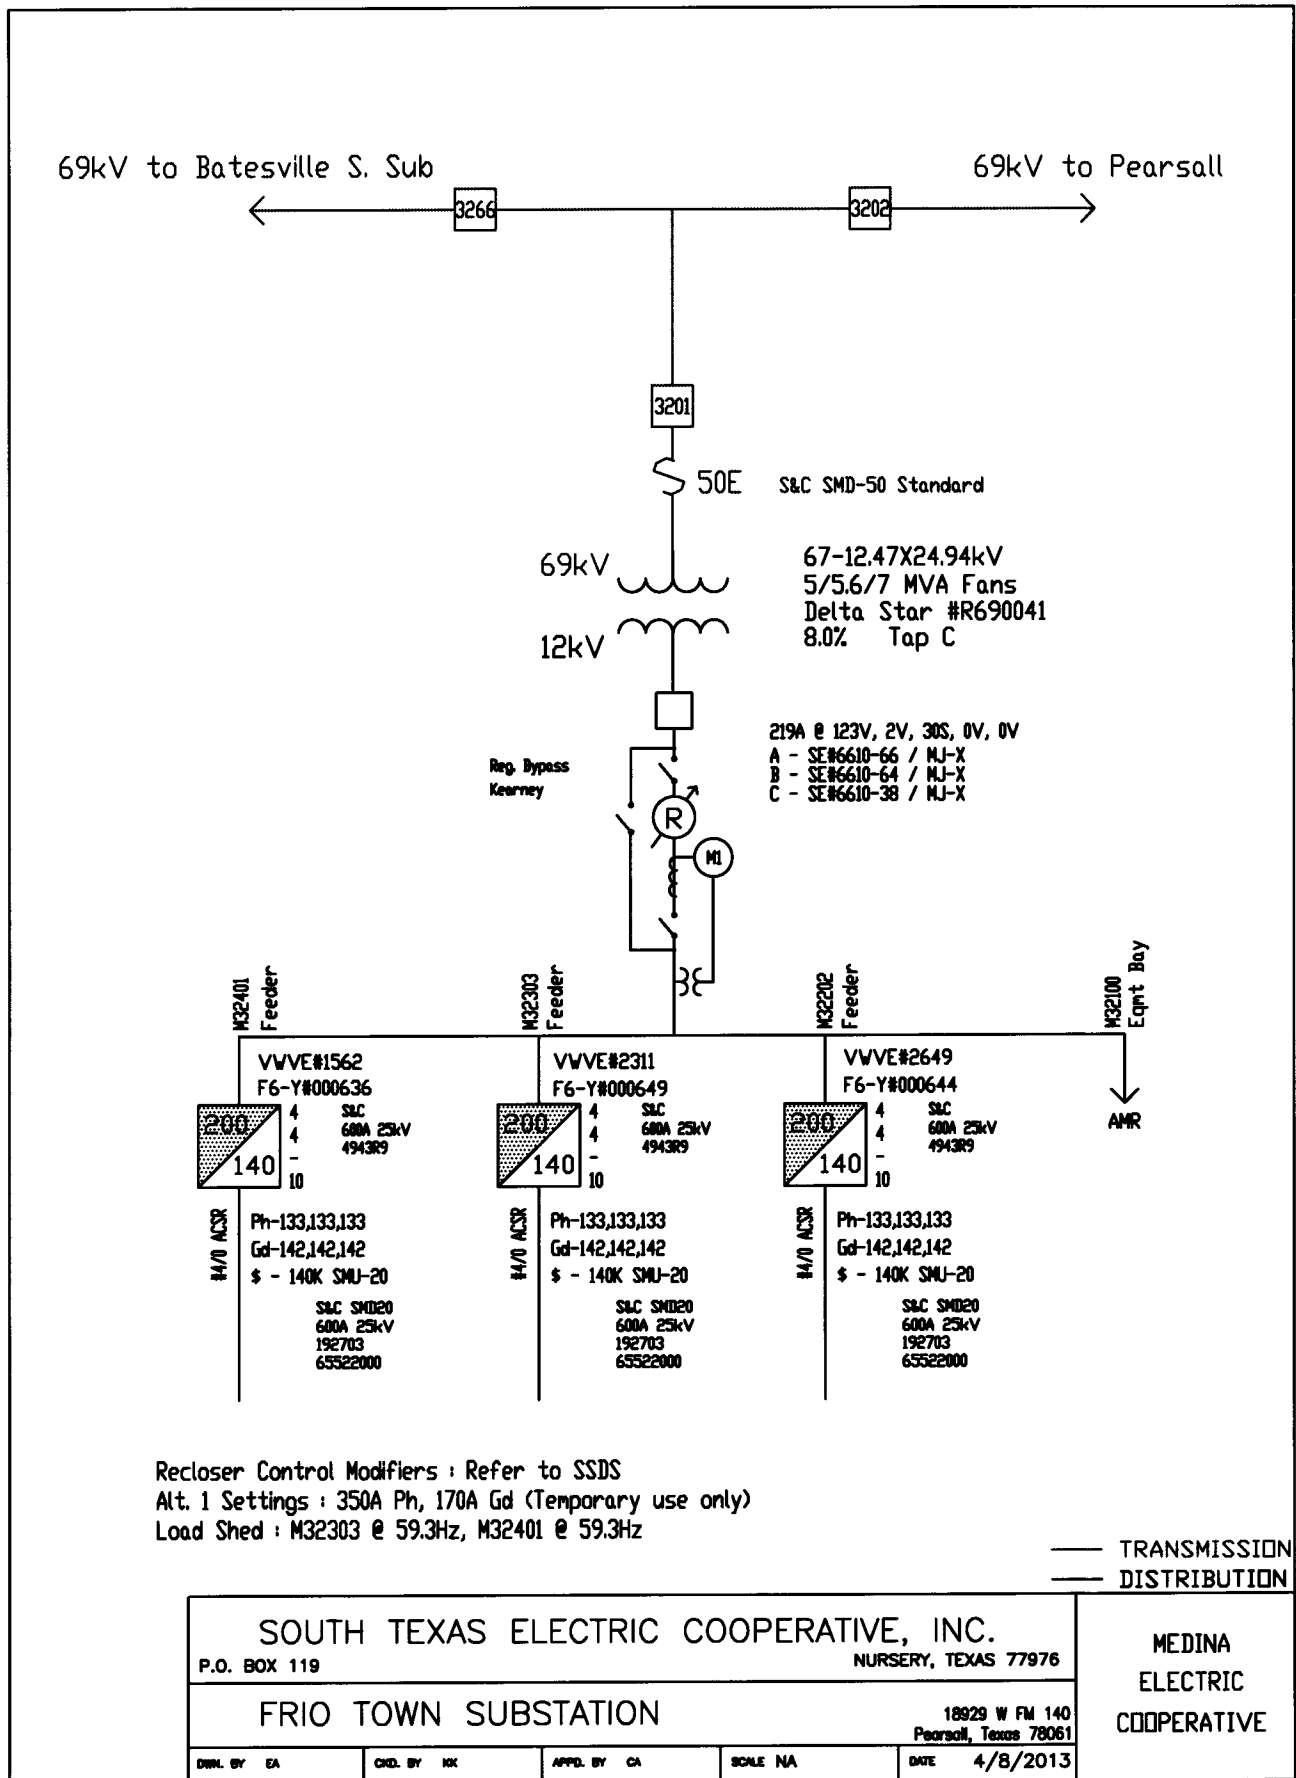


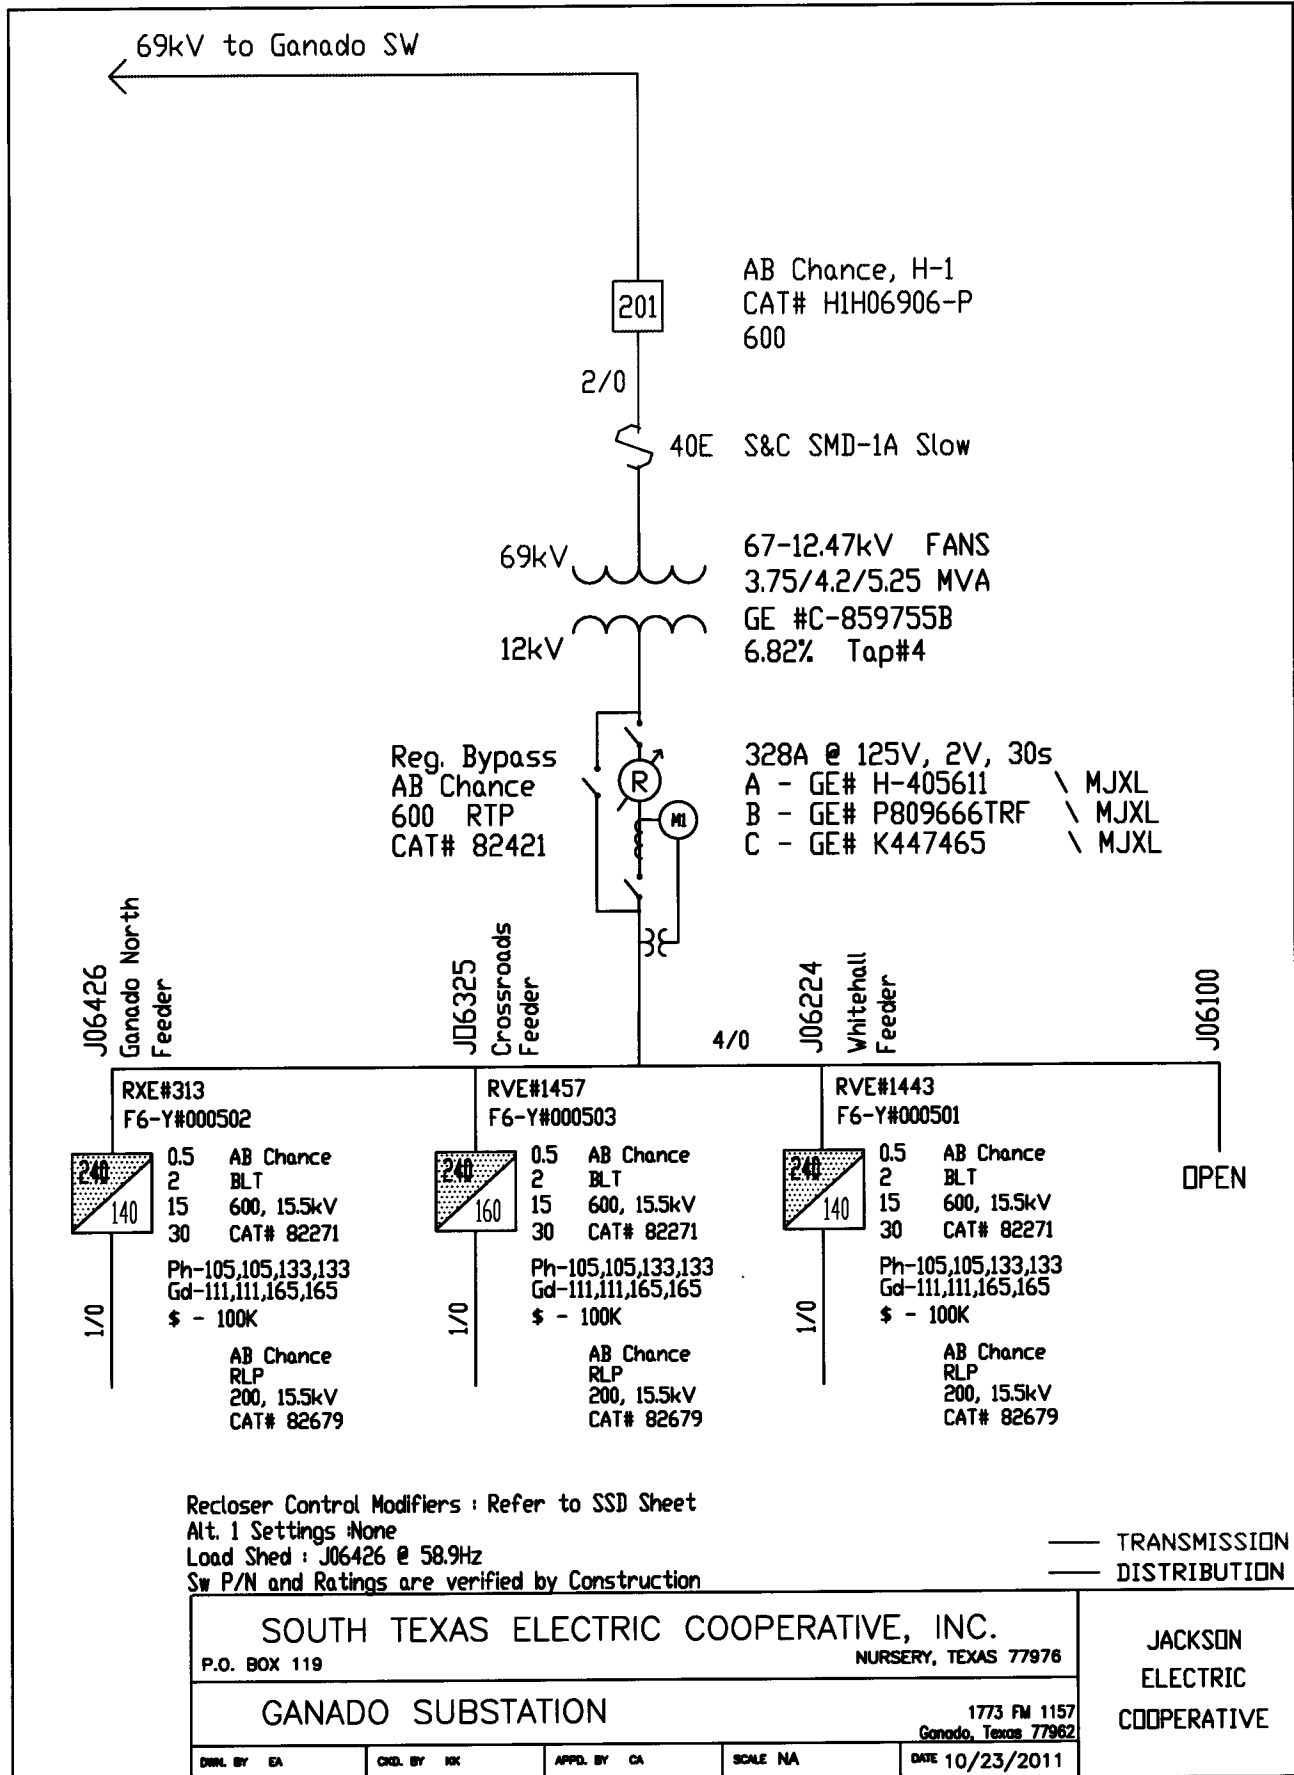


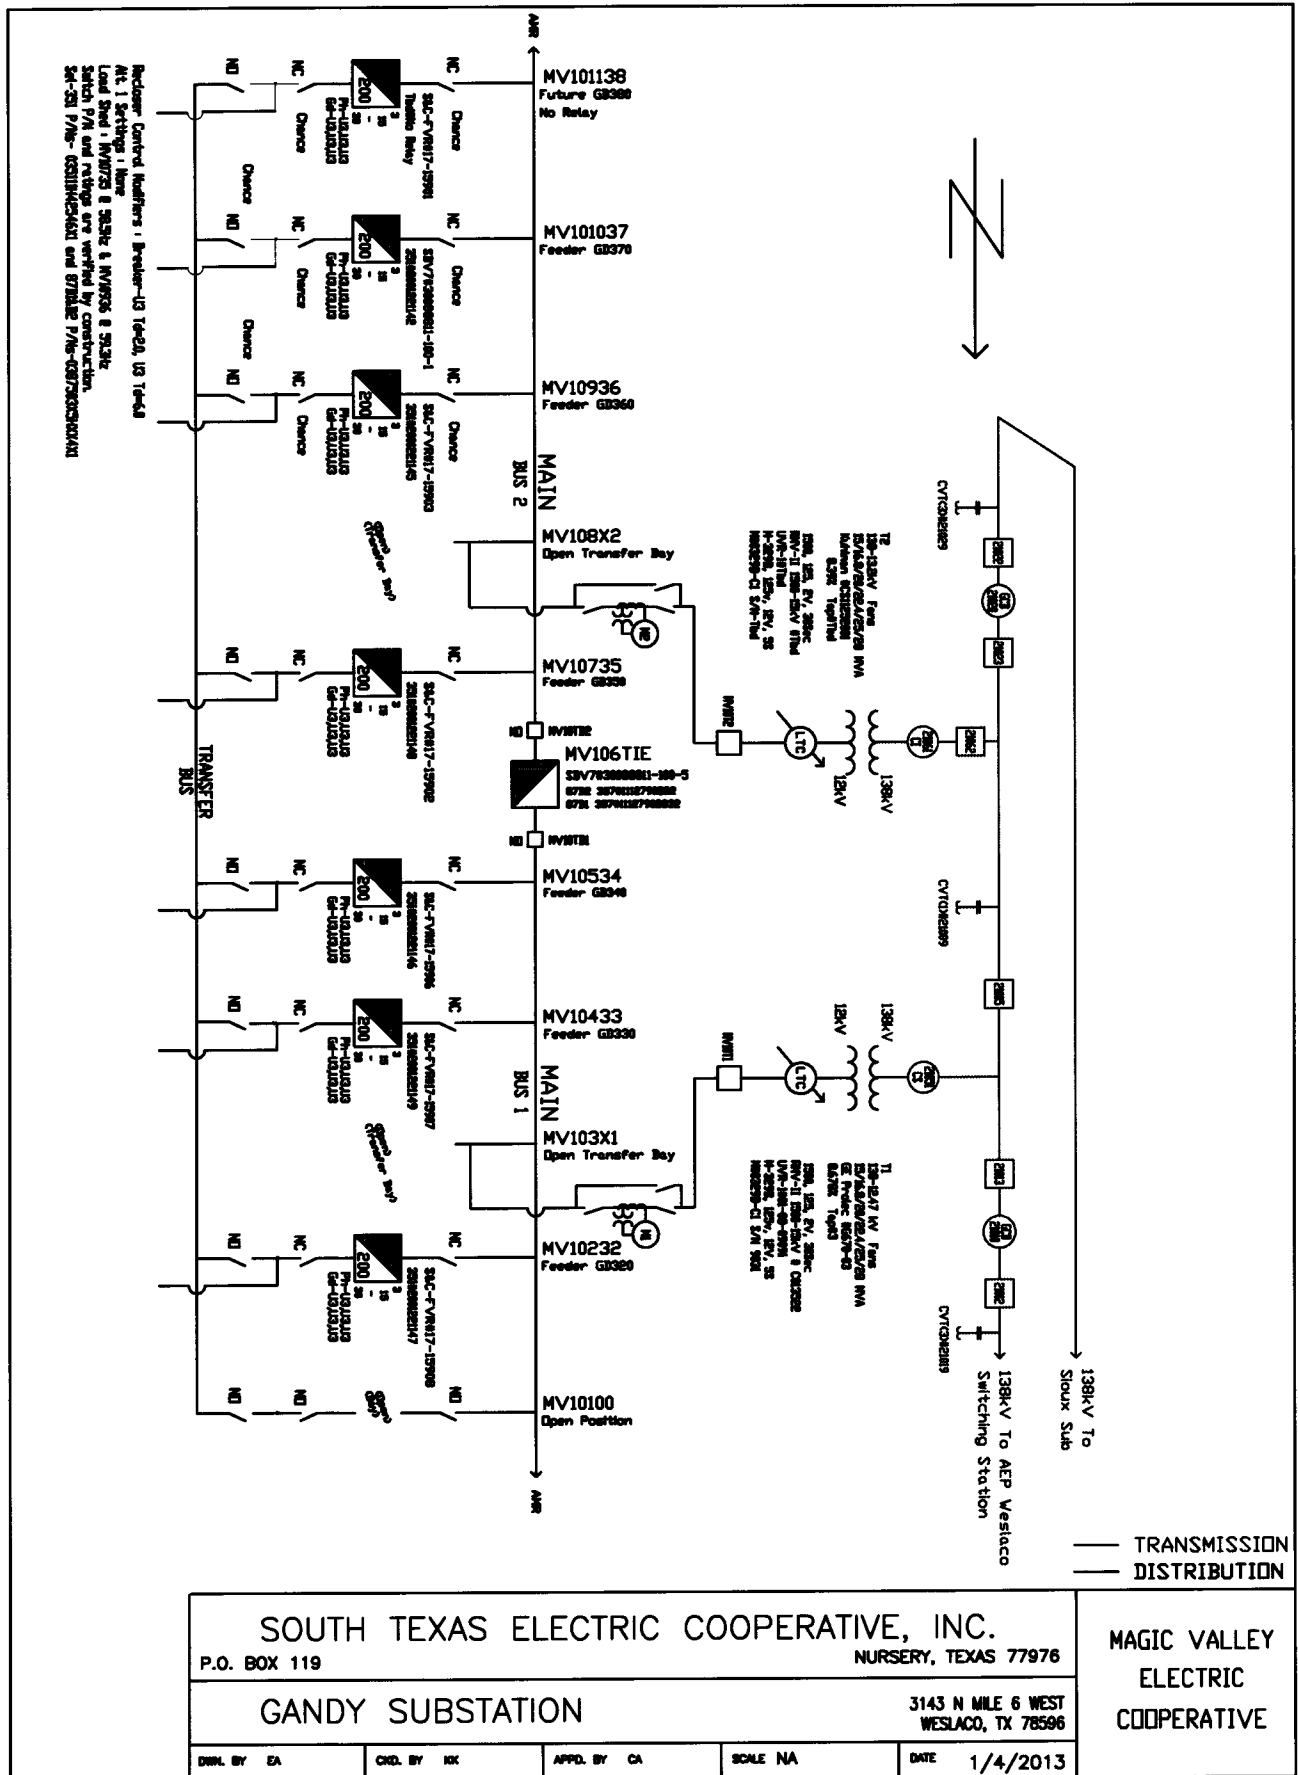


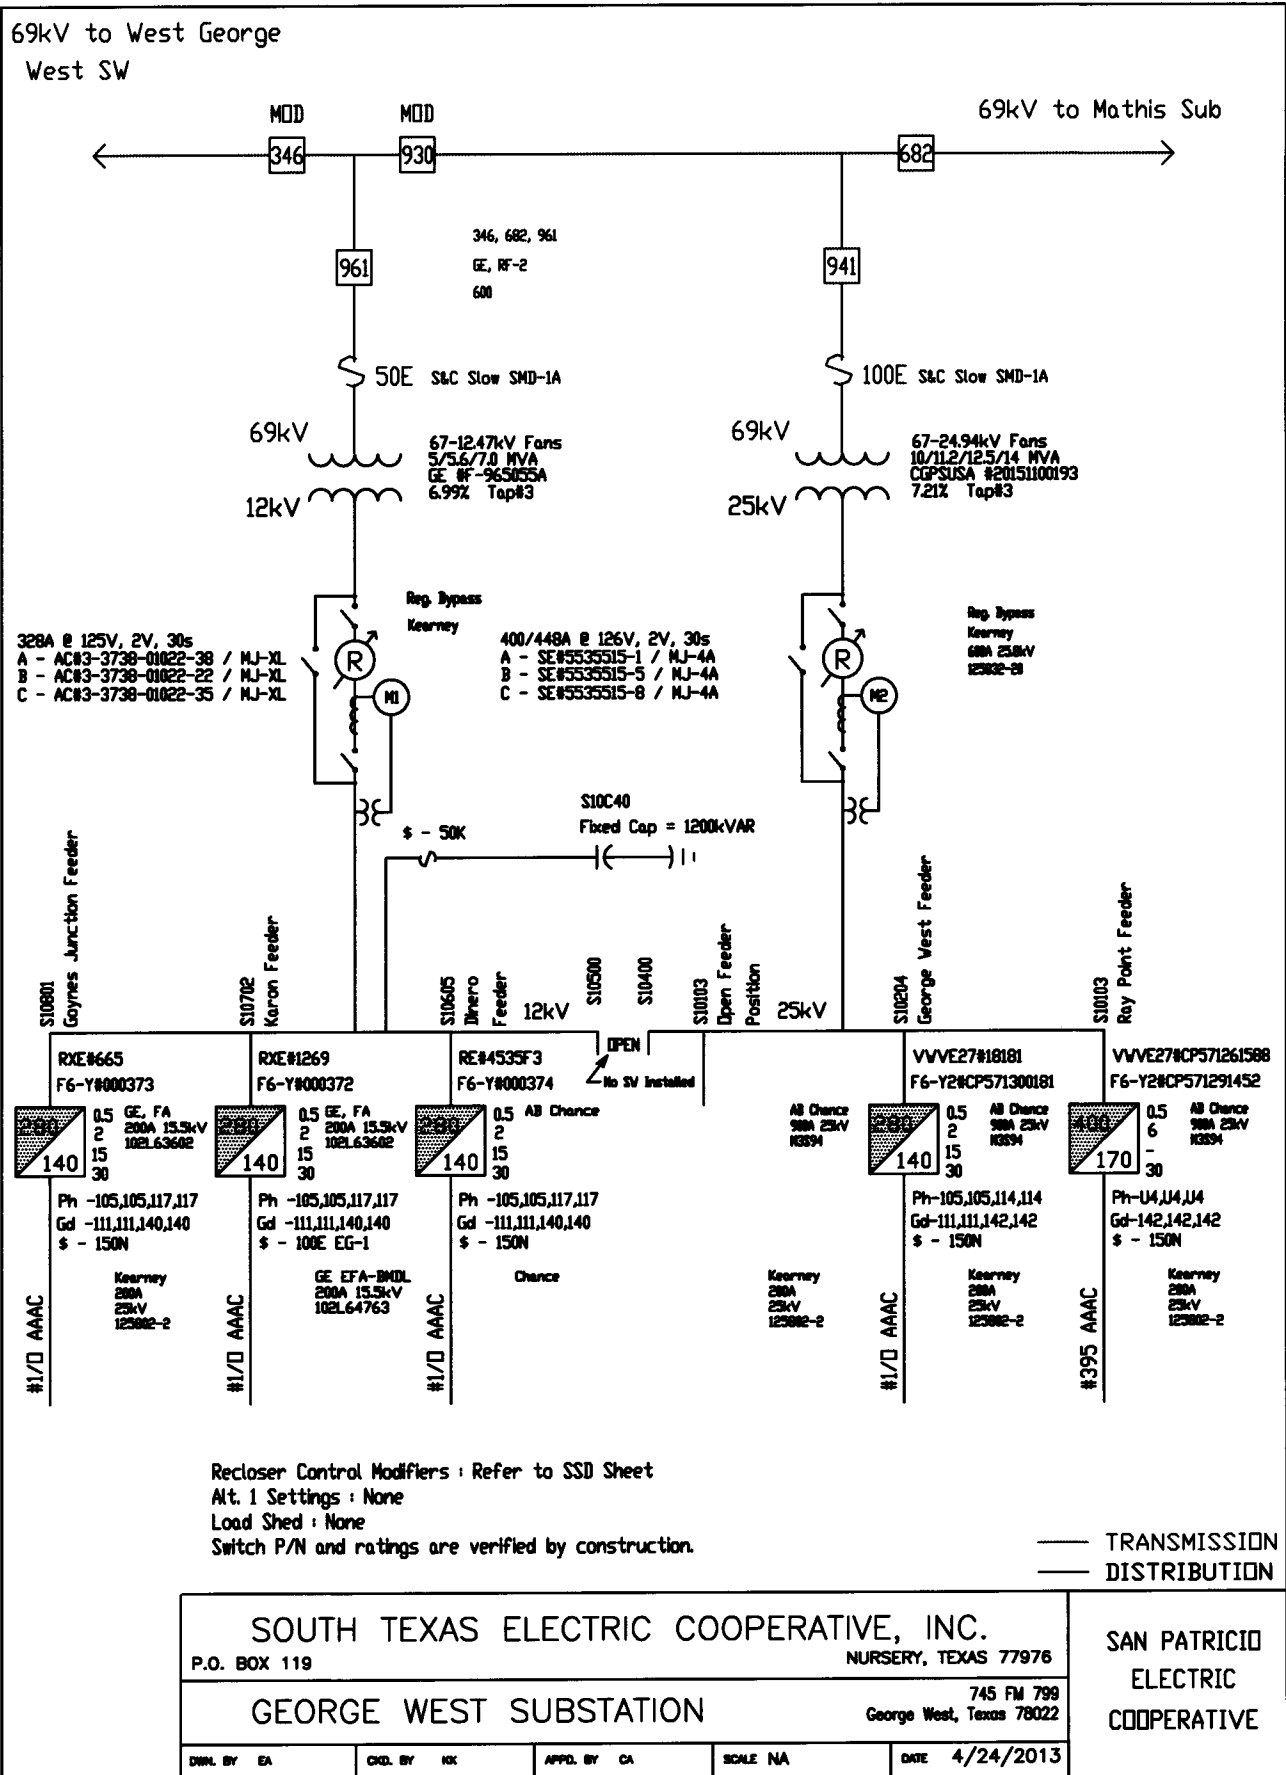

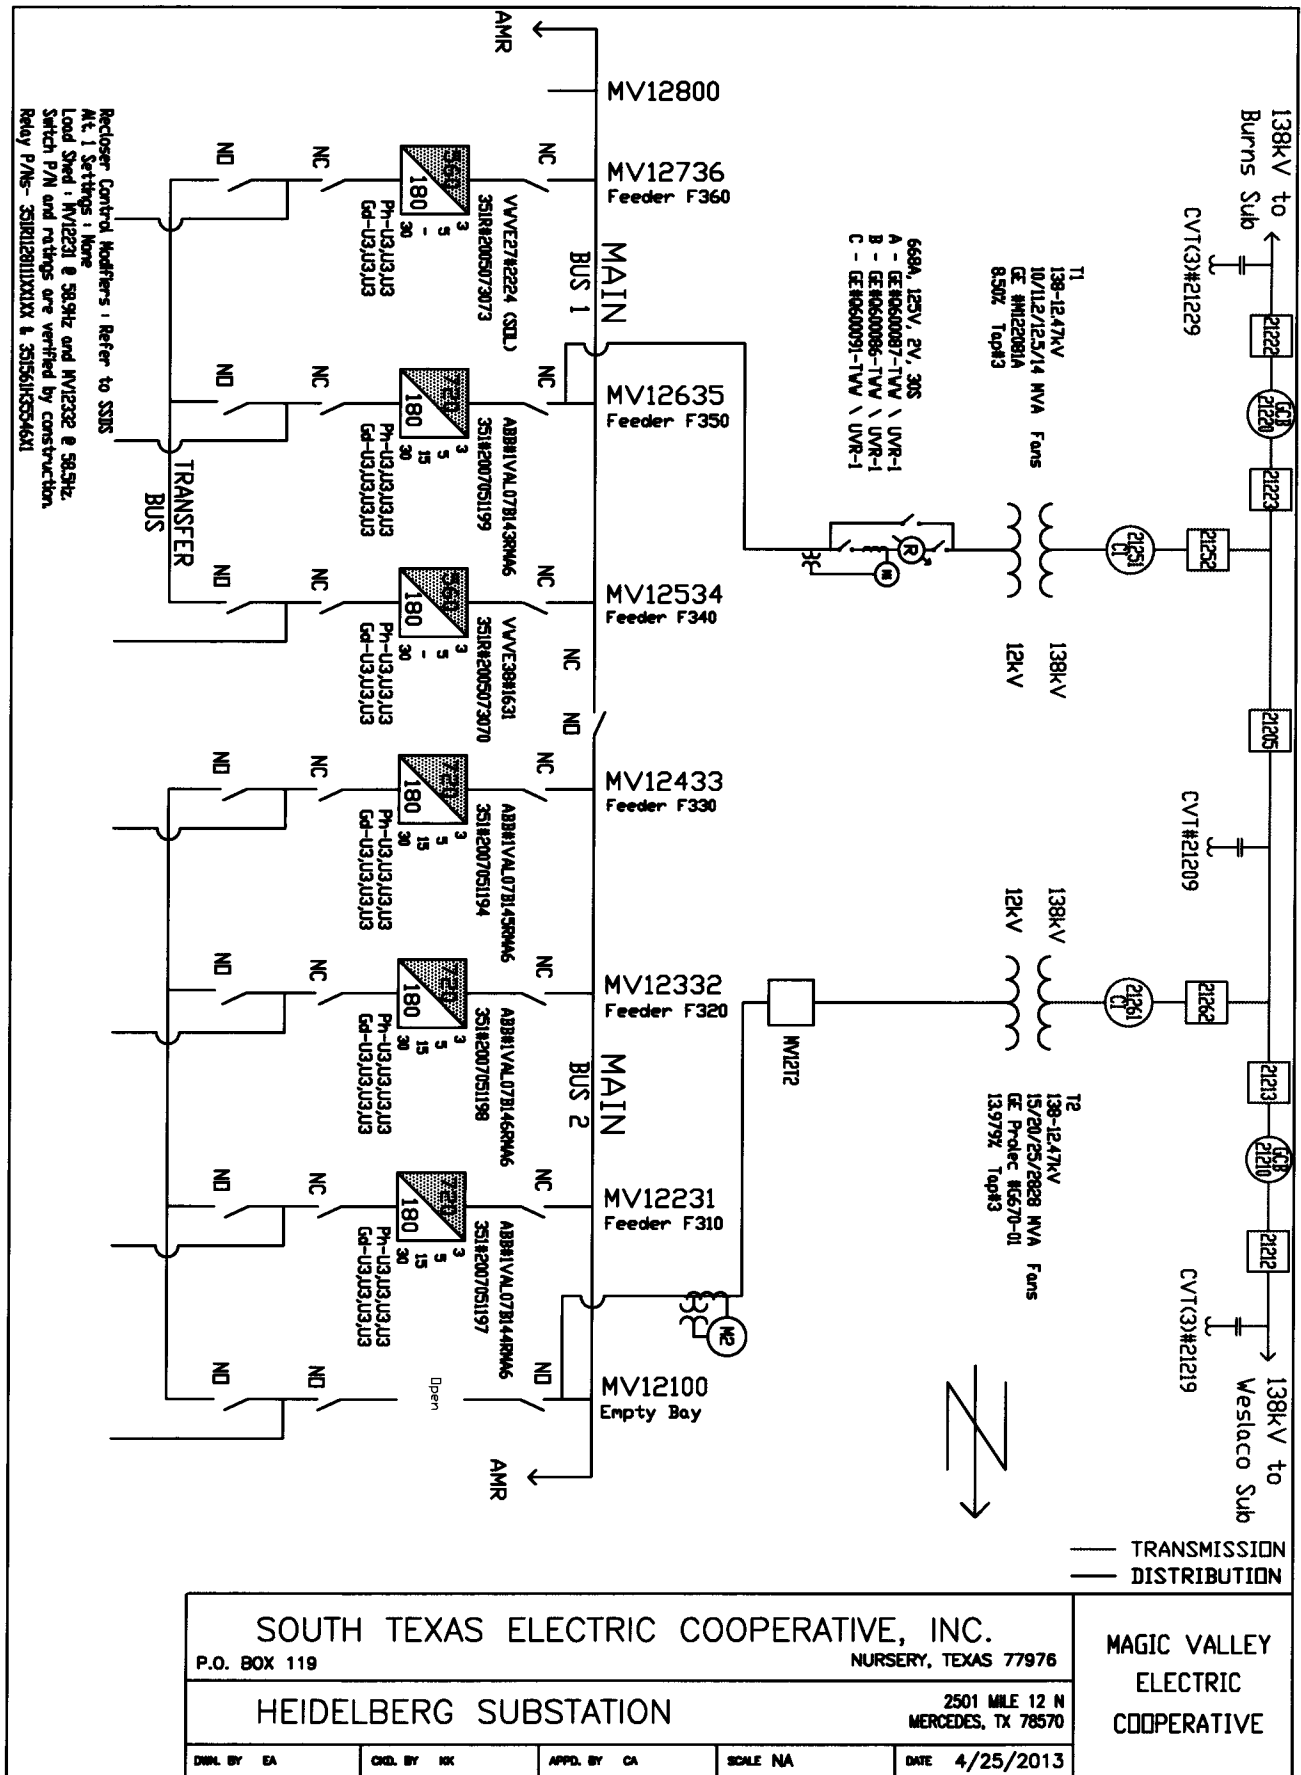


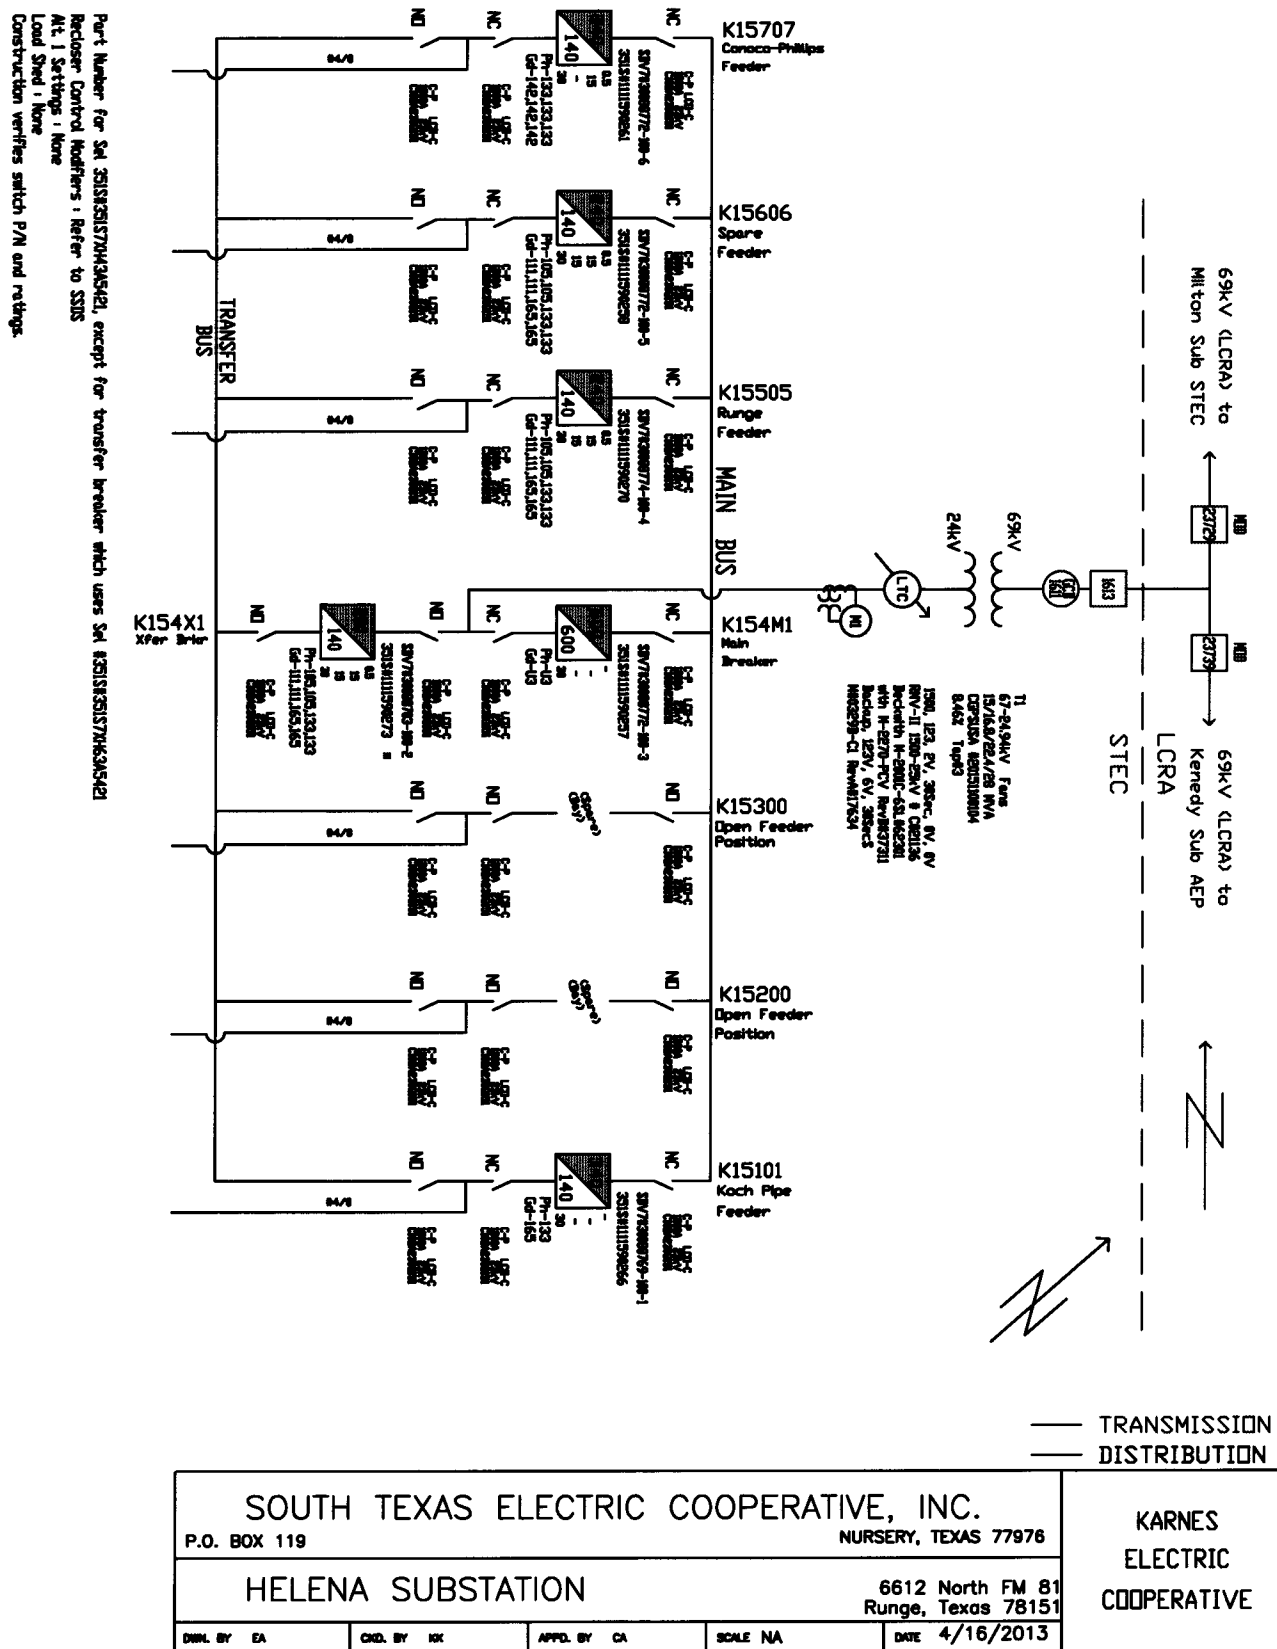

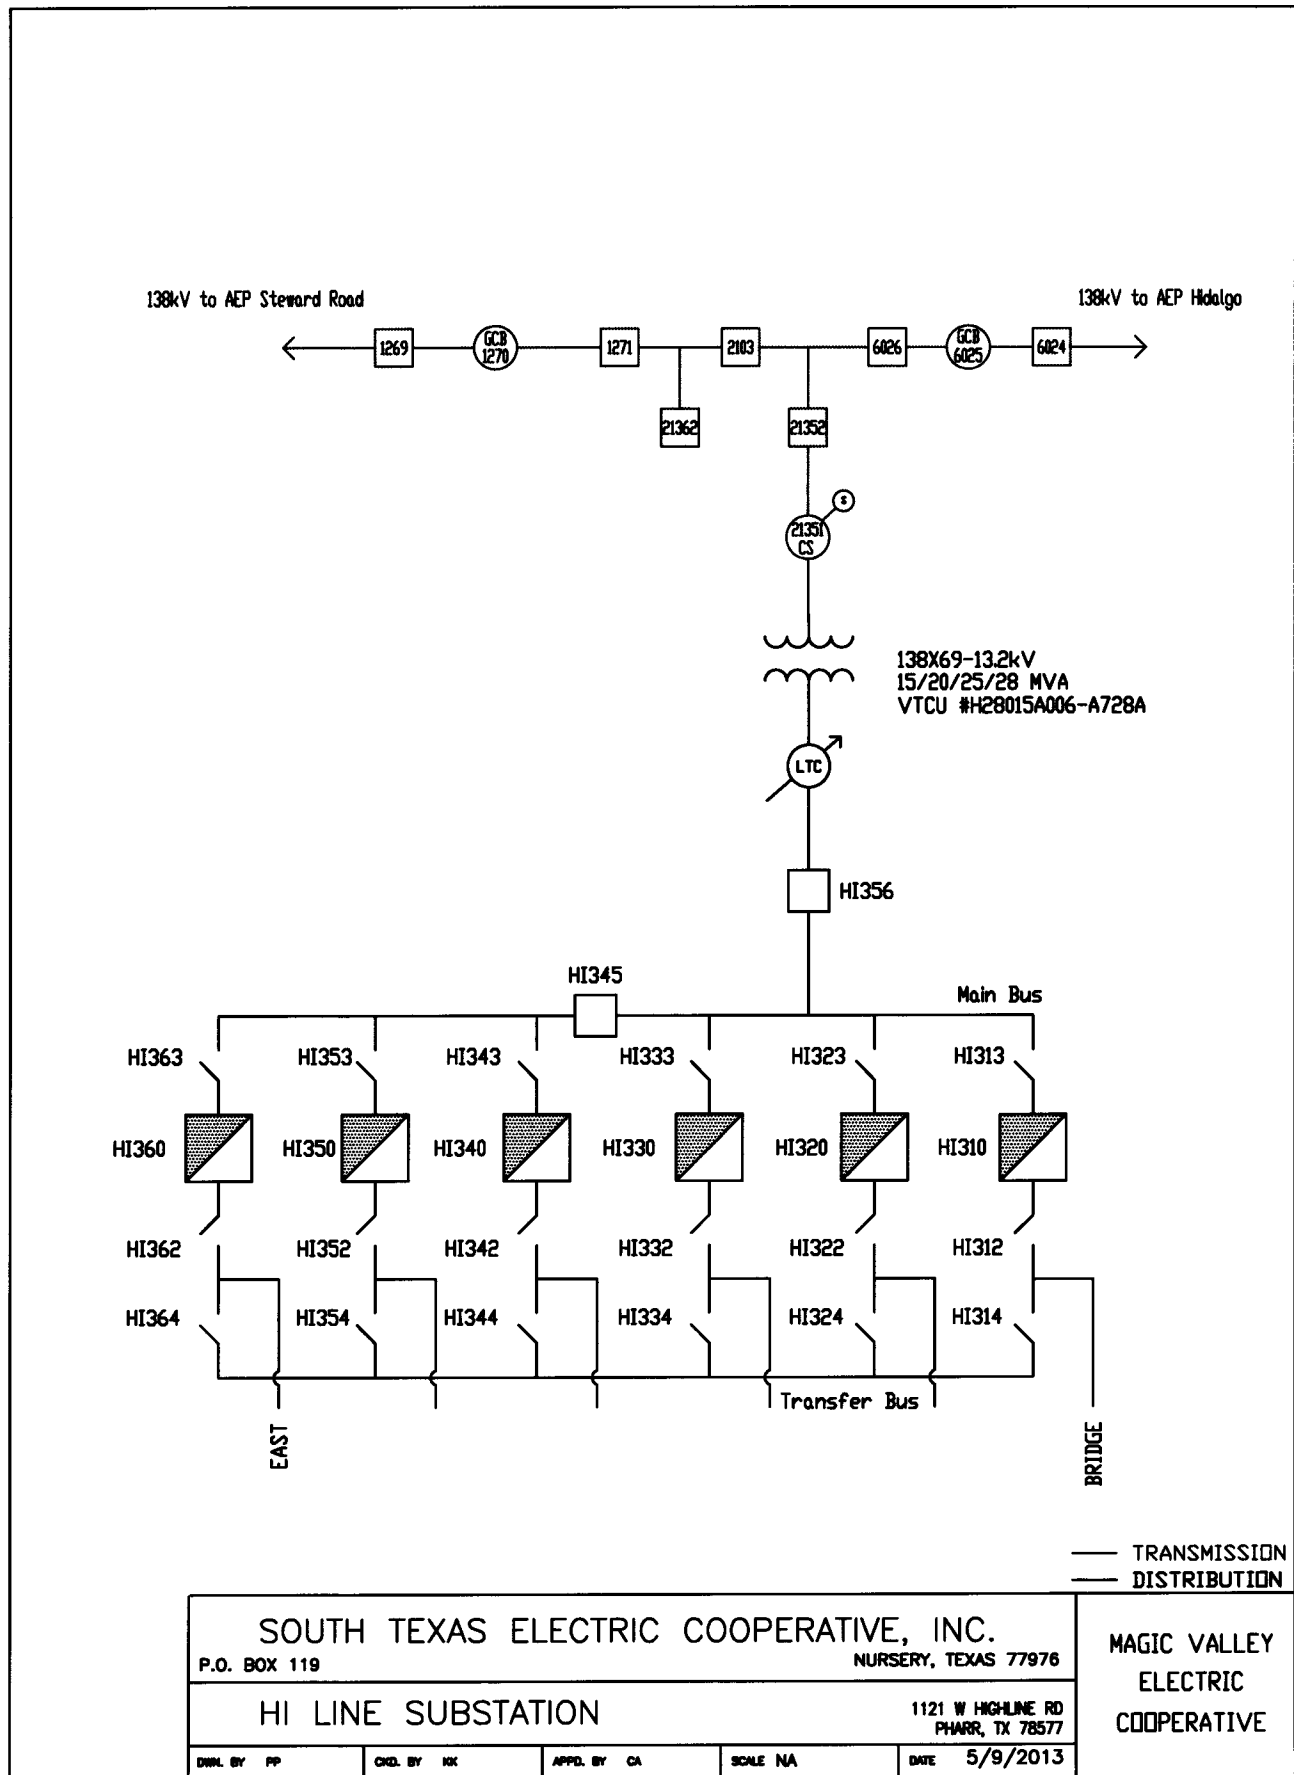

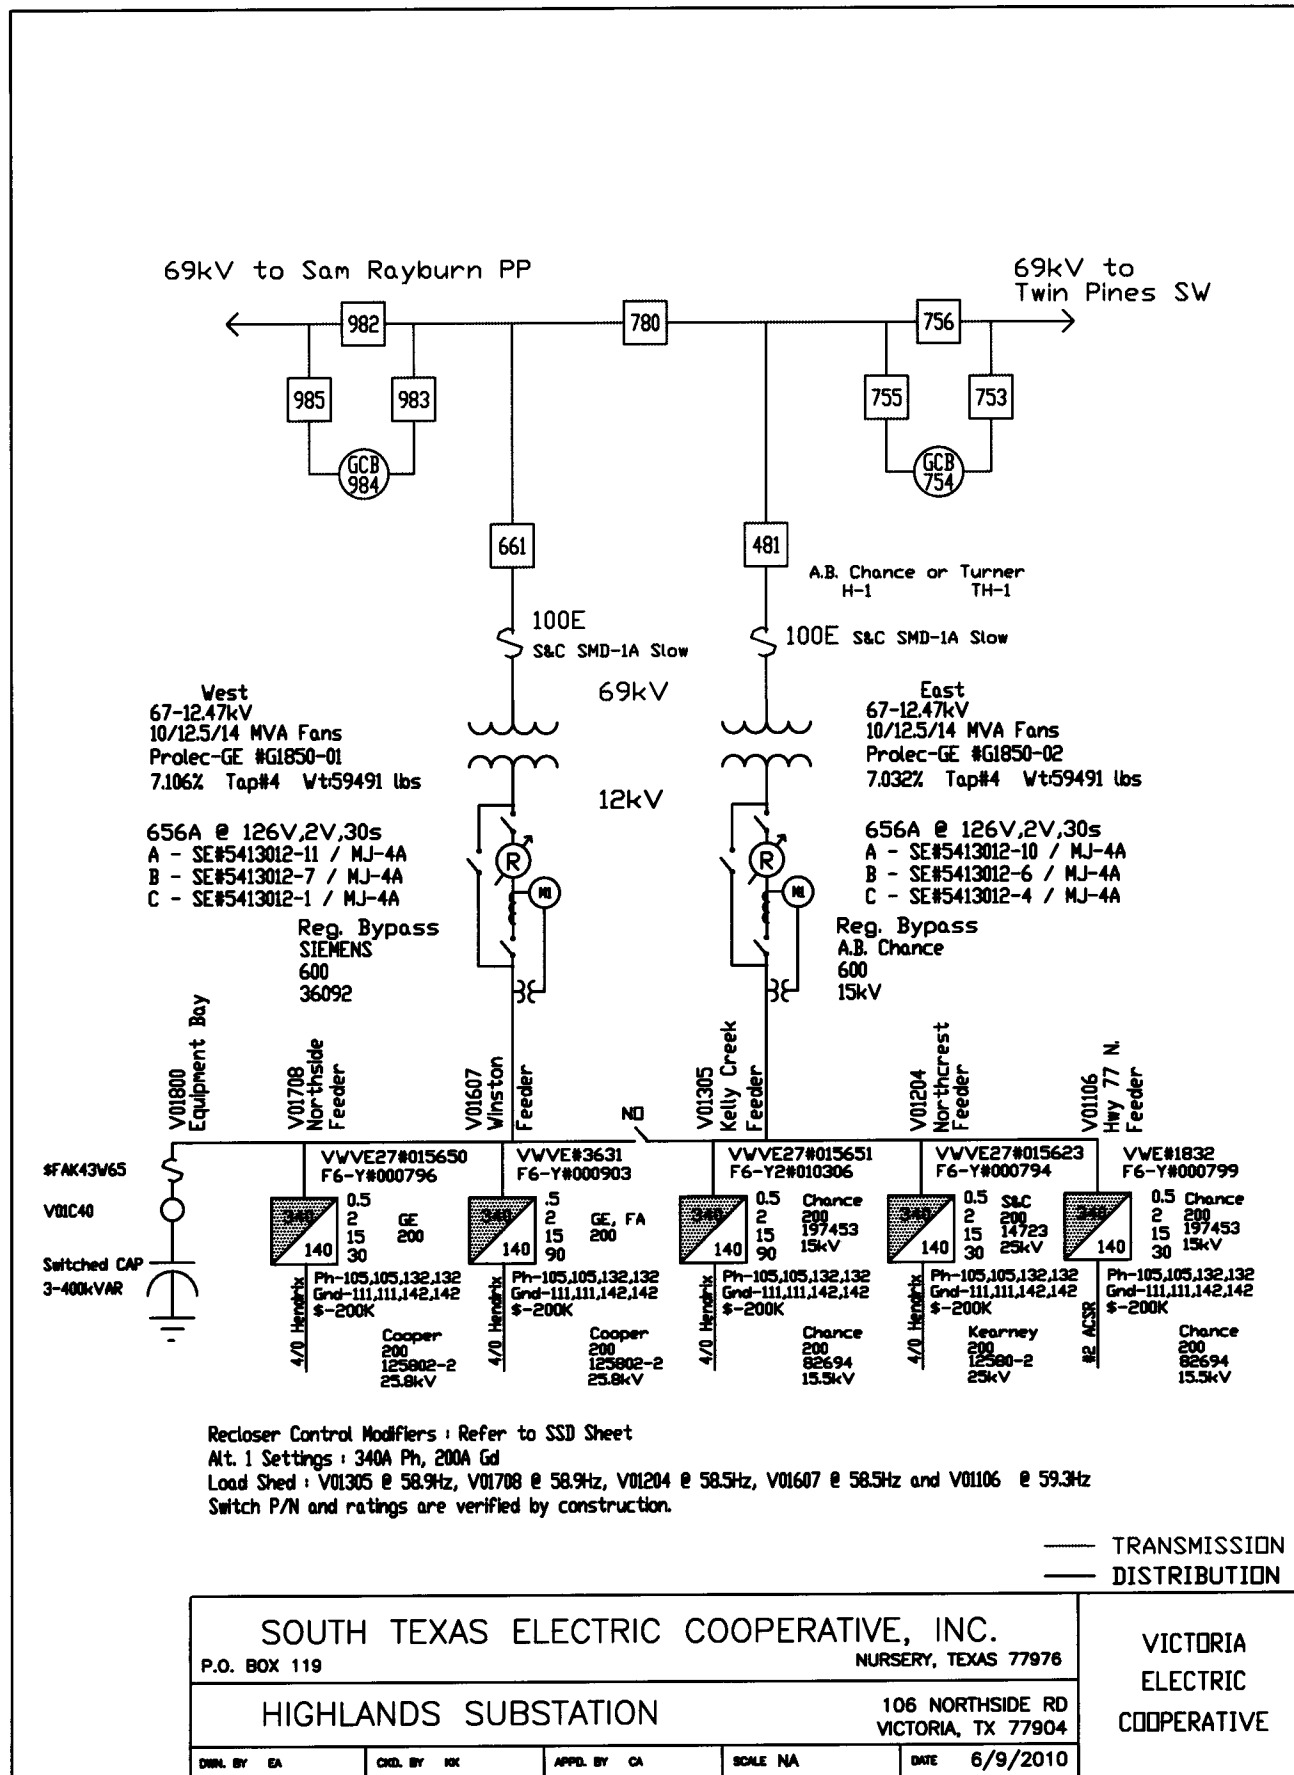



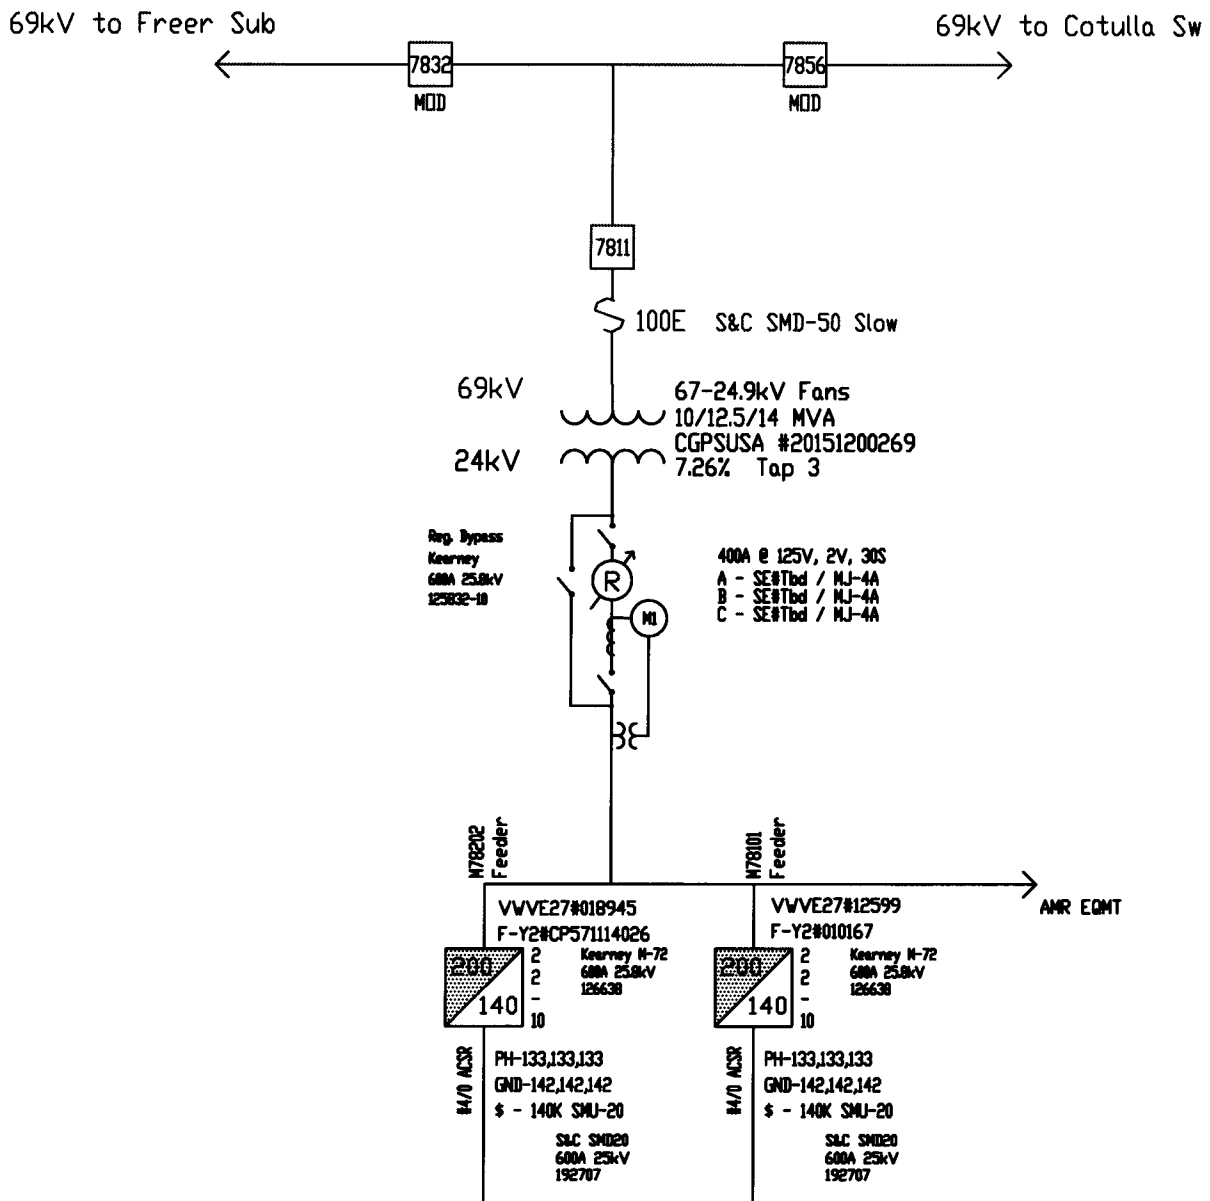


Recloser Control Modifiers : Refer to SSDS
Alt. 1 Settings : 300A Phase, 170A Ground (Temporary Use Only)
Load Shed : None
Switch P/N and ratings are verified by construction.

— TRANSMISSION
— DISTRIBUTION

SOUTH TEXAS ELECTRIC COOPERATIVE, INC.				
P.O. BOX 119		NURSERY, TEXAS 77976		
HOLLAND SUBSTATION			7651 LaBonita Ranch Rd. Artesia Wells, Texas 78001	
DRN. BY EA	CHK. BY NK	APP. BY CA	SCALE NA	DATE 3/22/2013

MEDINA
ELECTRIC
COOPERATIVE

69kV to Hondo Creek SW 69kV to D'Hannis Sub

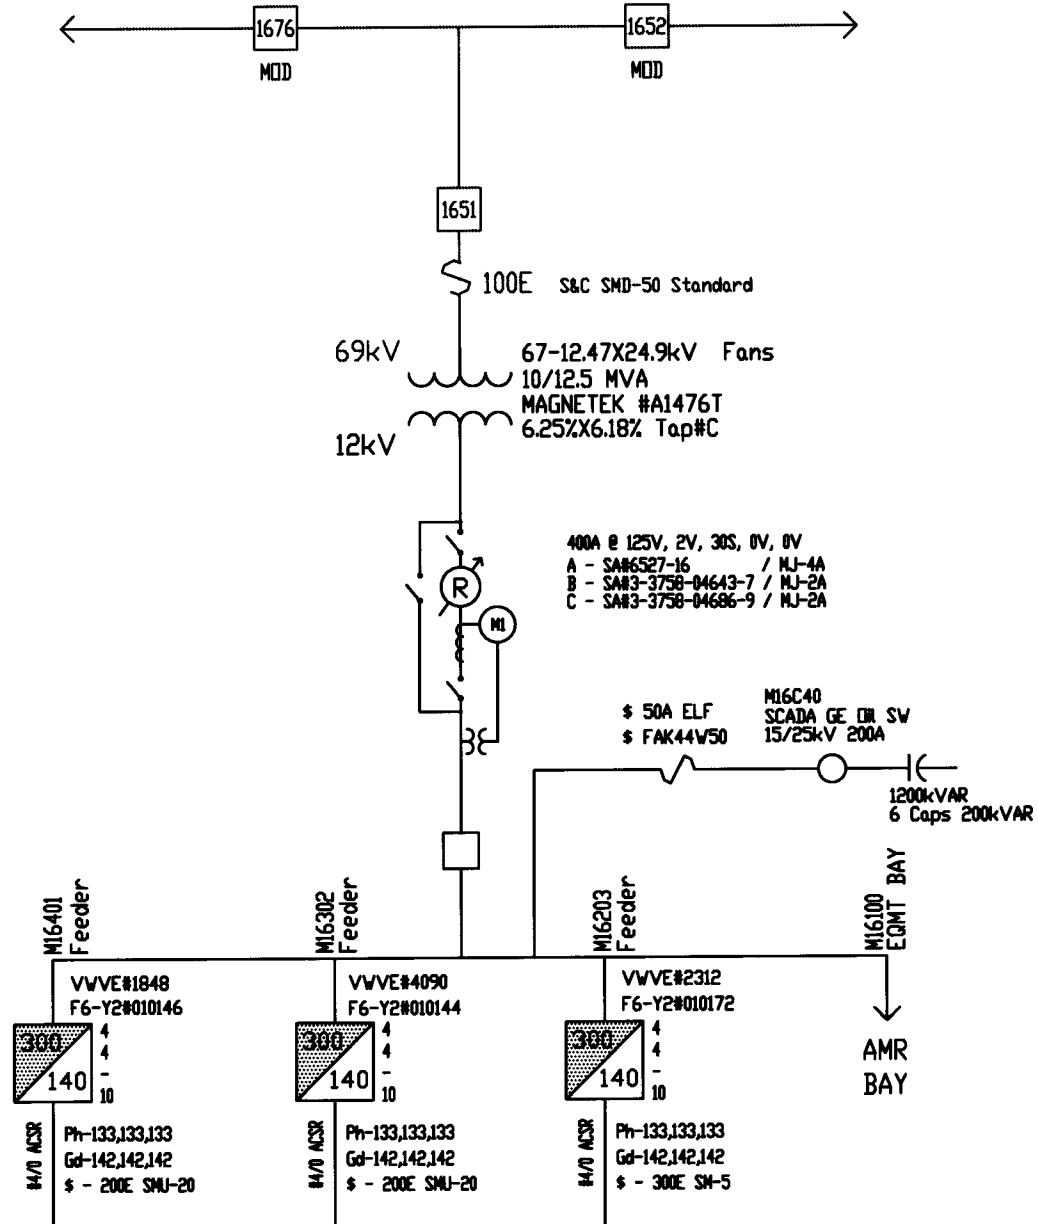


Recloser Control Modifiers : Refer to SSD Sheet
Alt. 1 Settings : 400A Ph, 170A Gd (Temporary use only)
Load Shed : M16203 @ 58.5Hz, M16302 @ 58.9Hz & M16401 @ 58.9Hz
Switch P/N and ratings are verified by construction.

— TRANSMISSION
— DISTRIBUTION

SOUTH TEXAS ELECTRIC COOPERATIVE, INC.				
P.O. BOX 119		NURSERY, TEXAS 77976		
HONDO SUBSTATION			1340 State Hwy 173 S Hondo, TX 78861	
DRAWN BY EA	CHKD BY HK	APPRD BY CA	SCALE NA	DATE 05/24/2012

MEDINA
ELECTRIC
COOPERATIVE

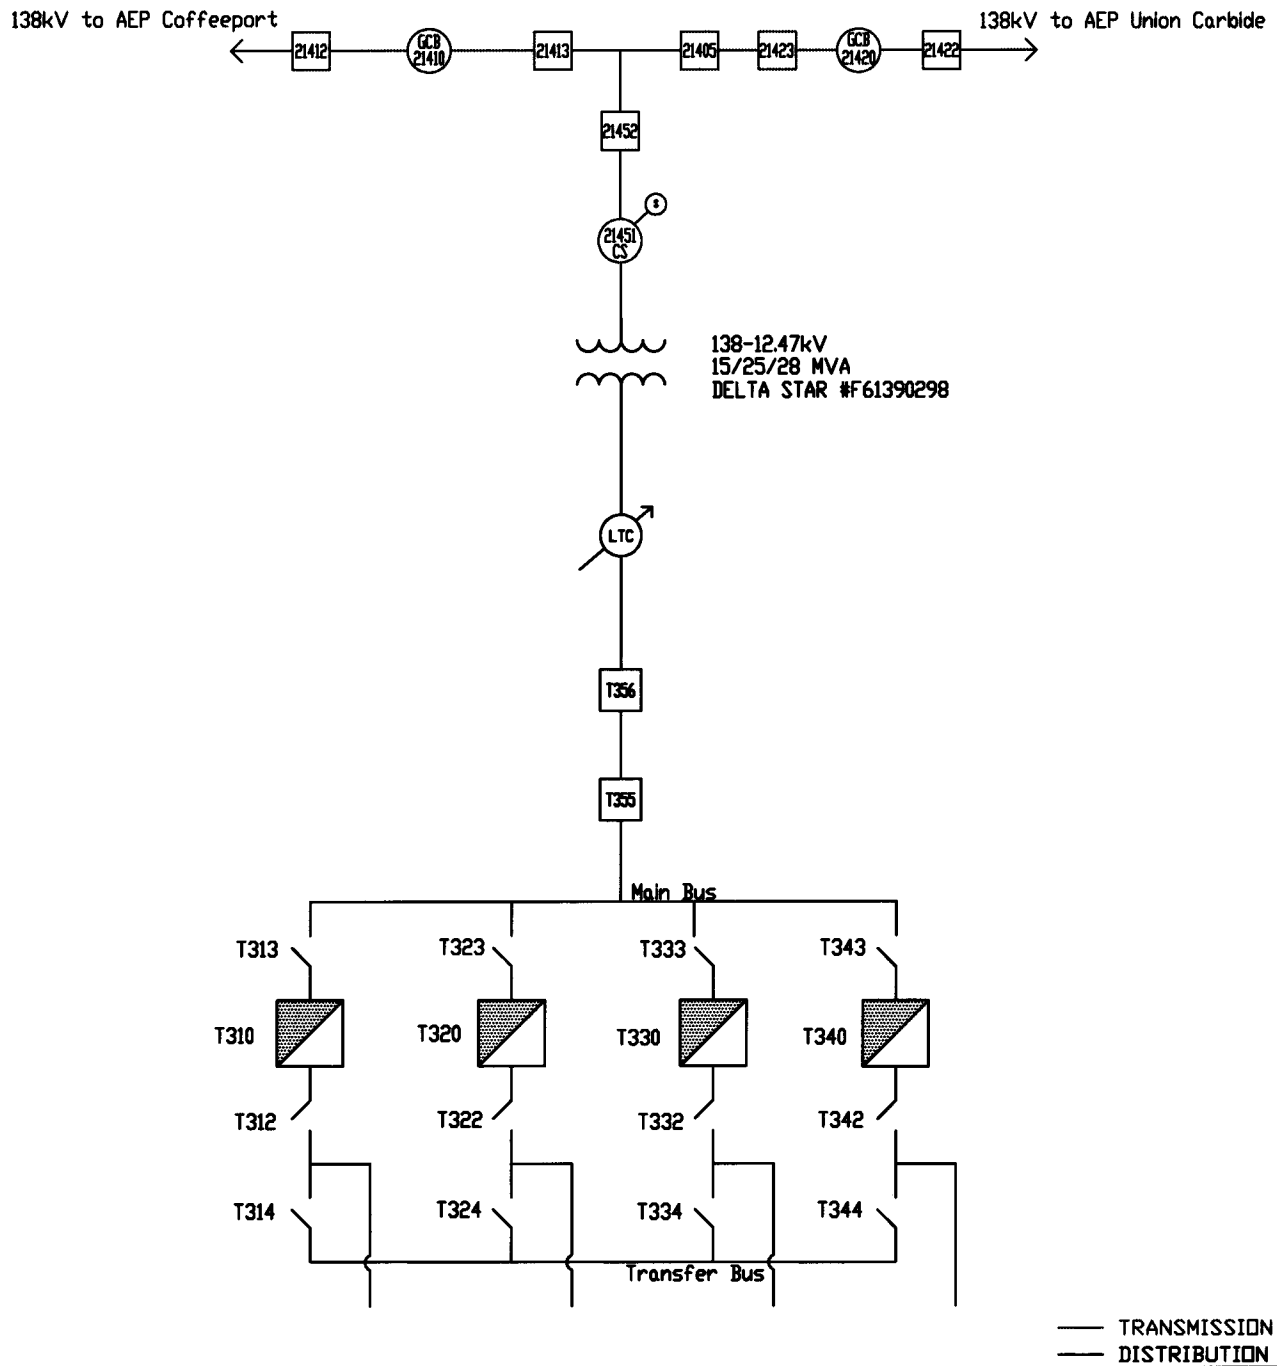

SOUTH TEXAS ELECTRIC COOPERATIVE, INC.				
P.O. BOX 119		NURSERY, TEXAS 77976		
HWY 511 SUBSTATION				
		2955 FM 511 BROWNSVILLE, TX 78520		
DIRL. BY PP	CHK. BY NK	APPD. BY CA	SCALE NA	DATE 5/9/2013

MAGIC VALLEY
ELECTRIC
COOPERATIVE