

twelve months, based upon studies conducted to evaluate their performance. EPA recommendations include performing certain maintenance activities on a monthly basis. These include: (1) Checking for foaming and uneven air distribution in the aeration tank; (2) Checking the air distribution system components, including filters, seals, oil level, pressure (for diffused air systems), vibration or overheating (for mechanical air systems), and any other manufacturer's required or recommended maintenance procedures; (3) Check the clarifier for floating scum, appearance of effluent, location of sludge blanket, and any mechanical equipment in accordance with manufacturer's recommendations; and (4) Check controls, alarms, and controls box.

Results of several studies on aerobic units have consistently indicated that home owners usually have neither the expertise nor the incentive to properly maintain their own treatment units. In order to provide assurance to regulatory authorities that these systems will be properly maintained and operated, and ensure adequate environmental and public health protection, it may be essential to require that home owners enter into maintenance agreements with either a local utility district or private service provider.

XI. Potential Environmental Impacts

Properly designed, installed, and maintained aerobic units can, on the average, produce effluent of the quality indicated on the attached table. In addition, the effluent from aerobic treatment processes tends to have much less odor than does effluent from septic tanks. If environmental conditions for a given site for onsite disposal are such that enhanced total nitrogen and pathogen reduction are needed prior to final land disposal, then adverse environmental impacts might result from the use of these units alone, without an additional pretreatment process(es)

XII. Energy Consumption

Studies show that the energy consumption for aerobic units averages between 2.5 to 10 KWH/day, depending upon the motor design and time of operation.

XIII. Costs

Estimated initial aerobic unit costs, installed, and including septic tank pretreatment unit,	\$6,000
Equipment repair/replacement costs, estimated at \$50/year	\$4.17/month
O&M, with a maintenance contract of \$360/year (est. 12 hrs. @ \$15/hour * 2.0, including taxes, overhead, and profit),	\$30/month
Septage and sludge pumping once annually (it is assumed that the septic tank is pumped simultaneously, as needed, so as to	\$14.58/month

eliminate separate costs for that),	
Energy costs (using 6 KWH/day energy use),	\$14.60/month
20-year NPW (not incl. design & permitting costs),	\$13,573.76

XIV. Aesthetic Considerations

Both septic tanks and aerobic units are typically buried below grade, and usually do not have significant visual impacts on the site. Some minor background sound may be associated with the operation of the aerobic unit. A properly functioning aerobic unit should produce an effluent with far less odor than would be characteristic of septic tank effluent, should that be of concern for the particular site.

XV. State and Local Acceptance


Aerobic units have been used extensively in the State of Texas and elsewhere in the U.S. A list of state-approved aerobic units is attached.

XVI. References



1. U.S. EPA, "Onsite Wastewater Treatment and Disposal Systems Design Manual", EPA/625/I-80-012, October 1980.
2. "Performance of Aerobic Treatment Units", N.J. Hutzler, L.E. Waldorf, and J. Fancy. Distributed by the University of Wisconsin, Madison, SSWMP.
3. Manufacturers' information.

Conceptual Drawing

Aerated Tanks (Aerobic Units)

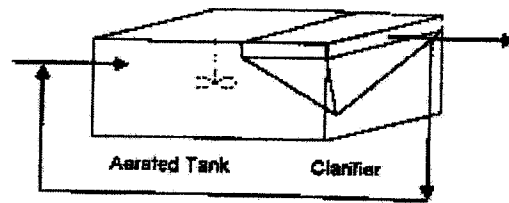

Aerated Unit

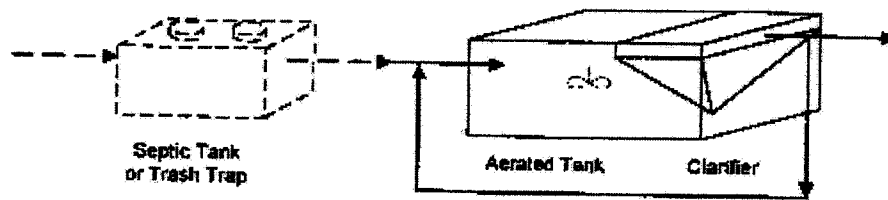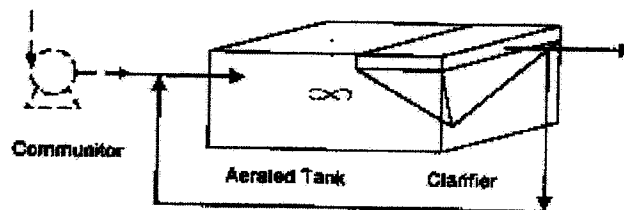
Aerated Unit with Septic Tank or
Trash Trap Pretreatment


Aerated Unit with Comminutor

Effluent Quality of University of Wisconsin Aerobic Units (SSWMP, 1978)

Effluent Quality Parameter	Mean	No. of Samples	95% Confidence Interval	Range of Data
BOD ₅ , (mg/L)	37	112	32-42	0-208

Soluble BOD ₅ , (mg/L)	15	94	12-18	0-120
COD, (mg/L)	108	116	100-116	20-349
TSS, (mg/L)	39	117	33-46	3-252
VSS, (mg/L)	27	118	23-32	1-144
Total N, (mg/L)	36	87	34-38	15-78
NH ₃ - N, (mg/L)	0.9	92	0.1-1.7	0-60
NO ₂ + NO ₃ , (mg/L)	30	95	27-33	0.3-72
Total P, (mg/L)	26	80	22-30	6-140
PO ₄ - P, (mg/L)	21	78	18-24	6-51
Fecal Coliform, (Log no./L)	5	115	4.7-5.3	2.8-7.3
Fecal Streptococci, (Log no./L)	4.3	113	3.9-4.7	2.0-6.3

From: "Performance of Aerobic Treatment Units", N.J. Hutzler, L.E. Waldorf and J. Fancy.
Distributed by the University of Wisconsin - Madison, College of Agricultural and Life Sciences
and College of Engineering, Small Scale Waste Management

Information provided by

Community Environmental Services Inc.

[Back to Fact Sheet Table of Contents](#)



Austin City Connection - The Official Web site of the City of Austin

Contact Us: Send Email or 512-972-0146.

Legal Notices | Privacy Statement

© 1995 City of Austin, Texas. All Rights Reserved.


P.O. Box 1088, Austin, TX 78767 (512) 974-2000

In the State of Texas

§
§
§

County of Cooke

I, Betsy Fleitman, City Secretary for the City of Lindsay, Texas, hereby certify that the attached document is a true and correct copy of a document taken from the official City files of the City of Lindsay, Texas, and is maintained in the regular course of business of the City of Lindsay, Texas. Given under my hand and the seal of office on June 3, 2008.



City Secretary
City of Lindsay, Texas

CITY OF LINDSAY, TEXAS**ORDINANCE NO. 0805-3**

AN ORDINANCE OF THE CITY OF LINDSAY, TEXAS, ESTABLISHING REGULATIONS FOR PROVIDING UTILITY SERVICE OUTSIDE THE CORPORATE LIMITS; PROVIDING FOR A PENALTY NOT TO EXCEED TWO THOUSAND DOLLARS FOR EACH INSTANCE OF VIOLATION OF THE ORDINANCE; AND ESTABLISHING AN EFFECTIVE DATE.

WHEREAS, the City of Lindsay is providing for the supply and distribution of water and the treatment of wastewater, to promote the health, safety, and convenience of its citizens and for the safeguarding of water resources common to all residents of the community and adjacent areas; and,

WHEREAS, for the protection of its citizens, there is a need for establishing regulations for providing utility service outside the corporate limits of the City of Lindsay; now therefore

BE IT ORDAINED BY THE CITY COUNCIL OF THE CITY OF LINDSAY THAT:

SECTION 1: UTILITY SERVICE OUTSIDE CITY

(A) Any person desiring utility services furnished by the city to property which is outside the limits of the city shall, prior to the furnishing of utility service by the city, including water and sewer, file a petition for annexation which shall be in the form prescribed by Texas Local Government Code, Section 43.028 and execute a written agreement providing minimum requirements as follows:

- (1) The furnishing of utility services shall not be construed to compel the city to furnish consumers beyond the corporate limits or to continue such supply once begun.
- (2) The city reserves the right to furnish such customers it deems advisable, and to, at any time, wholly or partially discontinue the utility service.
- (3) Any utility main constructed outside of the corporate limits shall be entirely at the owner's expense and it, as and when incorporated within the city, shall become the property of the city without reimbursement to the owner; and, the city assumes no responsibility or liability for satisfactory service maintenance, pressure or wastage until it acquires sole ownership as a part of its utility system.
- (4) In the event of a relocation or the construction of a permanent line or main, the property owner shall pay the pro rata cost on his or her property at the then applicable rates, and connect his or her service to said permanent line or main.
- (5) Exception: In no event shall sewer service be furnished beyond the corporate limits unless the persons desiring sewer utility service are currently receiving

water from the water utility of the City of Lindsay, Cooke County, Texas, or an agreement consistent with the provisions of this Ordinance to provide city water utility service to the petitioners property has been reached.

(B) The City Council may, if in their judgment it is deemed advisable, render water or sewer services to premises situated outside of the corporate limits of the city upon complying with this section, and in addition, subject to the following conditions and rules.

(1) WATER--application; construction and materials requirements: Any person desiring to use the water shall, when an extension of a main is necessary to render such service, make application to the Public Works Department requesting service, and shall state in such application the exact location of the premises to be served and the purpose for which the water is to be used. Such application shall also contain an agreement signed by the owner of the property to be served which will render the owner liable for all water rates or charges accruing under such service. In the event such application is granted, such person so applying shall, at his or her own cost and expense, lay the kind and character of water pipe prescribed by the city, the minimum size of which shall be six inches (6"), before connection with the city water main; furthermore, any such person shall, at his or her own cost and expense, purchase a meter together with a meter box and necessary fittings, all of which shall be of the kind and character prescribed by the Public Works Department, for the purpose of measuring water so petitioned for by the person, and such water pipe and meter shall be kept at all times in a good condition of repair at the cost of such person using the water and such water connections so made, and all pipes laid by such person shall be in accordance with the regulations governing connections and the laying of water pipes within the city.

(2) SEWER--application; construction and materials requirements: Subject to Section 1, (A), (5) above, any person desiring sewer service shall, when an extension of a main is necessary to render such service, make application to the Public Works Department, requesting service, and shall state in such application the exact location of the premises to be served and the purpose for which wastewater treatment is required. Such application shall also contain an agreement signed by the owner of the property to be served which will render the owner liable for all sewer rates or charges accruing under such service. In the event such application is granted, such person so applying shall, at his or her own cost and expense, engineer the proposed sewers and provide detailed plans and specifications for review by the city's engineer. Furthermore, any such person shall, at his or her own cost and expense, construct the sewer pipe, manholes, or lift station, and related appurtenances, all of which shall be of the kind and character prescribed by the Public Works Department, for the purpose of wastewater treatment so petitioned for by the person, and such sewer collection system shall be kept at all times in a good condition of repair at the cost of such person using the collection system so made, and all materials laid by such person shall be in accordance with the regulations governing the construction of sewer mains within the city.

State Law reference-Authority to operate utilities and prescribe rates, V.T.C.A., Local Government Code, § 402.017; City has exclusive jurisdiction over all water and sewer utility rates, operations, and services provided by a water and sewer utility, V.T.C.A., Water Code, § 13.042; Authority to control and regulate waste discharges and require pretreatment, V.T.C.A., Water Code, § 26.176 and § 26.177.

- (2) **Written Permission to Connect:** When such extension of water or sewer mains or service pipes have been installed outside of the corporate limits and application for additional service is made to connect with such extension or service pipe, such applicant shall present with his or her application written permission to connect with such extension of the main or service, signed by the original applicant who paid the original cost thereof or by his or her assigns.
- (3) **City Not Liable For Maintenance of Pipe; Discontinuance:** The city shall not be liable for the maintenance of any water or sewer main or service pipe lying outside of the corporate limits of the city and the right is reserved to discontinue water or sewer service through any such main or service line which causes a waste or leakage of water or sewer.
- (4) **City Not Liable For Defective Condition of Pipe or Ditches:** The city shall in no case be liable on account of any defective condition in any water or sewer pipe, or in any trench or ditch dug for the purpose of laying water or sewer pipe by any person desiring to make connection with any of the city's mains, and it shall always be expressly understood that the person using said water or sewer shall, at all times, keep the pipes, related appurtenances, and other connections in good condition of repair, and shall be liable for all damages occasioned to any person or property by reason of any defective condition arising through the want of repair, or otherwise, to the water or sewer pipe or the ditches in which the same are laid.
- (5) **City May Revoke Permission:** It is further understood that in no event will the city, under the terms of this section, be obligated to continue to furnish water or sewer service to any person outside of the corporate limits, but may revoke the permission at any time without notice.
- (6) **Regulations:** All such service outside the corporate limits shall, in all respects not otherwise provided herein, be subject to the same regulations for service and the manner of paying the compensation, as provided for service inside of the corporate limits.
- (7) **Placing of Meters:** All meters serving premises outside of the corporate limits shall be set inside (or as near as practicable) the corporate limits, and the city shall not be responsible for the condition of any mains, pipes or services outside of the corporate limits or beyond the meter serving such premises.
- (8) **If approval is granted to locate the meter beyond the corporate limits, an in-line valve shall be installed at the corporate limits in its place.**

SECTION 2: PENALTY PROVISION

Any person, firm or corporation violating any provision of this Ordinance shall be deemed guilty of a misdemeanor and upon final conviction thereof fined in an amount not exceeding two thousand dollars (\$2,000.00) for violations of all provisions that govern fire safety, public health, and sanitation, and not exceeding five hundred dollars (\$500.00) for all other violations, provided, however, that no penalty shall be greater or less than the penalty provided for the same or similar offense under the laws of the State of Texas. Each and every day any such violation continues shall constitute a separate offense punishable hereunder.

SECTION 3: REPEAL CLAUSE

All parts of any ordinance in conflict with the provisions of this ordinance are to the extent of such conflict hereby repealed.

SECTION 4: SAVINGS CLAUSE

If any provision of this ordinance shall be held to be invalid or unconstitutional, the remainder of such ordinance shall continue in full force and effect the same as if such invalid or unconstitutional provision had never been a part hereof.


SECTION 5: EFFECTIVE DATE

This ordinance is declared to be an emergency measure necessary for the immediate preservation of the peace, health, safety and general welfare of the people of this municipality and shall be effective upon the posting and/or publication of its caption as required by law and the City Secretary is hereby directed to implement such posting and/or publication.

PASSED AND APPROVED by the City Council of the City of Lindsay, Texas, on this the 8 day of August 2005.

Ayes 4
Nays 0
Abstentions 0

APPROVED:

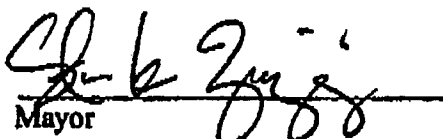
Mayor

ATTEST:


City Secretary

<p>City of Lindsay, Texas CCN Application SOAH Docket No. 582-06-2023 TCEQ Docket No. 2006-0272-UCR Water and Sewer Utility, Debt - Equity Ratio</p>
--

Line No.	Col (A)	Col (B)	Col (C)
FY 2004			

	Description	Amount	Notes
1	Debt		
2	Current Lease Payable	\$ 39,935	
3	Less: Discount on Lease Payable	(19,935)	
4	Lease Payable	392,297	
5	Less: Discount on Lease Payable	(110,123)	
6	Subtotal	\$ 302,174	
7	Equity		
8	Invested in Capital Assets, net of related debt	\$ 223,621	
9	Unrestricted	366,133	
10	Subtotal	\$ 589,754	
11	Debt/Equity Ratio	0.51	Line 6 / Line 10
12	Capital Structure		
13	Debt	33.9%	Line 6 / (Line 6 + Line 10)
14	Equity	66.1%	Line 10 / (Line 6 + Line 10)

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Water and Sewer Utility, Debt - Equity Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2005			
	Description	Amount	Notes
1	Debt		
2	Current Lease Payable	\$ 38,697	
3	Less: Discount on Lease Payable	(18,697)	
4	Lease Payable	353,600	
5	Less: Discount on Lease Payable	(91,426)	
6	Subtotal	\$ 282,174	
7	Equity		
8	Invested in Capital Assets, net of related debt	\$ 276,640	
9	Unrestricted	393,360	
10	Subtotal	\$ 670,000	
11	Debt/Equity Ratio	0.42	Line 6 / Line 10
12	Capital Structure		
13	Debt	29.6%	Line 6 / (Line 6 + Line 10)
14	Equity	70.4%	Line 10 / (Line 6 + Line 10)

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Water and Sewer Utility, Debt - Equity Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2006			
	Description	Amount	Notes
1	Debt		
2	Current Lease Payable	\$ 39,211	
3	Less: Discount on Lease Payable	(17,544)	
4	Lease Payable	317,553	
5	Less: Discount on Lease Payable	(75,379)	
6	Subtotal	\$ 263,841	
7	Equity		
8	Invested in Capital Assets, net of related debt	\$ 271,644	
9	Unrestricted	499,014	
10	Subtotal	\$ 770,658	
11	Debt/Equity Ratio	0.34	Line 6 / Line 10
12	Capital Structure		
13	Debt	25.5%	Line 6 / (Line 6 + Line 10)
14	Equity	74.5%	Line 10 / (Line 6 + Line 10)

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Water and Sewer Utility, Debt - Equity Ratio

Line No.	Col (A)	Col (B)	Col (C)
----------	---------	---------	---------

FY 2007

	Description	Amount	Notes
1	Debt		
2	Current Lease Payable	\$ 41,160	
3	Less: Discount on Lease Payable	(16,160)	
4	Lease Payable	276,394	
5	Less: Discount on Lease Payable	(57,553)	
6	Subtotal	\$ 243,841	
7	Equity		
8	Invested in Capital Assets, net of related debt	\$ 270,064	
9	Unrestricted	609,328	
10	Subtotal	\$ 879,392	
11	Debt/Equity Ratio	0.28	Line 6 / Line 10
12	Capital Structure		
13	Debt	21.7%	Line 6 / (Line 6 + Line 10)
14	Equity	78.3%	Line 10 / (Line 6 + Line 10)

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Governmental Funds, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2004			
	<u>Description</u>	<u>Amount</u>	<u>Notes</u>
1	Current Assets:		
2	Cash and Cash Equivalents	\$ 14,793	
3	Certificates of Deposit	648,000	
4	Receivables:		
5	Property Taxes (Net)	67,428	
6	Sales Tax	5,881	
7	Due from State	6,243	
8	Accrued Interest	840	
9	Subtotal	\$ 743,185	
10	Current Liabilities:		
11	Accounts Payable	\$ 1,818	
12	Accrued Payroll Taxes	1,014	
13	Deferred Revenue	58,297	
14	Subtotal	\$ 61,129	
15	Working Capital Ratio	12.16	Line 9 / Line 14

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Governmental Funds, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2005			
	<u>Description</u>	<u>Amount</u>	<u>Notes</u>
1	Current Assets:		
2	Cash and Cash Equivalents	\$ 43,362	
3	Certificates of Deposit	619,000	
4	Receivables:		
5	Property Taxes (Net)	80,648	
6	Sales Tax	8,885	
7	Accrued Interest	1,046	
8	Subtotal	\$ 752,941	
9	Current Liabilities:		
10	Accounts Payable	\$ 1,628	
11	Accrued Payroll Taxes	1,119	
12	Deferred Revenue	46,925	
13	Subtotal	\$ 49,672	
14	Working Capital Ratio	15.16	Line 8 / Line 13

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Governmental Funds, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2006			
	Description	Amount	Notes
1	Current Assets:		
2	Cash and Cash Equivalents	\$ 110,106	
3	Certificates of Deposit	619,000	
4	Receivables:		
5	Property Taxes (Net)	91,748	
6	Liquor and motel taxes	5,552	
7	Sales Tax	5,797	
8	Accrued Interest	1,047	
9	Subtotal	\$ 833,250	
10	Current Liabilities:		
11	Accounts Payable	\$ 51,222	
12	Accrued Payroll Taxes	2,594	
13	Deferred Revenue	84,617	
14	Subtotal	\$ 138,433	
15	Working Capital Ratio	6.02	Line 9 / Line 14

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Governmental Funds, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2007			
	Description	Amount	Notes
1	Current Assets:		
2	Cash and Cash Equivalents	\$ 86,839	
3	Certificates of Deposit	666,754	
4	Receivables:		
5	Property Taxes (Net)	102,460	
6	Liquor and motel taxes	2,827	
7	Sales Tax	8,174	
8	Accrued Interest	1,047	
9	Subtotal	\$ 868,101	
10	Current Liabilities:		
11	Accounts Payable	\$ 2,971	
12	Accrued Payroll Taxes	1,440	
13	Deferred Revenue	92,640	
14	Subtotal	\$ 97,051	
15	Working Capital Ratio	8.94	Line 9 / Line 14

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Water and Sewer Utility, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
----------	---------	---------	---------

FY 2004

	<u>Description</u>	<u>Amount</u>	<u>Notes</u>
1	Current Assets		
2	Cash and Cash Equivalents	\$ 70,162	
3	Certificates of Deposit	297,000	
4	Accounts Receivable	8,048	
5	Accrued Interest	426	
6	Subtotal	\$ 375,636	
7	Current Liabilities		
8	Accounts Payable	\$ 9,503	
9	Customer Deposits	11,200	
10	Current Lease Payable	39,935	
11	Less: Discount on Lease Payable	(19,935)	
12	Subtotal	\$ 40,703	
13	Working Capital Ratio	9.23	Line 6 / Line 12

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Water and Sewer Utility, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2005			

	Description	Amount	Notes
1	Current Assets		
2	Cash and Cash Equivalents	\$ 32,088	
3	Certificates of Deposit	357,000	
4	Accounts Receivable	11,369	
5	Accrued Interest	760	
6	Subtotal	\$ 401,217	
7	Current Liabilities		
8	Accounts Payable	\$ 7,857	
9	Customer Deposits	12,430	
10	Current Lease Payable	38,697	
11	Less: Discount on Lease Payable	(18,697)	
12	Subtotal	\$ 40,287	
13	Working Capital Ratio	9.96	Line 6 / Line 12

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Water and Sewer Utility, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
FY 2006			

	Description	Amount	Notes
1	Current Assets		
2	Cash and Cash Equivalents	\$ 77,387	
3	Certificates of Deposit	414,496	
4	Accounts Receivable	13,162	
5	Subtotal	\$ 505,045	
6	Current Liabilities		
7	Accounts Payable	\$ 6,031	
8	Customer Deposits	14,885	
9	Current Lease Payable	39,211	
10	Less: Discount on Lease Payable	(17,544)	
11	Subtotal	\$ 42,583	
12	Working Capital Ratio	11.86	Line 5 / Line 11

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Water and Sewer Utility, Working Capital Ratio

Line No.	Col (A)	Col (B)	Col (C)
----------	---------	---------	---------

FY 2007

	<u>Description</u>	<u>Amount</u>	<u>Notes</u>
1	Current Assets		
2	Cash and Cash Equivalents	\$ 123,756	
3	Certificates of Deposit	487,286	
4	Accounts Receivable	12,657	
5	Subtotal	\$ 623,699	
6	Current Liabilities		
7	Accounts Payable	\$ 14,296	
8	Customer Deposits	16,280	
9	Current Lease Payable	41,160	
10	Less: Discount on Lease Payable	(16,160)	
11	Subtotal	\$ 55,576	
12	Working Capital Ratio	11.22	Line 5 / Line 11

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Residential Water Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
1	Lakewood Village	3.75	Dickens	-
2	Leakey	6.45	Lakewood Village	3.00
3	Surfside Beach	7.50	Leakey	9.70
4	Shenandoah	9.00	Shenandoah	11.00
5	Rocksprings	10.00	Wallis	11.25
6	White Deer	10.75	Quintana	12.50
7	Rankin	11.13	Surfside Beach	16.25
8	Wheeler	11.20	Centerville	16.76
9	Wallis	11.25	Wickett	17.50
10	Claude	11.50	Texhoma	17.60
11	McLean	11.50	McLean	17.75
12	Texhoma	11.60	Meadow	19.50
13	Meadow	12.00	La Vernia	19.86
14	McCamey	12.50	Camp Wood	20.00
15	Wickett	12.50	Opdyke West	20.00
16	Morgan's Point	12.50	Wheeler	20.45
17	Quintana	12.50	White Deer	20.75
18	Oyster Creek	13.20	Miami	20.80
19	Anton	13.20	Whiteface	21.00
20	Whiteface	13.50	Anton	21.20
21	Miami	13.65	Bovina	21.20
22	Camp Wood	13.75	Follett	22.00
23	Higgins	14.75	Oyster Creek	22.20
24	Richland Springs	14.75	Morgan's Point	22.50
25	Eldorado	15.00	Earth	23.00
26	Centerville	15.01	Rankin	23.13
27	Bovina	15.20	Higgins	23.50
28	Plains	15.25	Richland Springs	23.50
29	Groom	15.40	Sundown	23.80
30	Earth	15.50	Claude	24.00
31	Sundown	15.80	Plains	24.00
32	Meadowlakes	15.90	McCamey	24.25
33	New Waverly	16.00	Darrouzett	24.34
34	Lefors	16.00	Groom	24.40
35	Goldsmith	16.00	Meadowlakes	24.40
36	Palm Valley	16.35	Sabinal	24.70
37	Sudan	16.35	Carmin	25.50
38	Sabinal	16.45	New Waverly	26.00
39	Vega	16.75	Lexington	26.10
40	Iraan	16.90	Muenster	26.50
41	Petersburg	17.00	Sudan	27.00
42	Hillcrest Village	17.00	Petersburg	27.00
43	Point Venture	17.00	Beasley	27.00
44	Beasley	17.00	Timpson	27.10
45	Follett	17.00	Turkey	27.10

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Residential Water Rates⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
46	Goldthwaite	17.07	Rocksprings	27.50
47	Saint Jo	17.50	Eldorado	27.50
48	Lexington	17.60	Gustine	27.50
49	Timpson	17.60	Clarendon	27.90
50	Darrouzett	17.74	Vega	28.00
51	Emory	18.00	Tenaha	28.00
52	Lindsay ⁽²⁾	18.00	Palm Valley	28.10
53	Carmine	18.00	Iraan	28.40
54	Ore City	18.19	Hedley	28.50
55	Pineland	18.60	Lefors	29.00
56	Menard	18.75	Lindsay ⁽²⁾	29.00
57	Charlotte	18.90	Normangee	29.00
58	Muenster	19.00	Mertzon	29.00
59	Normangee	19.00	Lake Tanglewood	29.04
60	Turkey	19.00	Skellytown	29.10
61	Skellytown	19.10	Pineland	29.35
62	La Vernia	19.86	Hillcrest Village	29.50
63	Woodbranch Village	20.00	Menard	30.00
64	Stockdale	20.00	Stockdale	30.00
65	Sterling City	20.00	Bronte	30.00
66	Jewett	20.00	Charlotte	30.15
67	Happy	20.00	Three Rivers	30.20
68	Gustine	20.00	Lakeside	30.45
69	Opdyke West	20.00	Goldsmith	31.00
70	Lake Tanglewood	20.20	Lorenzo	31.00
71	Tenaha	20.50	Omaha	31.85
72	Fulshear	20.50	Liverpool	32.00
73	DeKalb	20.66	Ore City	32.03
74	Three Rivers	20.70	Orange Grove	32.25
75	Omaha	20.75	Sterling City	32.50
76	Bremond	20.75	Jewett	32.50
77	Clarendon	20.90	Happy	32.50
78	Celeste	20.90	Runge	32.60
79	Woodsboro	21.00	Roaring Springs	32.75
80	Lorenzo	21.00	Point Venture	33.00
81	La Grulla	21.00	Woodbranch Village	33.00
82	Mertzon	21.00	Fulshear	33.00
83	Hedley	21.00	Stratford	33.00
84	Maud	21.18	Blum	33.00
85	Honey Grove	21.55	Honey Grove	33.05
86	Runge	21.60	Burton	33.20
87	Stratford	21.75	La Grulla	33.50
88	Collinsville	22.00	Goldthwaite	33.75
89	Robert Lee	22.20	Arp	34.10

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Residential Water Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
90	Corrigan	22.25	Sunray	34.25
91	Moulton	22.25	Big Sandy	34.50
92	Bronte	22.50	Moulton	34.75
93	Winona	22.50	Hemphill	34.99
94	East Mountain	22.55	Woodsboro	35.00
95	Roaring Springs	22.75	Winona	35.00
96	Lyford	23.00	Amherst	35.50
97	Shoreacres	23.00	Melvin	35.50
98	Bogata	23.00	Texline	35.60
99	Blum	23.00	Corrigan	36.00
100	Lakeside	23.10	Zavalla	36.00
101	Texline	23.10	Silverton	36.00
102	Farwell	23.15	Ector	36.00
103	Sunray	23.25	Matador	36.50
104	Naples	23.25	DeKalb	36.66
105	Big Sandy	23.25	Annona	36.80
106	New Summerfield	23.25	Bremond	37.00
107	Knox City	23.35	Collinsville	37.00
108	Marietta	23.60	New Summerfield	37.00
109	Roscoe	23.64	Stinnett	37.00
110	Oglesby	23.75	Gunter	37.13
111	Log Cabin	23.90	Saint Jo	37.50
112	Rule	24.00	Tioga	37.50
113	Zavalla	24.00	Eustace	37.50
114	Matador	24.00	Celeste	37.65
115	Dodd City	24.00	Lyford	38.00
116	Frankston	24.25	Naples	38.25
117	Gunter	24.28	Redwater	38.50
118	Stinnett	24.50	Gordon	38.72
119	Bandera	24.75	Robert Lee	38.95
120	Rochester	24.75	East Mountain	39.05
121	Orange Grove	24.80	Farwell	39.15
122	Burton	24.80	Splendora	39.25
123	Rosebud	24.85	Marietta	39.40
124	Tioga	25.00	Sour Lake	39.45
125	Johnson City	25.13	Kress	39.50
126	Arp	25.35	Flatonia	39.50
127	Splendora	25.50	San Leanna	39.50
128	Hemphill	25.59	Knox City	39.60
129	Ganado	25.90	Josephine	39.65
130	Redwater	26.00	Ganado	39.90
131	Kress	26.00	Emory	40.00
132	Silverton	26.00	Roscoe	40.09
133	Tatum	26.15	Colmesneil	40.50
134	Annona	26.30	Browndell	40.75

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Residential Water Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
135	Aspermont	26.50	Somerville	41.00
136	Chillicothe	26.50	Ladonia	41.00
137	Avinger	26.50	Cresson	41.00
138	Gorman	26.63	La Ward	41.00
139	Josephine	26.80	Goree	41.30
140	Pleasant Valley	26.80	Rosebud	41.35
141	Buffalo	27.00	Dodd City	41.50
142	Grapeland	27.00	Frankston	41.75
143	Flatonia	27.00	Driscoll	42.10
144	Savoy	27.00	Log Cabin	42.25
145	Eustace	27.00	Maud	42.36
146	Ector	27.00	Ransom Canyon	42.63
147	Liverpool	27.00	Rochester	42.75
148	Cumby	27.05	Strawn	42.75
149	Sour Lake	27.10	Bogata	43.00
150	Somerville	27.25	Brownsboro	43.00
151	Blanket	27.50	Troy	43.00
152	Queen City	27.90	Iredell	43.00
153	Brownsboro	28.00	Tatum	43.65
154	Amherst	28.00	Rule	44.00
155	San Leanna	28.00	Chillicothe	44.00
156	Reklaw	28.00	Cut and Shoot	44.00
157	Melvin	28.00	Crowell	44.00
158	Troy	28.50	Scotland	44.20
159	Ladonia	28.50	Grapeland	44.50
160	Balmorhea	28.50	Johnson City	44.63
161	Austwell	28.50	Bandera	44.75
162	Cut and Shoot	29.00	Crosbyton	45.00
163	Rising Star	29.00	Gorman	45.38
164	Strawn	29.00	Walnut Springs	45.50
165	Jamaica Beach	29.50	Cumby	45.52
166	Browndell	29.50	Rogers	45.70
167	Gordon	29.58	Trenton	45.72
168	Coahoma	29.90	Cross Plains	46.50
169	Crosbyton	30.00	Smyer	46.50
170	Cross Plains	30.00	Buffalo	47.00
171	Colmesneil	30.00	Queen City	47.00
172	Tehuacana	30.00	Spur	47.40
173	Ransom Canyon	30.38	Elmendorf	47.46
174	Walnut Springs	30.50	Avinger	47.75
175	Ponder	30.65	Marion	47.75
176	Trenton	30.82	Ponder	48.40
177	Cresson	31.00	Aspermont	49.00
178	Barstow	31.00	Bruceville-Eddy	49.00
179	La Ward	31.00	Alba	49.50

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Residential Water Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
180	Scotland	31.20	Tom Bean	49.50
181	New Deal	31.40	Thorndale	49.60
182	Lakeside City	31.50	Austwell	49.75
183	Driscoll	31.50	Savoy	49.85
184	Edgewood	31.76	Lakeside City	50.25
185	Goree	31.80	New Deal	50.40
186	Holliday	32.00	Shoreacres	51.00
187	Alba	32.00	Barstow	51.00
188	Sadler	32.00	Lott	51.00
189	Dickens	32.00	Bells	51.35
190	Thrall	32.15	Jamaica Beach	52.00
191	Spur	32.40	Goodrich	52.00
192	Hico	32.50	Thrall	52.40
193	Buffalo Gap	32.50	Riesel	52.50
194	Callisburg	32.50	Trinidad	52.75
195	Gary	32.91	Godley	52.90
196	Marion	33.00	Reklaw	53.00
197	Rio Vista	33.00	Rio Vista	53.00
198	Iredell	33.00	Buckholts	53.00
199	Caddo Mills	33.25	Balmorhea	53.50
200	Rogers	33.30	Pleasant Valley	53.60
201	Wells	33.50	Rising Star	54.00
202	Bayside	33.50	Gary	54.27
203	Streetman	33.50	Runaway Bay	54.34
204	Briarcliff	33.75	Holliday	54.50
205	Bruceville-Eddy	34.00	Streetman	54.50
206	Trinidad	34.00	Crawford	54.50
207	Crowell	34.00	Tehuacana	55.00
208	Tom Bean	34.50	Callisburg	55.00
209	Thorndale	34.85	Bayside	55.50
210	Quinlan	35.00	Wells	56.00
211	Seadrift	35.00	Star Harbor	56.00
212	Clarksville City	35.00	Clarksville City	56.25
213	Tolar	35.00	Caddo Mills	56.45
214	Buckholts	35.00	Ingleside on the Bay	56.68
215	Wolfe City	35.20	West Tawakoni	57.20
216	Alvord	35.32	Edgewood	57.31
217	Huxley	35.50	Dawson	57.40
218	Bells	35.60	Hico	57.50
219	Groveton	36.00	Westlake	57.50
220	Lott	36.00	Huxley	58.00
221	Elmendorf	36.24	Marshall Creek	58.50
222	Riesel	36.25	Sadler	59.00
223	Godley	36.40	Blanket	59.35
224	Smyer	36.50	Quinlan	60.00

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Residential Water Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
225	Goodrich	37.00	Seadrift	60.00
226	Elkhart	37.20	Tolar	60.00
227	Archer City	37.50	Groveton	60.25
228	Carbon	37.60	Rhome	61.00
229	Boyd	37.80	Elkhart	61.20
230	Rhome	37.82	Coahoma	61.40
231	Bangs	38.00	Bangs	62.00
232	Dawson	38.70	Berryville	62.00
233	West Tawakoni	38.95	Wolfe City	62.20
234	Pelican Bay	39.00	Oglesby	62.50
235	Newcastle	39.35	Tye	62.50
236	Runaway Bay	39.93	Meridian	62.50
237	Indian Lake	40.00	Hudson Oaks	62.50
238	Tye	40.25	Alvord	63.42
239	Crawford	40.75	Moody	63.50
240	Marshall Creek	41.50	Hubbard	64.80
241	Hubbard	41.80	Buffalo Gap	65.00
242	Meridian	42.50	Milford	65.00
243	Moody	43.00	Newcastle	65.48
244	Milford	43.00	East Tawakoni	66.45
245	Star Harbor	43.00	Lone Oak	67.19
246	Maypearl	43.50	Carbon	68.60
247	Berryville	44.50	Maypearl	71.00
248	Frost	44.56	Archer City	72.50
249	Graford	45.00	Boyd	72.80
250	Westlake	45.00	Mount Calm	73.00
251	Lone Oak	45.29	Lueders	74.30
252	Lueders	45.30	Briarcliff	76.25
253	Kerens	46.50	Wortham	77.47
254	Hudson Oaks	46.75	Pelican Bay	78.00
255	Blanco	47.05	Lipan	78.00
256	Lipan	48.00	Blanco	78.55
257	East Tawakoni	48.20	Kerens	79.00
258	Ingleside on the Bay	52.43	Graford	80.00
259	Richland	52.43	Coolidge	80.75
260	Roby	53.20	Richland	82.58
261	Wortham	53.22	Roby	86.40
262	Mount Calm	55.50	Bryson	88.00
263	Bryson	58.00	Frost	88.15
264	Coolidge	58.25	Indian Lake	94.00
265	Dell City	80.65	Dell City	97.45

Notes:

(1) Source: TML 2007 Water and Sewer Rate Survey

(2) Rates Calculated assuming a 3/4" meter, based upon rate schedule effective 10/1/2007

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Residential Wastewater Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
1	Somerset	0.00	Tuscola	0.00
2	Lakewood Village	3.75	Marshall Creek	0.00
3	Wheeler	4.00	Texhoma	0.00
4	Silverton	4.50	Iredell	0.00
5	Rule	4.80	Burton	0.00
6	Moran	5.50	Dickens	0.00
7	White Deer	5.60	Lakewood Village	3.00
8	Roby	6.00	Wheeler	4.00
9	Turkey	6.00	Silverton	4.50
10	Camp Wood	6.50	Rule	4.80
11	Goree	6.70	Moran	5.50
12	Iraan	7.00	Roby	6.00
13	Kress	7.00	Turkey	6.00
14	Wickett	7.00	White Deer	6.60
15	Bronte	7.50	Kress	7.00
16	Morgan's Point	7.80	Wickett	7.00
17	Claude	8.00	Goree	7.20
18	Coahoma	8.00	Bronte	7.50
19	Dickens	8.00	Iraan	7.75
20	Groom	8.00	Camp Wood	7.78
21	Hedley	8.00	McCamey	8.00
22	Matador	8.00	Claude	8.00
23	McCamey	8.00	Coahoma	8.00
24	Meadow	8.00	Vega	8.00
25	Newcastle	8.00	Matador	8.00
26	Vega	8.00	Meadow	8.00
27	Higgins	8.50	Groom	8.00
28	Rochester	8.50	Newcastle	8.00
29	Wallis	8.65	Hedley	8.00
30	Sunray	8.75	Higgins	8.50
31	Follett	9.00	Rochester	8.50
32	Shenandoah	9.00	Wallis	8.65
33	Whiteface	9.00	Sunray	8.75
34	Anton	9.50	Shenandoah	9.00
35	Annona	10.00	Whiteface	9.00
36	Aspermont	10.00	Follett	9.00
37	Bryson	10.00	Anton	9.50
38	Colmesneil	10.00	Petersburg	10.00
39	Crowell	10.00	Crowell	10.00
40	Goldsmith	10.00	Sudan	10.00
41	McLean	10.00	Aspermont	10.00
42	Opdyke West	10.00	McLean	10.00
43	Petersburg	10.00	Colmesneil	10.00
44	Sudan	10.00	Bryson	10.00
45	Bogata	10.25	Annona	10.00

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Residential Wastewater Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
46	Goldthwaite	10.50	Goldsmith	10.00
47	Palm Valley	10.50	Opdyke West	10.00
48	Skellytown	10.50	Skellytown	10.50
49	Oyster Creek	10.56	Spur	10.75
50	Spur	10.75	Morgan's Point	10.80
51	Bremond	11.00	Farwell	11.00
52	Darrouzett	11.00	Knox City	11.00
53	Farwell	11.00	Bremond	11.00
54	Knox City	11.00	Richland Springs	11.00
55	Richland Springs	11.00	Darrouzett	11.00
56	Tye	11.00	Stinnett	12.00
57	Roscoe	11.03	Sterling City	12.00
58	Centerville	11.60	Balmorhea	12.00
59	Tatum	11.60	Gustine	12.00
60	Chillicothe	11.75	La Grulla	12.50
61	Edgewood	11.75	Graford	12.50
62	Balmorhea	12.00	Roaring Springs	12.50
63	Gustine	12.00	Naples	12.75
64	Omaha	12.00	Clarendon	13.00
65	Sterling City	12.00	Sabinal	13.00
66	Stinnett	12.00	Coolidge	13.00
67	Stockdale	12.00	Chillicothe	13.00
68	Driscoll	12.25	Lefors	13.00
69	Burton	12.27	Edgewood	13.25
70	Dawson	12.50	Sundown	13.33
71	Graford	12.50	Alba	13.50
72	La Grulla	12.50	Holliday	14.00
73	Lott	12.50	Bogata	14.00
74	Roaring Springs	12.50	Centerville	14.19
75	Rhome	12.61	Stockdale	14.50
76	Naples	12.75	Happy	14.50
77	Lindsay ⁽²⁾	13.00	Robert Lee	14.64
78	Avinger	13.00	Oglesby	14.75
79	Clarendon	13.00	Rankin	14.80
80	Coolidge	13.00	Crosbyton	15.00
81	Lefors	13.00	Omaha	15.00
82	Point Venture	13.00	Amherst	15.00
83	Sabinal	13.00	Frost	15.00
84	Three Rivers	13.05	Miami	15.00
85	Sundown	13.33	Texline	15.00
86	Alba	13.50	Callisburg	15.00
87	Beasley	13.50	Lindsay	15.25
88	Celeste	13.50	Tatum	15.35
89	Gorman	13.75	Plains	15.50
90	Winona	13.75	Earth	15.50

City of Lindsay, Texas CCN Application
SOAH Docket No. 582-06-2023
TCEQ Docket No. 2006-0272-UCR
Residential Wastewater Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
91	Holliday	14.00	Dawson	15.50
92	New Waverly	14.00	Tye	16.00
93	Plains	14.25	Cross Plains	16.00
94	Happy	14.50	Rising Star	16.00
95	Sadler	14.50	Orange Grove	16.18
96	Robert Lee	14.64	Menard	16.50
97	Oglesby	14.75	Roscoe	16.54
98	Strawn	14.75	Archer City	17.00
99	Rankin	14.80	Meadowlakes	17.00
100	Ladonia	14.95	Three Rivers	17.30
101	Amherst	15.00	Eldorado	17.50
102	Callisburg	15.00	Shoreacres	17.50
103	Crawford	15.00	Lott	17.50
104	Crosbyton	15.00	Oyster Creek	17.76
105	Dodd City	15.00	Collinsville	18.00
106	Frost	15.00	Tenaha	18.00
107	Iredell	15.00	Mertzton	18.00
108	Menard	15.00	Avinger	18.00
109	Miami	15.00	Lindsay ⁽²⁾	18.00
110	Splendora	15.00	Dell City	18.25
111	Texline	15.00	Somerset	18.50
112	Bangs	15.10	Bangs	18.60
113	Cumby	15.50	Lorenzo	18.75
114	Earth	15.50	Wells	19.00
115	Riverside	15.50	Streetman	19.00
116	Tenaha	15.50	Point Venture	19.25
117	Charlotte	15.57	Woodbranch Village	20.00
118	Cross Plains	16.00	Lakeport	20.00
119	Emory	16.00	Crawford	20.00
120	Muenster	16.00	Winona	20.00
121	Redwater	16.00	Tolar	20.00
122	Rising Star	16.00	Lipan	20.00
123	Surfside Beach	16.00	New Waverly	20.25
124	DeKalb	16.25	Runaway Bay	20.50
125	Archer City	17.00	Caddo Mills	20.50
126	Bandera	17.00	Goldthwaite	20.90
127	Big Sandy	17.00	Palm Valley	21.00
128	Meadowlakes	17.00	Driscoll	21.00
129	Eldorado	17.50	Celeste	21.00
130	Shoreacres	17.50	Eustace	21.00
131	Thorndale	17.50	Strawn	21.00
132	Timpson	17.60	Rosebud	21.25
133	Josephine	17.76	Gorman	21.25
134	Brownsboro	18.00	Rhome	21.26
135	Collinsville	18.00	Fulshear	21.50

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Residential Wastewater Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
136	Jewett	18.00	Savoy	21.65
137	Mertzon	18.00	Maud	21.80
138	Walnut Springs	18.00	Muenster	22.00
139	Wells	18.00	Zavalla	22.00
140	Honey Grove	18.13	Thorndale	22.50
141	Wolfe City	18.15	New Deal	22.75
142	Orange Grove	18.18	Valley View	23.00
143	Corrigan	18.25	Brownsboro	23.00
144	Dell City	18.25	Ransom Canyon	23.10
145	Meridian	18.60	Ladonia	23.20
146	Lorenzo	18.75	Quinlan	23.40
147	Rosebud	18.75	Beasley	23.50
148	Lakeside City	19.00	Rocksprings	24.00
149	Lexington	19.00	La Vernia	24.00
150	Normangee	19.00	Charlotte	24.02
151	Rocksprings	19.00	Jewett	24.25
152	Streetman	19.00	Riverside	24.25
153	Ganado	19.05	Wolfe City	24.40
154	Blanco	19.35	Josephine	24.96
155	Eustace	19.50	Lyford	25.00
156	Woodsboro	19.65	Honey Grove	25.00
157	Seadrift	19.75	Maypearl	25.00
158	Lakeport	20.00	Rio Vista	25.00
159	Lipan	20.00	Dodd City	25.00
160	Lyford	20.00	Star Harbor	25.00
161	Star Harbor	20.00	Cumby	25.50
162	Tolar	20.00	Rogers	26.00
163	Woodbranch Village	20.00	Redwater	26.00
164	Frankston	20.25	Trenton	26.25
165	Caddo Mills	20.50	Buckholts	26.30
166	Carmine	20.50	Elmendorf	26.48
167	Runaway Bay	20.50	Big Sandy	26.50
168	Buffalo	21.20	Lakeside City	26.50
169	Hemphill	21.23	Carmine	26.50
170	Tioga	21.25	Blanco	26.60
171	Flatonia	21.50	Walnut Springs	26.75
172	Fulshear	21.50	Lexington	27.00
173	Hico	21.50	Campbell	27.00
174	Runge	21.60	Timpson	27.10
175	Savoy	21.65	Emory	27.25
176	Maud	21.80	Splendora	27.50
177	Ore City	21.88	Flatonia	27.75
178	Kerens	22.00	New Summerfield	28.00
179	Zavalla	22.00	Ector	28.00
180	Quinlan	22.20	Sadler	28.00

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Residential Wastewater Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
181	Texhoma	22.25	Bandera	28.25
182	Queen City	22.28	Ganado	28.30
183	Moulton	22.35	Normangee	29.00
184	Maypearl	22.50	Ore City	29.36
185	New Deal	22.75	Hemphill	29.48
186	Anderson	23.00	Bells	29.50
187	Blum	23.00	Godley	29.70
188	New Summerfield	23.00	Seadrift	29.75
189	Valley View	23.00	Stratford	30.00
190	Ransom Canyon	23.10	Frankston	30.00
191	Sour Lake	23.10	Hillcrest Village	30.00
192	Godley	23.20	Woodsboro	30.50
193	Buckholts	23.30	Surfside Beach	30.50
194	Alvord	23.50	Anderson	30.50
195	Moody	23.50	Moody	31.00
196	Rogers	23.50	DeKalb	31.25
197	Boyd	23.62	Sour Lake	31.45
198	La Vernia	24.00	Hico	31.50
199	Tom Bean	24.00	Tom Bean	31.50
200	Somerville	24.25	Arp	31.80
201	Troy	24.25	Bovina	32.00
202	Johnson City	24.69	Corrigan	32.00
203	Ponder	24.90	Runge	32.60
204	Pineland	24.95	Hubbard	33.00
205	Hardin	25.00	Blum	33.00
206	Milford	25.00	Buffalo	33.20
207	Rio Vista	25.00	Industry	33.50
208	Arp	25.30	Meridian	33.60
209	Goodrich	25.50	Tioga	33.75
210	Industry	26.00	Lakeside	34.16
211	Trenton	26.25	Alvord	34.40
212	Gunter	26.32	Pineland	34.70
213	Elmendorf	26.48	Hardin	35.00
214	Bells	26.50	Milford	35.00
215	Thrall	26.50	Smyer	35.00
216	Campbell	27.00	La Ward	35.00
217	Lakeside	27.08	Queen City	35.48
218	Wortham	27.75	Mount Calm	35.50
219	Ector	28.00	Boyd	36.12
220	Grapeland	28.00	Troy	36.50
221	Saint Jo	28.00	Somerville	38.00
222	Trinidad	28.00	Gunter	38.37
223	Groveton	29.25	Saint Jo	39.25
224	Riesel	29.25	Moulton	39.60
225	Marion	29.75	Johnson City	39.84

City of Lindsay, Texas CCN Application
 SOAH Docket No. 582-06-2023
 TCEQ Docket No. 2006-0272-UCR
 Residential Wastewater Rates ⁽¹⁾

<u>Rank</u>	<u>City</u>	<u>5,000 Gallons</u>	<u>City</u>	<u>10,000 gallons</u>
226	Clarksville City	30.00	Clarksville City	40.00
227	Hillcrest Village	30.00	Ingleside on the Bay	41.00
228	Stratford	30.00	Trinidad	41.75
229	Ingleside on the Bay	31.00	Lone Oak	41.90
230	East Tawakoni	31.50	Kerens	42.00
231	Lone Oak	31.90	East Tawakoni	42.50
232	Bovina	32.00	Ponder	42.65
233	Elkhart	32.20	Thrall	44.00
234	Jamaica Beach	32.35	Bayside	44.00
235	Hubbard	33.00	Briarcliff	45.00
236	Bayside	34.00	Grapeland	45.50
237	West Tawakoni	34.45	Riesel	45.50
238	La Ward	35.00	Wortham	47.75
239	Smyer	35.00	Jamaica Beach	48.60
240	Mount Calm	35.50	Marion	49.50
241	Austwell	39.00	Goodrich	51.00
242	Westlake	39.63	Elkhart	51.20
243	Marshall Creek	41.50	West Tawakoni	52.70
244	Briarcliff	45.00	Groveton	53.50
245	Tuscola	48.98	Westlake	55.68
246	Hudson Oaks	75.00	Austwell	60.25
247			Hudson Oaks	132.00

Notes:

(1) Source: TML 2007 Water and Sewer Rate Survey

(2) Rates Calculated assuming a 3/4" meter, based upon rate schedule effective 10/1/2007

Kathleen Hartnett White, *Chairman*
R B "Ralph" Marquez, *Commissioner*
Larry R. Soward, *Commissioner*
Glenn Shankle, *Executive Director*



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

Protecting Texas by Reducing and Preventing Pollution

September 21, 2005

Mr. Arturo D. Rodriguez, JR., Attorney
Russell, Moorman & Rodriguez, LLP
102 West Morrow, Suite 103
Georgetown, Texas 78626

Re: Application from the Town of Lindsay to Amend Certificate of Compliance and Necessity (CCN)
No. 13025 in Cooke County; Application No. 35096-C

Application from the Town of Lindsay to Amend CCN No. 20927 in Cooke County; Application
No. 35097-C

CN: 601118607; RN: 104296488 (water) and 104315569 (sewer)

Dear Mr. Rodriguez:

Your CCN applications for the Town of Lindsay, received on August 31, 2005, have been assigned Application Nos. 35096-C and 35097-C, but have not been accepted for filing. Please refer to these numbers in future correspondence.

The next step towards having your applications accepted is to provide the revised public notices without delay. The notice to the public must be published once each week for two (2) consecutive weeks in a newspaper of general circulation in Cooke County. It is the responsibility of the applicant to provide correct notice of the applications to any utilities within two (2) miles of your proposed service area, any city with an extraterritorial jurisdiction which overlaps the proposed service area or other affected parties in your requested area. You will also be required to provide mailed notice to all landowners included in your proposed CCN area pursuant to commission order dated October 21, 2004. The landowner information may be obtained from the county appraisal district tax rolls for the county or counties in which the proposed CCN lies. Check the notices carefully before mailing or publishing.

As proof that notice was provided, you are required to send us the following:

- a) an original and three copies of a publisher's affidavit of the newspaper publication with tear sheets of the published notice attached;
- b) four copies of each individual notice and map sent to neighboring utilities and affected parties;
- c) one copy of each individual landowner notice and map sent to landowners; and
- d) an original and three copies of the signed affidavits that individual notice to neighboring utilities, affected individuals and each landowner has been given. (Copies of the Affidavit forms are enclosed with this letter.)

P.O. Box 13087 • Austin, Texas 78711-3087 • 512/239-1000 • Internet address: www.tceq.state.tx.us

APEx.S

Include the enclosed location map delineating the proposed service area with your individual notices to neighboring utilities, other affected parties and each landowner.

In addition to the notice requirements the following information is also necessary to proceed with your applications:

- a) Provide the name(s) and physical address(es) of any customers currently receiving water and/or sewer service from the City of Lindsay in the requested area. Distinguish between water and sewer service in your response.
- b) Provide copies of service application(s) and/or written request(s) from all landowner(s), developer(s) and/or potential customer(s) seeking to obtain water and/or sewer service in the requested area. Distinguish between water and sewer service in your response.
- c) Provide a map indicating the location of any and all requests for service received. Distinguish between water and sewer service in your response.
- d) Provide a construction cost breakdown and an estimated time line to indicate the cost and time-frame to provide water and/or sewer service to any request(s) for service received by the City of Lindsay. Distinguish between water and sewer service in your response.
- e) You will also be required to provide landowners consent for all proposed area located outside the City of College Station's current extraterritorial jurisdiction.

These items must be completed and returned by **October 21, 2005**. Processing of these applications cannot proceed until the close of the 30 day public comment period which begins after all the required notices have been given. If we do not receive the requested information by this date, your applications will be returned for failure to prosecute.

If you have any questions, please contact Ms. Karen Blaschke at 512/239-6932, or if by correspondence, include Mail Code 153 in the letterhead address.

Sincerely,



Michelle Abrams, Team Leader
Utilities & Districts Section
Water Supply Division

MA/KLB/ac

Enclosures

cc: TCEQ, Region 4 Office

Notice for Publication

NOTICE OF APPLICATION FOR CERTIFICATE OF CONVENIENCE
AND NECESSITY (CCN) TO PROVIDE WATER AND SEWER
UTILITY SERVICE IN COOKE COUNTY

The Town of Lindsay has filed applications to amend CCN Nos. 13025 and 20927 with the Texas Commission on Environmental Quality to provide water & sewer utility service in Cooke County.

The proposed utility service area is located approximately 4.6 miles north, 3.5 miles south, .6 miles east and 4.1 miles west of downtown Lindsay, Texas, and is generally bounded on the north by CR 434; on the east by Gainesville Airport; on the south by FM 1630; and on the west by CR 415.

The total area being requested for water service includes approximately 18,230 acres and 371 current customers. The total area being requested for sewer service includes approximately 18,230 acres and 362 current customers.

A copy of the proposed service area map is available at 608 Ash Street, Lindsay, Texas 76250, Phone Number 940/665-4455

A request for a public hearing must be in writing. You must state (1) your name, mailing address, and daytime telephone number; (2) the applicant's name, application number or another recognizable reference to this application; (3) the statement, "I/we request a public hearing"; (4) a brief description of how you or the persons you represent, would be adversely affected by the granting of the application for a CCN; and (5) your proposed adjustment to the application or CCN which would satisfy your concerns and cause you to withdraw your request for a hearing.

Persons who wish to intervene or comment should write the:

Texas Commission on Environmental Quality
Water Supply Division
Utilities and Districts Section, MC-153
P. O. Box 13087
Austin, TX 78711-3087

within thirty (30) days from the date of this publication or notice. A public hearing will be held only if a legally sufficient hearing request is received or if the Commission on its own motion requests a hearing. Only those individuals who submit a written hearing request or a written request to be notified if a hearing is set will receive notice if a hearing is scheduled.

If a public hearing is requested, the Executive Director will not issue the CCN and will forward the application to the State Office of Administrative Hearings (SOAH) for a hearing. If no settlement is reached and an evidentiary hearing is held, the SOAH will submit a recommendation to the Commission for final decision. If an evidentiary hearing is held, it will be a legal proceeding similar to a civil trial in state district court.

Si desea informacion en Espanol, puede llamar al 1-800-687-4040.

NOTICE OF APPLICATION FOR CERTIFICATE OF CONVENIENCE AND NECESSITY
(CCN) TO PROVIDE WATER AND SEWER UTILITY SERVICE IN COOKE
COUNTY

To: _____ Date Notice Mailed: _____, 2005
(Neighboring System or City)

(Address)

(City State Zip)

The Town of Lindsay has filed applications to amend CCN Nos. 13025 and 20927 with the Texas Commission on Environmental Quality to provide water & sewer utility service in Cooke County.

The proposed utility service area is located approximately 4.6 miles north, 3.5 miles south, .6 miles east and 4.1 miles west of downtown Lindsay, Texas, and is generally bounded on the north by CR 434; on the east by Gainesville Airport; on the south by FM 1630; and on the west by CR 415. See enclosed map of the proposed service area.

The total area being requested for water service includes approximately 18,230 acres and 371 current customers. The total area being requested for sewer service includes approximately 18,230 acres and 362 current customers.

A request for a public hearing must be in writing. You must state (1) your name, mailing address, and daytime telephone number; (2) the applicant's name, application number or another recognizable reference to this application; (3) the statement, "I/we request a public hearing"; (4) a brief description of how you or the persons you represent, would be adversely affected by the granting of the application for a CCN; and (5) your proposed adjustment to the application or CCN which would satisfy your concerns and cause you to withdraw your request for a hearing.

Persons who wish to intervene or comment should write the:

Texas Commission on Environmental Quality
Water Supply Division
Utilities and Districts Section, MC-153
P. O. Box 13087
Austin, TX 78711-3087

within thirty (30) days from the date of this publication or notice. A public hearing will be held only if a legally sufficient hearing request is received or if the Commission on its own motion requests a hearing. Only those individuals who submit a written hearing request or a written request to be notified if a hearing is set will receive notice if a hearing is scheduled.

If a public hearing is requested, the Executive Director will not issue the CCN and will forward the application to the State Office of Administrative Hearings (SOAH) for a hearing. If no settlement is reached and an evidentiary hearing is held, the SOAH will submit a recommendation to the Commission for final decision. If an evidentiary hearing is held, it will be a legal proceeding similar to a civil trial in state district court.

Si desea informacion en Espanol, puede llamar al 1-800-687-4040.

NOTICE OF APPLICATION FOR CERTIFICATE OF CONVENIENCE AND NECESSITY
(CCN) TO PROVIDE WATER AND SEWER UTILITY SERVICE IN COOKE
COUNTY

To: _____ Date Notice Mailed: _____, 2005
(Landowner)

(Address)

(City State Zip)

The Town of Lindsay has filed applications to amend CCN Nos. 13025 and 20927 with the Texas Commission on Environmental Quality to provide water & sewer utility service in Cooke County.

The proposed utility service area is located approximately 4.6 miles north, 3.5 miles south, .6 miles east and 4.1 miles west of downtown Lindsay, Texas, and is generally bounded on the north by CR 434; on the east by Gainesville Airport; on the south by FM 1630; and on the west by CR 415. See enclosed map of the proposed service area.

The total area being requested for water service includes approximately 18,230 acres and 371 current customers. The total area being requested for sewer service includes approximately 18,230 acres and 362 current customers.

A request for a public hearing must be in writing. You must state (1) your name, mailing address, and daytime telephone number; (2) the applicant's name, application number or another recognizable reference to this application; (3) the statement, "I/we request a public hearing"; (4) a brief description of how you or the persons you represent, would be adversely affected by the granting of the application for a CCN; and (5) your proposed adjustment to the application or CCN which would satisfy your concerns and cause you to withdraw your request for a hearing.


Persons who wish to intervene or comment should write the:

Texas Commission on Environmental Quality
Water Supply Division
Utilities and Districts Section, MC-153
P. O. Box 13087
Austin, TX 78711-3087

within thirty (30) days from the date of this publication or notice. A public hearing will be held only if a legally sufficient hearing request is received or if the Commission on its own motion requests a hearing. Only those individuals who submit a written hearing request or a written request to be notified if a hearing is set will receive notice if a hearing is scheduled.

If a public hearing is requested, the Executive Director will not issue the CCN and will forward the application to the State Office of Administrative Hearings (SOAH) for a hearing. If no settlement is reached and an evidentiary hearing is held, the SOAH will submit a recommendation to the Commission for final decision. If an evidentiary hearing is held, it will be a legal proceeding similar to a civil trial in state district court.

Si desea informacion en Espanol, puede llamar al 1-800-687-4040.

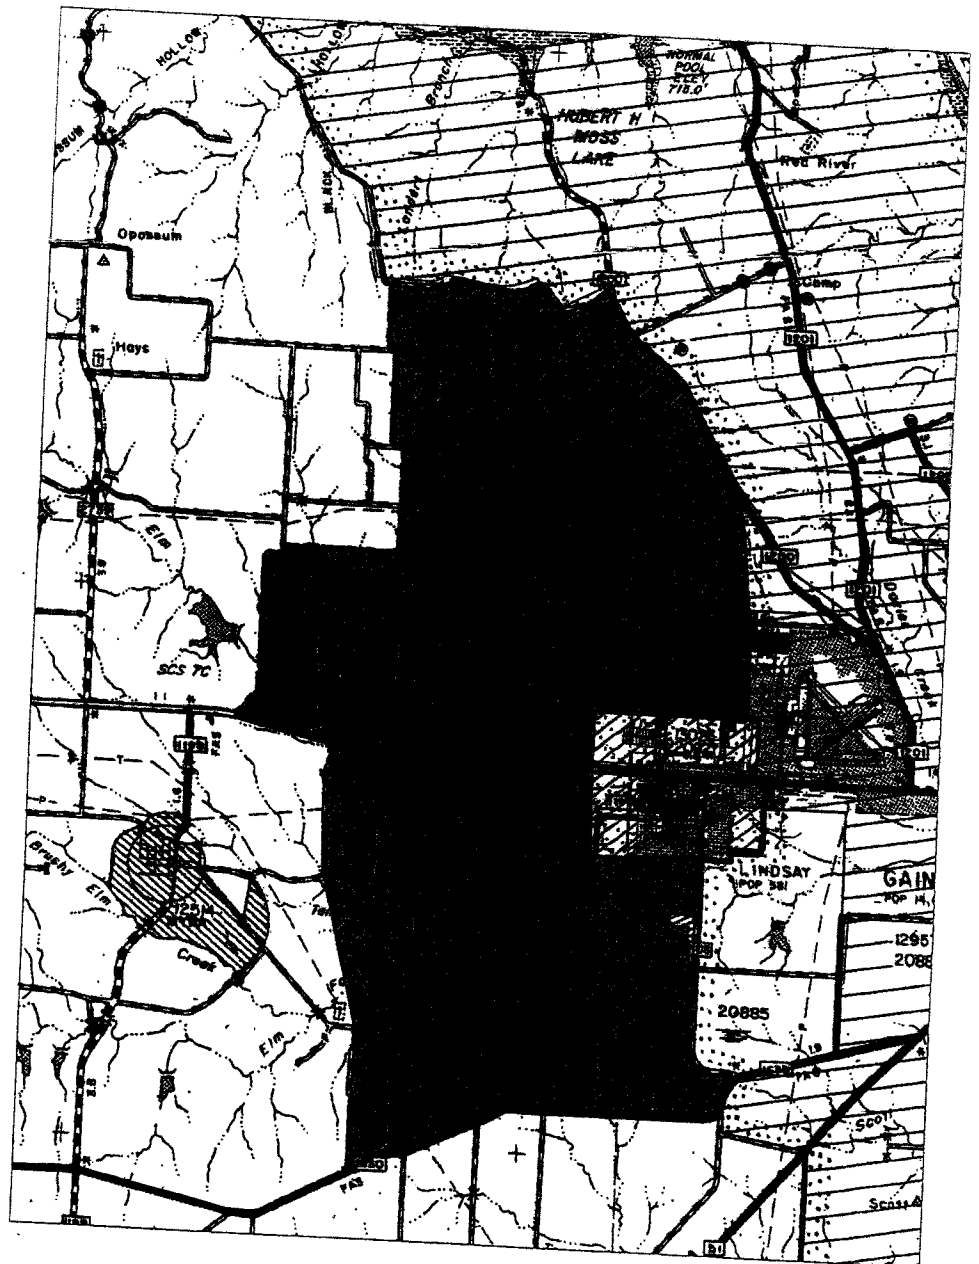

LINDSAY PROPOSED WATER AND SEWER CCN

- LINDSAY PROPOSED CCN AREA
- REQUESTS FOR SERVICE LOCATIONS



Texas Commission on Environmental Quality

APPLICATION NO. _____

PUBLISHER'S AFFIDAVIT

STATE OF TEXAS

COUNTY OF _____

Before me, the undersigned authority, on this day personally appeared _____,

who being by me duly sworn, deposes and says that (s)he is the _____ of the
TITLE

NAME OF NEWSPAPER

_____ ; that said
newspaper is regularly published in _____
County(ies) and generally circulated in _____
County (Counties), Texas; and that the attached notice was published in said newspaper on the
following date(s), to wit: _____

Newspaper Representative's Signature

Subscribed and sworn to before me this _____ day of _____, 2005, to certify which
witness my hand and seal of office.

Notary Public in and for the State of Texas

Print or Type Name of Notary Public

Commission Expires _____



Texas Commission on Environmental Quality

APPLICATION NO. _____

AFFIDAVIT OF NOTICE TO LANDOWNERS

STATE OF TEXAS

COUNTY OF _____

_____ has provided individual notice to the following entities:

DATE

OATH

I, _____, being duly sworn, file this form as _____ (indicate relationship to applicant, that is, owner, member of partnership, title of officer of corporation, or other authorized representative of applicant); that in such capacity, I am qualified and authorized to file and verify such form, am personally familiar with the notices given with this application, and have complied with all notice requirements in the application and application acceptance letter; and that all such statements made and matters set for therein are true and correct.

Applicant's Authorized Representative

If the applicant to this form is any person other than the sole owner, partner, officer of the applicant, or its' attorney, a properly verified Power of Attorney must be enclosed.

Subscribed and sworn to before me this _____ day of _____, 20____, to certify which witness my hand and seal of office.

Notary Public in and for the
State of Texas

Print or Type Name of Notary Public
Commission Expires _____



Texas Commission on Environmental Quality

APPLICATION NO. _____

AFFIDAVIT OF NOTICE TO NEIGHBORING UTILITIES AND AFFECTED PARTIES

STATE OF TEXAS

COUNTY OF _____

_____ has provided individual notice to the following entities:

DATE

OATH

I, _____, being duly sworn, file this form as _____ (indicate relationship to applicant, that is, owner, member of partnership, title of officer of corporation, or other authorized representative of applicant); that in such capacity, I am qualified and authorized to file and verify such form, am personally familiar with the notices given with this application, and have complied with all notice requirements in the application and application acceptance letter; and that all such statements made and matters set forth therein are true and correct.

Applicant's Authorized Representative

If the applicant to this form is any person other than the sole owner, partner, officer of the applicant, or its attorney, a properly verified Power of Attorney must be enclosed.

Subscribed and sworn to before me this _____ day of _____, 20____, to certify which witness my hand and seal of office.

Notary Public in and for the
State of Texas

Print or Type Name of Notary Public
Commission Expires _____

**SOAH DOCKET NO. 582-06-2023
TCEQ DOCKET NO. 2006-0272-UCR**

APPLICATION OF THE TOWN OF LINDSAY TO AMEND WATER AND SEWER CERTIFICATES OF CONVENIENCE AND NECESSITY (CCN) NOS. 13025 AND 20927 IN COOKE COUNTY, TEXAS APPLICATION NOS. 35096-C & 35097-C	§ § § § § § §	BEFORE THE STATE OFFICE OF ADMINISTRATIVE HEARINGS
---	---------------------------------	---

**LINDSAY PURE WATER COMPANY'S RESPONSE TO THE CITY OF LINDSAY'S
INTERROGATORIES AND 2ND SET OF REQUESTS FOR PRODUCTION**

TO: The City of Lindsay, by and through its attorney of record, Arturo D. Rodriguez, Jr. of Russell & Rodriguez, L.L.P., 102 West Morrow Street, Suite 103, Georgetown, Texas 78626.

COMES NOW, Lindsay Pure Water Company, Protestant herein, and files its Response to the City of Lindsay's Interrogatories and 2nd Set of Requests for Production.

INTERROGATORIES

INTERROGATORY NO. 1: Please describe in detail the Company's existing water transmission lines, if any, capable of providing water service to any area in which the City has requested in its Application.

RESPONSE: The Company's existing water system consists of approximately three miles of six-inch diameter C900 pipe, which serves the existing 26 homes within the Company's CCN.

INTERROGATORY NO. 2: Please describe in detail the Company's existing booster stations, if any, capable of providing water service to any area in which the City has requested in its Application.

RESPONSE: The Company currently has one high-pressure pump, one high-volume pump, a 1,000 gallon pressure tank and a liquid chlorination system serving its existing CCN.

INTERROGATORY NO. 3: Please describe in detail the Company's existing water distribution lines, if any, capable of providing water service to any area in which the City has requested in its Application.

RESPONSE: See the response to Interrogatory No. 1.

INTERROGATORY NO. 4: Please describe in detail the Company's existing water storage tanks, if any, capable of providing water service to any area in which the City has requested in its Application.

RESPONSE: The Company currently has one 100,000 gallon vertical water storage tank, which is approximately 99 feet tall.



INTERROGATORY NO. 5: Please identify the Company's sources of water, including ground water and surface water, and explain whether surface water sources are secured by contract or permit.

RESPONSE: The Company's existing well is approximately 890 feet deep and produces water at approximately 100 gallons per minute from the Upper and Lower Trinity Aquifer.

Respectfully submitted,

John J. Carlton
JOHN J. CARLTON

State Bar No. 03817600

ARMBRUST & BROWN, L.L.P.

100 Congress Avenue, Suite 1300

Austin, Texas 78701-2744

(512) 435-2300 – Telephone

(512) 436-2360 – Telecopy

ATTORNEYS FOR LINDSAY PURE

WATER COMPANY

CERTIFICATE OF SERVICE

By my signature above, I hereby certify that a true and correct copy of the foregoing Lindsay Pure Water Company's Response to City of Lindsay's Request for Disclosure and First Set of Requests for Production has been sent by Facsimile and/or First Class Mail on this 14 day of March, 2008, to the following:

Arturo D. Rodriguez, Jr.
Russell & Rodriguez, L.L.P.
102 West Morrow Street, Suite 103
Georgetown, Texas 78626
Phone: (512) 930-1317
Facsimile: (512) 930-7742

Blas J. Coy, Jr.
Office of Public Interest Counsel
TCEQ – MC 103
P.O. Box 13087
Austin, Texas 78711-3087
Phone: (512) 239-6363
Facsimile: (512) 239-6377

Brian MacLeod, Attorney
TCEQ – MC-175
P.O. Box 13087
Austin, Texas 78711-3087
Phone: (512) 239-0750
Facsimile: (512) 239-0606

Christiaan Siano, Attorney
TCEQ – MC-173
P.O. Box 13087
Austin, Texas 78711-3087
Phone: (512) 239-0600
Facsimile: (512) 239-0606

Docket Clerk
Office of the Chief Clerk – MC 105
Texas Commission on Environmental
Quality
P.O. Box 13087
Austin, Texas 78711-3087
Phone: (512) 239-3300
Facsimile: (512) 239-3311