

SECTION 3.0 -- EXTENSION POLICY (Continued)

A utility may only charge a developer standby fees for unrecovered costs of facilities committed to a developer's property under the following circumstances:

- Under a contract and only in accordance with the terms of the contract; or
- if service is not being provided to a lot or lots within two years after installation of facilities necessary to provide service to the lots has been completed and if the standby fees are included on the utility's approved tariff after a rate change application has been filed. The fees cannot be billed to the developer or collected until the standby fees have been approved by the commission.
- For purposes of this section, a manufactured housing rental community can only be charged standby fees under a contract or if the utility installs the facilities necessary to provide individually metered service to each of the rental lots or spaces in the community.

Section 3.04 - Appealing Connection Costs

The imposition of additional extension costs or charges as provided by Sections 3.0 - Extension Policy of this tariff shall be subject to appeal as provided in this tariff, PUC rules, or the rules of such other regulatory authority as may have jurisdiction over the utility's rates and services. Any applicant required to pay for any costs not specifically set forth in the rate schedule pages of this tariff shall be given a written explanation of such costs prior to payment and/or commencement of construction. If the applicant does not believe that these costs are reasonable or necessary, the applicant shall be informed of the right to appeal such costs to the PUC or such other regulatory authority having jurisdiction over the utility's rates in that portion of the utility's service area in which the applicant's property(ies) is located.

Section 3.05 - Applying for Service

The Utility will provide a written service application form to the applicant for each request for service received by the Utility's business offices. A separate application shall be required for each potential service location if more than one service connection is desired by any individual applicant.

Service application forms will be available at the Utility's business office during normal weekday business hours. Service applications will be sent by prepaid first class United States mail to the address provided by the applicant upon request. Completed applications should be returned by hand delivery in case there are questions which might delay fulfilling the service request. Completed service applications may be submitted by mail if hand delivery is not possible.

Where a new tap or service connection is required, the service applicant shall be required to submit a written service application and request that a tap be made. A diagram, map, plat, or written metes and bounds description of precisely where the applicant desires each tap or service connection is to be made and, if necessary, where the meter is to be installed, along the applicant's property line may also be required with the tap request.

SECTION 3.0 -- EXTENSION POLICY (Continued)

The actual point of connection and meter installation must be readily accessible to Utility personnel for inspection, servicing, and meter reading while being reasonably secure from damage by vehicles and mowers. If the Utility has more than one main adjacent to the service applicant's property, the tap or service connection will be made to the Utility's nearest service main with adequate capacity to service the applicant's full potential service demand. Beyond the initial 200 feet, the customer shall bear only the equivalent cost of extending from the nearest main. If the tap or service connection cannot be made at the applicant's desired location, it will be made at another location mutually acceptable to the applicant and the Utility. If no agreement on location can be made, the applicant may refer the matter to the PUC for resolution.

Section 3.06 - Qualified Service Applicant

A "qualified service applicant" is an applicant who has: (1) met all of the Utility's requirements for service contained in this tariff, PUC rules and/or PUC order, (2) has made payment or made arrangement for payment of tap fees, (3) has provided all easements and rights-of-way required to provide service to the requested location, (4) delivered an executed customer service inspection certificate to the Utility, if applicable, and (5) has executed a customer service application for each location to which service is being requested.

The Utility shall serve each qualified service applicant within its certified service area as soon as practical after receiving a completed service application. All service requests will be fulfilled within the time limits prescribed by PUC rules once the applicant has met all conditions precedent to achieving "qualified service applicant" status. If a service request cannot be fulfilled within the required period, the applicant shall be notified in writing of the delay, its cause and the anticipated date that service will be available. The PUC service dates shall not become applicable until the service applicant has met all conditions precedent to becoming a qualified service applicant as defined by PUC rules.

Section 3.07 - Developer Requirements

As a condition of service to a new subdivision, the Utility shall require a developer (as defined by PUC rule) to provide permanent recorded public utility easements as a condition of service to any location within the developer's property.

APPENDIX A -- SAMPLE SERVICE AGREEMENT

From 30 TAC Chapter 290.47(b), Appendix B

SERVICE AGREEMENT

- I. **PURPOSE.** The NAME OF SEWER SYSTEM is responsible for protecting the drinking water supply from contamination or pollution which could result from improper private water distribution system construction or configuration. The purpose of this service agreement is to notify each customer of the restrictions which are in place to provide this protection. The utility enforces these restrictions to ensure the public health and welfare. Each customer must sign this agreement before the NAME OF SEWER SYSTEM will begin service. In addition, when service to an existing connection has been suspended or terminated, the sewer system will not re-establish service unless it has a signed copy of this agreement.

- II. **RESTRICTIONS.** The following unacceptable practices are prohibited by State regulations.
 - A. No direct connection between the public drinking water supply and a potential source of contamination is permitted. Potential sources of contamination shall be isolated from the public water system by an air-gap or an appropriate backflow prevention device.

 - B. No cross-connection between the public drinking water supply and a private water system is permitted. These potential threats to the public drinking water supply shall be eliminated at the service connection by the installation of an air-gap or a reduced pressure-zone backflow prevention device.

 - C. No connection which allows water to be returned to the public drinking water supply is permitted.

 - D. No pipe or pipe fitting which contains more than 8.0% lead may be used for the installation or repair of plumbing at any connection which provides water for human use.

 - E. No solder or flux which contains more than 0.2% lead can be used for the installation or repair of plumbing at any connection which provides water for human use.

- III. **SERVICE AGREEMENT.** The following are the terms of the service agreement between the NAME OF SEWER SYSTEM (the Sewer System) and NAME OF CUSTOMER (the Customer).
 - A. The Sewer System will maintain a copy of this agreement as long as the Customer and/or the premises is connected to the Sewer System.

 - B. The Customer shall allow his property to be inspected for possible cross-connections and other potential contamination hazards. These inspections shall be conducted by the Sewer System or its designated agent prior to initiating new water service; when there is reason to believe that cross-connections or other


potential contamination hazards exist; or after any major changes to the private water distribution facilities. The inspections shall be conducted during the Sewer System's normal business hours.

- C. The Sewer System shall notify the Customer in writing of any cross-connection or other potential contamination hazard which has been identified during the initial inspection or the periodic reinspection.
 - D. The Customer shall immediately remove or adequately isolate any potential cross-connections or other potential contamination hazards on his premises.
 - E. The Customer shall, at his expense, properly install, test, and maintain any backflow prevention device required by the Sewer System. Copies of all testing and maintenance records shall be provided to the Sewer System.
- IV. ENFORCEMENT. If the Customer fails to comply with the terms of the Service Agreement, the Sewer System shall, at its option, either terminate service or properly install, test, and maintain an appropriate backflow prevention device at the service connection. Any expenses associated with the enforcement of this agreement shall be billed to the Customer.

CUSTOMER'S SIGNATURE: _____

DATE: _____

APPENDIX B -- APPLICATION FOR SERVICE
(Utility Must Attach Blank Copy)



Public Utility Commission of Texas

By These Presents Be It Known To All That

Double Diamond Utilities Company, Inc.


having obtained certification to provide sewer utility service for the convenience and necessity of the public, and it having been determined by this Commission that the public convenience and necessity would in fact be advanced by the provision of such service, Double Diamond Utilities Company, Inc., is entitled to this

Certificate of Convenience and Necessity No. 20705

to provide continuous and adequate sewer utility service to that service area or those service areas in Grayson, Hill, Johnson, and Palo Pinto Counties as by final Order or Orders duly entered by this Commission, which Order or Orders resulting from Docket No. 44267 are on file at the Commission offices in Austin, Texas; and are a matter of official record available for public inspection; and be it known further that these presents do evidence the authority and the duty of Double Diamond Utilities Company, Inc., to provide such utility service in accordance with the laws of this State and Rules of this Commission, subject only to any power and responsibility of this Commission to revoke or amend this Certificate in whole or in part upon a subsequent showing that the public convenience and necessity would be better served thereby.



Issued at Austin, Texas, the _____ day of _____ 2016.


Double Diamond Utilities Company, Inc.
 Sewer Service Area
 CCN No. 20705
 PUC Docket No. 44267
 Amended CCN No. 20705 in Palo Pinto County

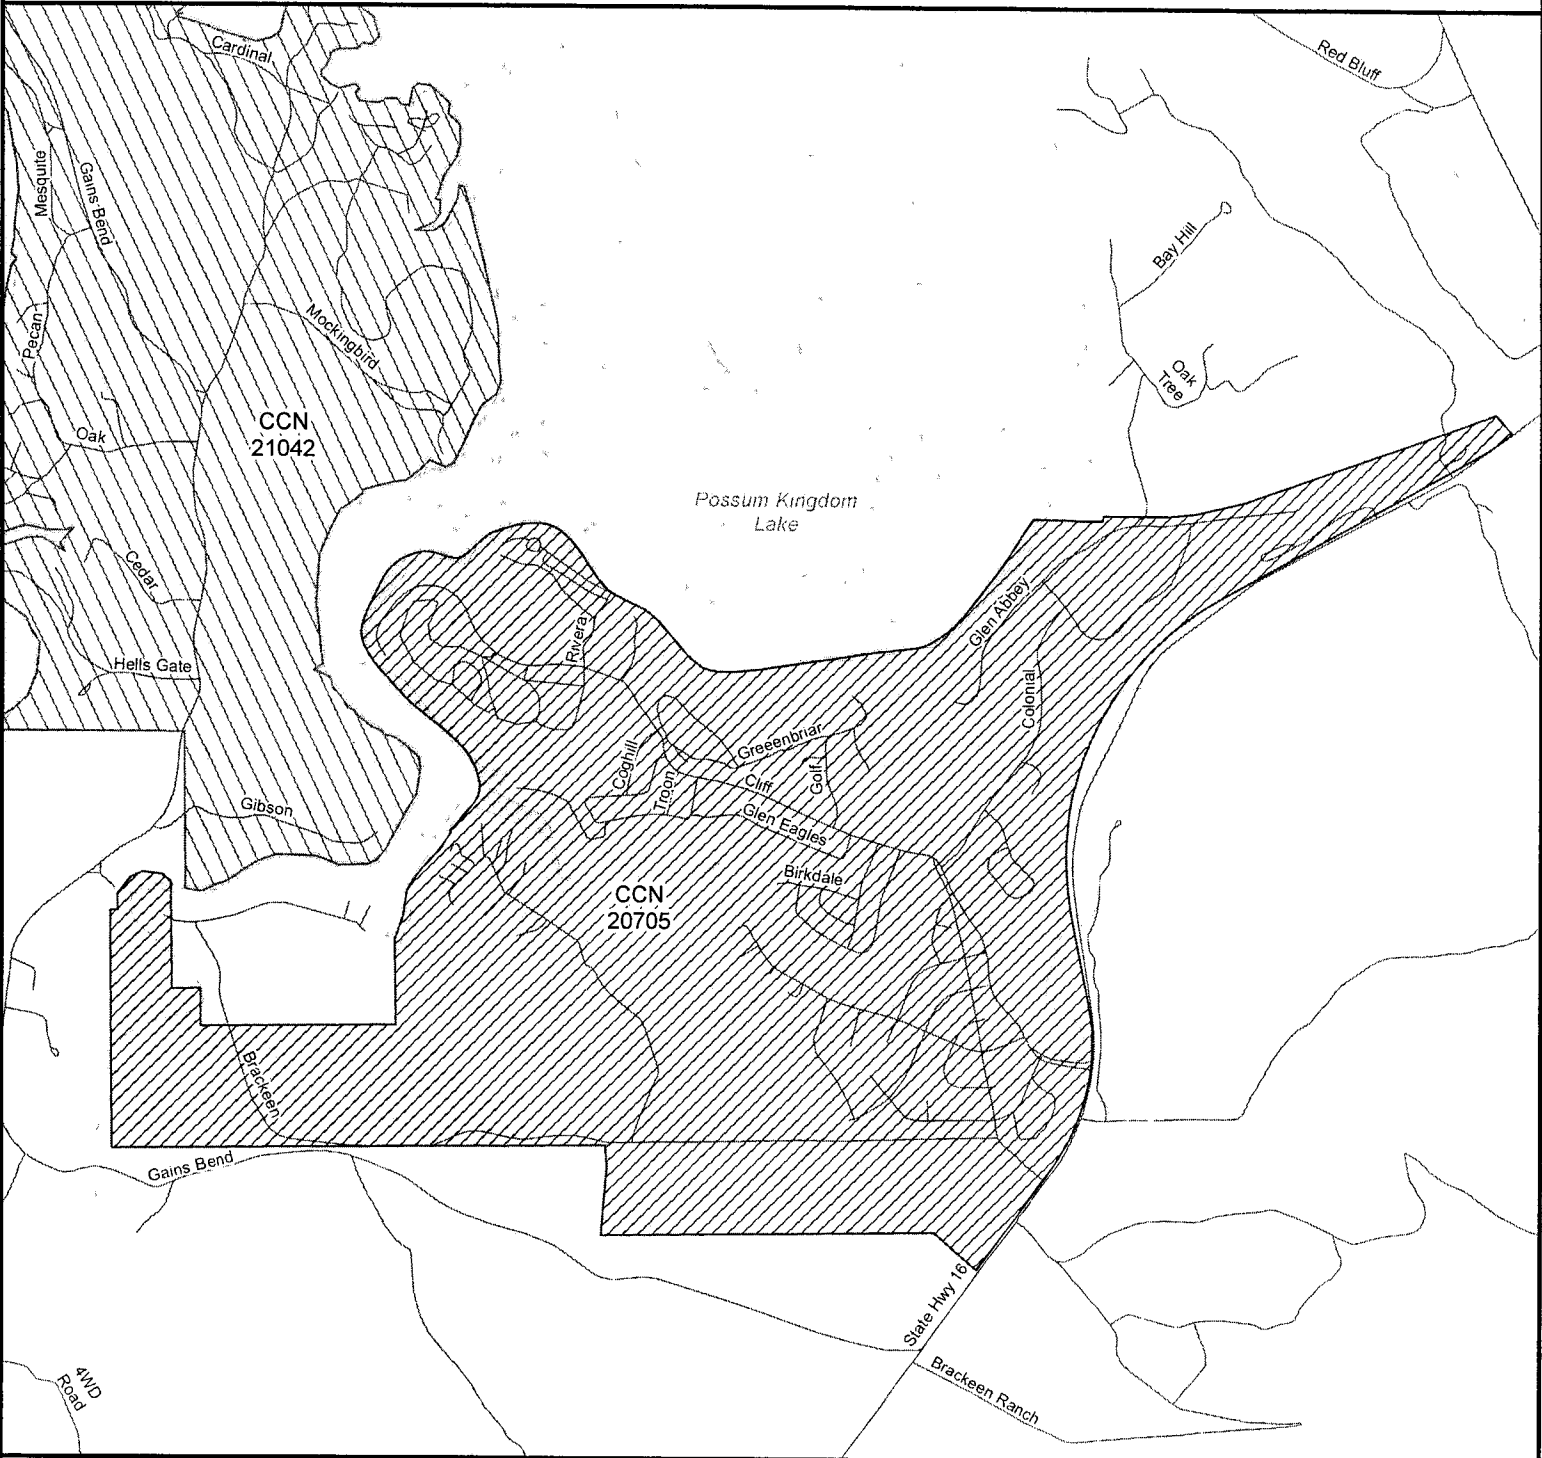


Public Utility Commission of Texas
 1701 N. Congress Ave
 Austin, TX 78701

Sewer CCN Service Areas

-  20705 - Double Diamond Utilities Company, Inc.
-  21042 - Gaines Bend Utilities, Inc.



Map by: Komal Patel
 Date created: January 29, 2015
 Project Path: n:\finalmapping\44267DoubleDiamondUtilitiesSewer.mxd



Public Utility Commission of Texas

By These Presents Be It Known To All That

Possum Kingdom Water Supply Corporation

having obtained certification to provide water utility service for the convenience and necessity of the public, and it having been determined by this Commission that the public convenience and necessity would in fact be advanced by the provision of such service, Possum Kingdom Water Supply Corporation is entitled to this

Certificate of Convenience and Necessity No. 12890

to provide continuous and adequate water utility service to that service area or those service areas in Palo Pinto County as by final Order or Orders duly entered by this Commission, which Order or Orders resulting from Docket No. 44267 are on file at the Commission offices in Austin, Texas; and are a matter of official record available for public inspection; and be it known further that these presents do evidence the authority and the duty of Possum Kingdom Water Supply Corporation to provide such utility service in accordance with the laws of this State and Rules of this Commission, subject only to any power and responsibility of this Commission to revoke or amend this Certificate in whole or in part upon a subsequent showing that the public convenience and necessity would be better served thereby.

Issued at Austin, Texas, the _____ day of _____ 2016.