



Control Number: 45627



Item Number: 13

Addendum StartPage: 0

PUBLIC UTILITY COMMISSION

RECEIVED



2016 JUL 19 AM 9:17

PUBLIC UTILITY COMMISSION  
FILING CLERK

AFFIDAVIT OF NOTICE TO CUSTOMERS, NEIGHBORING UTILITIES AND  
AFFECTED PARTIES  
DOCKET NO. 45627

STATE OF TEXAS  
COUNTY OF Tyler

Before me, the undersigned authority, on this day personally appeared

Charles Branch

, who being by me

duly sworn, deposes and that (s)he is the

OWNER

(TITLE)

of the

Doucette Water System + Lakeside Water Supply

(NAME OF UTILITY)

that the attached notice was provided to customers and other affected parties by

mail

(METHOD USED TO PROVIDE NOTICE)

on or about the following date, to wit:


July 12, 2016

(DATE)

[Signature]

(SIGNATURE OF UTILITY OFFICIAL)

Subscribed and sworn to before me this 12 day of July, 2016,  
to certify which witness my hand and seal of office.

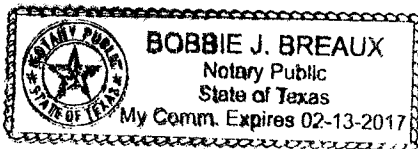

Bobbie J. Breau

Notary Public in and for the State of Texas

Bobbie J. Breau

Print or Type Name of Notary Public

Commission Expires 02-13-2017

## Notice to Current Customers, Neighboring Systems, and Cities

### CHARLES BRANCH DBA DOUCETTE WATER SYSTEM AND LAKESIDE WATER SUPPLY NOTICE OF INTENT TO SELL FACILITIES AND TRANSFER WATER CERTIFICATE OF CONVENIENCE AND NECESSITY (CCN) NO. 12001 TO THOMAS KAIN RAWLS AND DANASA RAWLS IN TYLER COUNTY, TEXAS

To: \_\_\_\_\_  
(Name of Customer, Neighboring System, or City)

Date Notice Mailed: 7/12, 2016

\_\_\_\_\_  
(Address)

\_\_\_\_\_  
(City State Zip)

<u>Doucette Water System and Lakeside Water Supply</u>	<u>P.O. Box 697</u>	<u>Doucette, TX</u>	<u>75742</u>
(Seller's or Transferor's Name)	(Address)	(City) (State)	(Zip Code)

has submitted an application with the Public Utility Commission of Texas (Commission) to sell facilities and transfer water CCN No. 12001 in Tyler County, Texas to:

<u>Thomas Kain Rawls and Danasa Rawls</u>	<u>1430 CR 2800</u>	<u>Colmesneil, TX</u>	<u>75938</u>
(Purchaser's or Transferee's Name)	(Address)	(City) (State)	(Zip Code)

The sale is scheduled to take place as approved by the Commission. The transaction and the transfer of CCN include the following subdivision: Community of Lake Amanda and Frog Pond, Colmesneil, Texas 75938.

**Doucette Water System:** The area subject to this transaction is located approximately 4 miles north of downtown Woodville on Hwy 69, Texas and is generally bounded on the north by CR 2775; on the east by CR 3100; on the south by intersection of CR 2765 and US 69; and on the west by East Branch Turkey Creek.

The total area being requested includes approximately 500 acres and serves 133 current customers. This transaction will have the following effect on the current customers' rates and services: None.

**Lakeside Water Supply:** The area subject to this transaction is located approximately 1 mile southeast of downtown Colmesneil, Texas and is generally bounded on the north by FM 256 East; on the east by CR 3220; on the south by CR 3150; and on the west by FM 3065.

The total area being requested includes approximately 800 acres and serves 172 current customers. This transaction will have the following effect on the current customers' rates and services: None.

A request for a public hearing must be in writing. You must state (1) your name, mailing address, and daytime telephone number; (2) the applicant's name, application number or another recognizable reference to this application; (3) the statement, "I/we request a public hearing"; (4) a brief description of how you or the persons you represent, would be adversely affected by the granting of the application for a STM; and (5) your proposed adjustment to the application or CCN which would satisfy your concerns and cause you to withdraw your request for a hearing.

Persons who wish to intervene or comment should file a request in writing with the:

Filing Clerk  
Public Utility Commission of Texas  
1701 North Congress Avenue  
P.O. Box 13326  
Austin, Texas 78711-3326


within thirty (30) days from the date of this publication or notice. A public hearing will be held only if a legally sufficient hearing request is received or if the Commission on its own motion requests a hearing. Only those individuals who submit a written hearing request or a written request to be notified if a hearing is set will receive notice if a hearing is scheduled.

If a public hearing is requested, Commission will not transfer the CCN and will forward the application to the State Office of Administrative Hearings (SOAH) for a hearing. If no settlement is reached and an evidentiary hearing is held, the SOAH will submit a recommendation to the Commission for final decision. If an evidentiary hearing is held, it will be a legal proceeding similar to a civil trial in state district court.

*Si desea informacion en Espanol, puede llamar al 1-888-782-8477*

Charles Branch  
Utility Representative

Doucette Water System, Lakeside Water Supply 1, 2, 3, 4 + 5  
Utility Name

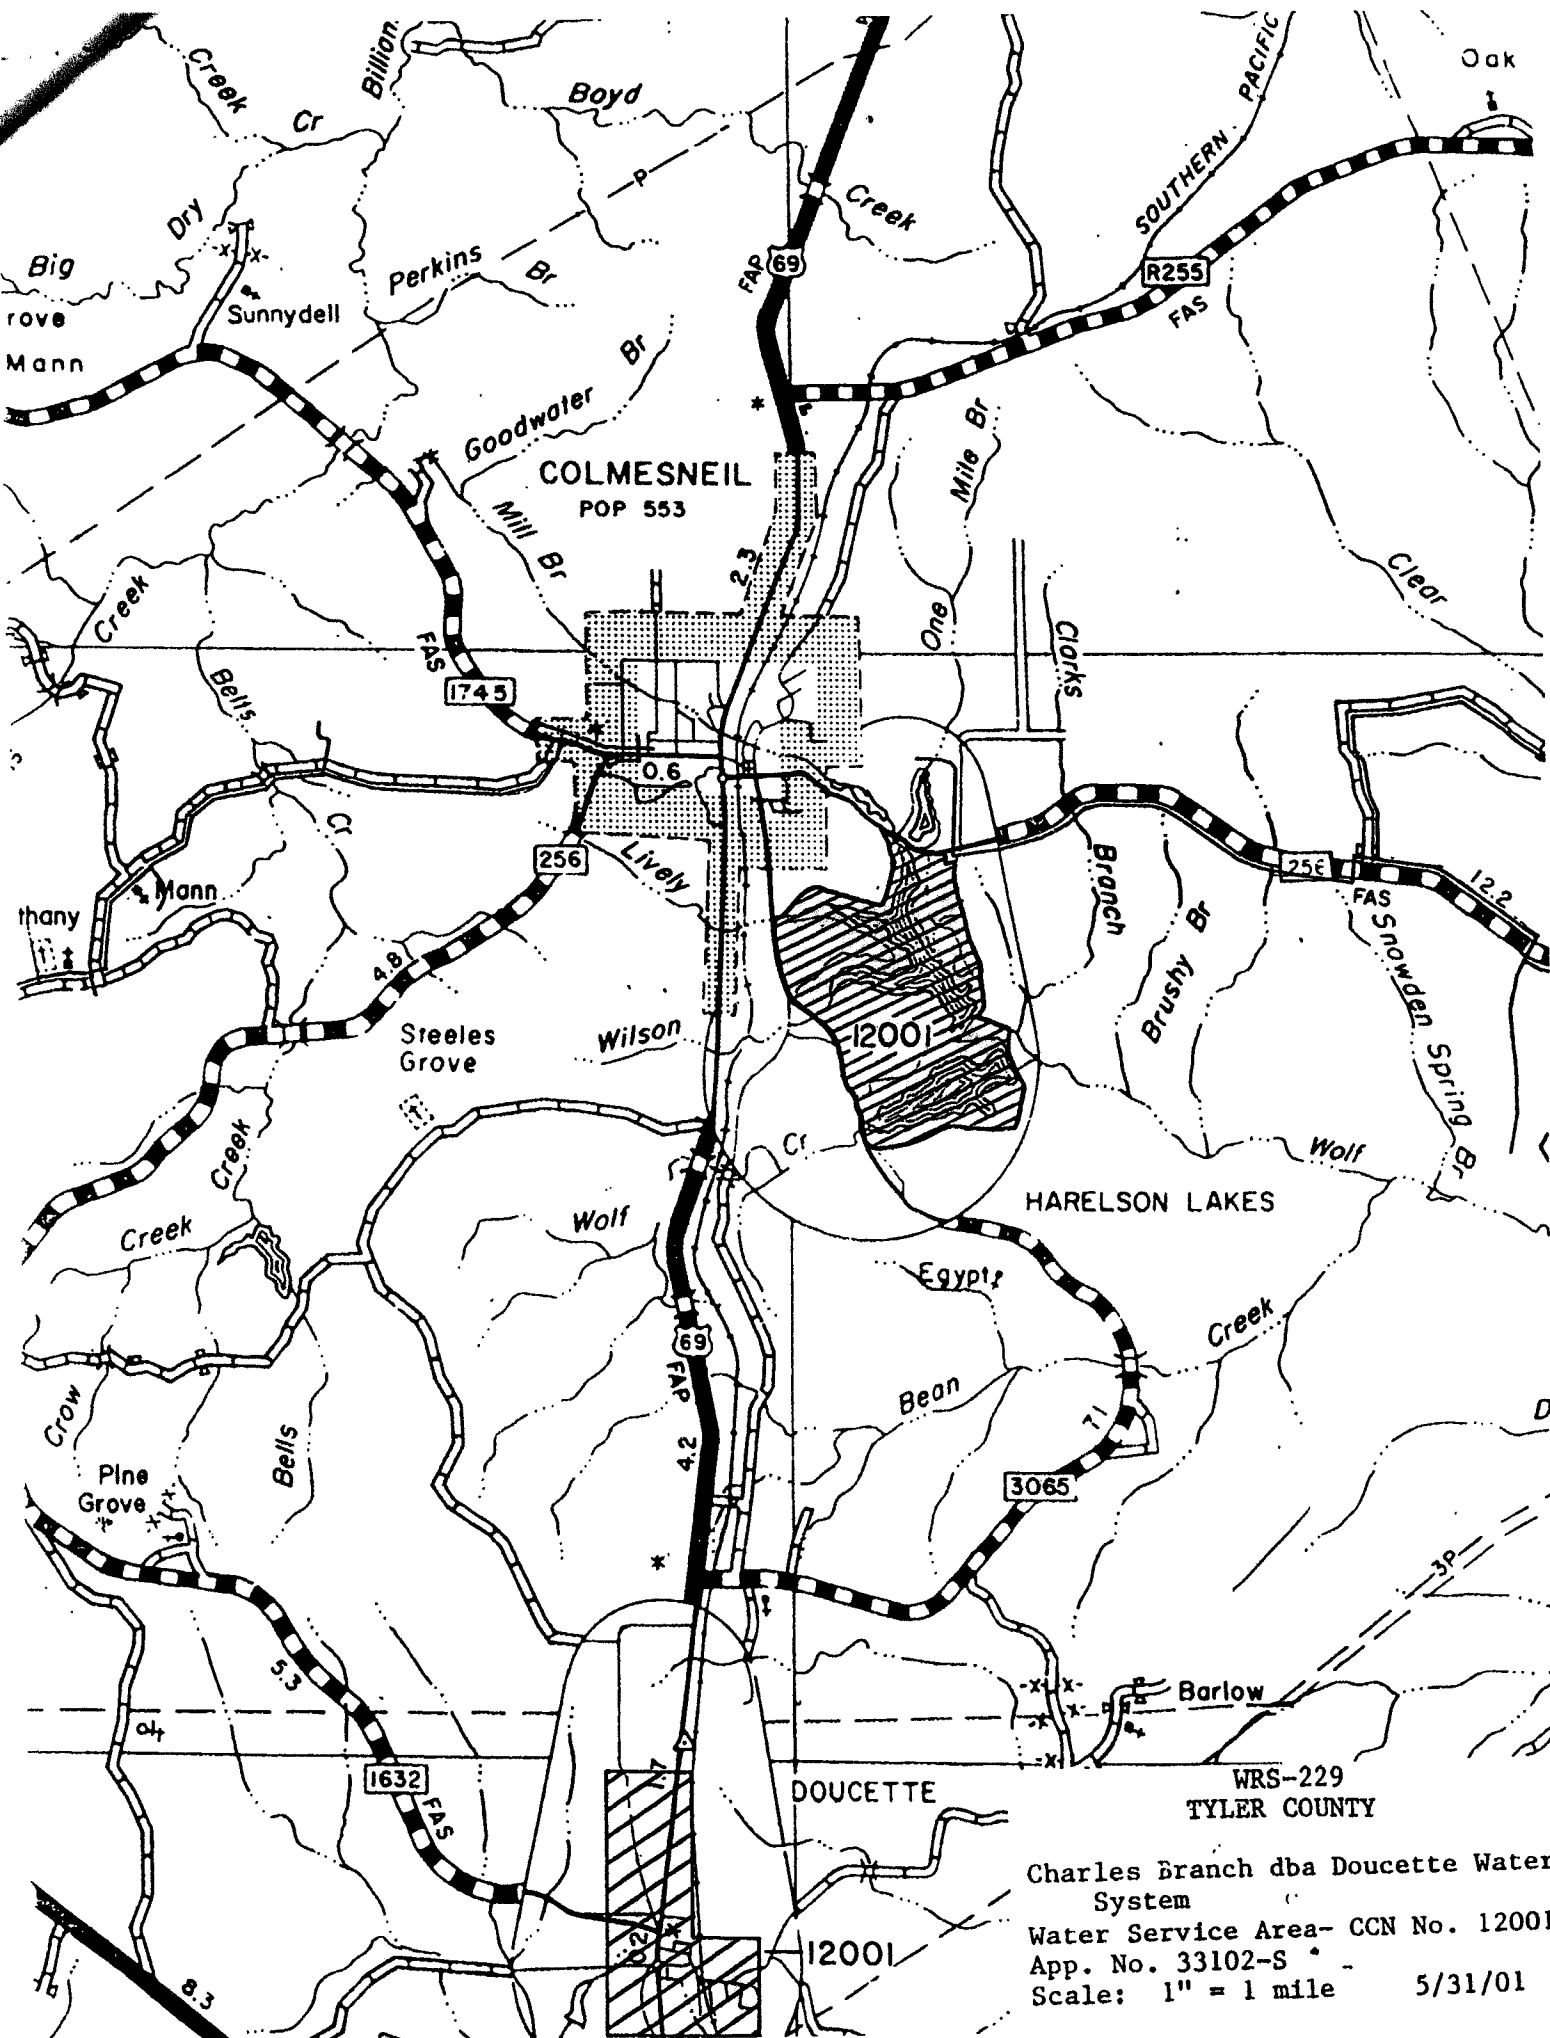

Charles Branch dba Doucette Water System  
Water Service Area- CCN No. 12001  
App. No. 33102-S  
Scale: 1" = 1 mile 5/31/01