



Filing Receipt

Received - 2022-01-28 10:15:53 AM
Control Number - 52299
ItemNumber - 1360



Partners for a Better Quality of Life

January 27, 2022

Public Utility Commission of Texas
Central Records
1701 N Congress
PO Box 13326
Austin, Texas 78711-3326

RE: City of Riesel – Senate Bill 3 Compliance

Dear Central Records:

The purpose of this letter is to provide the City of Riesel's water and sanitary sewer specific information for compliance with the Public Utility Commission of Texas (PUCT) – Senate Bill 3 Texas Water Code (TWC) § 13.1396.

TWC § 13.1394, defines an "affected utility" as a retail public utility, exempt utility, or provider or conveyor of potable or raw water service that:

- *Furnishes water service to more than one customer; and*
- *Is not an affected utility under Section 13.1395.*

The City of Riesel meets the definition for an affected utility and is required to file this information with the PUCT. The following information for the affected utility must also be filed with each transmission and distribution service provider, each retail electric provider, and the office of emergency management of each county where the utility has water or sewer facilities that qualify for critical load status.

The information required to be filed includes the location and general description of all water and sewer facilities that qualify for critical load status, attached hereto as Attachment 1. Other information required to be filed includes the emergency contact information for the affected utility:

<u>Point of Contact:</u> Randy Ehlers City of Riesel Public Works Director Phone: (254) 896-6681 publicworks@cityofriesel.org	<u>Alternative Point of Contact:</u> Alisha Flanary City of Riesel City Secretary Phone: (254) 896-6501 citysecretary@cityofriesel.org	<u>Mailing Address:</u> City of Riesel 104 N. Memorial Riesel, TX 76682
--	---	--

Please do not hesitate to contact CP&Y, Inc., if there are any questions or additional information is needed.

Sincerely,
CP&Y, Inc.

Scott Wetzel, P.E.
Senior Project Manager


200 West Highway 6, Suite 620
Waco, Texas 76712
TBPE # F-1741
TBPLS # 10194124

(p) 254.772.9272 · (f) 254.776.2924
www.cpyi.com



ATTACHMENT-1

CITY OF RIESEL TEXAS - CRITICAL ELECTRIC LOAD REQUIREMENTS									
Item No.	Item Description	Latitude	Longitude	Motors/Pumps	Hp	GPM	Volts	Phase	Generator
1	WATER - Main Plant Pump Station	31.477619	-96.920431	#1	25	350	230	3	Yes
				#2	25	350	230	3	Yes
2	WATER - Rattlesnake Rd Pump Station	31.478055	-96.92	#1	60	700	230	3	Yes
				#2	60	700	230	3	Yes
3	WATER - Mt. Moriah Rd Pump Station	31.503059	-96.958526	#1	20	250	230	3	No
				#2	20	250	230	3	No
4	WATER - Mt. Moriah Rd Groundwater Well	31.503059	-96.958526	#1	100	340	460	3	No
5	WATER - Rattlesnake Rd Groundwater Well	31.478055	-96.92	#1	100	250	460	3	Yes
WATER - TOTAL					410				
Item No.	Item Description	Latitude	Longitude	Motors/Pumps	Hp	GPM	Volts	Phase	Generator
6	SEWER - Main Lift Station	31.469466	-96.928666	#1	7.5	300	460	3	YES
				#2	7.5	300	460	3	
				#3	7.5	300	460	3	
7	SEWER - Irrigation Pond LS	31.468799	-96.929055	#1	10	200	460	3	Yes
				#2	10	200	460	3	
8	SEWER - Luedke Lift Station	31.472477	-96.915455	#1	15	360	230	3	Yes
				#2	15	360	230	3	
9	SEWER - Lehman (Ross) Lift Station	31.474172	-96.911672	#1	2	30	230	1	No
				#2	2	30	230	1	
10	SEWER - Jackson (Frederick) Lift Station	31.46528	-96.932363	#1	2	30	230	1	No
				#2	2	30	230	1	
SEWER - TOTAL					80.5				

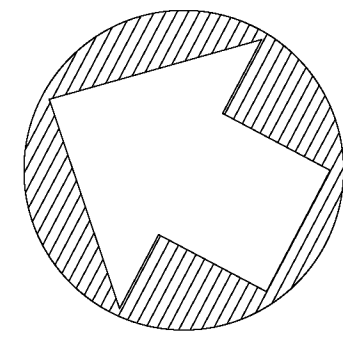

0 500 1000


LEGEND

- EXIST. 1" GALV. WATER LINE
- EXIST. 2" GALV. WATER LINE
- EXIST. 2" PVC WATER LINE
- EXIST. 4" PVC WATER LINE
- EXIST. 6" PVC WATER LINE
- EXIST. 8" PVC WATER LINE




EXIST. WATER METER

- EXIST. MS WATER LINES

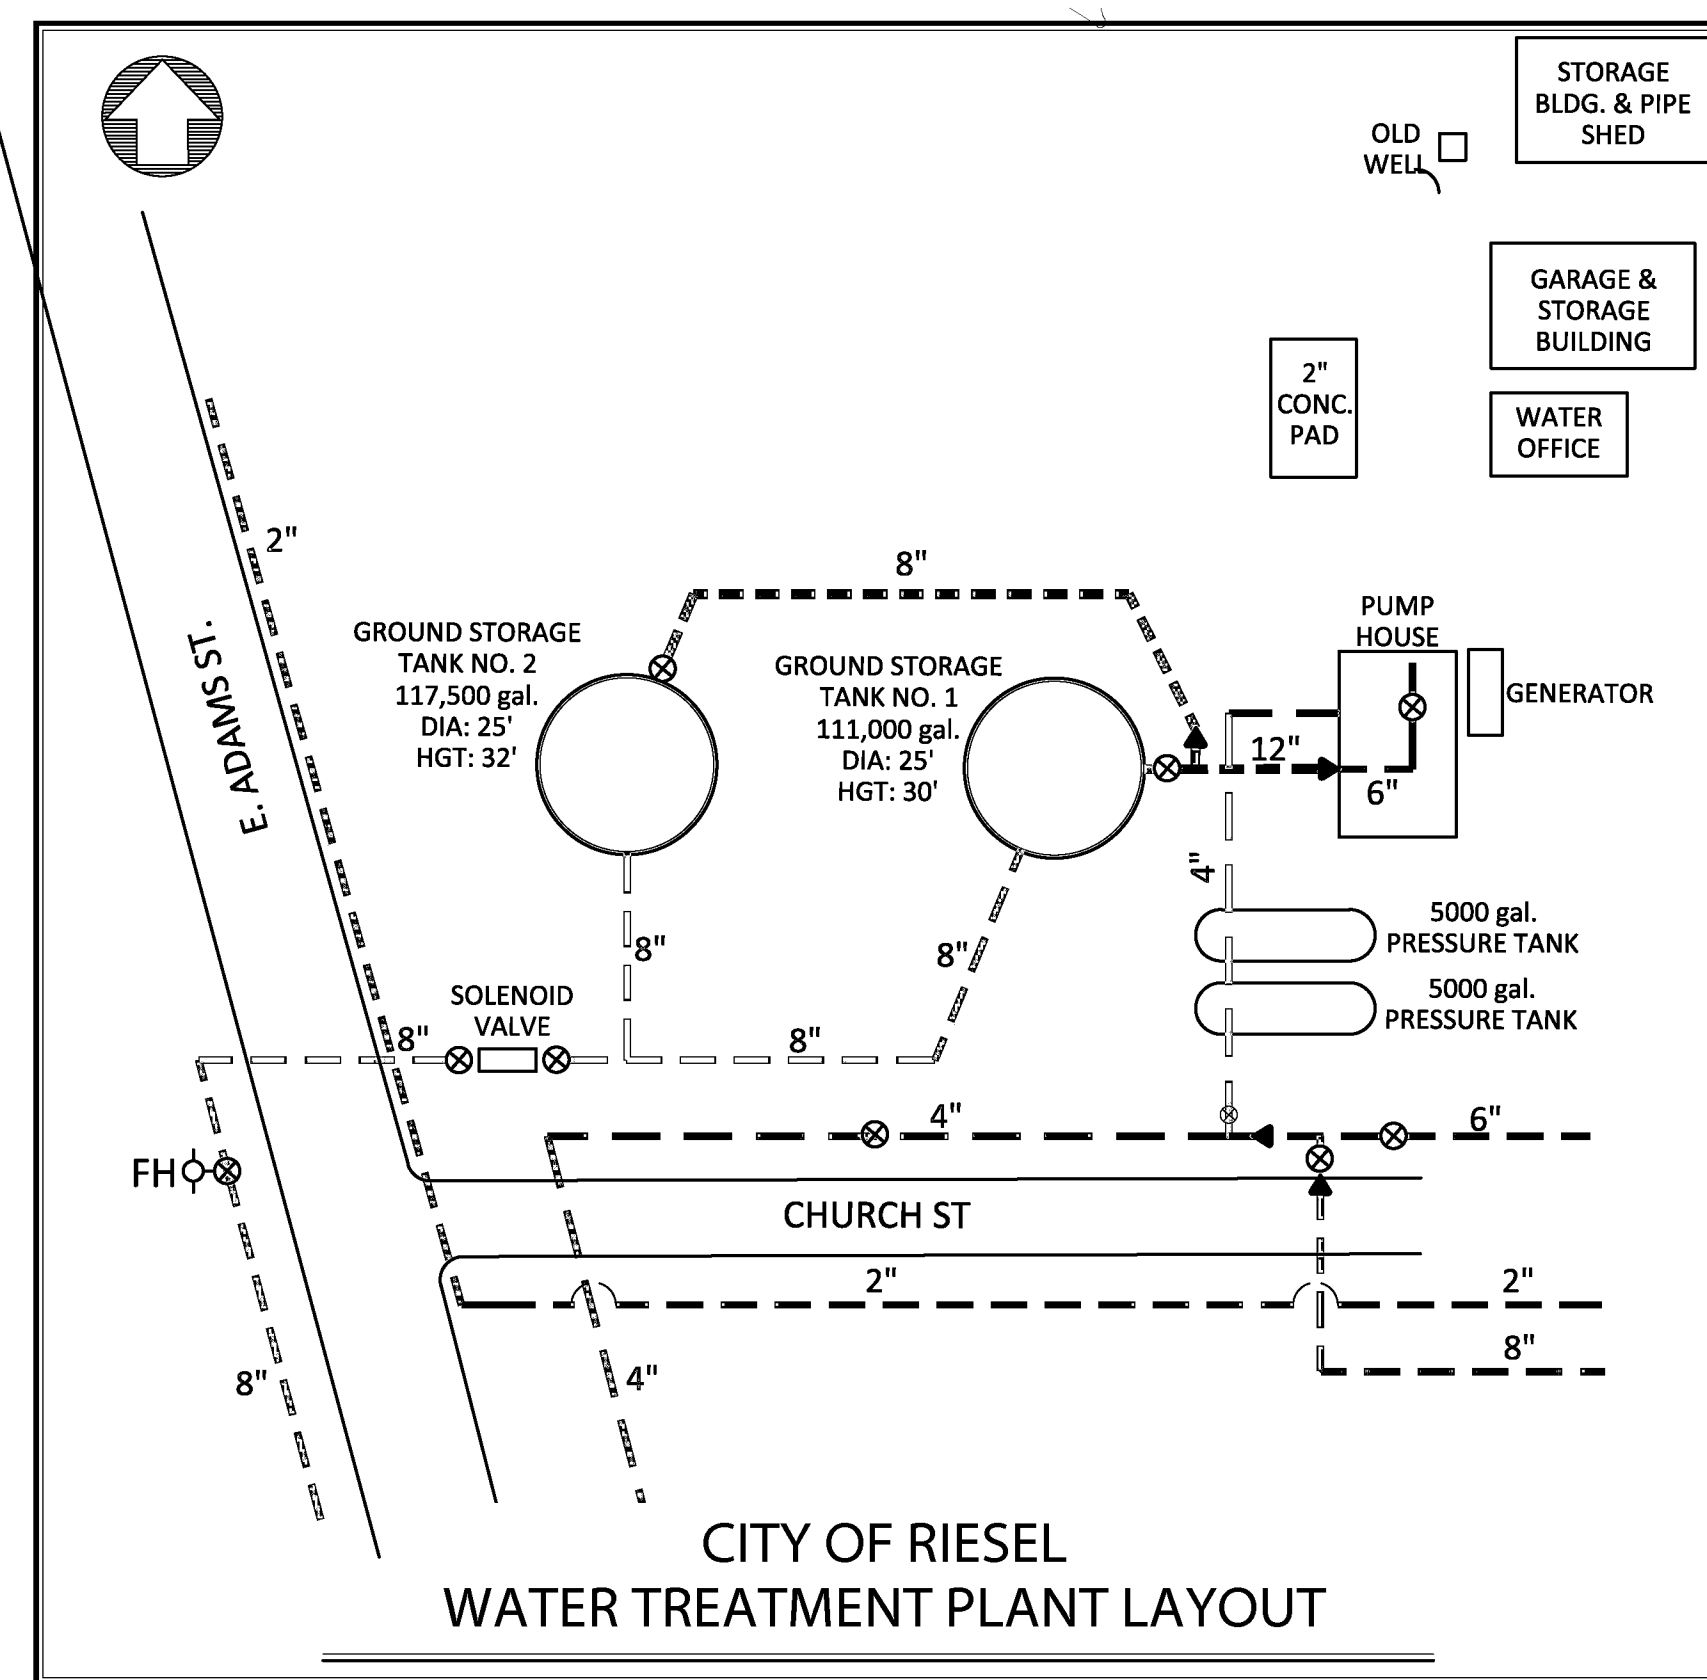


CITY OF RIESEL

WATER SYSTEM MAP

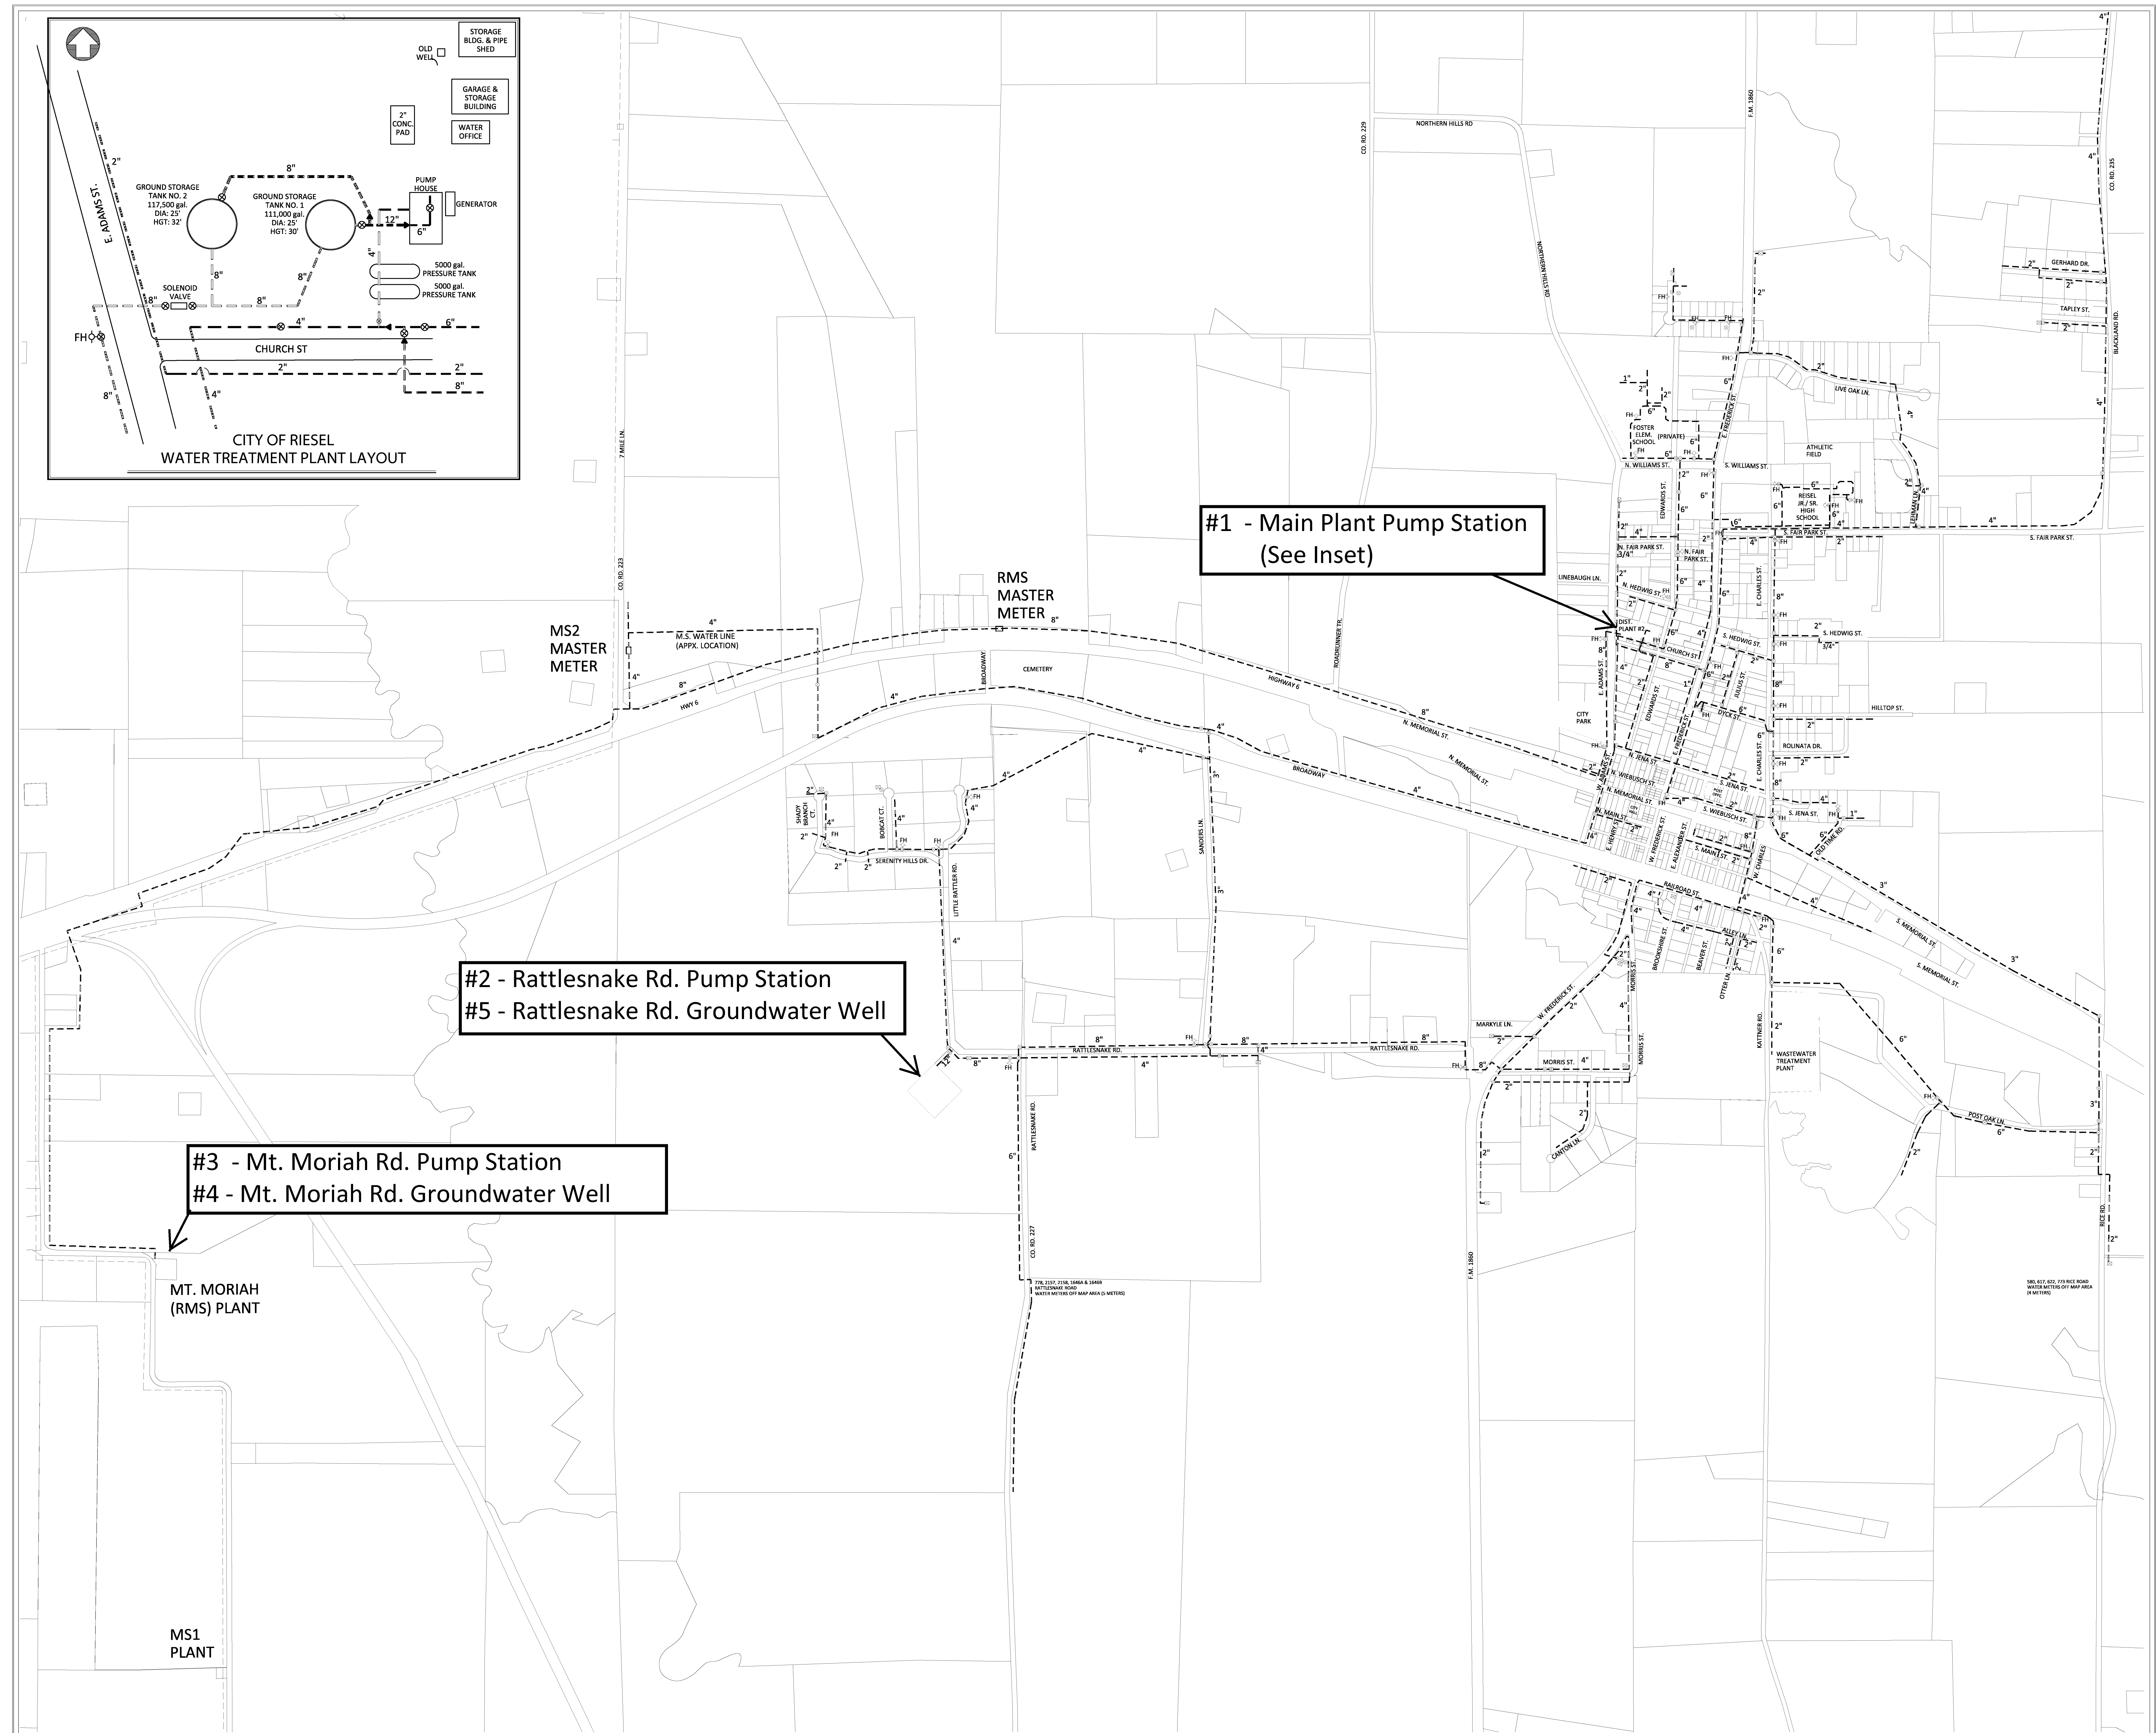



CP&Y, INC.
TEXAS REGISTERED
ENGINEERING FIRM
E-1741

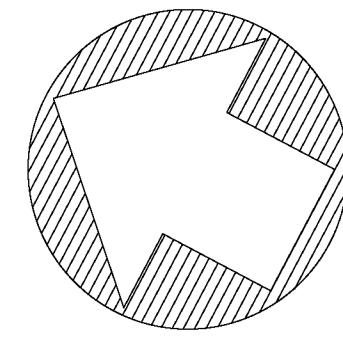

0 400 800

LEGEND

- EXIST. 4" SEWER LINE
- EXIST. 6" SEWER LINE
- EXIST. 8" SEWER LINE
- EXIST. 10" SEWER LINE
- EXIST. 12" SEWER LINE
- EXIST. 4" SEWER SERVICE
- ⊙ EXIST. 24" MANHOLE
- ⊙ EXIST. 36" MANHOLE
- ⊗ EXIST. SEWER MAIN CLEANOUT

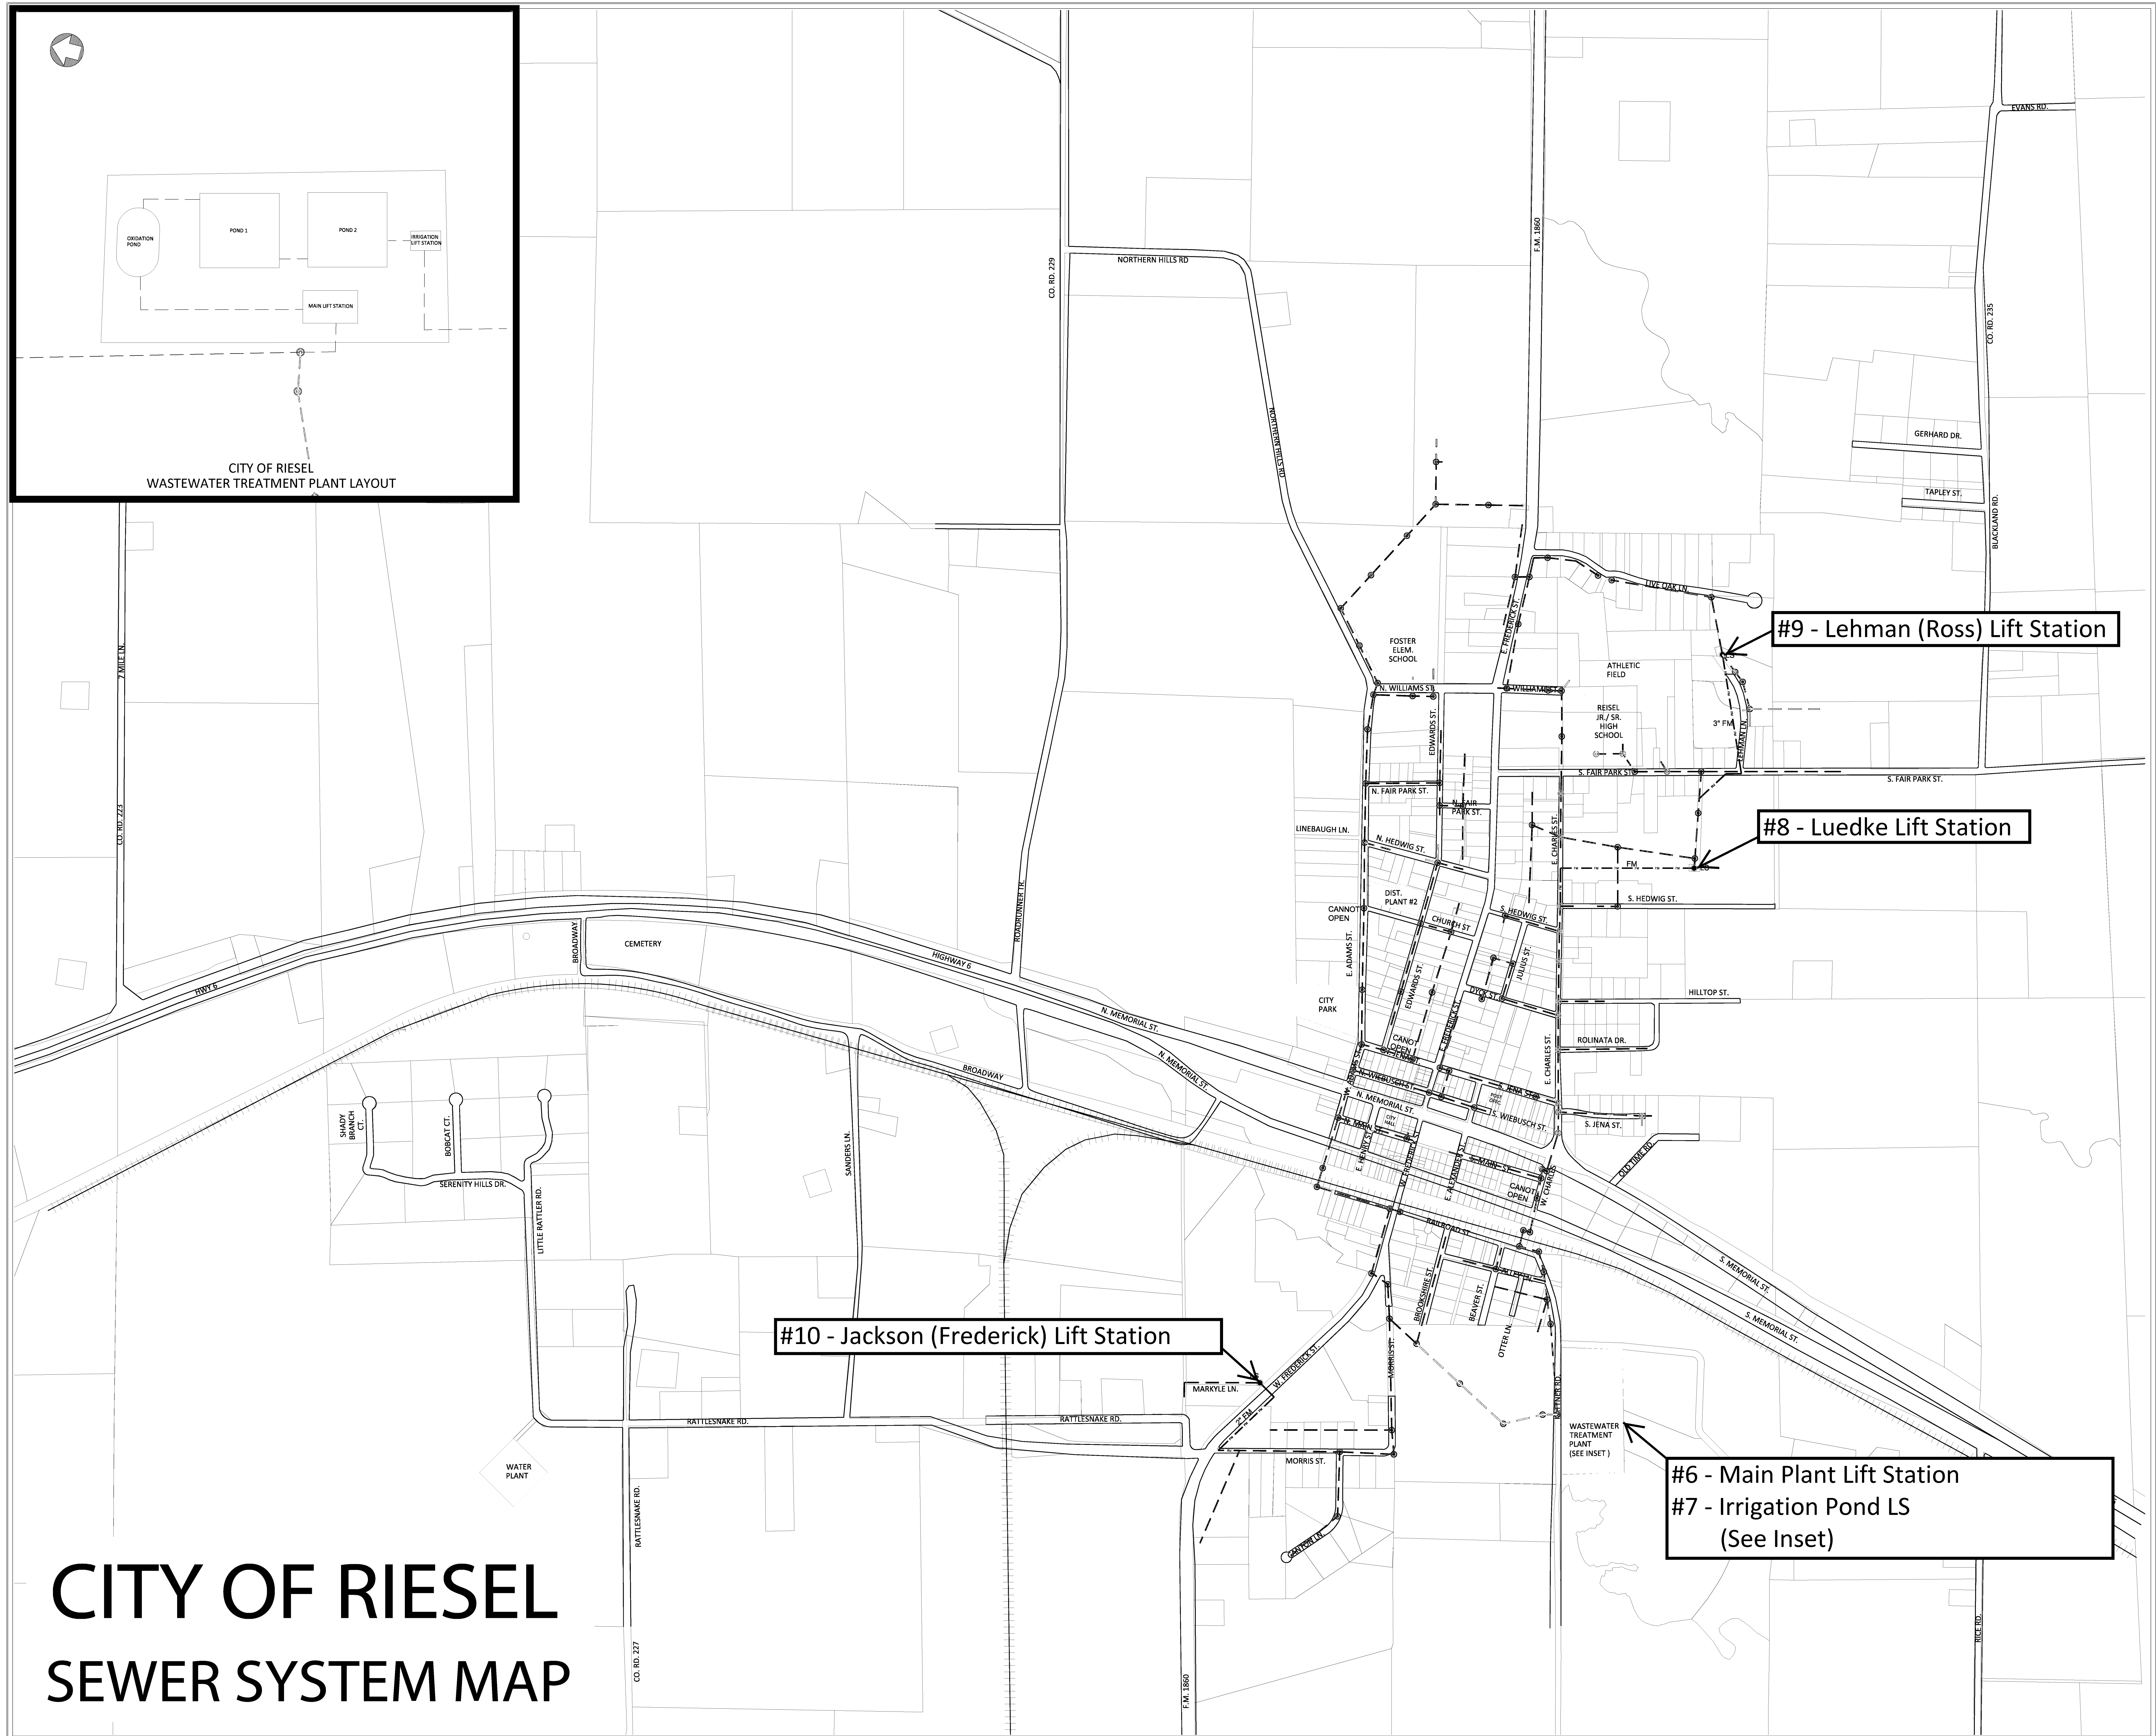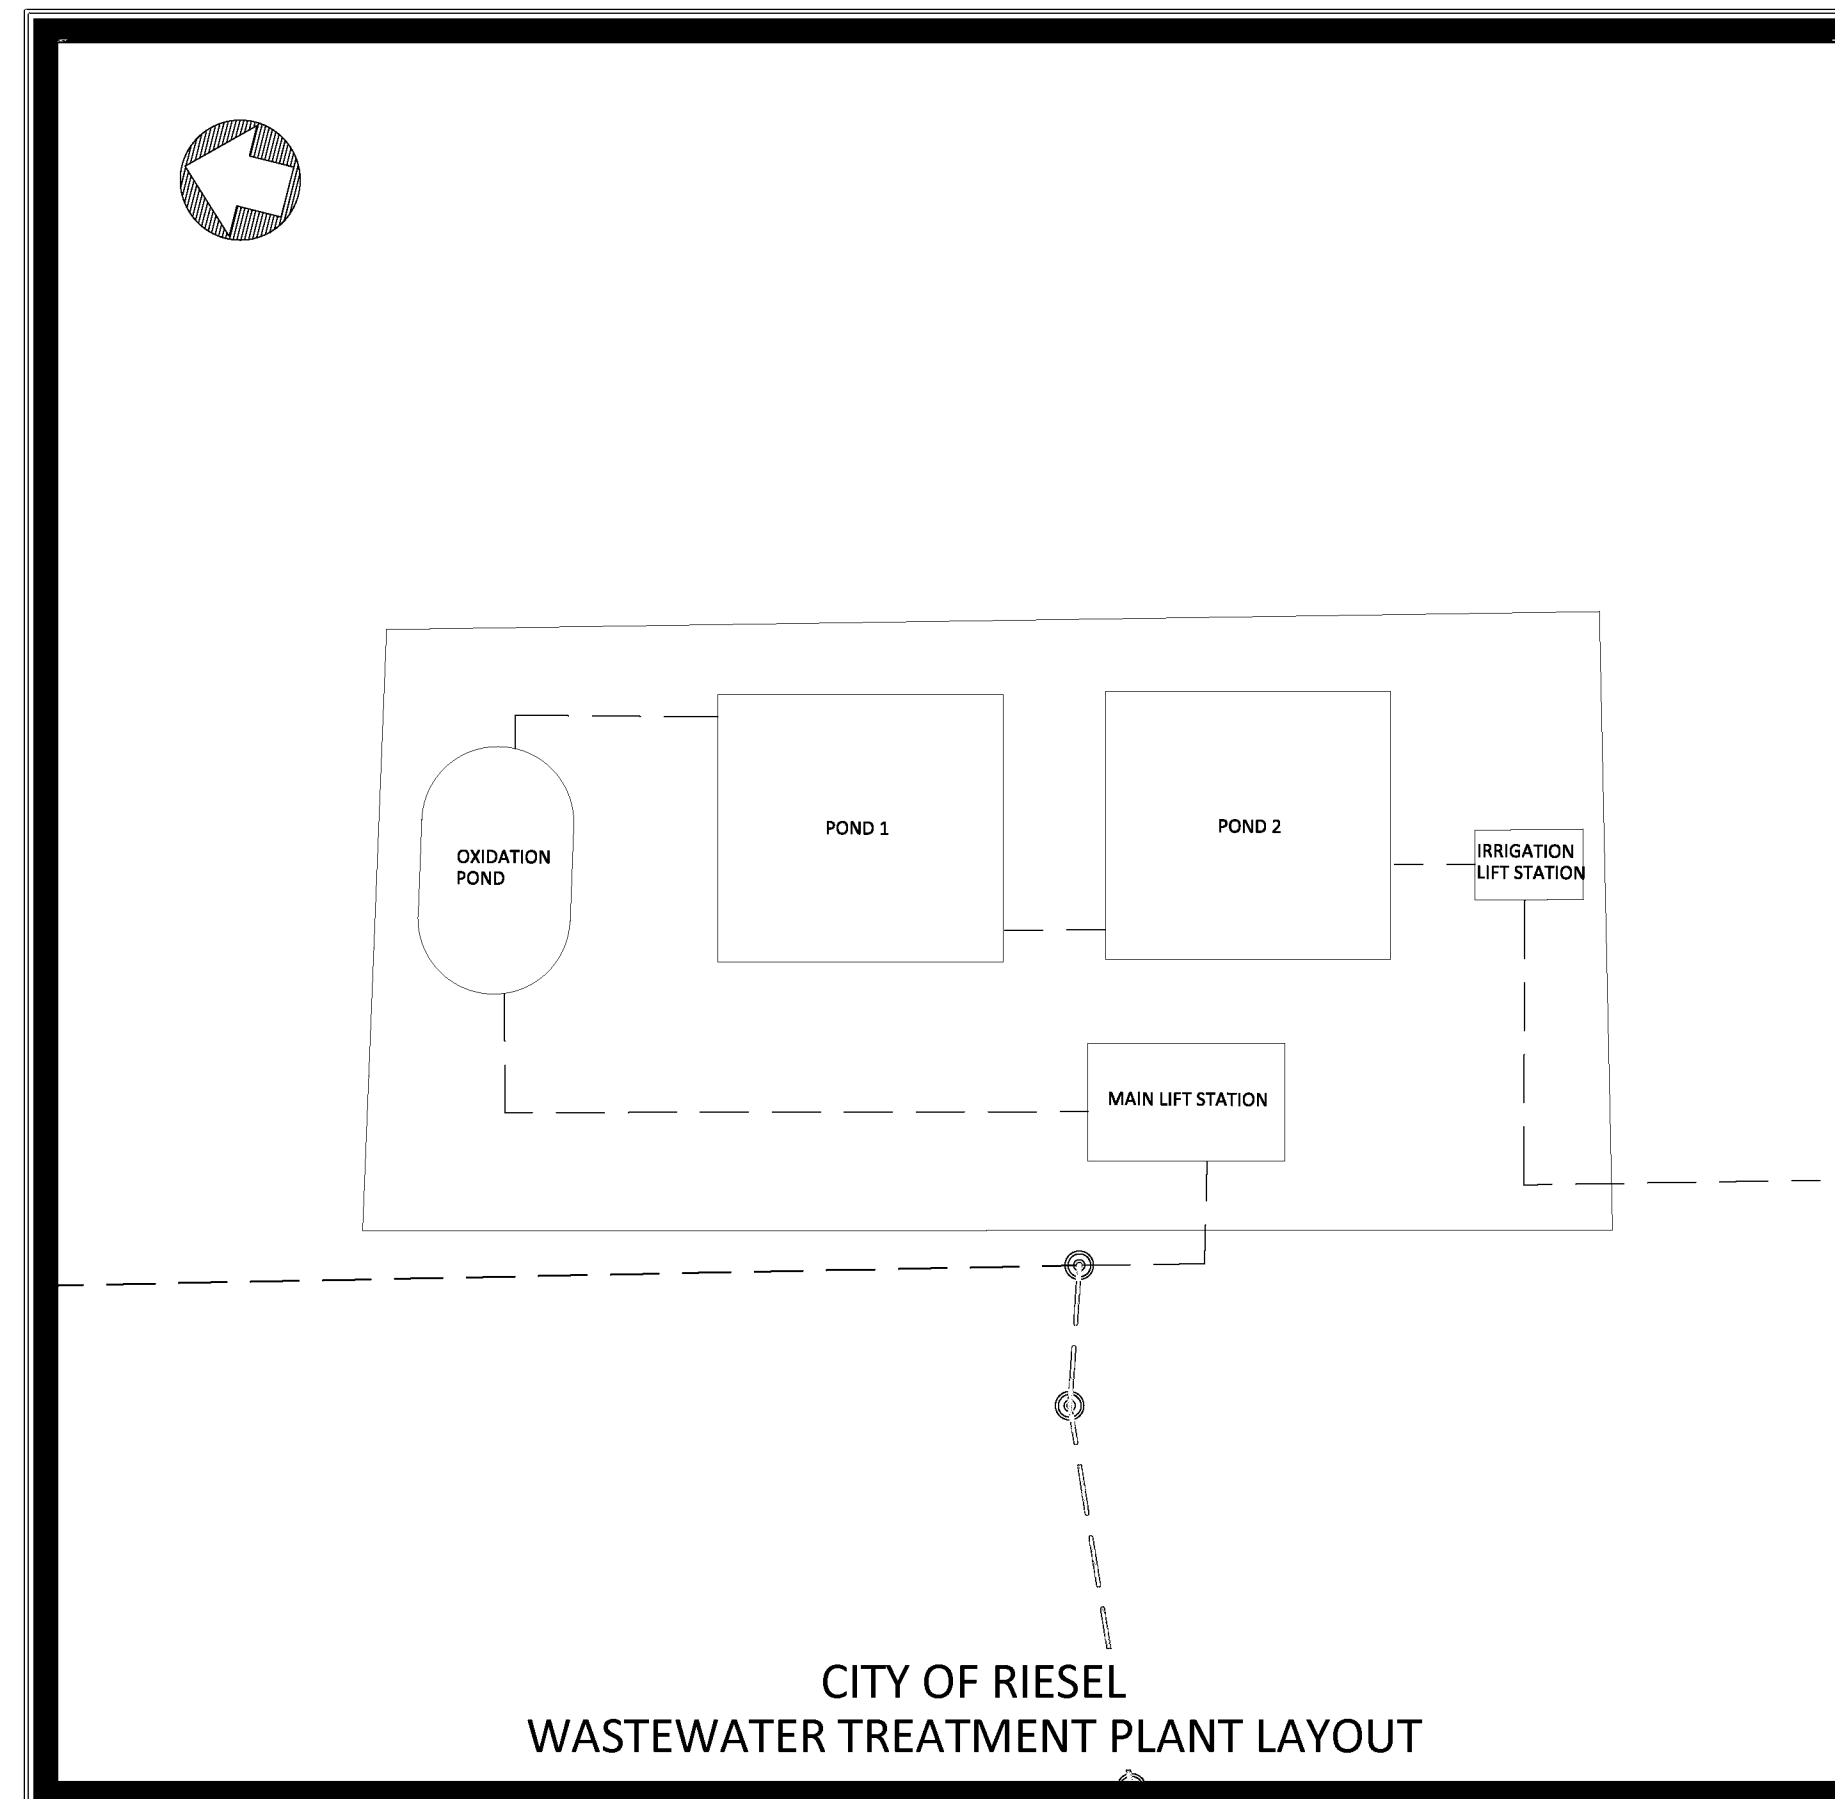

CP&Y, INC.
TEXAS REGISTERED
ENGINEERING FIRM
F-1741



Partners for a Better Quality of Life

January 27, 2022

Public Utility Commission of Texas
Central Records
1701 N Congress
PO Box 13326
Austin, Texas 78711-3326

RE: City of Riesel – Senate Bill 3 Compliance – Correction to Item 1359, Control Number 52299

Dear Central Records:

This letter is to notify you that the City of Riesel's water and sanitary sewer specific information has been refiled due to an error. The revision made was to correct the City's name in the contact information section.

I request that once the correct file has been uploaded, that filing 52299_1359_1183387 and 5229_1359_1183386 be deleted.

Thank you for your help in this matter.

Sincerely,
CP&Y, Inc.

A handwritten signature in black ink, appearing to read 'Scott Wetzel', is written over a horizontal line.

Scott Wetzel, P.E.
Senior Project Manager

200 West Highway 6, Suite 620
Waco, Texas 76712
TBPE # F-1741
TBPLS # 10194124

(p) 254.772.9272 · (f) 254.776.2924
www.cpyi.com

