



Filing Receipt

Received - 2021-10-19 08:54:44 AM

Control Number - 52299

ItemNumber - 193



Public Utility Commission of Texas
PO Box 13326
Austin, Texas 78711

RE: Critical Load/ Critical Water for Marilee SUD 0910081

To whom it may concern,

Per SB3, the new law requiring the development and implementation of emergency preparedness plan, we are required to notify our electrical providers which are Grayson Collin Electric and Oncor and inform them of our production facilities that qualify for critical load status.

Below you will find a list of the critical load status qualifying locations:

1. Well #1E / pump station- 9383 Farmington Rd Van Alstyne, Texas 75495
2. Well #3E / pump station – 11414 Farmington Rd Van Alstyne, Texas 75495
3. Well #4E / elevated tower- 7242 Farmington Rd Van Alstyne, Texas 75495


Emergency Contact information for Marilee SUD:

1. Donna Loiselle, General Manager
Phone: 972-382-3222 Mobile: 940-391-8588
2. Mike Garrison, Water Operations
Phone: 972-382-3222 Mobile: 903-375-2686
3. Bobby Chalker, Field Supervisor
Phone: 972-382-3222 Mobile: 936-433-0234
4. Gary Jones, Assistant Field Supervisor
Phone: 972-382-3222 Mobile: 903-818-4156

If you need any additional information, please contact our office.

Regards,

Mike Garrison
Water Operations

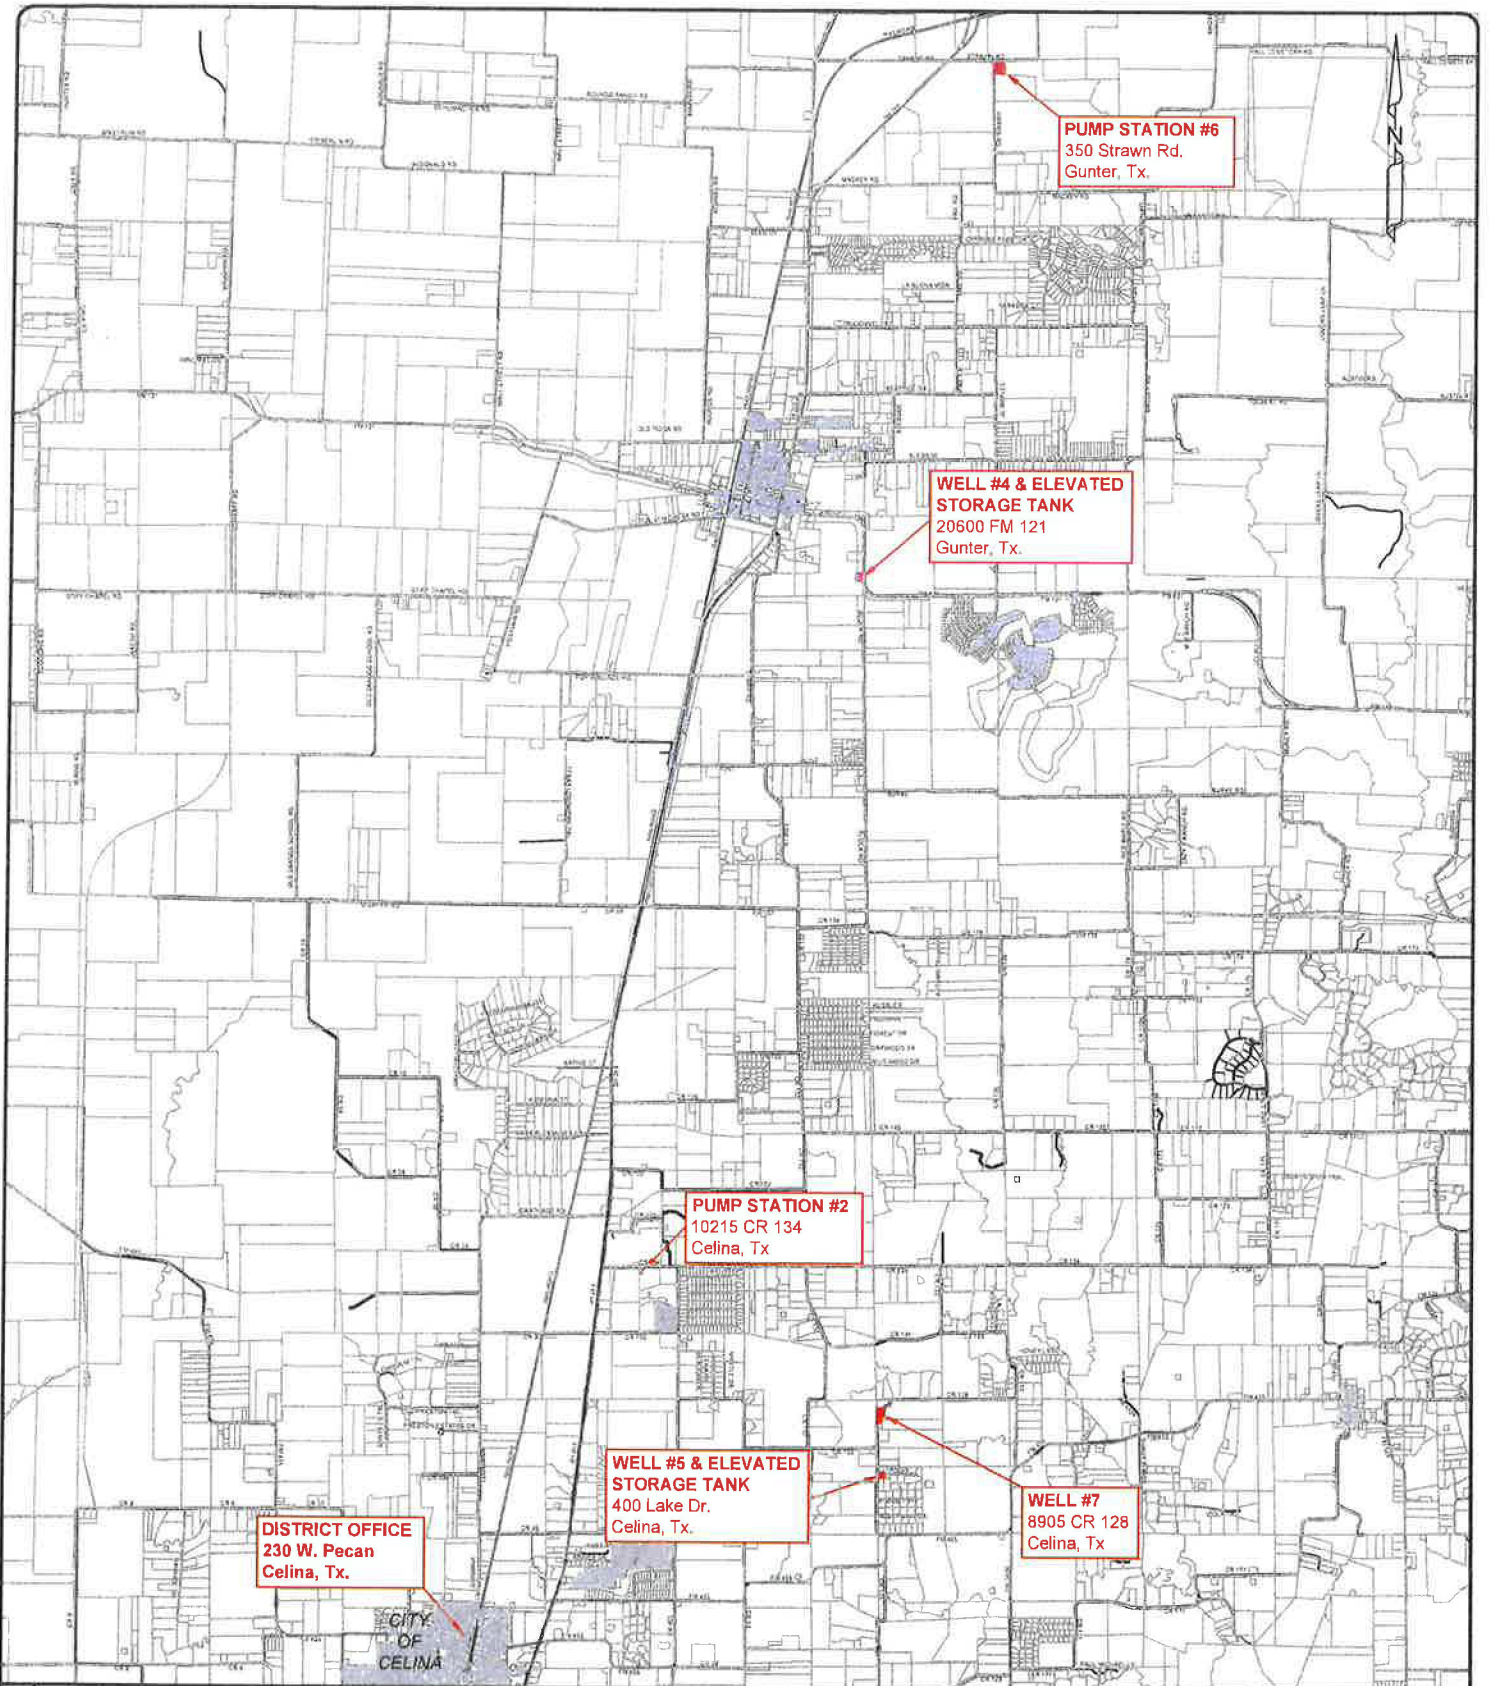

SHEET 1 OF 1

MARILEE SPECIAL UTILITY DISTRICT
COLLIN & GRAYSON COUNTIES, TEXAS

MARILEE CRITICAL SITES



118 McKinney St. • P.O. Box 606 • Farmersville, Texas 75442
Tel: 972.784.7777
(TXENG FIRM F-1114)

DESIGNED: E.W.D.	DATE: 10-13-2021
DRAWN: M.K.W.	REVISION:
FILE: N:\Marilee SUD\System Maps\Critical Sites map	



October 13, 2021

Public Utility Commission of Texas
PO Box 13326
Austin, Texas 78711

RE: Critical Load/ Critical Water for Marilee Elmont SUD 0910055

To whom it may concern,

Per SB3, the new law requiring the development and implementation of emergency preparedness plan, we are required to notify our electrical providers which are Grayson Collin Electric and Oncor and inform them of our production facilities that qualify for critical load status.

Below you will find a list of the critical load status qualifying locations:

1. Well #1E / pump station- 9383 Farmington Rd Van Alstyne, Texas 75495
2. Well #3E / pump station – 11414 Farmington Rd Van Alstyne, Texas 75495
3. Well #4E / elevated tower- 7242 Farmington Rd Van Alstyne, Texas 75495


Emergency Contact information for Marilee SUD:

1. Donna Loiselle, General Manager
Phone: 972-382-3222 Mobile: 940-391-8588
2. Mike Garrison, Water Operations
Phone: 972-382-3222 Mobile: 903-375-2686
3. Bobby Chalker, Field Supervisor
Phone: 972-382-3222 Mobile: 936-433-0234
4. Gary Jones, Assistant Field Supervisor
Phone: 972-382-3222 Mobile: 903-818-4156

If you need any additional information, please contact our office.

Regards,

Mike Garrison
Water Operations

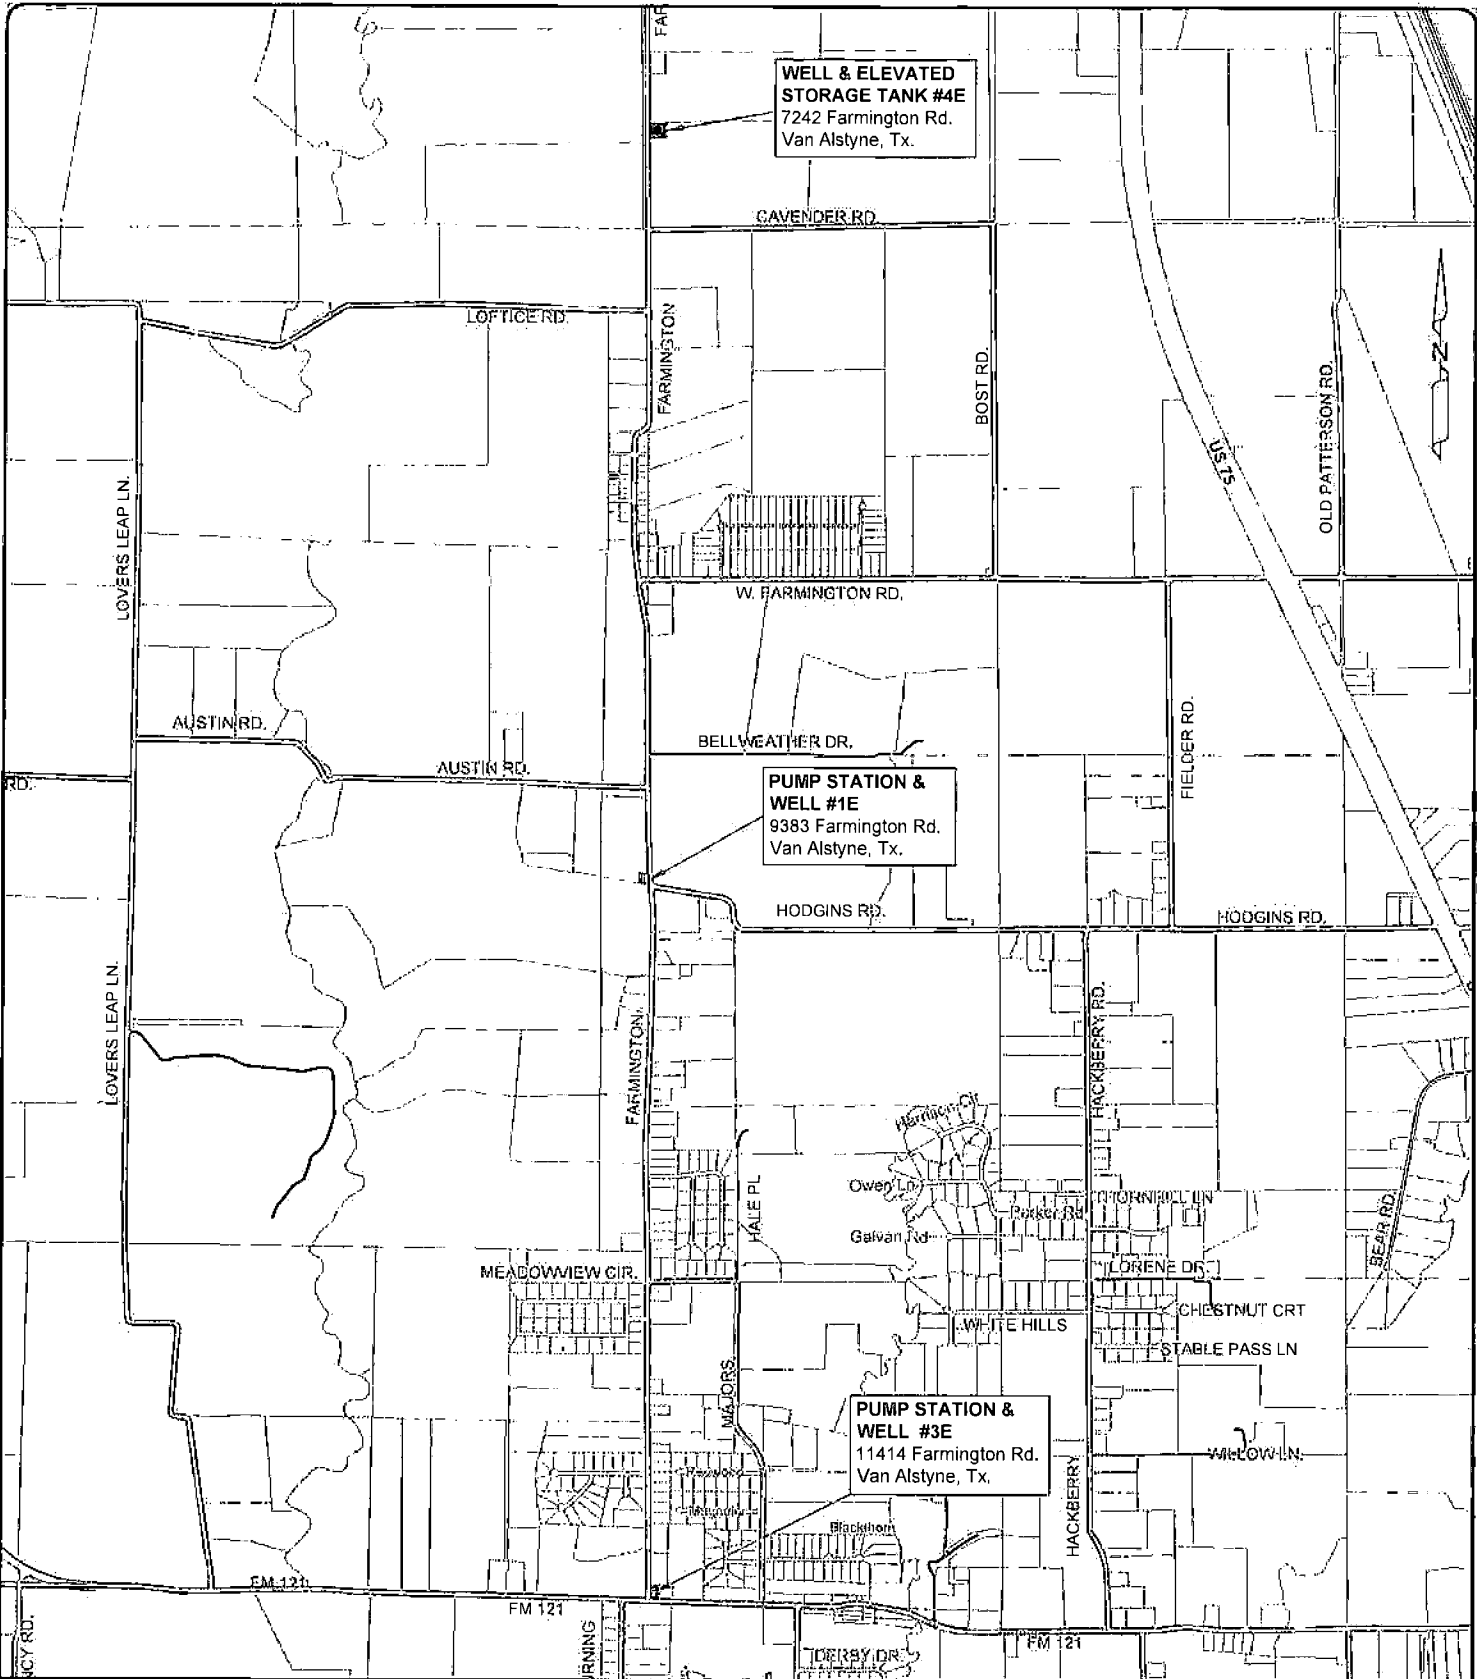

**WELL & ELEVATED
STORAGE TANK #4E**
7242 Farmington Rd.
Van Alstyne, Tx.

**PUMP STATION &
WELL #1E**
9383 Farmington Rd.
Van Alstyne, Tx.

**PUMP STATION &
WELL #3E**
11414 Farmington Rd.
Van Alstyne, Tx.

SHEET 1 OF 1

**MARILEE SPECIAL UTILITY DISTRICT
COLLIN & GRAYSON COUNTIES, TEXAS**

ELMONT CRITICAL SITES



118 McKinney St. • P.O. Box 606 • Farmersville, Texas 75442
Tel: 972.784.7777
(TXENG FIRM F-1114)

DESIGNED: E.W.D.	DATE: 10-13-2021
DRAWN: M.K.W.	REVISION:
FILE: N:\Marilee SUD\System Maps\Critical Sites map	