



Control Number: 52299



Item Number: 196



2021 OCT 19 AM 9:00

FILED CLEAR

October 13, 2021

Public Utility Commission of Texas  
PO Box 13326  
Austin, Texas 78711

RE: Critical Load/ Critical Water for Marilee Elmont SUD 0910055

To whom it may concern,

Per SB3, the new law requiring the development and implementation of emergency preparedness plan, we are required to notify our electrical providers which are Grayson Collin Electric and Oncor and inform them of our production facilities that qualify for critical load status.

Below you will find a list of the critical load status qualifying locations:

1. Well #1E / pump station- 9383 Farmington Rd Van Alstyne, Texas 75495
2. Well #3E / pump station – 11414 Farmington Rd Van Alstyne, Texas 75495
3. Well #4E / elevated tower- 7242 Farmington Rd Van Alstyne, Texas 75495

Emergency Contact information for Marilee SUD:

1. Donna Loiselle, General Manager  
Phone: 972-382-3222 Mobile: 940-391-8588
2. Mike Garrison, Water Operations  
Phone: 972-382-3222 Mobile: 903-375-2686
3. Bobby Chalker, Field Supervisor  
Phone: 972-382-3222 Mobile: 936-433-0234
4. Gary Jones, Assistant Field Supervisor  
Phone: 972-382-3222 Mobile: 903-818-4156

If you need any additional information, please contact our office.

Regards,


Mike Garrison  
Water Operations

196

**WELL & ELEVATED STORAGE TANK #4E**  
 7242 Farmington Rd.  
 Van Alstyne, Tx.

**PUMP STATION & WELL #1E**  
 9383 Farmington Rd.  
 Van Alstyne, Tx.

**PUMP STATION & WELL #3E**  
 11414 Farmington Rd.  
 Van Alstyne, Tx.

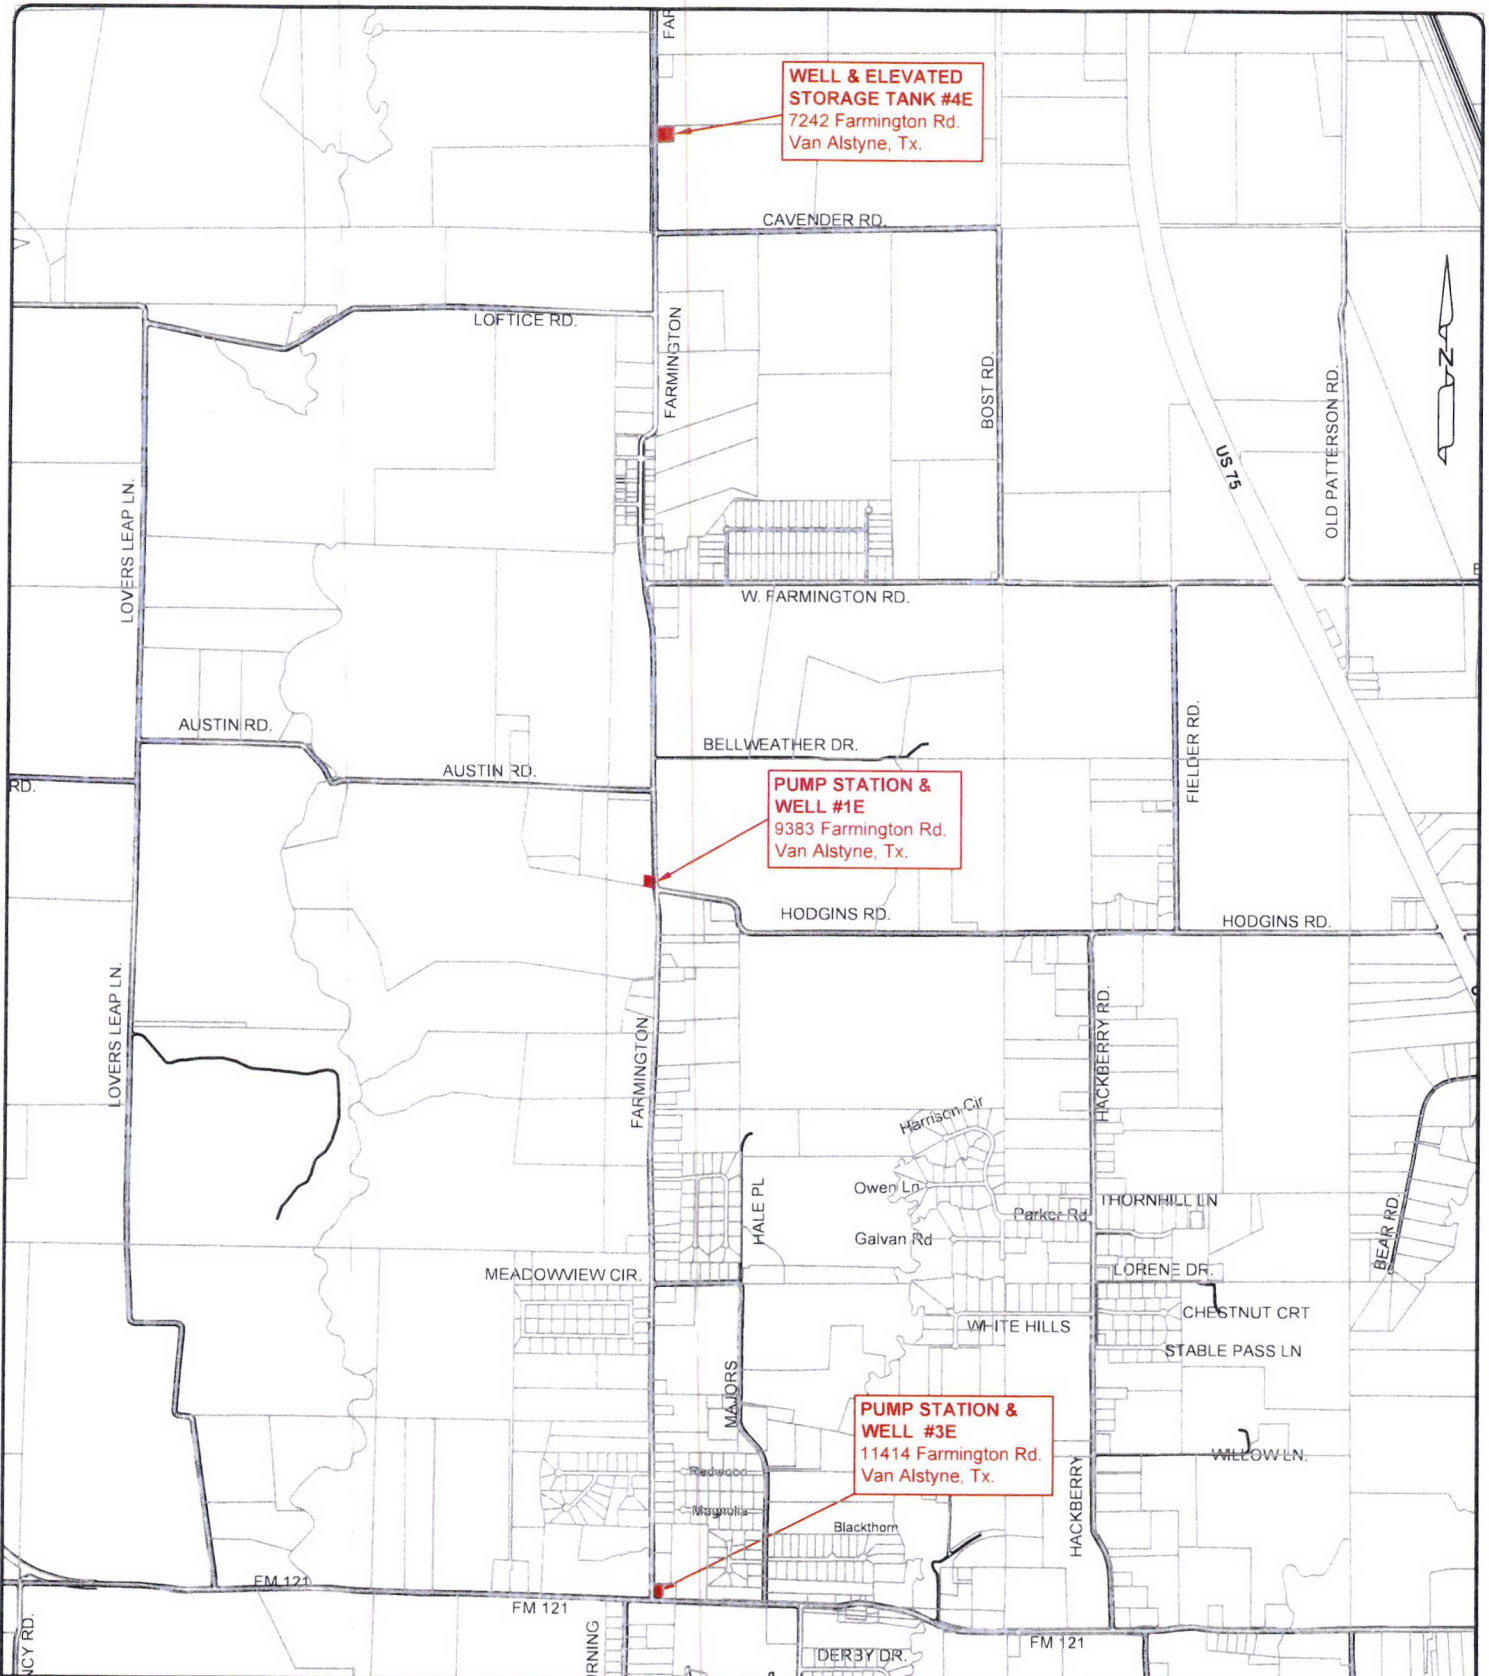

SHEET 1 OF 1

MARILEE SPECIAL UTILITY DISTRICT  
 COLLIN & GRAYSON COUNTIES, TEXAS

ELMONT CRITICAL SITES



118 McKinney St. • P.O. Box 606 • Farmersville, Texas 75442  
 Tel: 972.784.7777  
 (TXENG FIRM F-1114)

DESIGNED: E.W.D.	DATE: 10-13-2021
DRAWN: M.K.W.	REVISION:
FILE: N:\Marlee SUD\System Maps\Critical Sites map	