





Filing Receipt

Received - 2021-10-22 07:15:22 PM
Control Number - 52299
ItemNumber - 323


Northtown MUD Lift Station No. 1 14032 ½ Merseyside Dr., Pflugerville, TX 78660

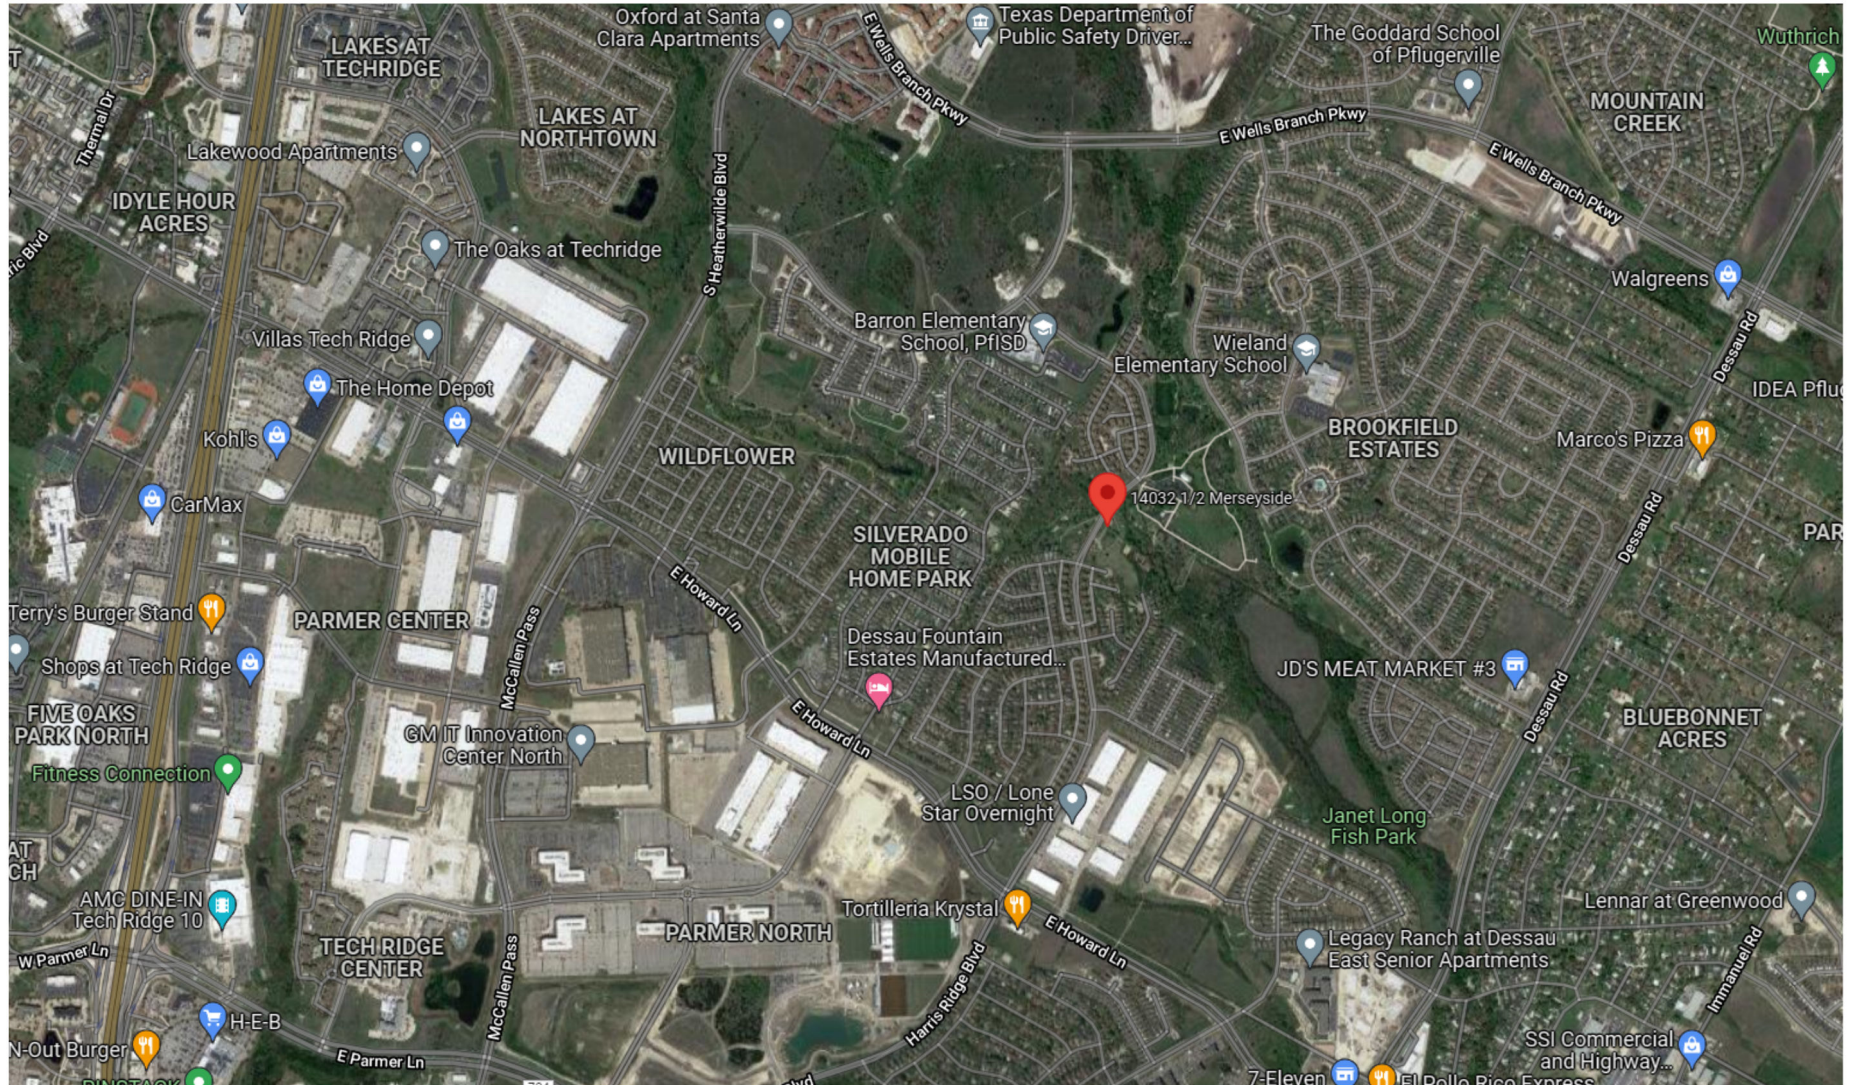

Northtown MUD LS No. 2 14210 ½ Dessau Rd., Pflugerville, TX 78660

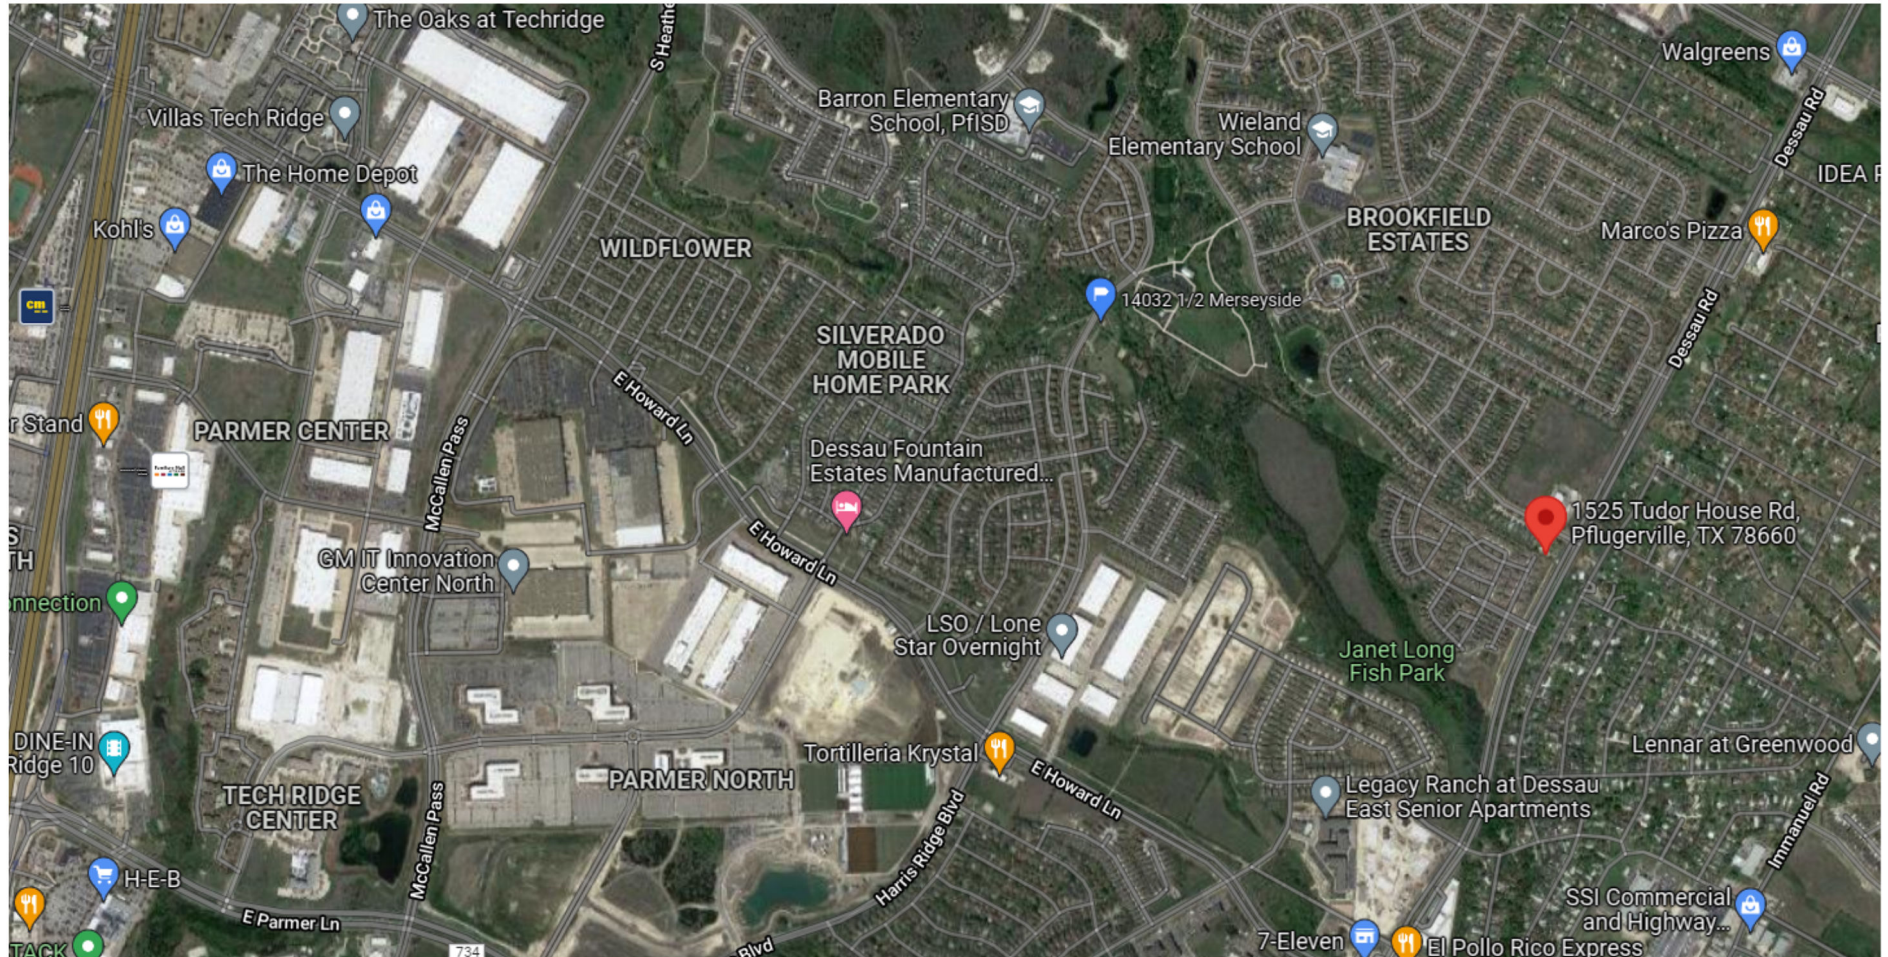

Northtown MUD LS No. 3 14906 ½ Dessau Rd., Pflugerville, TX 78660

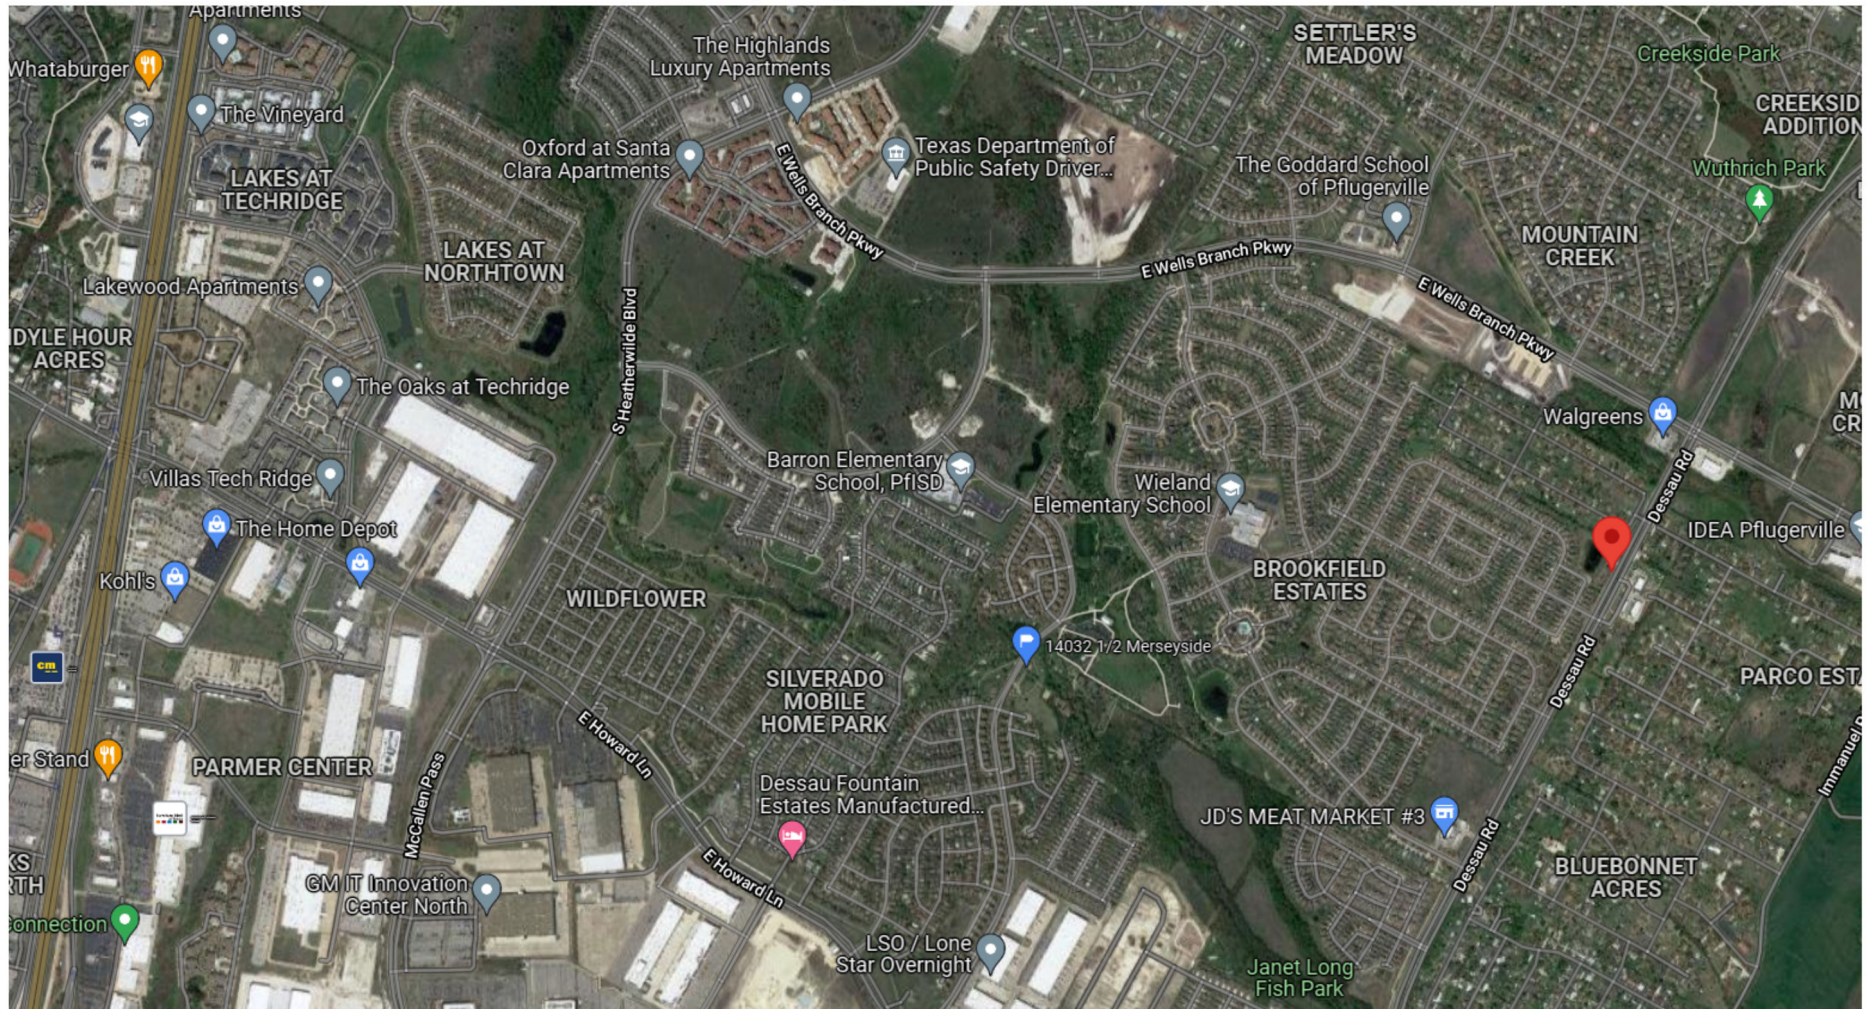

Public Utility Commission of Texas
Central Records
1701 N Congress P.O. Box 13326
Austin, Texas 78711-3326

Texas Division of Emergency Management
Texas Department of Public Safety
Emergency Management of the Governor
P.O. Box 4087
Austin, TX 78773-0220

Travis County Office of Emergency Management
5010 Old Manor Rd
Austin, Texas 78767

Austin Energy- City of Austin Utilities
PO Box 2267
Austin, Texas 78783-2267

RE: Project 52299 Senate Bill 3, 87th Legislature, Regular Session Compliance – Texas Water Code (TWC) § 13.1396

Public Utilities Commission of Texas, Austin Energy- City of Austin Utilities, Travis County Office of Emergency Management, and the Texas Division of Emergency Management:

On behalf of the **Northtown Municipal Utility District**, which is defined as an “affected utility” under TWC § 13.1396, Crossroads Utility Services, LLC, is filing this letter of compliance to meet the requirements of Texas Senate Bill 3. According to the *Utili-Facts* guidance sheet, a publication of the Public Utility Commission of Texas, this letter is to identify the name of the water or sewer utility, identify the location and a general description of all water and sewer facilities that qualify for critical load status, and include emergency contact information for the affected utility. The subsequent information provided is in congruence of the requirements of Senate Bill 3, and meets the compliance deadline of November 1st, 2021.

Name of Water or Sewer Utility: Northtown Municipal Utility District

Mailing Address: c/o Crossroads Utility Services
2601 Forest Creek Dr.
Round Rock, TX 78665

Table 1: Water and Sewer Facilities that Qualify for Critical Load Status

Name/Description	Water or Sewer	Address	Electric Service Account Number
Lift Station No. 1	Sewer	14032 ½ Merseyside Dr. Pflugerville, TX 78660	79809 10000
Lift Station No. 2	Sewer	14210 ½ Dessau Rd., Pflugerville, TX 78660	50256 10000
Lift Station No. 3	Sewer	14906 ½ Dessau Rd., Pflugerville, TX 78660	11038 20000

Table 2: Emergency Contact Information

Name	Role	Contact Information
Robert Anderson	Utility Manager	512-740-0010
		randerson@crossroadsus.com
James Wills	VP Operations	737-615-9189
		jwills@crossroadsus.com

Attached to this letter, please find a map of the district showing the locations of the critical infrastructure listed in Table 1. If there are any questions or requests for additional information in order to appropriately file the district as compliant of Senate Bill 3, please feel free to contact me.

Sincerely,

Robert E. Anderson

cc: