



Harkness Engineering and Consulting, LLC

October 17, 2021

Public Utility Commission of Texas
Central Records, Project 52299
1701 N Congress PO Box 13326
Austin, Texas 78711-3326

2021 OCT 25 AM 10:16
PUBLIC UTILITY COMMISSION
FILING CLEAR

***Re: Cape Royale Utility District, CCN No. 11223, PWS No. TX2040005, Senate Bill 3,
Critical Load Reporting, Project 52299***

Ladies and Gentlemen:

On behalf of Cape Royale Utility District, please find attached information for the District as required and defined by Texas Senate Bill 3, Affect Utilities.

Please let me know if you have any questions.

Best regards,

A handwritten signature in cursive script that reads "Mark S. Harkness".

Mark S. Harkness, P.E.
Principal

cc: Mr. Larry Clark
Cape Royale Utility District
1330 N. Cape Royale Dr.
Coldspring, TX 77331



Harkness Engineering and Consulting, LLC

CAPE ROYALE UTILITY DISTRICT
CCN NO. 11223
PWS NO. TX2040005
CRITICAL LOADS

WATER PLANT NO. 1

Address: 6 Piping Rock Place, Coldspring, TX 77331

Water Plant No.1 consists of a 500 gpm water well, three booster pumps, two ground storage tanks, and one pressure tank. The total electrical load is about 125KW.

WATER PLANT NO. 2

Address: 480 N. Cape Royale Drive, Coldspring, TX 77331

Water Plant No.1 consists of a 500 gpm water well, three booster pumps, one ground storage tanks, and one pressure tank. The total electrical load is about 125KW.

WASTEWATER TREATMENT PLANT

Address: 70 Pebble Beach Circle, Coldspring, TX 77331

The Wastewater Treatment plant consists of two parallel treatment trains. The total electrical load is about 75KW.

WATEWATER LIFT STATIONS

The District operates eleven Wastewater Lift Stations.
Their locations are, all in Coldspring, TX, 77331:

LS1 31 Twinstone
LS2 214 S. Royale Greens
LS3 70 S. Forest Cove
LS4 575 N. Forest Cove
LS5 200 S. Pine Harbour
LS6 110 Clearwater Circle
LS7 295 Imperial Circle
LS8 925 Kings Way
LS9 615 Kings Way
LS10 190 Harbour Row Drive
LS 11 70 Pebble Beach Circle

The electrical load is about 20 KW per Lift Station (220 KW Total).



Harkness Engineering and Consulting, LLC

CAPE ROYALE UTILITY DISTRICT
CONTACT INFORMATION

ADDRESS


Cape Royale Utility District
1330 N. Cape Royale Drive
Coldspring, Texas 77331
Phone: 936-653-4861

PRIMARY EMERGENCY CONTACT

Larry Clark
General Manager
Mobile: 936-425-1552

SECONDARY EMERGENCY CONTACT

Mike Jacobs
Field Supervisor
Mobile: 832-401-6830

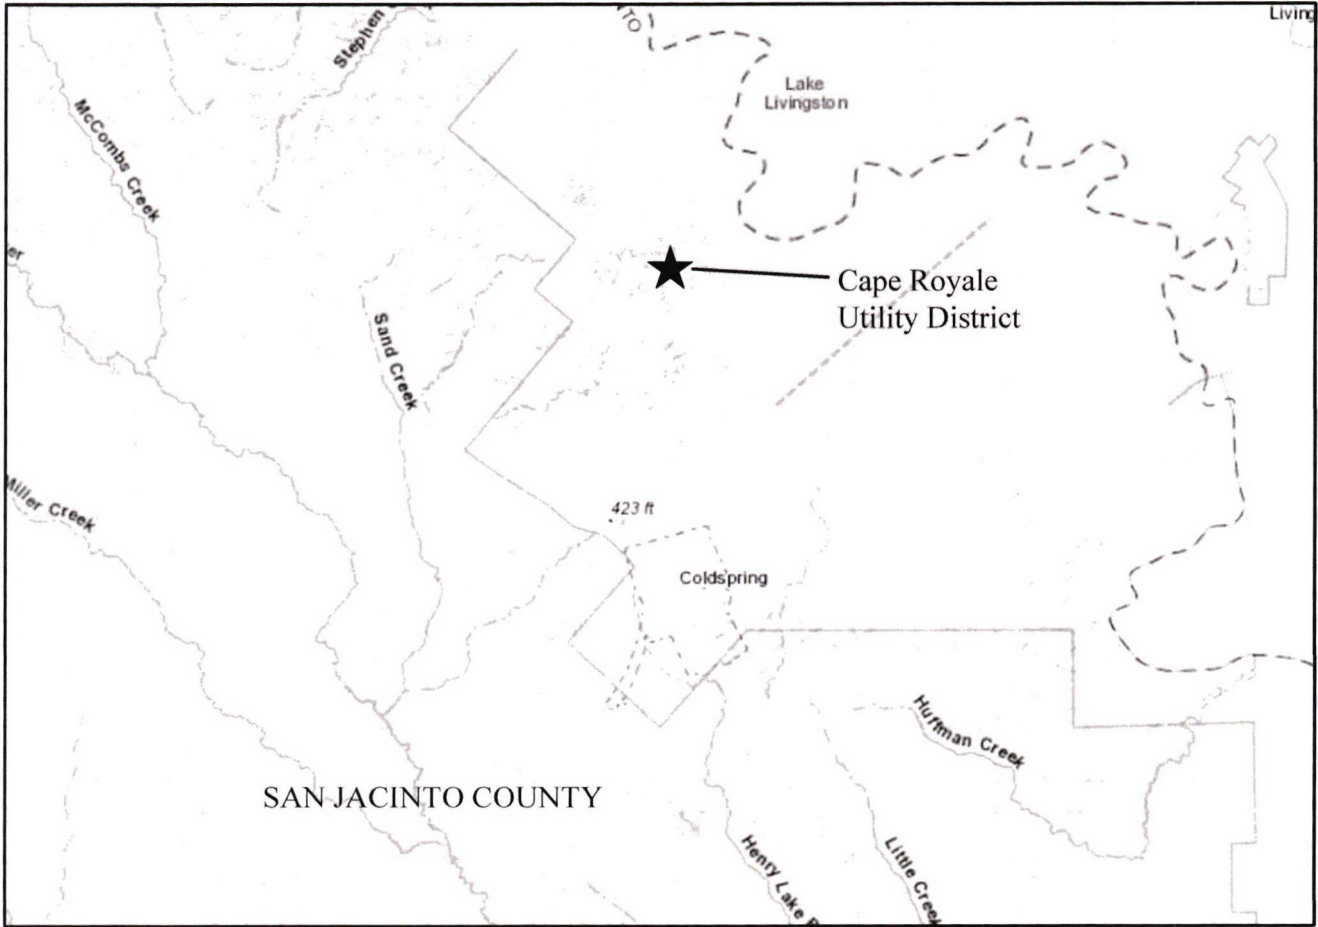

Harkness Engineering
and Consulting, LLC


Texas Firm Registration No. 18400

Cape Royale Utility District

Location Map



NOTE:
LS = Lift Station

| | | | | | | | |
|--|--|-----|------|----|----------|---|---|
|  Harkness Engineering and Consulting, LLC Texas Firm Registration No. 18400 | Harkness Engineering and Consulting, LLC 1805 Harvard St. Houston, Texas 77008 713-819-6981 | | | | | Client Cape Royale Utility District 1330 Cape Royale Drive Coldspring, Texas 77331 | Cape Royale Utility District Critical Load Locations Sheet 1 of 1 |
| | | REV | DATE | BY | COMMENTS | | |