



Filing Receipt

Received - 2021-10-25 01:44:05 PM
Control Number - 52299
ItemNumber - 367



**Meeker Municipal Water District
807 North Meeker Rd Beaumont TX 77713**

Public Utility Commission of Texas (PUCT)
PO Box 13326
Austin, TX 78711-3326
E-filing: www.puc.texas.gov

RE: Information for Meeker MWD, CCN 11290, as per Senate Bill 3, 87th Legislature, Project 52299


To Whom it May Concern:

The Meeker MWD qualifies for critical load status as per definition for an affected utilities per The Public Utility Commission of Texas (PUCT) in Project 52299.

Please find attached the facility and the emergency contact information for Meeker MWD.

If you have any questions, please contact Lynn Van Der Beek at 409-866-1670 or at Meekerwater08@att.net.

Sincerely,

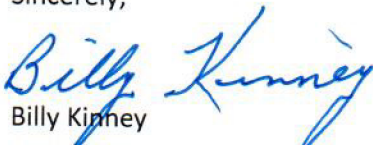
Billy Kinney
President

Enclosed: Emergency Contact List, Picture of well sites and Description of system GPS

Cc: Entergy,

Jefferson County Office of Emergency Management, rgrimm@cojefferson.tx.us

Texas Division of Emergency Management, Texas Department of Public Safety, PO Box 4087, Austin, TX 78773-0220

MEEKER MWD

Description of System:

Meeker Municipal Water District, MWD, supplies drinking water to customers within its boundaries. The CCN# 11290 is for water service only, all sewer is on private septic or aerobic systems. The source water consists of three ground water wells and an elevated storage tank. All four sites are critical load locations in order to supply potable water to the District.

Electric utility is Entergy of Texas – a request is made to qualify for critical load status for four facilities.



Facility	Address	GPS	Entergy Acct. #
Well #3	10325 Tram Road, Beaumont, TX 77713	30°09'35.5"N, 94°14'05.9"W 30.159853, -94.234962	136130135
Well #2	4970 Tolivar Canal, Beaumont, TX 77713	30°09'25.6"N, 94°13'57.6"W 30.157104, -94.232667	141517185
Well #1	4712 Tolivar Canal Beaumont, TX 77713	30°09'11.8"N, 94°13'57.0"W 30.153279, -94.232488	141484550
Elevated Tower	807 N Meeker Road, Beaumont, TX 77713 (Mailing Address)	30° 4' 38.805"N, 94° 15' 47.1558"W 30.077446, -94.263098	138913769

Emergency Contact Information


Name	Title	Email	Office Phone	Cell Phone	Home Phone
Billy Kinney	President MMWD	billyrk@swbell.net		409-781-1008	409-861-2345
Josh Armfield	T. Johnson Ind. Owner	utilityinnovations@gmail.com	409-284-0440	409-782-7005	
Tommy Showers	VP of MMWD	Thomas.c.showers@exxonmobil.com	409-882-2654	409-782-6415	
Charlie Adams	T. Johnson Ind. VP	utilityinnovations@gmail.com	409-284-0440	409-782-4588	

*List in order of priority


Meeker Municipal Water District

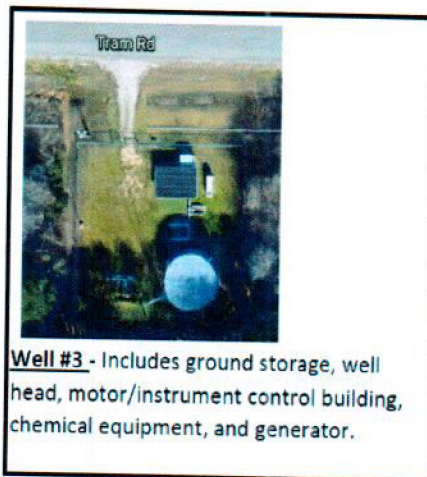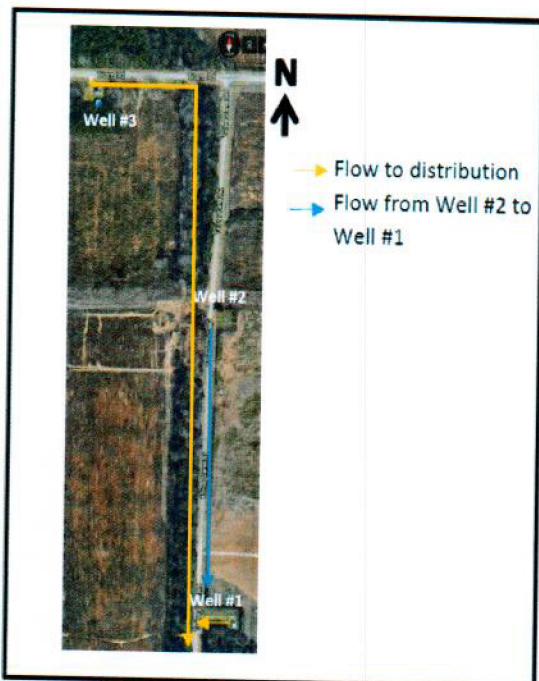

Well #3 - Includes ground storage, well head, motor/instrument control building, chemical equipment, and generator.

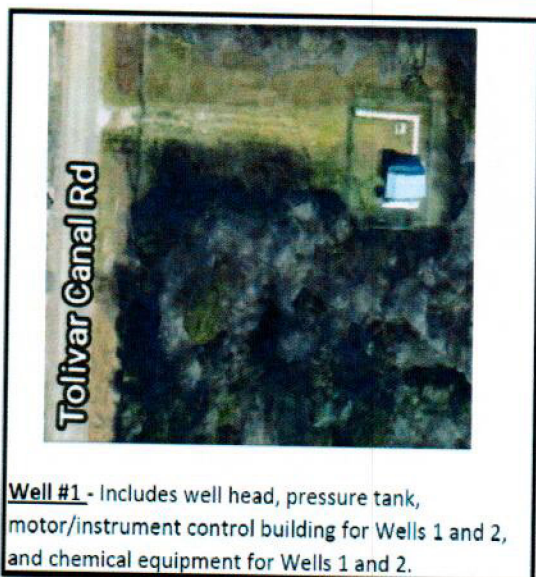


Well #1 - Includes well head, pressure tank, motor/instrument control building for Wells 1 and 2, and chemical equipment for Wells 1 and 2.

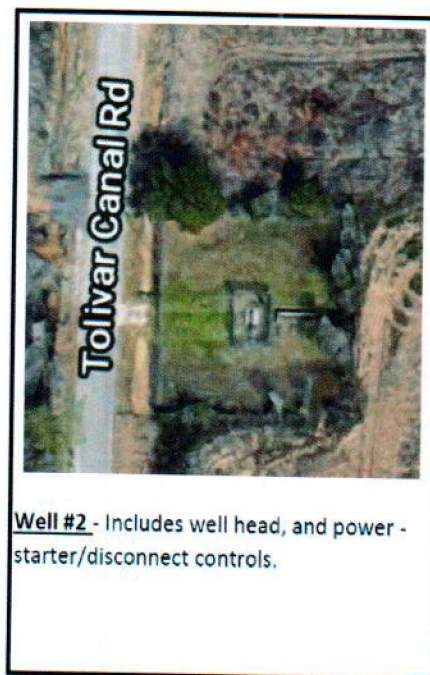

Well #2 - Includes well head, and power - starter/disconnect controls.

Note: Well #3 is largest Well and can operate by itself. Well #2 flows to Well #1 site and then to distribution system. The chemical feed and controls for Well #1 & #2 are located at Well #1. Depending on water system demand, all three wells can run and in emergency situations the interconnect with the City of Beaumont is activated. Under normal conditions the Wells are alternated between Well #3 and Wells #1&2 together.

Elevated Storage Tank
807 N Meeker Road

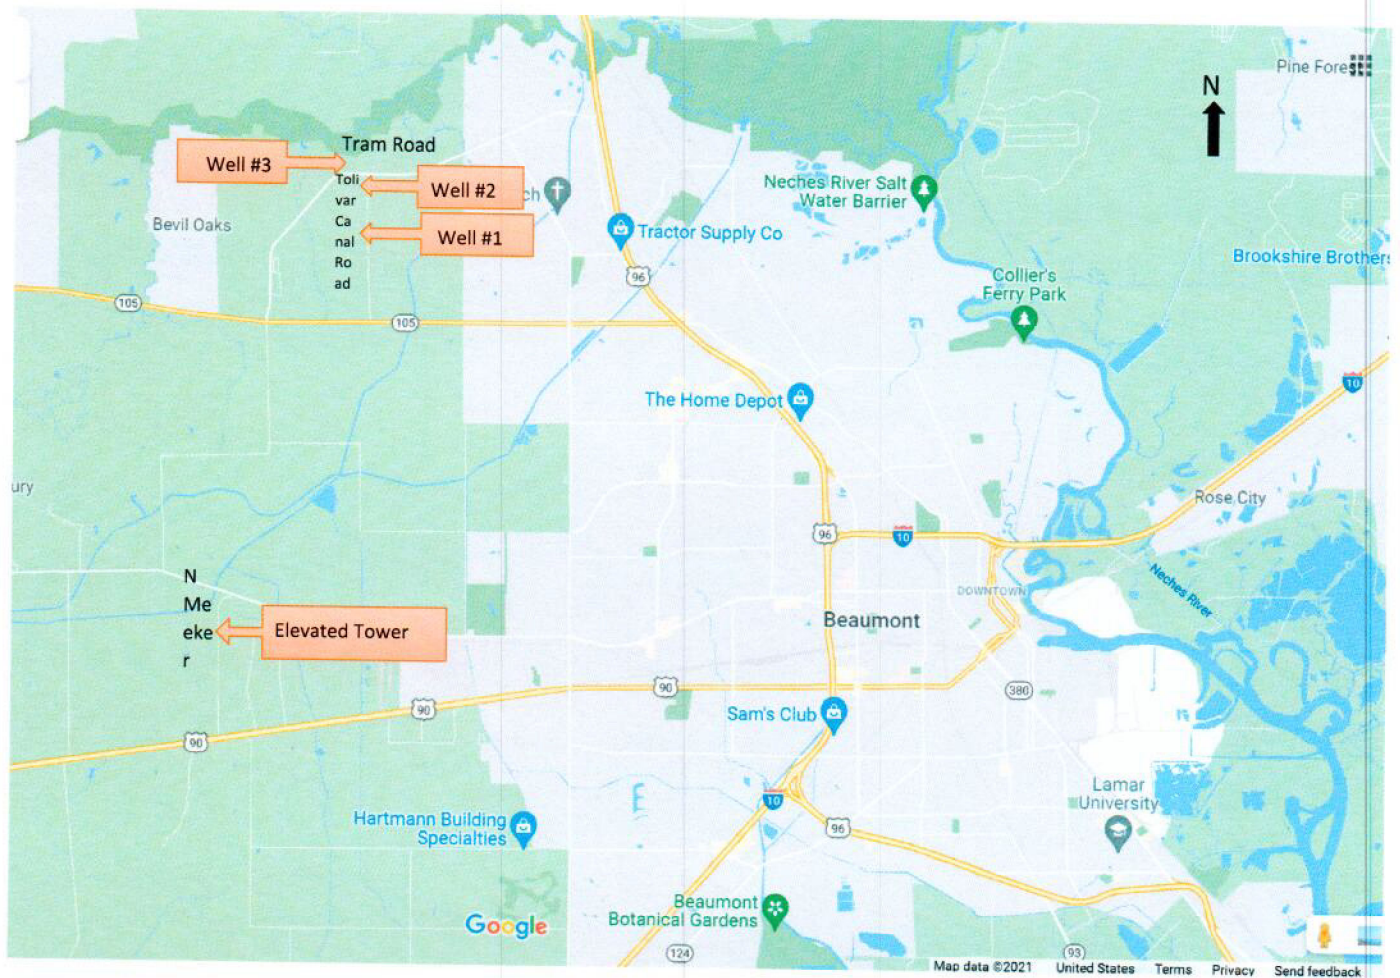

UTILI-FACTS

Project 52299

Senate Bill 3, 87th Legislature, Regular Session

Compliance Guidance - Texas Water Code (TWC) §13.1396

By **November 1, 2021**, entities that meet the definition of “affected utilities” under TWC §13.1394 must file specific information with the Public Utility Commission of Texas (PUC) in Project 52299. This information must also be filed with each transmission and distribution service provider, each retail electric provider, and the office of emergency management of each county where the utility has water or sewer facilities that qualify for critical load status.

Q: Am I an “affected utility”?

A: TWC §13.1394 defines an “affected utility” as a retail public utility, exempt utility, or provider or conveyor of potable or raw water service that:

- Furnishes water service to more than one customer; and
- Is not an affected utility under TWC §13.1395 (Fort Bend or Harris Counties).

Q: Who is required to file this information with the PUC?

A: All entities that meet the definition of an “affected utility” as defined in TWC §13.1394 are required to file this information with the PUC. Entities located in Fort Bend and Harris Counties are exempt from this requirement as they do not meet the definition of “affected utility” in TWC §13.1394.

Q: What information must be filed to meet this requirement?

A: You must file a letter identifying the name of your water or sewer utility. Please also include the names of any affiliates and assumed names, if any. In addition, include a list of all the public water systems and sewer systems owned by your utility for which you are filing the information.

- Identify the location and provide a written, general description of all water and sewer facilities that qualify for critical load status (may include maps if this would help you identify the location of your facilities); and
- Emergency contact information for the affected utility, including:
 - The name of the person who will serve as a point of contact and the person’s telephone number;

- The person who will serve as an alternative point of contact and the person’s telephone number; and
- The affected utility’s mailing address.

Q: Where must this information be filed?

A: This information must be filed with each of the following:

- 1) the PUC,
- 2) each electric utility that provides transmission and distribution services to you. Your electric utility is the company that distributes electricity from power generation facilities to homes and businesses in Texas.
- 3) each retail electric provider that sells electric power to you (applies only in competitive areas of ERCOT),
- 4) the office of emergency management of each county in which the utility has water and wastewater facilities that qualify for critical load status, and
- 5) the division of emergency management of the governor at: Texas Division of Emergency Management, 1033 La Posada Ste 300, Austin, TX 78752.

Please file this information in Central Records, Project 52299. You may request that the information be filed confidentially if you feel that publicly filing facility location and possibly maps will make your water or wastewater utilities more vulnerable. For instructions on the PUC’s filing requirements and on how to file with the PUC, please click on the link below. Instructions on how to file confidentially are also located at this link.

<https://www.puc.texas.gov/industry/filings/FilingProceed.aspx>

For instructions on how to file with your electric providers and the office of emergency management of each county in which you have water or wastewater facilities, please contact them directly.

Q: Is there a deadline?

A: Yes, the deadline to comply with this new requirement is November 1, 2021.

Q: What if I have additional questions?

A: Please email the PUC at DUO@puc.texas.gov or call (512)936-7405 if you have additional questions.