



Control Number: 52299



Item Number: 577



128 AM 9:58

Water Services Department
City of College Station
College Station, Texas 77485
ph. 979.764.3660

October 22, 2021

RE: Project 52299 / Senate Bill 3

To Who It May Concern:

The City of College Station (COCS) Water Services Department (WSD) is the sole potable water provider for the City of College Station, Texas. We are providing this Critical Load Status Letter for compliance with Senate Bill 3 in the 87th Legislature and Texas Water Code §13.1396.

Water/Wastewater Facilities that Qualify for Critical Load Status:

Facilities that are operated by the City of College Station's Water Services Department, that qualify for critical load status, can be found in the attached 'Exhibit A'. This exhibit includes the name, location, electrical provider, and the general description of each identified facility.

Emergency Contact Information:

Primary: Gary Mechler
Director of Water Services
979-764-3432 (office)
713-859-9248 (cell)
Gmechler@cstx.gov

Alternate: Alan Gibbs
Assistant Director of Water Services
979-764-6338 (office)
979-575-0135 (cell)
Agibbs@cstx.gov


Respectfully,

Gary Mechler
Director of Water Services

Enclosed: Exhibit A

577

CITY OF COLLEGE STATION

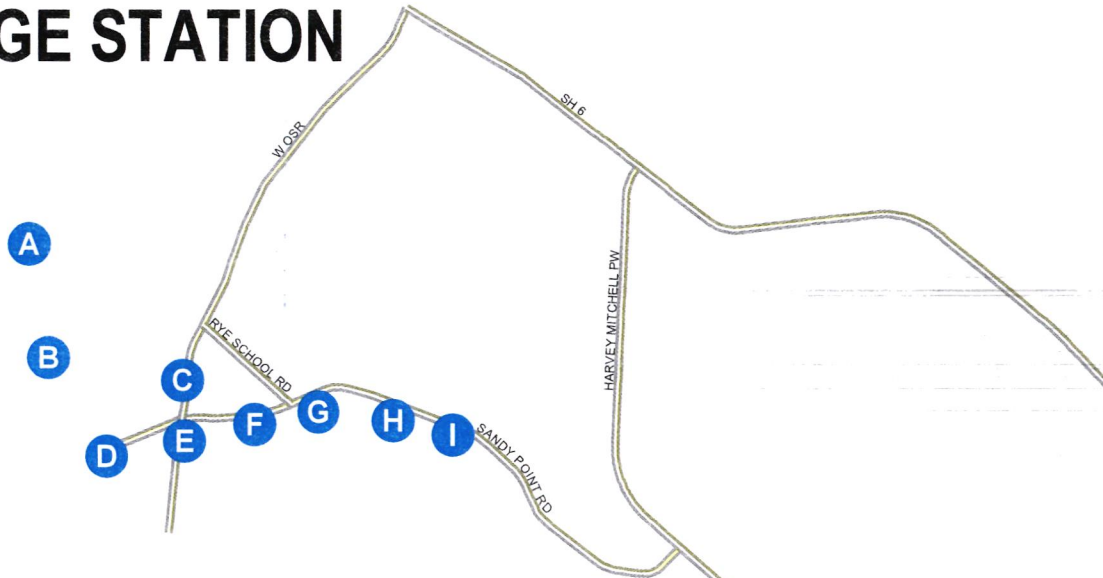

Facility ID	Facility Name	Facility Description	Address	Electric Provider	Meter Number	Other Meters
A	Well 9	3,300 GPM Simsboro Well (Permitted Capacity)	4208 Old San Antonio Rd	ENTERGY	AM12909332	
B	Well 8	3,300 GPM Simsboro Well (Permitted Capacity)	4208 Old San Antonio Rd	ENTERGY	AM11457205	
C	Well 7	3,000 GPM Simsboro Well (Permitted Capacity)	4210 Old San Antonio Rd	BTU	301239	
D	Well 6	3,400 GPM Simsboro Well (Permitted Capacity)	9620 Sandy Point Rd	BTU	301069	
E	Well 5	3,400 GPM Simsboro Well (Permitted Capacity)	4665 Old San Antonio Rd	BTU	301234	
F	Well 3	3,400 GPM Simsboro Well (Permitted Capacity)	8628 Sandy Point Rd	BTU	300535	
G	Well 2	3,400 GPM Simsboro Well (Permitted Capacity)	8351 Sandy Point Rd	BTU	301233	
H	Well 1	3,400 GPM Simsboro Well (Permitted Capacity)	7901 Sandy Point Rd	BTU	301240	
I	Sandy Point Road PS	31.68 MGD Pump Station (Firm Capacity)	7286 Sandy Point Rd	BTU	V203480	
J	Dowling Road PS	49.47 MGD Pump Station (Firm Capacity)	401 N Dowling Rd	CSU	163532886	163532883 160845636 160845638

WATER AND SEWER FACILITIES
THAT QUALIFY FOR CRITICAL LOAD STATUS

Facility ID	Facility Name	Facility Description	Address	Electric Provider	Meter Number	Other Meters
1	Hensel Park LS	2,200 GPM Lift Station (Firm Capacity)	540 Floriculture Rd	CSU	164704827	
2	Valley Park LS	128 GPM Lift Station (Firm Capacity)	404 Harvey Mitchell Pkwy S	CSU	164704680	
3	Eastside LS	625 GPM Lift Station (Firm Capacity)	4805 Underbrush Crossing	BTU	301150	
4	Luther Street LS	260 GPM Lift Station (Firm Capacity)	1250 Harvey Mitchell Pkwy S	CSU	73570598	
5	Carter Creek WWTP	9.5 MGD Wastewater Treatment Plant (Permitted Capacity)	2200 N Forest Pkwy	CSU	162875292	1961770
6	Aggie Acres LS	145 GPM Lift Station (Firm Capacity)	4430B Reveille Rd	BTU	202708	
7	Mission Ranch LS	436 GPM Lift Station (Firm Capacity)	3754 Hardin Hills Dr	BTU	300338	
8	Foxfire LS	399 GPM Lift Station (Firm Capacity)	2700 Faulkner Dr	CSU	162875261	
9	Carter Lake WWTP	5.9 GPM Wastewater Treatment Facility (Permitted Capacity)	2401 Carter Lake Dr	BTU	146004	
10	Rock Prairie LS	441 GPM Lift Station (Firm Capacity)	4055 SH 6 S	CSU	160845783	
11	LS 3	1,400 GPM Lift Station (Firm Capacity)	4040 SH 6 S	CSU	164704667	
12	LS 2	745 GPM Lift Station (Firm Capacity)	4130 SH 6 S	CSU	160845802	
13	Westminster LS	180 GPM Lift Station (Firm Capacity)	14363 FM 2154	CSU	163532918	
14	Castlegate 2 LS	155 GPM Lift Station (Firm Capacity)	3340 Greens Prairie Rd	CSU	163533116	
15	LS 4	990 GPM Lift Station (Firm Capacity)	2220 William D Fitch Pkwy	BTU	200815	
16	Lick Creek WWTP	9.5 MGD Wastewater Treatment Plant (Permitted Capacity)	14802 Rock Prairie Rd	CSU	164704574	163562873
17	Southern Pointe LS	395 GPM Lift Station (Firm Capacity)	425 Peach Creek Cut-Off Rd	ENTERGY	AM12141885	
18	Indian Lakes LS	40 GPM Lift Station (Firm Capacity)	17530 Seneca Springs	BTU	200601	
19	Crooked Creek Path LS	133 GPM Lift Station (Firm Capacity)	4076 Crooked Creek Path	BTU	200365	
20	Creek Meadow LS	645 GPM Lift Station (Firm Capacity)	4275 Greens Prairie Trl	BTU	200726	

