



## Filing Receipt

**Received - 2023-04-11 02:45:24 PM**  
**Control Number - 52667**  
**ItemNumber - 131**

**PROJECT NO. 52667**

**FILING OF ATTESTATIONS  
DEMONSTRATING COMPLIANCE  
WITH HB 4150**

§  
§  
§

**PUBLIC UTILITY COMMISSION  
OF TEXAS**

**PROGRESS REPORT OF  
DENTON COUNTY ELECTRIC COOPERATIVE, INC., D/B/A  
COSERV ELECTRIC**

Denton County Electric Cooperative, Inc. d/b/a CoServ Electric files this progress report regarding compliance with Section 6 of House Bill 4150 (“HB 4150”), providing information regarding distribution lines on United States Army Corps of Engineers (“USACE”) property that CoServ Electric identified as non-compliant in its report and attestation filed in this docket on January 14, 2022 (“Initial Report”). By letter dated March 4, 2022, the Division of Compliance and Enforcement (“DICE”) of the Public Utility Commission of Texas (“Commission”) requested a progress report and additional information to be filed on a monthly basis. This is CoServ Electric’s progress report for April 2023, which is timely filed.

**I. Progress Report**

In its last progress report, CoServ Electric identified four distribution line segments located in areas that could be suitable for a sailboat and remained non-compliant with the applicable clearance standards in Rule 232 of NESC Standard ANSI (c)(2) (“NESC Rule 232”). These four line segments remain in progress at Lake Ray Roberts or Lake Lewisville, as described below. Availability of atypical, taller poles continues to delay completion of construction for two of these line segments (Ray Roberts 3 and Lewisville 34). CoServ Electric is evaluating material alternatives due to supply chain delays. CoServ Electric expects construction of the Ray Roberts 20 project to be completed by April 28, 2023.

**1. Status of engineering design, permitting, and reconstruction.**

The status of the four remaining distribution line segments is as follows:

- Ray Roberts 3 – In construction; waiting for further delivery of 75-foot and 80-foot wood poles.
- Ray Roberts 20 – In construction; estimated completion by April 28, 2023.

- Lewisville 31A – Electrician and customer still working with USACE to install new customer-owned meter pedestal and underground facilities to four existing boathouses and one security light. Once the pedestal is located, CoServ Electric design will be finalized and released to construction. CoServ Electric will remove all existing overhead facilities from USACE property after completion of underground service installation.
- Lewisville 34 – Permit approved; waiting for delivery of 90-foot concrete pole to begin construction.

Further information is provided in Attachments A and B attached hereto.

Date: April 11, 2023


Respectfully submitted,



---

Carl R. Galant  
State Bar No. 24050633  
Travis Vickery  
State Bar No. 00794790  
1111 W. 6<sup>th</sup> Street, Bldg. B, Suite 400  
Austin, Texas 78703  
Phone: (512) 495-6083  
Fax: (512) 505-6383  
[cgalant@mcginnislaw.com](mailto:cgalant@mcginnislaw.com)  
[tvickery@mcginnislaw.com](mailto:tvickery@mcginnislaw.com)

**ATTORNEYS FOR COSERV ELECTRIC**



Legend

- To Be Done
- In Progress
- Complete

ATTACHMENT A

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF VISUAL REPRESENTATION ONLY. IT IS NOT TO BE USED IN CONJUNCTION WITH ANY OTHER LEGAL DOCUMENT OR FOR ANY PURPOSE OTHER THAN THE AFOREMENTIONED.



PROGRESS DRAWING  
LAKE RAY ROBERTS HB 4150 ANALYSIS  
SR #4191432




|           |        |           |            |           |      |            |        |
|-----------|--------|-----------|------------|-----------|------|------------|--------|
| SOLD:     | NTS    | DATE:     | 3-22-22    | DWG NO.:  | 3    | SHEET NO.: | 1 OF 1 |
| DRAWN BY: | D.J.L. | JOB CODE: | COS-2-L-43 | MEI-16183 | REV: | D.J.L.     | 6-7-22 |

ATTACHMENT B  
NESC - LAKE RAY ROBERTS CLEARANCES


|                  | New Job Code |             |  |  |  | Flowage Easement Elevation | Reference Pool Elevation |
|------------------|--------------|-------------|--|--|--|----------------------------|--------------------------|
| Lake Ray Roberts | COS-2-L43    | SR #4191432 |  |  |  | 645.50'                    | 640.5'                   |

| Lake Ray Roberts Crossing Number | Date Analyzed | ACTION NEEDED                               | WARNING FLAGS INSTALLED (EST.) | COSERV DESIGN COMPLETE | SURVEY COMPLETE | PERMIT SUBMITTED | PERMIT APPROVED | COSERV CONSTRUCTION COMPLETE | NOTES                                                                                  | SUITABLE / NOT SUITABLE (ENGINEERING FIRM DETERMINATION) | CLEARANCE COMPLIANCE | LAKE ACRES AT CROSSING |
|----------------------------------|---------------|---------------------------------------------|--------------------------------|------------------------|-----------------|------------------|-----------------|------------------------------|----------------------------------------------------------------------------------------|----------------------------------------------------------|----------------------|------------------------|
| Ray Roberts 3                    | 11/9/2021     | Construction - Waiting on 75' and 80' poles | Complete                       | Complete               | Complete        | Complete         | Complete        |                              | Design and Power Line Revisions Required. Estimated 4 Poles to be Replaced.            | SUITABLE FOR SAILBOAT                                    | NO                   | 33233.6                |
| Ray Roberts 9                    | 11/9/2021     | None                                        | Complete                       | 6/30/2022              | 7/8/2022        | Complete         | Complete        | Complete                     | Design and Power Line Revisions Required. Estimated 1 Pole to be Replaced.             | SUITABLE FOR SAILBOAT                                    | YES                  | 33233.6                |
| Ray Roberts 10                   | 11/9/2021     | None                                        | Complete                       | Complete               | N/A             | N/A              | N/A             | Complete                     | Removed CoServ utilities from Army Corp of Engineers Flowage Easements/Reference Pool. | N/A                                                      | YES                  | 33233.6                |
| Ray Roberts 20                   | 11/9/2021     | In Construction                             | Complete                       | Complete               | Complete        | Complete         | Complete        | 4/28/2023                    | Design and Power Line Revisions Required. Estimated 8 Poles to Be Replaced.            | SUITABLE FOR SAILBOAT                                    | NO                   | 1929.5                 |



Legend

- To Be Done
- In Progress
- Complete

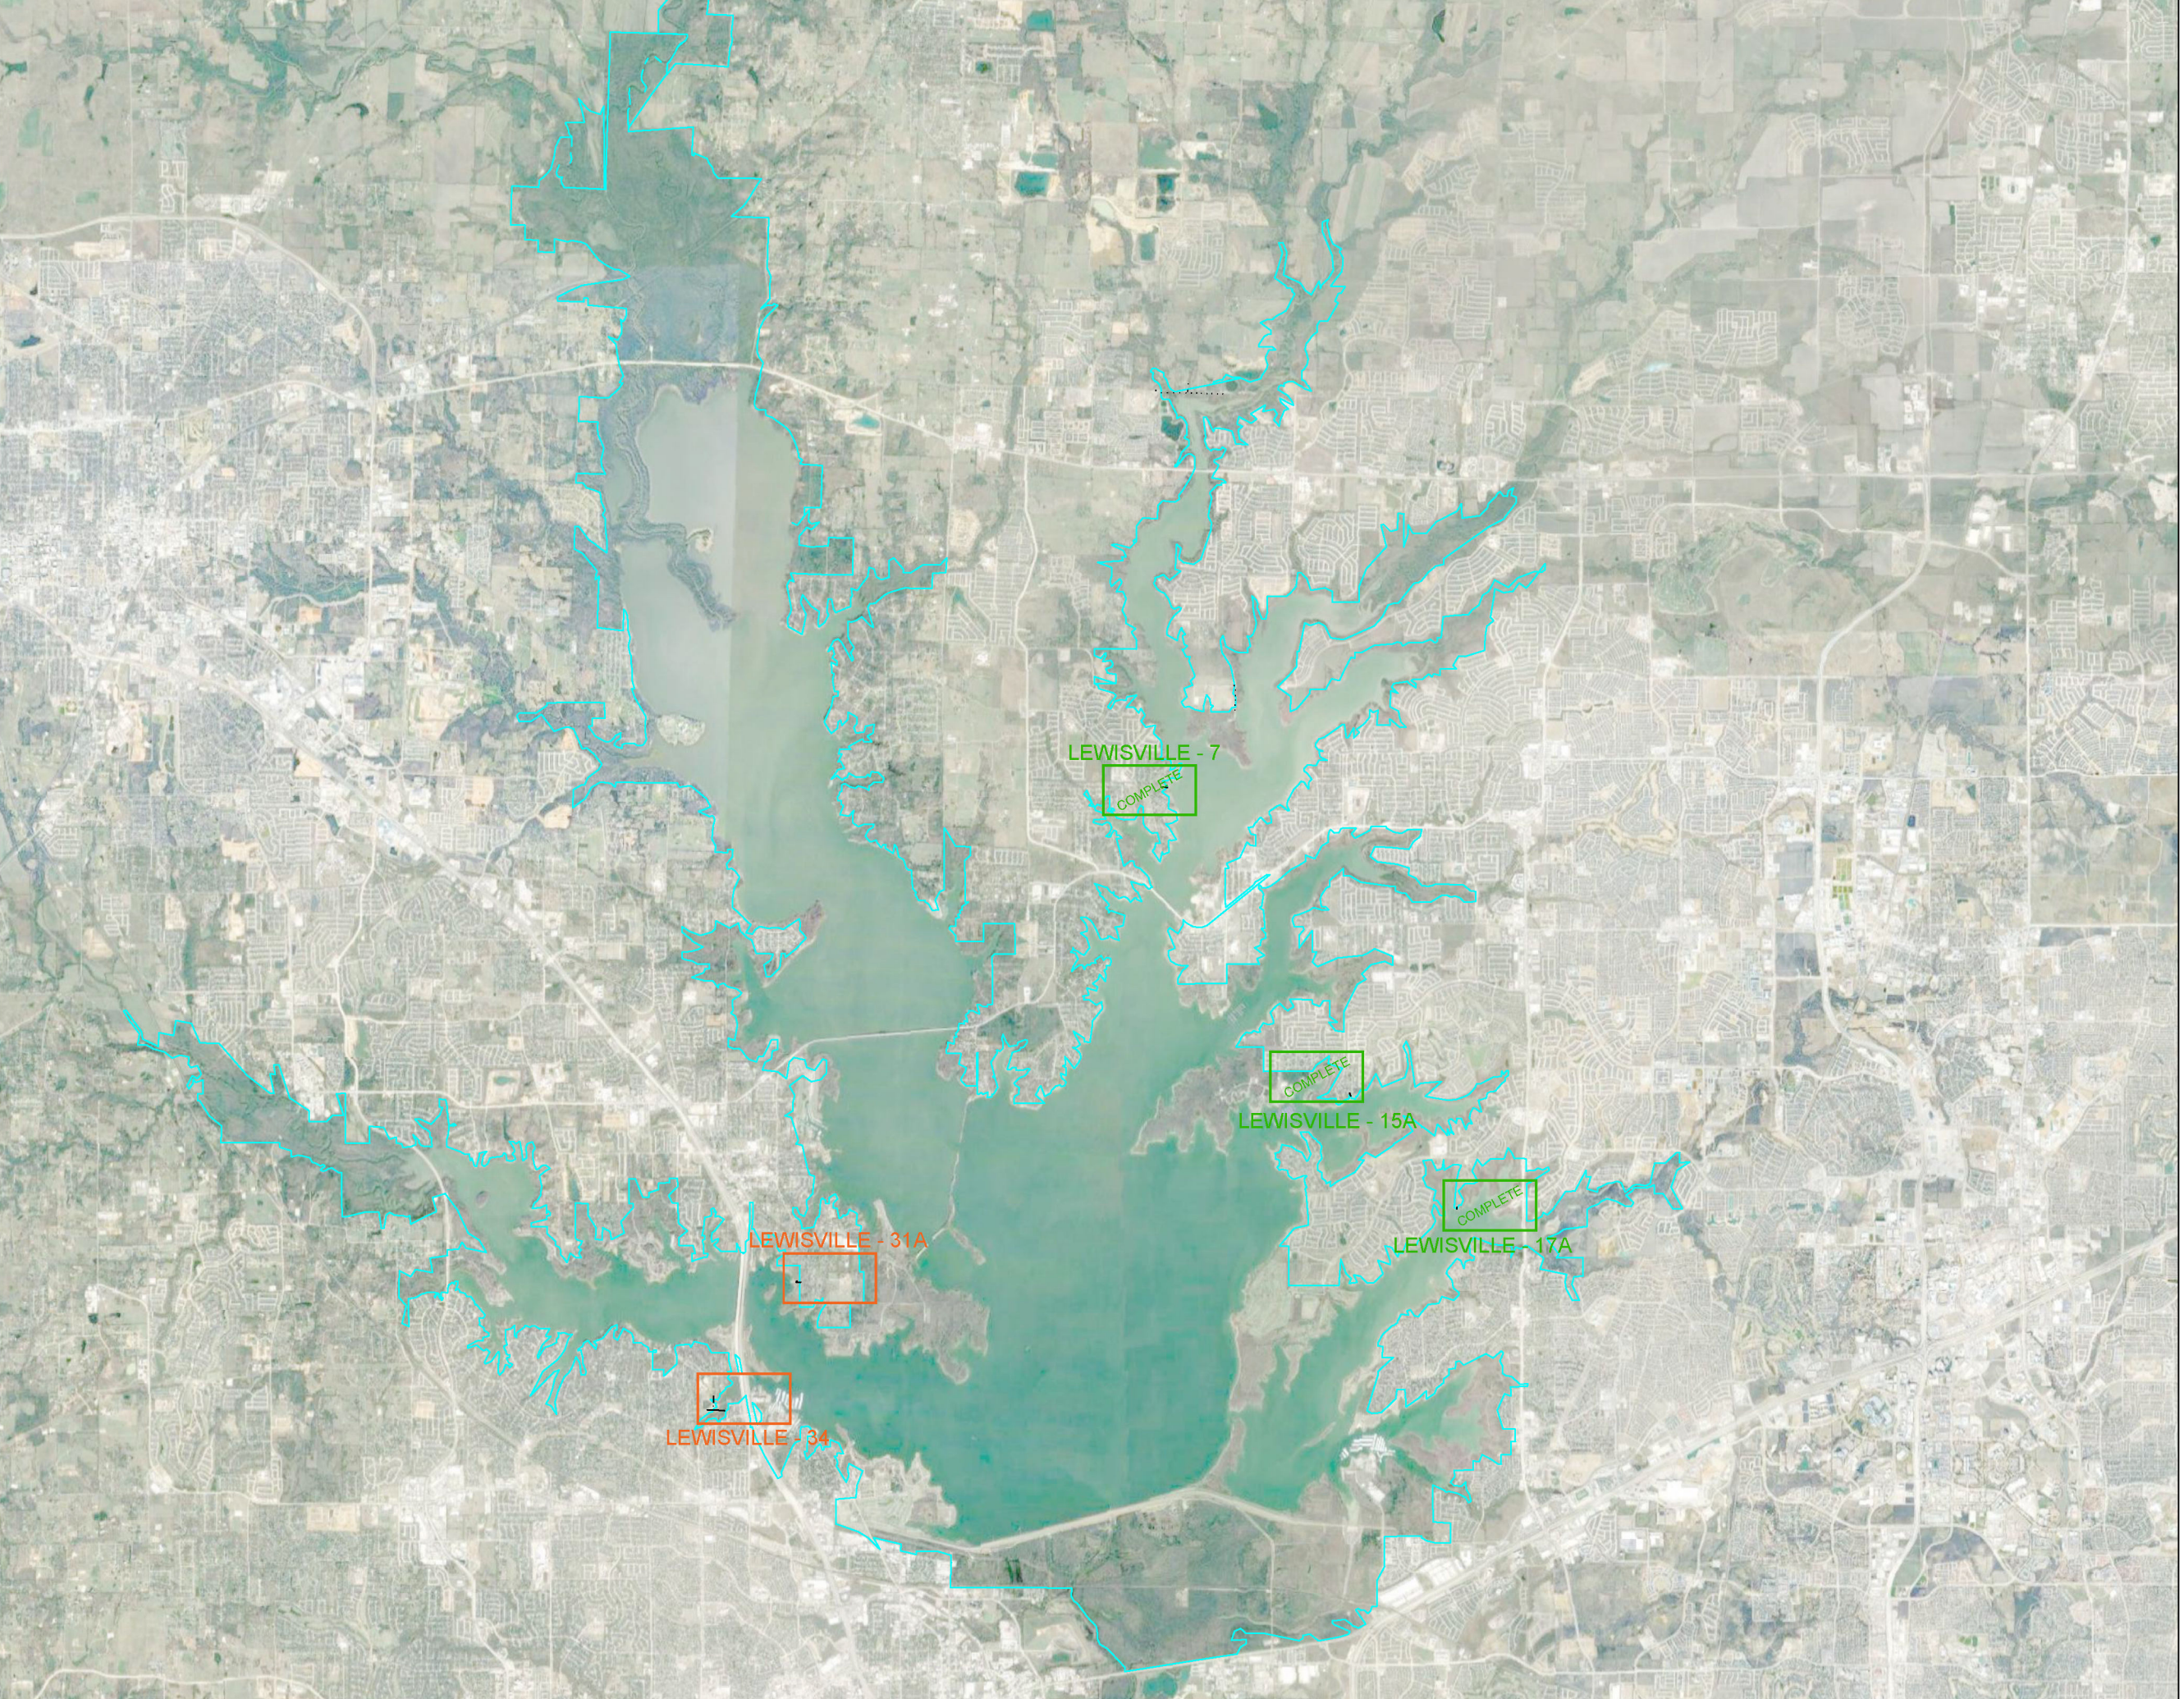

ATTACHMENT A

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF VISUAL REPRESENTATION ONLY. IT IS NOT TO BE USED IN CONJUNCTION WITH ANY OTHER LEGAL DOCUMENT OR FOR ANY PURPOSE OTHER THAN THE AFOREMENTIONED.



PROGRESS DRAWING  
LAKE LEWISVILLE HB 4150 ANALYSIS  
S.R. #4191426



Texas Registered Engineering Firm F-2664  
916 Southwest Parkway East  
College Station, TX 77840  
(979) 764-8356

|                  |                     |           |                    |
|------------------|---------------------|-----------|--------------------|
| SOLD: NTS        | DATE: 3-22-22       | DWG NO. 5 | SHEET NO. 1 OF 1   |
| DRAWN BY: D.J.L. | JOB CODE: COS-24-42 | MEI-16182 | REV: D.J.L. 6-7-22 |

**ATTACHMENT B**  
**NESC - LAKE LEWISVILLE CLEARANCES ANALYSIS**

|                 |              |             |  |  |  |                            |         |                          |         |
|-----------------|--------------|-------------|--|--|--|----------------------------|---------|--------------------------|---------|
|                 | New Job Code |             |  |  |  | Flowage Easement Elevation |         | Reference Pool Elevation |         |
| Lake Lewisville | COS-2-L-42   | SR #4191426 |  |  |  |                            | 537.00' |                          | 532.00' |

| Lake Lewisville Crossing Number | Date Analyzed | ACTION NEEDED                                                                                                  | WARNING FLAGS INSTALLED (EST.) | COSERV DESIGN COMPLETE | SURVEY COMPLETE | PERMIT SUBMITTED | PERMIT APPROVED | COSERV CONSTRUCTION COMPLETE | NOTES                                                                                              | SUITABLE / NOT SUITABLE (ENGINEERING FIRM DETERMINATION) | CLEARANCE COMPLIANCE | LAKE ACRES AT CROSSING |
|---------------------------------|---------------|----------------------------------------------------------------------------------------------------------------|--------------------------------|------------------------|-----------------|------------------|-----------------|------------------------------|----------------------------------------------------------------------------------------------------|----------------------------------------------------------|----------------------|------------------------|
| Lewisville 7                    | 11/5/2021     | None                                                                                                           | Complete                       | Complete               | N/A             | N/A              | N/A             | Complete                     | Removed CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool               | SUITABLE FOR SAILBOAT                                    | YES                  | 4609.6                 |
| Lewisville 15A                  | 11/5/2021     | None                                                                                                           | Complete                       | Complete               | N/A             | N/A              | N/A             | Complete                     | Removed CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool               | SUITABLE FOR SAILBOAT                                    | YES                  | 22291.6                |
| Lewisville 17A                  | 11/5/2021     | None                                                                                                           | Complete                       | Complete               | N/A             | N/A              | N/A             | Complete                     | Removed CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool               | SUITABLE FOR SAILBOAT                                    | YES                  | 22291.6                |
| Lewisville 31A                  | 11/5/2021     | Engineering Package Preliminary - Electrician installing new Meter Pedestal and underground Service for Member | Complete                       | 9/16/2022              | N/A             | N/A              | N/A             |                              | Design to remove CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool      | SUITABLE FOR SAILBOAT                                    | NO                   | 22291.6                |
| Lewisville 34                   | 11/5/2021     | Construction - Waiting on concrete pole                                                                        | Complete                       | Complete               | Complete        | Complete         | Complete        |                              | Power Line Revision Required. Ordering 90' Poles 14 to 16 weeks. Estimated 8 Poles to be Replaced. | SUITABLE FOR SAILBOAT                                    | NO                   | 22291.6                |