



Filing Receipt

Filing Date - 2023-07-11 09:27:11 AM

Control Number - 52667

Item Number - 146

PROJECT NO. 52667

FILING OF ATTESTATIONS § PUBLIC UTILITY COMMISSION
DEMONSTRATING COMPLIANCE §
WITH HB 4150 § OF TEXAS

PROGRESS REPORT OF
DENTON COUNTY ELECTRIC COOPERATIVE, INC., D/B/A
COSERV ELECTRIC

Denton County Electric Cooperative, Inc. d/b/a CoServ Electric files this progress report regarding compliance with Section 6 of House Bill 4150 (“HB 4150”), providing information regarding distribution lines on United States Army Corps of Engineers (“USACE”) property that CoServ Electric identified as non-compliant in its report and attestation filed in this docket on January 14, 2022 (“Initial Report”). By letter dated March 4, 2022, the Division of Compliance and Enforcement (“DICE”) of the Public Utility Commission of Texas (“Commission”) requested a progress report and additional information to be filed on a monthly basis. This is CoServ Electric’s progress report for July 2023, which is timely filed.

I. Progress Report

In its last progress report, CoServ Electric identified three distribution line segments located in areas that could be suitable for a sailboat and remained non-compliant with the applicable clearance standards in Rule 232 of NESC Standard ANSI (c)(2) (“NESC Rule 232”). CoServ Electric completed construction of Ray Roberts 3, therefore only two line segments remain in progress at Lake Lewisville, as described below. Availability of atypical, taller poles continues to delay completion of construction at Lewisville 34.

1. Status of engineering design, permitting, and reconstruction.

The status of the remaining distribution line segments is as follows:

- Ray Roberts 3 – Construction complete.
- Lewisville 31A – Electrician and customer still working with USACE to install new customer-owned meter pedestal and underground facilities to four existing boathouses and one security light. Once the pedestal is located, CoServ Electric design will be finalized and released to construction. CoServ Electric will remove all existing overhead facilities from USACE property after completion of underground service installation.

- Lewisville 34 – Permit approved; waiting for delivery of 90-foot concrete pole to begin construction.

Further information is provided in Attachments A and B attached hereto.


Date: July 11, 2023

Respectfully submitted,




Carl R. Galant
State Bar No. 24050633
Travis Vickery
State Bar No. 00794790
MCGINNIS LOCHRIDGE LLP
1111 W. 6th Street, Bldg. B, Suite 400
Austin, Texas 78703
Phone: (512) 495-6083
Fax: (512) 505-6383
cgalant@mcginnislaw.com
tvickery@mcginnislaw.com

ATTORNEYS FOR COSERV ELECTRIC



Legend

- To Be Done
- In Progress
- Complete

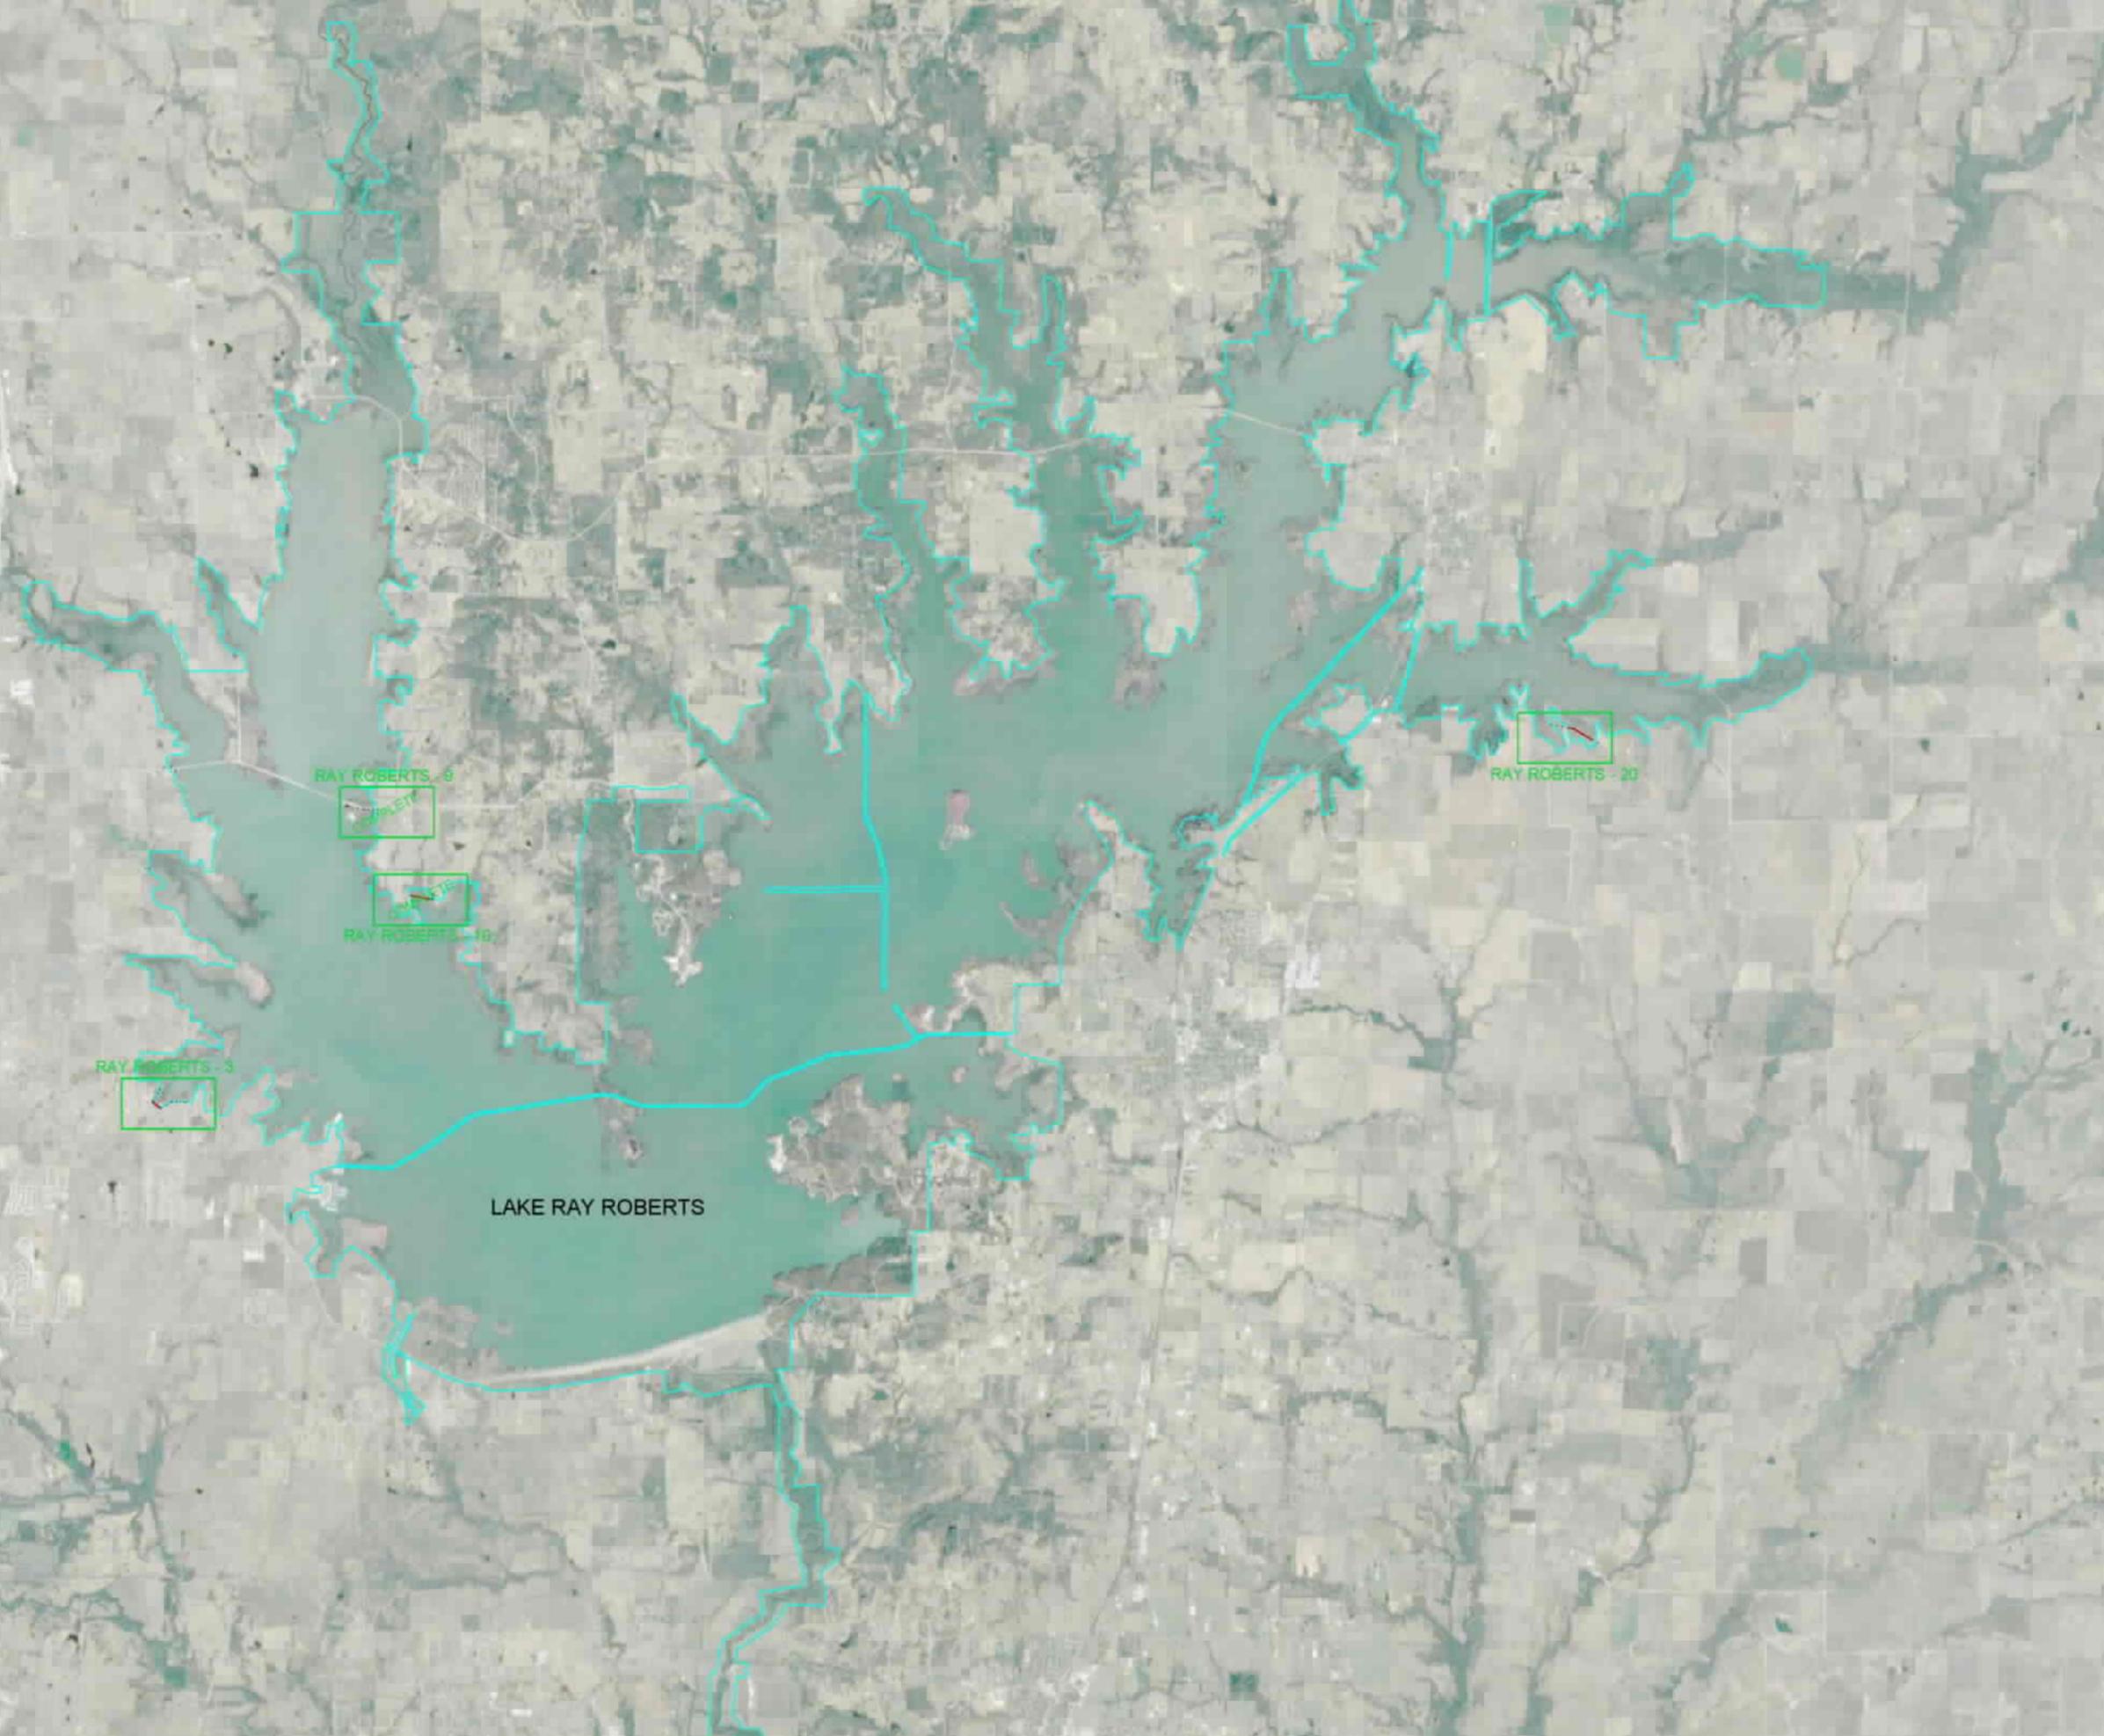

ATTACHMENT A

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF VISUAL REPRESENTATION ONLY. IT IS NOT TO BE USED IN CONJUNCTION WITH ANY OTHER LEGAL DOCUMENT OR FOR ANY PURPOSE OTHER THAN THE AFOREMENTIONED.



PROGRESS DRAWING
LAKE RAY ROBERTS HB 4150 ANALYSIS
SR #4191432



DATE	REV	BY	DATE	DESCRIPTION
NTS	1	MEI	5-23-22	
D.K.	2	CDG	9-24-43	
PROJECT NO.			MEI-16183	
SHEET NO.			3	
SCALE			1 OF 1	
DATE			D.L.	
			6-30-23	


ATTACHMENT B
NESC - LAKE RAY ROBERTS CLEARANCES


	New Job Code				Flowage Encasement Elevation	Reference Pool Elevation
Lake Ray Roberts	COs-2-L-15	SR:11191422			645.50'	640.5'

Lake Ray Roberts Crossing Number	Date Analyzed	ACTION NEEDED	WARNING FLAGS INSTALLED (EST.)	COSEVRY DESIGN COMPLETE	SURVEY COMPLETE	PERMIT SUBMITTED	PERMIT APPROVED	COSEVRY CONSTRUCTION COMPLETE	NOTES	SUITABLE / NOT SUITABLE (ENGINEERING FIRM DETERMINATION)	CLEARANCE COMPLIANCE	LAKE ACRES AT CROSSING
Ray Roberts 3	11/9/2021	None	Complete	Complete	Complete	Complete	Complete	Complete	Design and Power line Revisions Required. Estimated 4 Poles to be Replaced.	SUITABLE FOR SAILBOAT	YES	33233.6
Ray Roberts 9	11/9/2021	None	Complete	6/30/2022	7/8/2022	Complete	Complete	Complete	Design and Power line Revisions Required. Estimated 1 Pole to be Replaced.	SUITABLE FOR SAILBOAT	YES	33233.6
Ray Roberts 10	11/9/2021	None	Complete	Complete	N/A	N/A	N/A	Complete	Removed CoServ utilities from Army Corp of Engineers Flowage Encasement's Reference Pool.	N/A	YES	33233.6
Ray Roberts 20	11/9/2021	None	Complete	Complete	Complete	Complete	Complete	Complete	Design and Power line Revisions Required. Estimated 8 Poles to be Replaced.	SUITABLE FOR SAILBOAT	YES	1929.5



Legend

-  To Be Done
-  In Progress
-  Complete

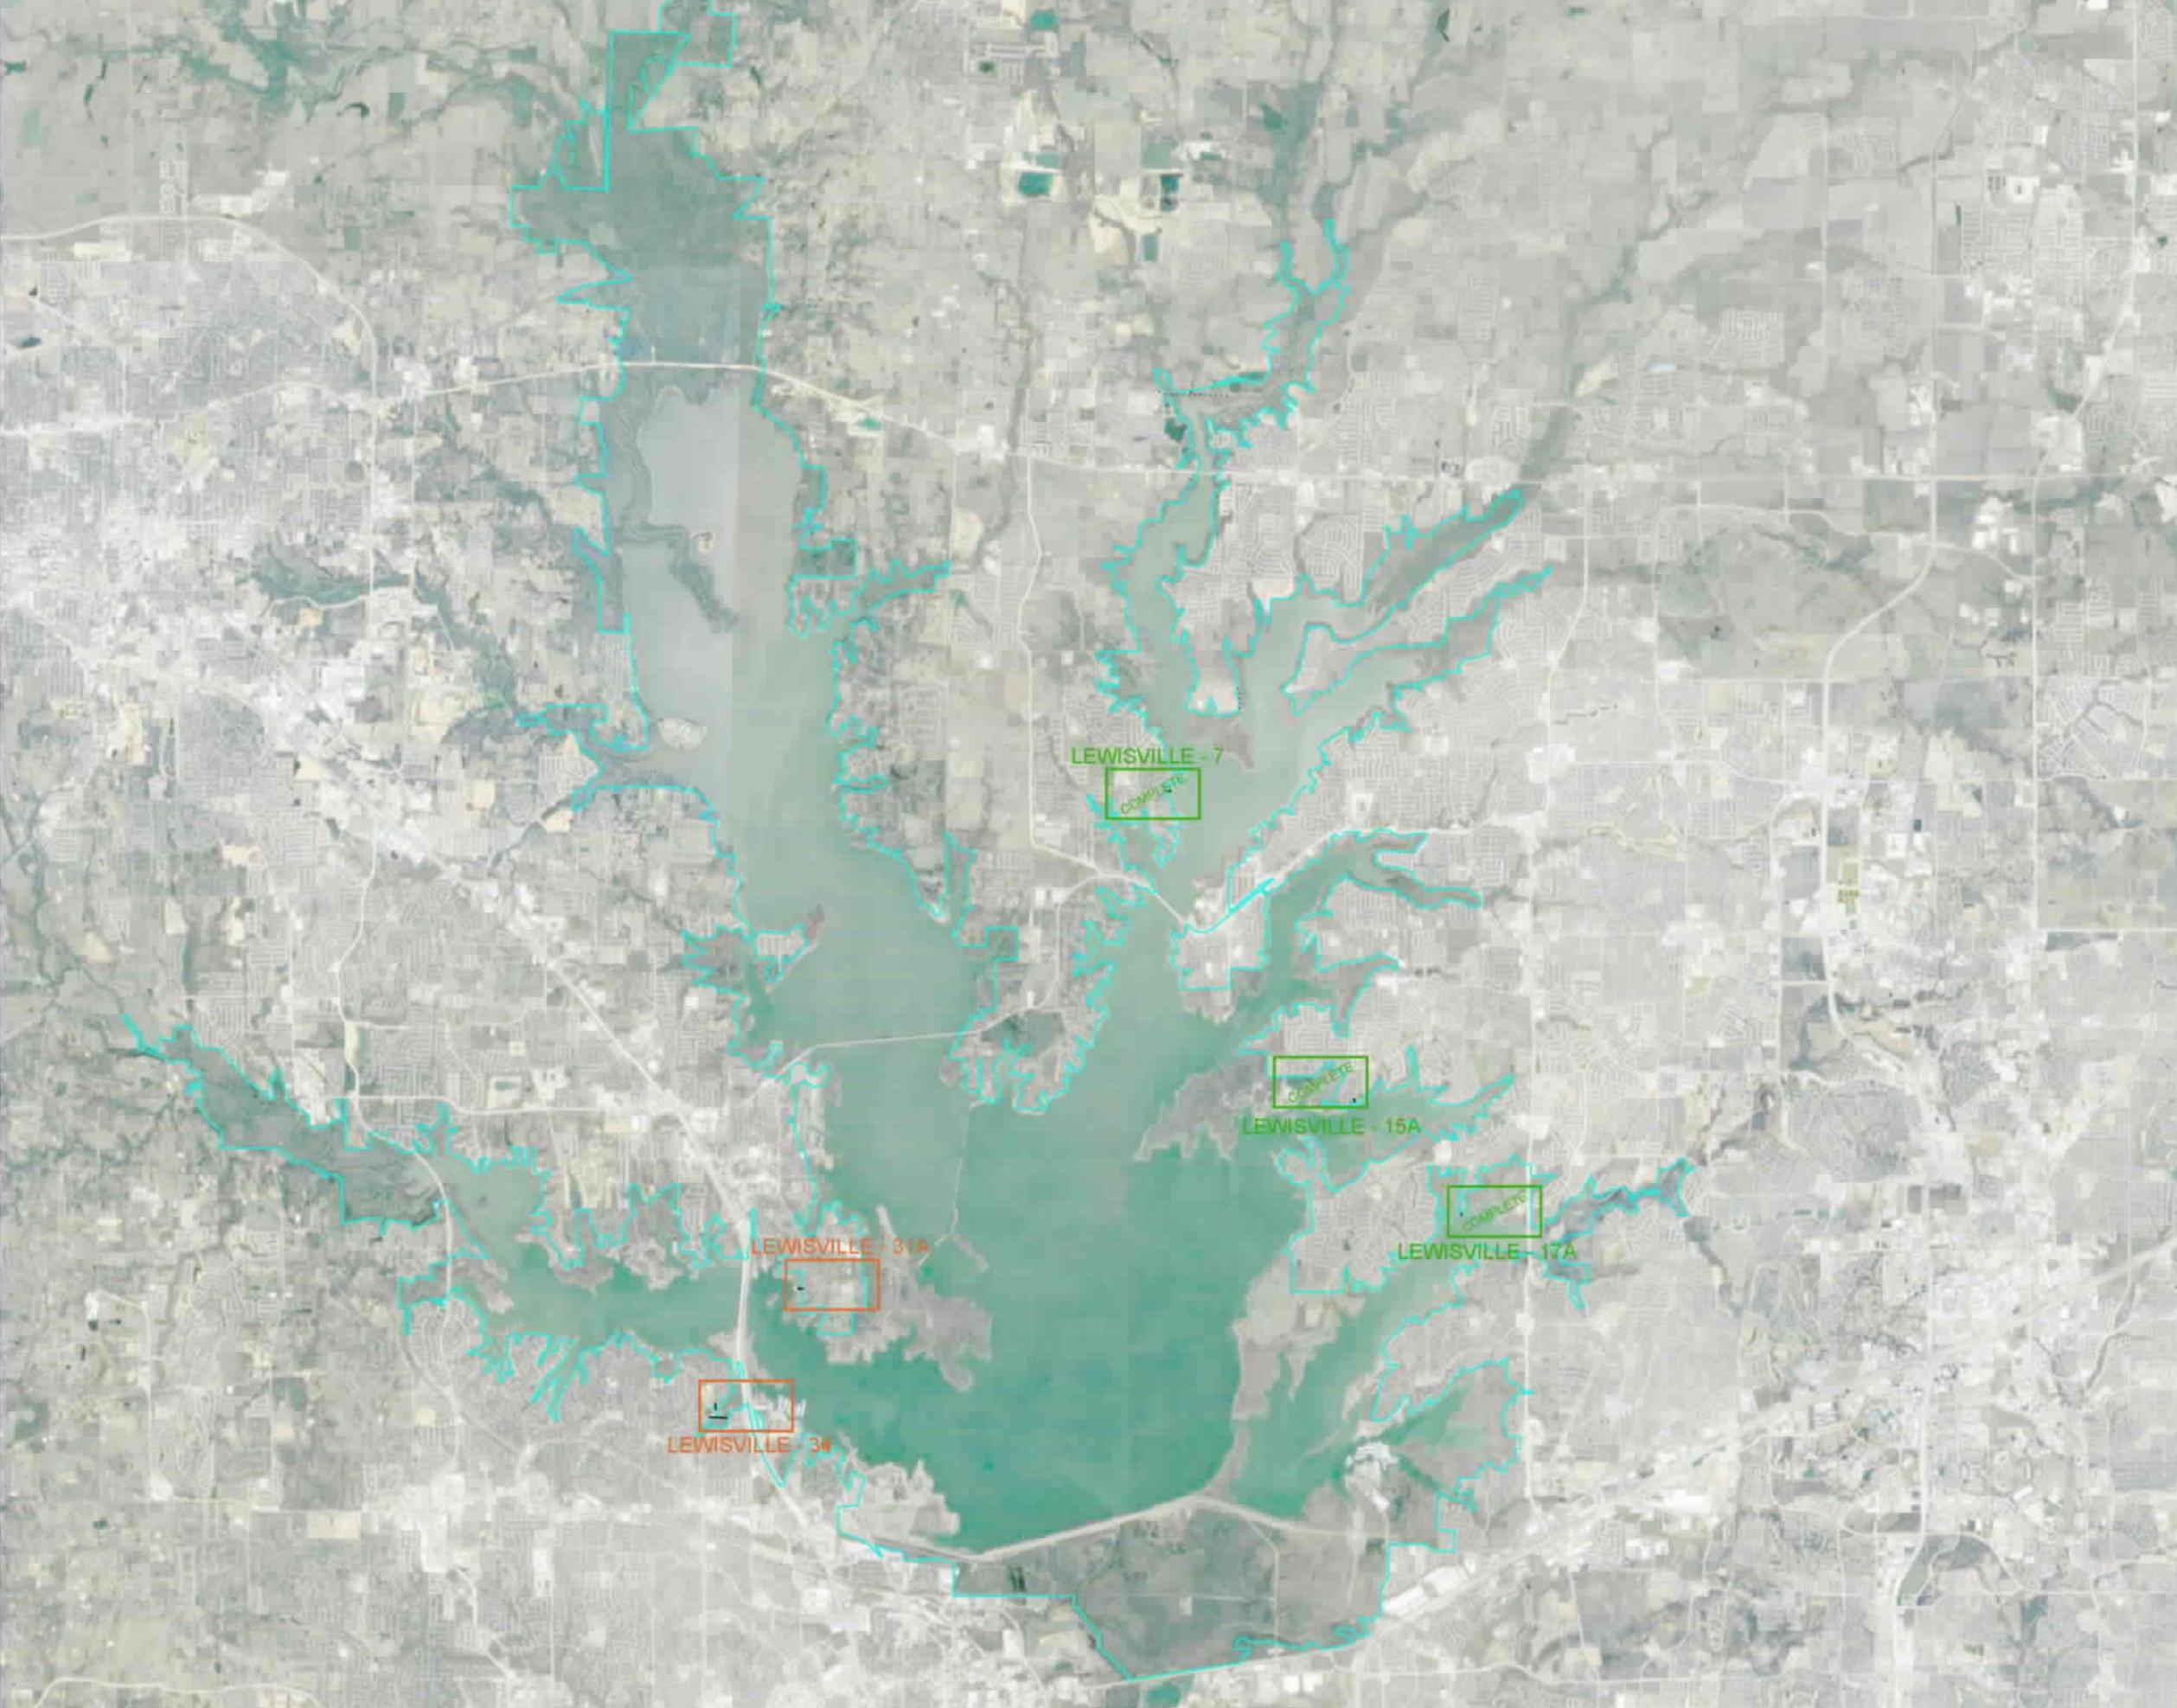

ATTACHMENT A

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF VISUAL REPRESENTATION ONLY. IT IS NOT TO BE USED IN CONJUNCTION WITH ANY OTHER LEGAL DOCUMENT OR FOR ANY PURPOSE OTHER THAN THE AFOREMENTIONED.

CoServ
ELECTRIC

PROGRESS DRAWING
LAKE LEWISVILLE HB 4150 ANALYSIS
S.R. #4191426

 **McCord**
ENGINEERING, INC.

Texas Registered Engineering Firm F-2664
916 Southwest Parkway East
College Station, TX 77940
(979) 764-8356

DATE: NTS	DATE: 3-23-22	PROJECT: MEI-16182	SHEET NO: 1 OF 1
DESIGNED BY: D.K.	DATE: 03/09/24 4:2	PROJECT: MEI-16182	DATE: 03/23/22

ATTACHMENT B
NESC - LAKE LEWISVILLE CLEARANCES ANALYSIS

		New Job Code						Flowage Easement Elevation		Reference Pool Elevation		
Lake Lewisville		COE-2-1-42	MR-24191-42b					537.00'		532.00'		
Lake Lewisville Crossing Number	Date Analyzed	ACTION NEEDED	WARNING FLAGS INSTALLED (EST.)	COSERV DESIGN COMPLETE	SURVEY COMPLETE	PERMIT SUBMITTED	PERMIT APPROVED	COSERV CONSTRUCTION COMPLETE	NOTES	SUITABLE / NOT SUITABLE (ENGINEERING FIRM DETERMINATION)	CLEARANCE COMPLIANCE	LAKE ACRES AT CROSSING
Lewisville 7	11/5/2023	None	Complete	Complete	N/A	N/A	N/A	Complete	Removed CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool	SUITABLE FOR SALBOAT	YES	4808.8
Lewisville 15A	11/5/2023	None	Complete	Complete	N/A	N/A	N/A	Complete	Removed CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool	SUITABLE FOR SALBOAT	YES	22291.8
Lewisville 17A	11/5/2023	None	Complete	Complete	N/A	N/A	N/A	Complete	Removed CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool	SUITABLE FOR SALBOAT	YES	22291.8
Lewisville 33A	11/5/2023	Engineering Package Preliminary - Electrician installing new Meter Pedestal and underground Service for Member	Complete	9/16/2022	N/A	N/A	N/A		Design to remove CoServ utilities from Army Corp of Engineers Flowage Easement/Reference Pool	SUITABLE FOR SALBOAT	NO	22291.8
Lewisville 14	11/5/2023	Construction - Walling on concrete pole	Complete	Complete	Complete	Complete	Complete		Power Line Revision Required. Ordering 90' Poles 14' in 1-6 weeks. Estimated 8 Poles to be Replaced.	SUITABLE FOR SALBOAT	NO	22291.8