

Filing Receipt

Received - 2022-03-17 05:15:22 PM Control Number - 52667

ItemNumber - 63

Cooke County Electric Cooperative Association d/b/a Pentex Energy PUC Project 52667 HB 4150 Compliance Update

Pentex Energy filed an affidavit on PUC Project #52667 – Filing of Attestation Demonstrating Compliance with HB 4150. The affidavit has a date of January 4, 2022.

- Pentex Energy owns two (2) distribution lines over a lake listed in PURA § 38.004(b).
 - Hubert M Moss Lake, Cooke County
 - Sivells Bend 1204 over south inlet Moss Lake
 - Sivells Bend 1204 over north inlet Moss Lake

Progress report and other documentation follows for these two distribution lines.

3/17/2022 Page 1 of 7

Sivells Bend 1204 over south inlet Moss Lake

Progress Report: This project was completed on January 27, 2022.

Permitting: No permits were required.

Mapping: See following page.

Job Specifications:


- The project (WO 051944) was designed in Fall 2021. The project was staked on November 30, 2021
- Construction on the project began on January 11, 2022.
- Work was completed on January 27, 2022.
- Eleven (11) wood distribution poles were replaced to increase the clearance.

Measures taken to inform public:

- No communication measures were needed.
- The poles and distribution lines are located over land or in areas where sailboating is not suitable except during periods of flooding.
- Pentex was prepared to de-energize the electric lines should flooding take place before the project was completed.


3/17/2022 Page 2 of 7

WO 051944 Overall Location

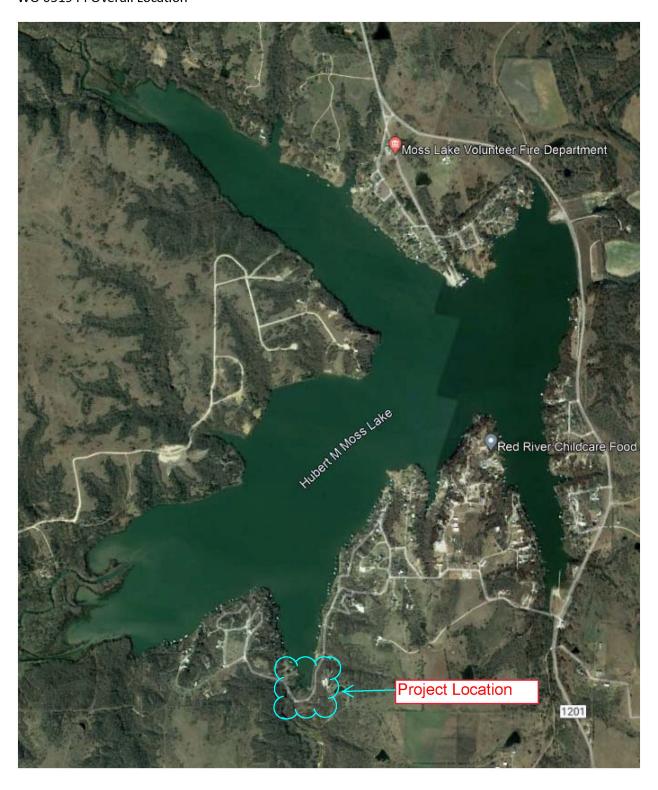

3/17/2022 Page 3 of 7

WO 051944 Details

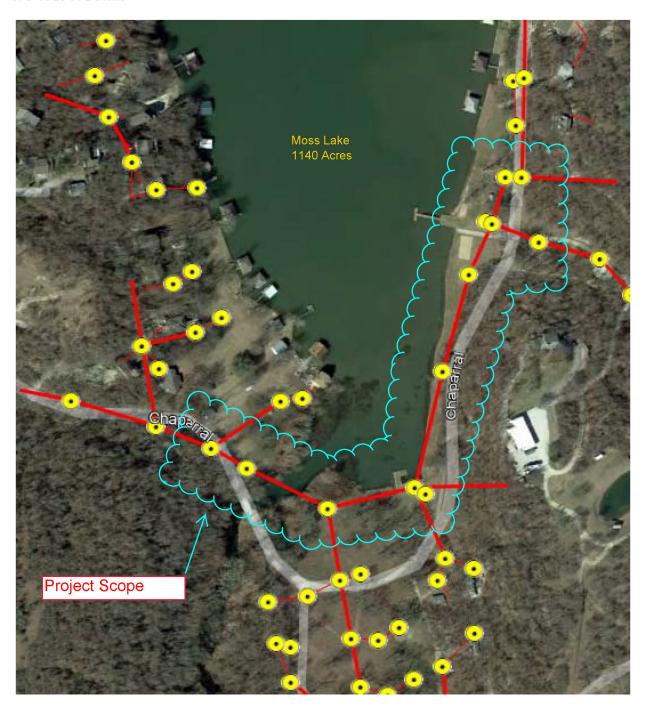

3/17/2022 Page 4 of 7

Sivells Bend 1204 over north inlet Moss Lake

Progress Report: This project was completed on January 27, 2022.

Permitting: No permits were required.

Mapping: See following page.

Job Specifications:

- The project (WO 051947) was designed in Fall 2021. The project was staked on November 30, 2021
- Construction on the project began on January 11, 2022.
- Work was completed on January 27, 2022.
- One (1) wood distribution pole was replaced to increase the clearance.

Measures taken to inform public:

- No communication measures were needed.
- The poles and distribution lines are located over land or in areas where sailboating is not suitable except during periods of flooding.
- Pentex was prepared to de-energize the electric lines should flooding take place before the project was completed.


3/17/2022 Page 5 of 7

WO 051947 Overall Location



3/17/2022 Page 6 of 7

WO 051947 Details

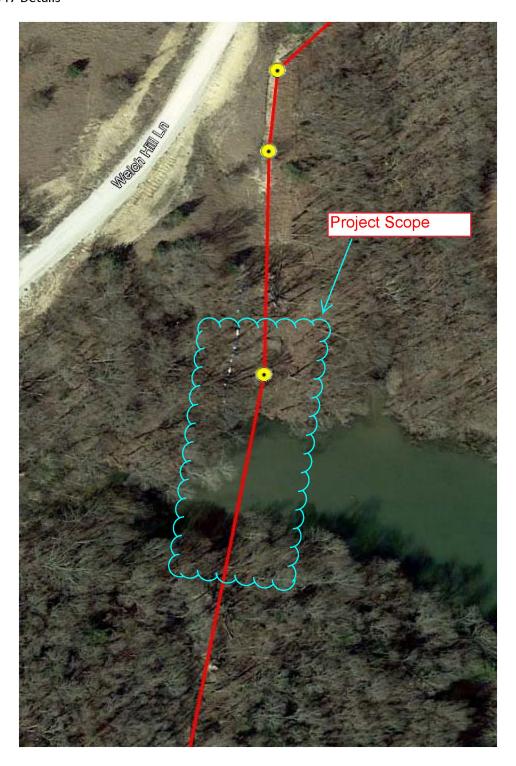

3/17/2022 Page 7 of 7