



Filing Receipt

Filing Date - 2023-06-02 04:58:03 PM

Control Number - 53385

Item Number - 1469



LONG DRAW SOLAR
1987




**ENGIE Long Draw Solar
Emergency Response Plan**

**SOLAR PROJECT
ERP PROCEDURES
MANUAL**

**ENGIE Long Draw Solar, Gail,
Texas.**

Emergency Response Plan




ENGIE Long Draw Solar Emergency Response Plan

Emergency Response Plan

Table of Contents

1.0	Introduction	3
2.0	Project Description.....	3
3.0	Notification and Communication	3
3.1	Emergency Information.....	3
3.2	Notification Process	3
3.3	Site Evacuation Procedure	6
3.4	Natural Disasters or Acts of Terrorism Without Warning	6
3.5	Fire Prevention Procedures.....	7
3.6	Severe Weather Conditions	7
3.7	Weather Emergency Response	7
3.8	Hot/Cold Weather Emergency Checklist.....	7
3.9	Cyber Security	7
3.10	Pandemic & Epidemic	7
3.11	Physical Security.....	7
3.12	Water Shortage.....	7
3.13	Hot/Cold Weather Emergency.....	7
3.14	Adequacy and Operability of Fuel Switching Equipment.....	8
3.15	Restoration of Service.....	8
3.16	Drills	8
3.17	Plan Holders	8
4.0	Emergency Within a Turbine.....	8
5.0	In Case of Spillage.....	8
6.0	Aircraft Impact.....	9
7.0	Acts of Sabotage, Terrorism & Bomb Threats	9
7.1	Bomb Threat Procedure	10
7.2	Chemical and Biological Threat.....	10
8.0	Post Incident Review of Response Procedure	11
Appendices:		
	Summary of Emergency Services	12
	Other Useful Contacts	13
	Concise Emergency Plan.....	14
	Vicinity and Access Maps.....	15



ENGIE Long Draw Solar Emergency Response Plan

1.0 Introduction

The Emergency Response Plan primarily deals with what action needs to be taken if an incident occurs at Long Draw. All contractors and subcontractors working on the site will attend site orientation presented by Engie familiarizing them with site protocols and documented via orientation sign on sheet.

2.0 Project Description

The Long Draw Solar Project consists of 76 3.270MW HEM Power Electronics Inverters, Substation, Operations Building. The project is in Borden County, TX. A site map is provided on page 16.

3.0 Notification and Communication

3.1 Emergency Information

3.2 Notification Procedure

All emergency situations should immediately be reported.

The following 7-step Emergency Notification Procedure should be used:

- 1) **Notify 911 Immediately**
Give the site name, address, and directions to the operator, as well as describe the emergency.
- 2) **Describe the type of emergency** Typically the categories include:
 - Medical Emergency
 - Fire
 - Construction Emergency
 - Equipment Failure – Specify
 - Hazardous Spillage - Specify
 - Inverter Structural Failure – Specify
 - Power Failure
 - Extreme Weather Conditions
 - Thunderstorm/ Electrical Storm
 - Extreme High Winds
 - Severe Hail
 - Snow/Ice Storm
 - Transport Incident
 - Passenger Vehicle
 - Heavy Hauler
 - Heavy Plant
 - Aircraft Impact



ENGIE Long Draw Solar Emergency Response Plan

- Extreme Site Conditions
 - Flood
 - Earthquake
 - Volcanic Eruption
- Act of Sabotage/Vandalism
 - Act of Terrorist
 - Bomb Threat

When describing personnel involved, indicate the numbers affected and the following initial assessment:

- a) Fatality
 - b) Major Illness (heart attack, not breathing, unconscious, etc.)
 - c) Major Injury (broken bone, loss of limb, severe cuts/bleeding, etc.)
 - d) Minor Injury (twisted ankle, foreign body in eyes, minor cuts, etc.)
 - e) Bite/Sting (snake, scorpion, etc.)
 - f) Weather Effect (effects of heat, sun, cold, wind chill, lightning strike, etc.)
 - g) Incident Type (fall, crush, vehicle crash, fire, electric shock, etc.)
- 3) Location
Give the operator the location of the emergency, by referring to the nearest Inverter, combiner box, row number, structure, or road junction and whether casualties are in the open, trapped in a vehicle or site equipment.
- 4) Notify Plant Manager
Site staff will contact Long Draw Manager (see list) who will assist at the location of the emergency. Jointly, the supervisor will arrange for a trained first aider to attend the scene of the emergency, if required.



LONG DRAW
SOLAR PROJECT



ENGIE Long Draw Solar Emergency Response Plan

5) Coordinate

The supervisor(s)/Plant Manager will send an employee to the nearest site access point to meet the emergency services, and escort them to the location of the emergency. The gate guard should also be informed to assist in directing the emergency services to the scene of the incident.

6) Accompany

The supervisor(s) will continue to assist with the situation on site, and one of the supervisors will accompany any injured personnel to the hospital. He will stay until examination (including a drug & alcohol test) is complete, so that a full report including the extent of the injuries can be made. The employer can later require the injured to make an appointment to see the Company Doctor if confirmation of the extent or nature of injuries, treatment or disability is required.

3.3 Site Evacuation Procedure

1) Personnel empowered to order evacuation/shutdown of the site are:

- Supervisors of individual contractors may instruct their own people to evacuate
- Engie Site manager may instruct ALL personnel to evacuate
- Engie Site supervisors may instruct ALL personnel to evacuate

2) When instructed, evacuate site via nearest access to public road, and assemble at a designated location.

3) In case of fire, try to remain upwind of it.

4) The Long Draw Site manager (or designated person) will

arrange a head count of all personnel. This will be done by the supervisors from each contractor carrying out their own headcount and advising Engie site management of the result. Supervisors from each contractor will be responsible for maintaining an accurate record of which personnel are onsite each day, to be able to identify which personnel are missing in the case of an emergency evacuation. Further, a sign-in/sign-out procedure will be implemented at the entrance.

3.4 Natural Disasters or Acts of Terrorism Without Warning.

Natural disasters like earthquake, volcanic eruption and flash flood will almost certainly occur without warning. In such cases it is important that the site be evacuated with all possible haste. All site personnel should move away from the



ENGIE Long Draw Solar Emergency Response Plan

location of the event and get to a safe distance and location. It is essential that you remain calm and do not panic. Once you are safe, you should contact Emergency Services and your site supervisor or company headquarters to enable a roll call and for authorities to establish numbers of survivors and assess those who are not accounted for. **Hurricane annex is not applicable to Long Draw as the facility is not located in evacuation zone as defined by TDEM.**

Acts of terrorism, by their nature, frequently come without warning and should be treated in the same manner as natural disasters.

The radio (PMR) will be the source of information/communication and site personnel should tune into a news station until such time as all clear is announced and they can either safely return to the site or their home.

All personnel should remain at a safe location until the Plant Manager contacts you to confirm it is safe to return to site.

3.5 Fire Prevention Procedures

A separate Fire Prevention & Mitigation Plan has been developed for this project, in view of the fire risk posed by the natural vegetation and climate.

3.6 Severe Weather Conditions

Severe weather conditions, particularly gusting high wind speed and electrical storms, have a pronounced effect on the maintenance and any emergency medical response to any on site turbines. Records will be kept of prevailing weather conditions daily and periodically throughout the day weather forecast updates will be reviewed and assessed to ensure the safe continuity of work, while ensuring that weather sensitive activity is only commenced on the understanding that existing or imminent weather conditions will not exceed the risk assessed for that activity. In any event, due diligence should be proactive with routine observation by all concerned about obvious local changing atmospheric conditions that could indicate deteriorating weather conditions.

Engie Renewables Services LLC will stop all maintenance operations at 24m/s in accordance with 29 CFR 1910.27 (b) (2) (X) for all on site turbines. Engie North America will specify maximum wind speeds that are allowed for:

- Working on a suspended platform



ENGIE Long Draw Solar Emergency Response Plan

In addition, heavy lifting cranes have specific limitations with respect to positioning, rigging, and lifting components that will change with the dimensions of the component, the location, ground conditions, weather conditions and wind speeds.

Engie North America Inc recommendations and the crane limitations need to be considered for each stage of maintenance to balance the risk inherent in each operation.

Regarding atmospheric electrical activity, tall metal structures like Inverters and heavy lifting cranes are prone to attract such activity until such time as suitable grounding is in place. In the event of local electrical storms or thunderstorms, all Inverter locations should be evacuated, and site personnel seek safety in the cab of their vehicle at least 180 ft from the Inverter location until 30 minutes strike after the last known lightning strike within 30-mile radius or until such time as the storm has passed or abated.

3.7 Weather Emergency Response

Cold Weather Emergency

Forecasted potential cold weather emergencies are actively monitored by site team to help anticipate severity and proper response needed. If potential cold weather emergency has been forecasted the proper support personnel will be identified 48hrs before event is forecasted to occur and must remain available to support. If weather emergency impedes travel to and from site then support personnel will remain on site during the duration of the emergency. Support personnel will utilize cots and non-perishable foods located at site. Personnel will exhaust all feasible means to keep plant operational. Possible OMC condition that may occur if temperature drops below minimum turbine design specifications. See Table Below:

Table C-3 Comparison of site and design temperatures of AW140/3000 T82

Characteristic	Design Project's turbines ¹	Site: Prairie Hill Wind Project		
		Nordex	UL ²	Long-term ³
Operating temperature range [°C]	-10 to +40	-13.8 to +45.1	NA	-17.2 to +44.4
Survival temperature range [°C]	-20 to +50			

Hot Weather Emergency

Forecasted potential hot weather emergencies are actively monitored by site team to help anticipate severity and proper response needed. Site team will reference "OSHA Heat Index: A" to determine if its safe to work in current conditions. Personnel will exhaust all feasible means to keep plant operational. Possible OMC condition that may occur if temperature rises above turbine design specifications. See Table Below:

Table C-3 Comparison of site and design temperatures of AW140/3000 T82

Characteristic	Design Project's turbines ¹	Site: Prairie Hill Wind Project		
		Nordex	UL ²	Long-term ³
Operating temperature range [°C]	-10 to +40	-13.8 to +45.1	NA	-17.2 to +44.4
Survival temperature range [°C]	-20 to +50			



ENGIE Long Draw Solar Emergency Response Plan

3.8 Hot/Cold Weather Emergency Checklist

The purpose of this checklist is to verify necessary selected personnel and emergency supplies stock. This checklist is to be filled out 48 hours before forecasted event occurs.

		Hot/Cold Weather Emergency Personnel/Supplies Checklist																						
Personnel	Signature	Date																						
<table border="1"><thead><tr><th>Item</th><th>Quantity</th><th>Expiration Date</th></tr></thead><tbody><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></tbody></table>				Item	Quantity	Expiration Date																		
Item	Quantity	Expiration Date																						

3.9 Cyber Security

Reference cyber security "IRP for Long Draw" for this section.

3.10 Pandemic & Epidemic

Reference "Long Draw COVID-19 Job Site Protocol"

3.11 Physical Security

Plant Substation and Inverters are secured by use of locks. Substation also has video surveillance. All access doors to O&M building have locking capability. Plant SCADA room access is controlled by Simplex L1011 Auto Locking handle latch assembly which complies with D.O.D 5220.22M. If security breach occurs site team will respond and contact the proper authorities listed in emergency contacts to address situation.

3.12 Water Shortage

This section is not applicable for Long Draw as no water is used for site generation.



ENGIE Long Draw Solar Emergency Response Plan

3.13 Hot/Cold Weather Emergency

Reference document “Long Draw Weatherization Plan” for this section.

3.14 Adequacy and Operability of Fuel Switching Equipment

This section is not applicable for Long Draw as no fuel switching equipment is installed.

3.15 Restoration of Service

In the event of system trip or component failure the following steps below will be followed.

1. Notify Realtime Desk of situation/appropriate Engie personnel.
2. Identify source of event through visual means or event files.
3. Identify replacement components needed if necessary.
4. Replace damage system components if necessary.
5. Return affected system to service with appropriate energization plan.
6. Notify Realtime Desk/appropriate Engie personnel that system has been restored.

3.16 Drills

Drill will be performed annually and documented via sign in sheet.

3.17 Plan Holders

This plan will be held both by Engie Renewables Services LLC O&M and by each of the on-site ENGIE staff. In addition, copies shall be sent to the respective emergency services. This will also be provided, together with a site layout map and site location map, in a laminated format during orientation.

4.0 Emergency Within a Inverter

If an incident occurs within a Inverter, Emergency Services should be called and all on site specialist recovery equipment and techniques to enable injured personnel to be removed to safety from site. Engie Renewable Services LLC will have available, on site, such equipment, and trained personnel to action such a recovery.


5.0 In Case of Spillage

A separate spill prevention, control, and countermeasures plan (SPCC) has been developed to address those issues in detail. Please refer to that plan for more detailed instructions regarding spill prevention and response.

In the event of a spillage of a hazardous or potentially hazardous substance:

Initiate the oil spillage procedure after checking:

- Type of oil or hazardous substance involved
- Estimated quantity of spillage
- Fire Risk
- SDS recommendations and considerations



ENGIE Long Draw Solar Emergency Response Plan

Inform the closest site supervisor and organize delivery to the location of the site emergency spill kit.

Should the spill be too extensive to be resolved using the available spill kit, then the spill should be contained as far as is practicable and the nearest Hazmat specialist contacted to resolve the situation.

The spill should be reported to the National Response Center and the State:

National Response Center: 1-800-424-8802

The following information will be required when reporting the incident:

- Clearly identify the location of the spill
- What substance is involved
- Approximate quantity spilled
- Approximate concentration of the spilled material, if appropriate
- Identify the source of the spill
- Identify who is cleaning the spill
- Identify any resources damaged, if applicable
- Provide contact information

Location Of Safety Data Sheets for Hazardous Materials

Each subcontractor is required to maintain listings of all materials that they are using which may be flammable or hazardous to health in accordance with OSHA 1910.39-C and will provide a copy, updated as appropriate to the Long Draw site office.

6.0 Aircraft Impact

The site FAA Lighting Design complies with existing regulations and requirements, which will be fully operational as soon as each electrical circuit is energized. To minimize the risk of collision by low flying aircraft during the any operational times, fully erected turbines that have not been energized will be marked with a suitable self-powered obstruction light until such time as that circuit is energized.

In the unlikely event that such a collision occurs, the Emergency Response Plan will be brought into effect to mobilize the appropriate on-site Emergency Response Team and Emergency Services.

FAA Lights- Any failure or malfunction that lasts more than thirty (30) minutes and affects a top light or flashing obstruction light, regardless of its position, should be reported immediately to (877) 487-6867 so a Notice to Airmen (NOTAM) can be issued. As soon as the normal operation is restored, notify the same number.



ENGIE Long Draw Solar Emergency Response Plan

7.0 Acts of Sabotage, Terrorism & Bomb Threats

With the advent of potentially increased levels of terrorist activity on mainland USA, it has become essential that all companies consider the implications to the health and safety of their staff should a terrorist attack occur in the workplace. The primary concerns are threatened bombing attacks and the potential for chemical or biological attack

If an act of terrorism comes without warning, or in the case that an incident is subsequently found to be caused by vandalism or sabotage, the Emergency Response Plan will be brought into effect to mobilize the appropriate emergency services.

7.1 Bomb Threat Procedure

If a bomb threat call is received, the main objective is to record every word of the threat message accurately and obtain as much information as possible from the caller. To this end, the following questions should be asked:

- When will the bomb go off?
- Where is the bomb?
- What type of bomb is it?
- What does it look like?
- When was it put there?
- Why are you doing this?
- Who are you?

While talking to the person, try to determine:

- The sex of the caller
- The style of speech
- The accent and mannerisms of the caller
- Listen for background noises that could be helpful to an investigator

After receiving the call, the recipient will then:

- Contact the Site Manager or the nearest Site Supervisor
- Or Dial 911 and inform the County

Site Management should:

- Make sure the County Sheriff's Office has been informed.
- Ensure immediate evacuation of the area of the bombs supposed location, and the surrounding areas.
- Prepare to implement the Evacuation Procedure.
- Prepare relevant documentation to assist in assessing the situation with police and authorities – information such as the number of persons at each site location, site maps, plans of related buildings and equipment, etc.
- Coordinate and supply support to the County Sheriff's Office as requested.

Whether the threat is received in writing or in person, the same procedure should be followed as far as possible.

A procedural check list shall be maintained and readily available, incorporating the above elements.



ENGIE Long Draw Solar Emergency Response Plan

7.2 Chemical and Biological Threat

It is difficult to have a contingency plan that takes into consideration all the possibilities that avoid the consequences of a Chemical or Biological attack, however, should a warning or threat be issued, the identical procedure should be

applied as that used for a Bomb Threat. Leaving the area is even more imperative. Keeping your body covered as far as possible to avoid any skin contact with the threatened substance is a priority. Covering the nose and mouth to avoid inhalation is also a must.

If a letter or parcel is used to spread the noxious medium, all site personnel should be vigilant in their examination of suspicious or unsolicited deliveries. If there are any doubts as to the content of a letter or parcel, and if the senders address and the postmark do not match, the item should be treated as suspect and the authorities contacted to examine the piece under controlled conditions.

The site management cannot mandate for the malicious actions of others, but all site personnel should maintain a heightened state of awareness to protect themselves, their families, and their colleagues at work.

**DO NOT APPROACH, TOUCH OR ATTEMPT TO REMOVE ANY
SUSPICIOUS OBJECT OR DEVICE.**

8.0 Post-Incident Review of Response Procedure

At the weekly site safety meeting following an emergency response incident, the site team will review how successfully the Emergency Response Plan was implemented. Following this review, actions will be taken to correct any deficiencies, either by improved communication of the Emergency Response Plan or by modification to the Plan.

applied as that used for a Bomb Threat. Leaving the area is even more imperative. Keeping your body covered as far as possible to avoid any skin contact with the threatened substance is a priority. Covering the nose and mouth to avoid inhalation is also a must.

If a letter or parcel is used to spread the noxious medium, all site personnel should be vigilant in their examination of suspicious or unsolicited deliveries. If there are any doubts as to the content of a letter or parcel, and if the senders address and the postmark do not match, the item should be treated as suspect and the authorities contacted to examine the piece under controlled conditions.

The site management cannot mandate for the malicious actions of others, but all site personnel should maintain a heightened state of awareness to protect themselves, their families, and their colleagues at work.

**DO NOT APPROACH, TOUCH OR ATTEMPT TO REMOVE ANY
SUSPICIOUS OBJECT OR DEVICE.**



ENGIE Long Draw Solar Emergency Response Plan

Summary of Emergency Services for Long Draw Solar Project

Nearest 24/7 Hospital with ER capability that can be reached within 25 minutes

Will Respond to any Emergency call (Fire or EMS)

Dial: 911

Plant Manager:

(Jose Antu) – Direct Contact Number

Dial: 325-977-1793

Site Technician:

(Nate Martinez) – Direct Contact Number

Dial: 325-436-1640

Site Technician:

(Cody Haltom) – Direct Contact Number

Dial: 325-728-7414

Borden County Sheriff's Department – Sheriff's Department
117 E Wassom St, Gail TX 78738

Dial: 806-756-4311

Borden County Fire Department – Fire Department
PO Box 156 Gail, TX, 78738

Dial: 806-756-4311

Native Air – Air Evacuation Life Team
5305 Etgen Blvd, Snyder TX, 79549

Dial: 800-242-6199

Dawson County EMS Service – EMS Department
501 South Main Ave, Lamesa, TX 79720

Dial: 806-872-3464

Affordacare Urgent Care Clinic – Urgent Care Department
710 S Gregg St, Big Spring, TX 79720

Dial: 432-517-4692

Medical Arts Hospital (Nearest Emergency Room)
2200 N Byran Ave, Lamesa, TX 79331

Dial: 806-872-2183

Spill Reports - (NRC) National Response Center:

Dial (1800) 424-8802

Spill Reports - State: (800) 8232-8224

Emergency Service can be contacted by dialing 911.

Contact details of site supervisors, first aiders and other personnel are listed on a separate sheet that will be issued with this plan and updated as necessary.



ENGIE Long Draw Solar Emergency Response Plan

Other Useful Contacts

Center for Disease Control (CDC) <http://www.cdc.gov/>

Department of Health (DOH) <http://www.doh.wa.gov/>

Department of Homeland Security <http://www.dhs.gov/dhspublic/>

Federal Bureau of Investigation (FBI) <http://www.fbi.gov/>

United States Postal Service <http://www.usps.com/>

Federal Emergency Management Agency (FEMA) <http://www.fema.gov/>

Occupational Safety & Health Administration (OSHA) <http://www.osha.gov/>

Environmental Protection Agency <http://www.epa.gov/>

National Response Center to report Toxic Chemical & Oil Spills
Dial 1-800 424 8802 or <http://www.nrc.uscg.mil/nrcrpttxt.htm>

Poisons Center <http://uuhsc.utah.edu/healthinfo/adult/nontrauma/overview.htm>
or Dial 1-800 222 1222

Note: Immediately after dealing with the immediate crisis, the Engie Long Draw Plant Manager shall be contacted at 325-977-1793 and informed of the nature of the emergency.



ENGIE Long Draw Solar Emergency Response Plan

Long Draw Solar CONCISE EMERGENCY PLAN HOW TO DEAL WITH AN EMERGENCY SITUATION

Use these notes in case of injury, illness, fire, and in case of evacuation.

***** ALWAYS KNOW YOUR LOCATION *****

**(Each Inverter location is numbered, for example PCS 1, PCS 76, etc.
Also, Each Combiner box is numbered, for example COMB 1.01,
COMB 76.15)**

In case of INJURY or ILLNESS:

1. Call 911 after business hours. Give location and the turbine number of the emergency and describe the injury or illness.
2. During business hours notify a supervisor. All supervisors carry a cell phone and/or a two-way radio. Describe the emergency to the supervisor and include the turbine number.

Engie Plant Manager: (Jose Antu) 325-977-1793

Engie Plant Engineer (Kartheek Koka) 602-727-7071

Long Draw Site Office GPS Location: 32.7430946,
Address: 13657 US -101.6228368
HWY 180 Lamesa TX
79331

3. Dispatch a third party to the main gate to meet and escort the emergency services to your location. Reporting employee should STAY WITH THE CASUALTY.
4. Reporting employee, the supervisor or a designated health and safety representative should go with the casualty to the hospital.

In case of FIRE:

1. Call the fire department by dialing 911 and give the location of the fire.
2. Notify supervisors (as above).
3. Immediately clear the area of all personnel and, if possible, vehicles and flammables. If you are trained in fire safety, and the fire is small, attempt to put the fire out with an extinguisher. **DO NOT PUT YOURSELF AT RISK.**
4. Await the arrival of the fire department.

**In case of SEVERE or EXTREME WEATHER, ACTS OF SABOTAGE or TERRORISM
or MAJOR INCIDENT:**

1. Prepare to evacuate the site. Supervisors will initiate and coordinate the evacuation.




ENGIE Long Draw Solar
SOLAR PANELS



ENGIE Long Draw Solar Emergency Response Plan

FOLLOW THEIR INSTRUCTIONS.



ENGIE Long Draw Solar Emergency Response Plan

In any emergency, keep calm and don't panic. Give clear, concise information and directions. The attached map shows the layout of the roads and turbines on the wind project, and the site muster point.

Main muster point location for site. (Operations Building)


Secondary muster point is (Muster Area A)

Map showing layout of the roads and turbines on The Long Draw Solar Project

Figure 1: Project Site Map



ENGIE Long Draw Solar Emergency Response Plan

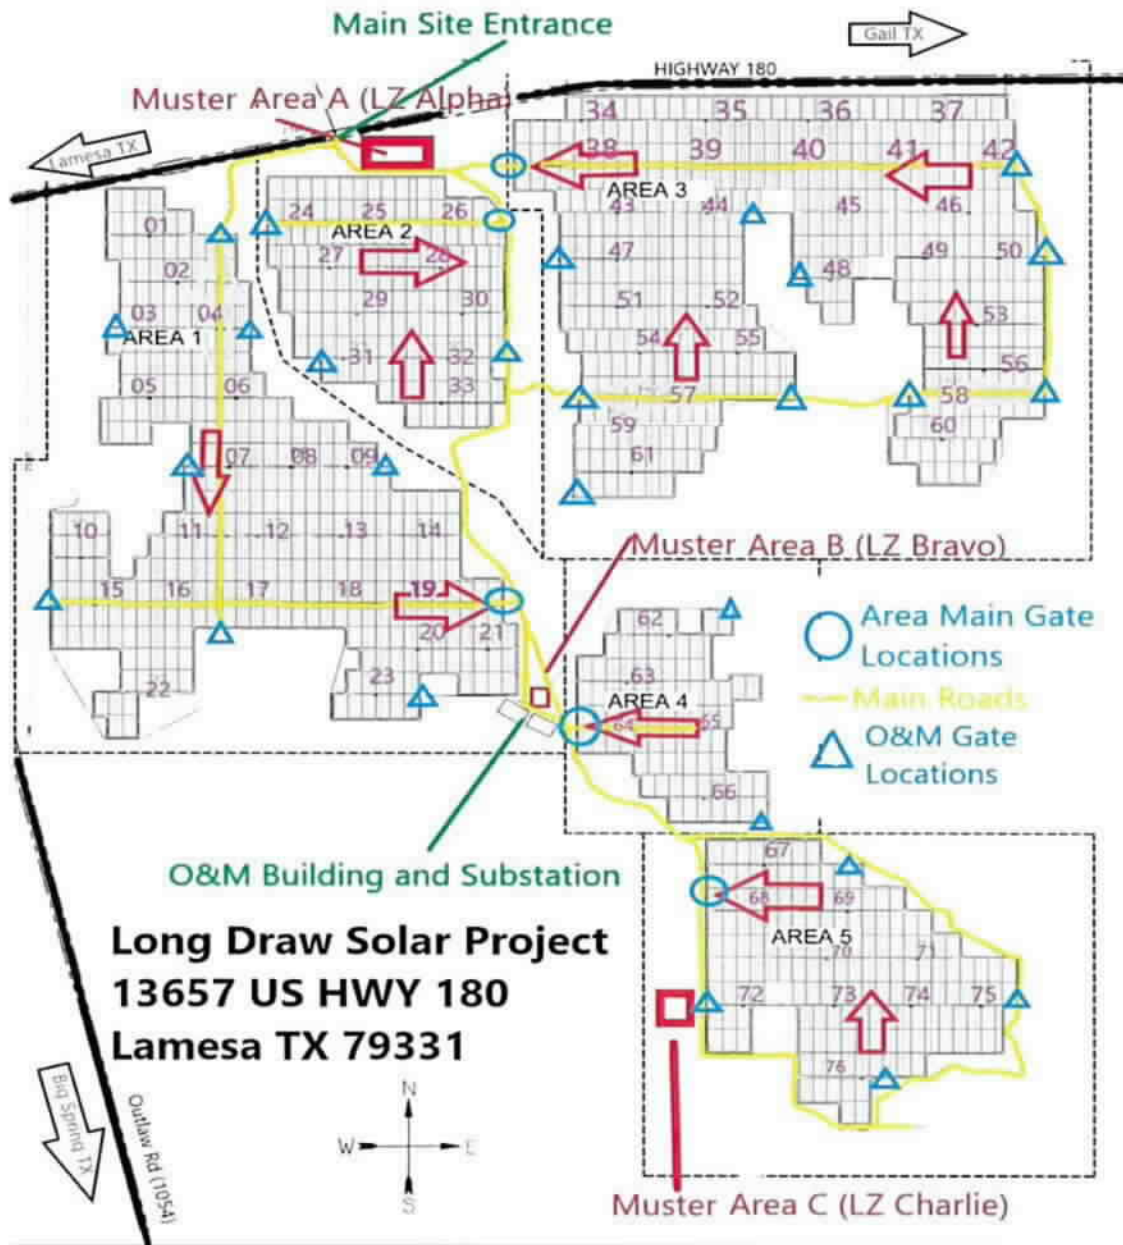



ENGIE Long Draw Solar Emergency Response Plan

Document Revision

This document shall be reviewed on an annual basis to ensure the integrity and safety.

Change history:

The following table summarizes the change history of the document.

Version	Description of Change	Initiator	Date
Draft	Initial revision & draft	Jose Antu	4/5/2022

Approval:

Approved by	Title	Date
Hurel Johnson	US Renewables Director-Solar	

AFFIDAVIT

State of Texas

§

County of Harris

§

§

Before me, the undersigned notary public, on this day personally appeared Rachel Kilpatrick, to me known to be the person whose name is subscribed to the foregoing instrument, who being duly sworn according to law, deposes and says:

- “1. My name is Rachel Kilpatrick. I am over the age of eighteen and am a resident of the State of Texas. I am competent to testify to all the facts stated in this Affidavit, and I have the authority to make this Affidavit on behalf of ENGIE Long Draw Solar LLC. (PGC certification number 20535).
2. I swear or affirm that in my capacity as Vice President, I have personal knowledge of the facts stated in the Emergency Operations Plan (“EOP”) submitted to ERCOT and filed in Project No. 53385.
3. I further swear or affirm that I have personal knowledge of the facts stated below:
 - Relevant operating personnel are familiar with and have received training on the applicable contents and execution of the EOP, and such personnel are instructed to follow the applicable portions of the EOP except to the extent deviations are appropriate as a result of specific circumstances during the course of an emergency;
 - The EOP has been reviewed and approved by the appropriate executives;
 - Engie North America Inc. intends to conduct a drill consistent with subsection (f) of PUC Subst. R. §25.53 by 30 September 2023, and will provide notice to the Commission at least 30 days before that drill is conducted. Once that drill is conducted, Engie North America Inc. will notify the Commission;
 - The EOP, or an appropriate summary, will be distributed to local jurisdictions as needed;
 - Engie North America Inc. maintains a business continuity plan that addresses returning to normal operations after disruptions caused by an incident; and,
 - Emergency management personnel who are designated to interact with local, state, and federal emergency management officials during emergency events have received the latest IS-100, IS-200, IS-700, and IS-800 National Incident Management Systems training.

4. - I further swear or affirm the information, statements, and/or representations contained in the Emergency Operations Plan are true, complete, and correct to the best of my knowledge and belief. Further affiant sayeth not. "


Rachel W Kilpatrick

Rachel Kilpatrick

Vice President

Engie North America Inc.

SWORN TO AND SUBSCRIBED TO BEFORE ME on the 2nd day of June 2023.

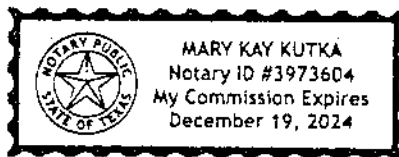

Mary Kay Kutka

My Commission Expires: 12/19/2024