

ENTERGYTEXAS, INC.
SUMMARY OF LINE LOSSES AND SYSTEM'S OWN USE

SYSTEM LOSSES (MWH) (1)									SYSTEM'S OWN USE (2), (3)	
TEST YEAR (TY)	PERIOD	SECONDARY	PRIMARY	SUBSTATION	< 230 kV	>= 230 kV	SUBTOTAL	DIFFERENCE	BOOK LOSSES	TOTAL SYSTEM
									LESS SYSTEM USE	
	Jan-21	25683	17086	14535	15751	6934	79990	(156870)	(76880)	544
	Feb-21	21812	14511	12344	13377	5889	67934	(401146)	(333211)	422
	Mar-21	32281	21476	18268	19798	8716	100538	367713	468251	387
	Apr-21	28278	18813	16003	17343	7635	88072	98989	187061	309
	May-21	28924	19243	16369	17739	7810	90085	124191	214276	2041
	Jun-21	30747	20456	17401	18857	8302	95762	(73649)	22114	1781
	Jul-21	33014	21963	18683	20247	8914	102821	(6703)	96118	671
	Aug-21	33700	22420	19071	20668	9099	104957	(27693)	77264	830
	Sep-21	29911	19899	16927	18344	8076	93156	(216375)	(123219)	671
	Oct-21	29516	19636	16704	18102	7969	91927	18107	110033	648
	Nov-21	27010	17969	15285	16565	7293	84122	(117211)	(33089)	620
	Dec-21	26971	17943	15263	16541	7282	84000	30205	114205	786

Rate year data is not applicable because the Company is not requesting a revised fuel factor

NOTES:

(1) System losses include transformer as well as line losses.

(2) Estimated usage for office buildings, area offices, service centers, and communication facilities.

This schedule is not provided in the format shown in the filing package because the information is not available by the categories shown in the filing package.

Loss Estimation at Voltage Levels
For the Period January 2021 Through December 2021
Using Current Implemented Loss Factors

Year	<u>Sales @ Source#</u>	<u>Engineering</u>	SECONDARY	PRIMARY	SUBSTATION	< 230 kV	>= 230 kV	Sub-Total	Book Losses	<u>SYSTEM</u>	<u>Difference= Book</u>
	(MWH)	Losses (MWH)								OWN USE	losses - SubTotal-
										(3)	System Own Use
Jan-21	1,682,981	79,990	25,683	17,086	14,535	15,751	6,934	79,990	(76,336)	544	(156,870)
Feb-21	1,429,336	67,934	21,812	14,511	12,344	13,377	5,889	67,934	(332,789)	422	(401,146)
Mar-21	2,115,315	100,538	32,281	21,476	18,268	19,798	8,716	100,538	468,638	387	367,713
Apr-21	1,853,029	88,072	28,278	18,813	16,003	17,343	7,635	88,072	187,371	309	98,989
May-21	1,895,378	90,085	28,924	19,243	16,369	17,739	7,810	90,085	216,316	2,041	124,191
Jun-21	2,014,834	95,762	30,747	20,456	17,401	18,857	8,302	95,762	23,894	1,781	(73,649)
Jul-21	2,163,357	102,821	33,014	21,963	18,683	20,247	8,914	102,821	96,789	671	(6,703)
Aug-21	2,208,287	104,957	33,700	22,420	19,071	20,668	9,099	104,957	78,094	830	(27,693)
Sep-21	1,960,001	93,156	29,911	19,899	16,927	18,344	8,076	93,156	(122,548)	671	(216,375)
Oct-21	1,934,133	91,927	29,516	19,636	16,704	18,102	7,969	91,927	110,682	648	18,107
Nov-21	1,769,928	84,122	27,010	17,969	15,285	16,565	7,293	84,122	(32,469)	620	(117,211)
Dec-21	1,767,362	84,000	26,971	17,943	15,263	16,541	7,282	84,000	114,991	786	30,205
Totals TY	22,793,943	1,083,366	347,847	231,416	196,853	213,332	93,918	1,083,366	732,632	9,709	(360,443)

Proposed Loss Factors

<u>Voltage Levels</u>	<u>Estimated Losses</u>	<u>Percentage of Total Losses</u>
Transmission Delivery - 230 KV and Above	79,686	8.67%
Transmission Delivery - Below 230 KV	181,004	19.69%
Substation	167,023	18.17%
Delivery at Primary Distribution Feeder	196,348	21.36%
Delivery at Secondary	295,137	32.11%
Total Losses	919,199	100.00%
 <u>Total Engineering Losses</u>		 <u>4.75%</u>

ENTERGY TEXAS, INC.
OFF-SYSTEM POWER SALES
FOR THE TWELVE MONTHS ENDED DECEMBER 31, 2021

Schedule H-12.5b-f
2022 Rate Case
Page 1 of 7

<u>Contents of Schedule 12.5b-f</u>	<u>Pages</u>
Summary Total Dollars for the period January 2021 - December 2021	2
Summary MWH for the period January 2021 - December 2021	3
Eligible Revenues for the period January 2021 - December 2021	4
Ineligible Revenues for the period January 2021 - December 2021	5
Total Revenues for the period January 2021 - December 2021	6
On System Sales - Wholesale and Retail	7

Definitions of abbreviations and acronyms

<u>POWER TYPES</u>	
F	Firm Sales
NF	Non-Firm Sales

Note: The Company has presented Schedules H-12.5b-f in a consolidated format to reflect the manner in which the Company maintains its accounting records.

Amounts may not add or tie to other schedules due to rounding.
Sponsored by: Andrew Dornier

ENTERGY TEXAS, INC.
OFF-SYSTEM POWER SALES
FOR THE TWELVE MONTHS ENDED DECEMBER 31, 2021

Schedule H-12.5b-f
2022 Rate Case
Page 2 of 7

WAIVER

Amounts may not add or tie to other schedules due to rounding.
Sponsored by: Andrew Dornier

ENTERGY TEXAS, INC.
OFF-SYSTEM POWER SALES
FOR THE TWELVE MONTHS ENDED DECEMBER 31, 2021

Schedule H-12.5b-f
2022 Rate Case
Page 3 of 7

WAIVER

Amounts may not add or tie to other schedules due to rounding.
Sponsored by: Andrew Dornier

ENTERGY TEXAS, INC.
OFF-SYSTEM POWER SALES
FOR THE TWELVE MONTHS ENDED DECEMBER 31, 2021

Schedule H-12.5b-f
2022 Rate Case
Page 4 of 7

WAIVER

Amounts may not add or tie to other schedules due to rounding.
Sponsored by: Andrew Dornier

ENTERGY TEXAS, INC.
OFF-SYSTEM POWER SALES
FOR THE TWELVE MONTHS ENDED DECEMBER 31, 2021

Schedule H-12.5b-f
2022 Rate Case
Page 5 of 7

<u>Line</u>	<u>Month</u>	<u>Supplier</u>	<u>Power Type</u>	<u>Resource Plan Capacity</u>	<u>Total Ineligible Revenues</u>
1	Jan-21	ETI - Resource Plan	F	1,182,648	1,182,648
2	Jan-21	Total		1,182,648	1,182,648
3	Feb-21	ETI - Resource Plan	F	1,182,648	1,182,648
4	Feb-21	Total		1,182,648	1,182,648
5	Mar-21	ETI - Resource Plan	F	675,799	675,799
6	Mar-21	Total		675,799	675,799
7	Apr-21	ETI - Resource Plan	F	675,799	675,799
8	Apr-21	Total		675,799	675,799
9	May-21	ETI - Resource Plan	F	1,520,548	1,520,548
10	May-21	Total		1,520,548	1,520,548
11	Jun-21	ETI - Resource Plan	F	2,592,446	2,592,446
13	Jun-21	Total		2,592,446	2,592,446
14	Jul-21	ETI - Resource Plan	F	2,592,446	2,592,446
16	Jul-21	Total		2,592,446	2,592,446
17	Aug-21	ETI - Resource Plan	F	2,592,446	2,592,446
19	Aug-21	Total		2,592,446	2,592,446
20	Sep-21	ETI - Resource Plan	F	1,555,468	1,555,468
22	Sep-21	Total		1,555,468	1,555,468
23	Oct-21	ETI - Resource Plan	F	691,319	691,319
25	Oct-21	Total		691,319	691,319
26	Nov-21	ETI - Resource Plan	F	691,319	691,319
28	Nov-21	Total		691,319	691,319
29	Dec-21	ETI - Resource Plan	F	1,209,808	1,209,808
31	Dec-21	Total		1,209,808	1,209,808
32				0	
35	Totals TY	ETI-Resource Plan	F	17,162,695	17,162,695
36					
37	Totals TY	Totals		17,162,695	17,162,695

Amounts may not add or tie to other schedules due to rounding.
Sponsored by: Andrew Dornier

ENTERGY TEXAS, INC.
OFF-SYSTEM POWER SALES
FOR THE TWELVE MONTHS ENDED DECEMBER 31, 2021

Schedule H-12.5b-f
2022 Rate Case
Page 6 of 7

WAIVER

Amounts may not add or tie to other schedules due to rounding.
Sponsored by: Andrew Dornier


ENTERGY TEXAS, INC.
OFF-SYSTEM POWER SALES
FOR THE TWELVE MONTHS ENDED DECEMBER 31, 2021

Schedule H-12.5b-f
2022 Rate Case
Page 7 of 7

The Company has requested a waiver of this schedule


Amounts may not add or tie to other schedules due to rounding.
Sponsored by: Andrew Dornier

**ENTERGY TEXAS, INC.
MONTHLY MINIMUM & PEAK DEMAND
CALENDAR YEAR 2021**

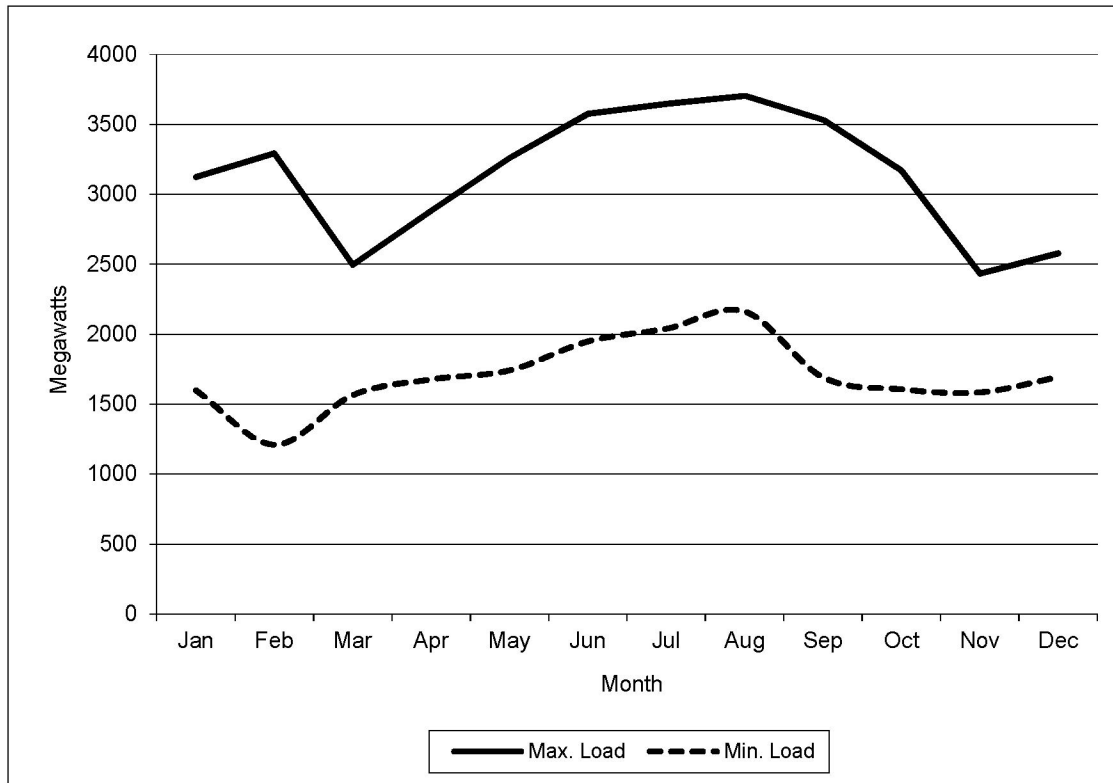


	Max. Load	Min. Load
Jan	3123	1598
Feb	3293	1210
Mar	2496	1565
Apr	2881	1677
May	3260	1742
Jun	3575	1948
Jul	3646	2039
Aug	3704	2162
Sep	3531	1691
Oct	3168	1606
Nov	2432	1584
Dec	2577	1694

**ENTERGY TEXAS, INC.
MONTHLY MINIMUM & PEAK DEMAND
CALENDAR YEAR 2020**

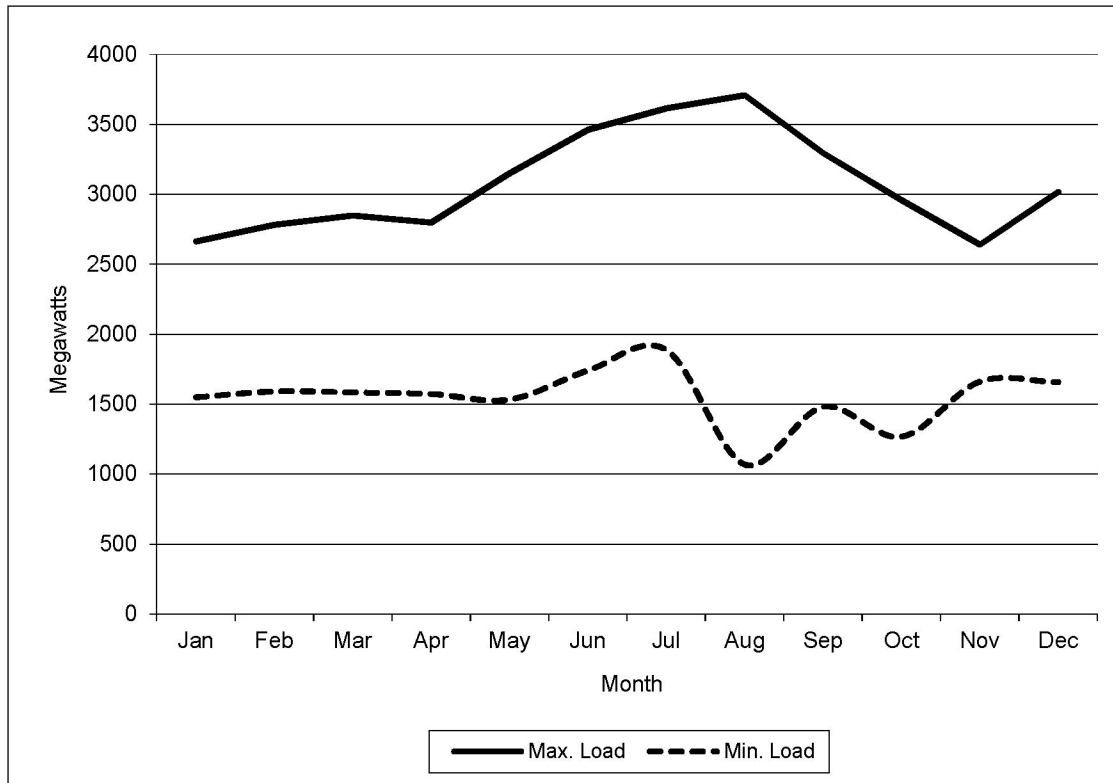


	Max. Load	Min. Load
Jan	2662	1549
Feb	2781	1591
Mar	2848	1584
Apr	2797	1573
May	3150	1533
Jun	3461	1740
Jul	3614	1887
Aug	3708	1069
Sep	3294	1480
Oct	2957	1267
Nov	2640	1661
Dec	3017	1656

**ENTERGY TEXAS, INC.
MONTHLY MINIMUM & PEAK DEMAND
CALENDAR YEAR 2019**

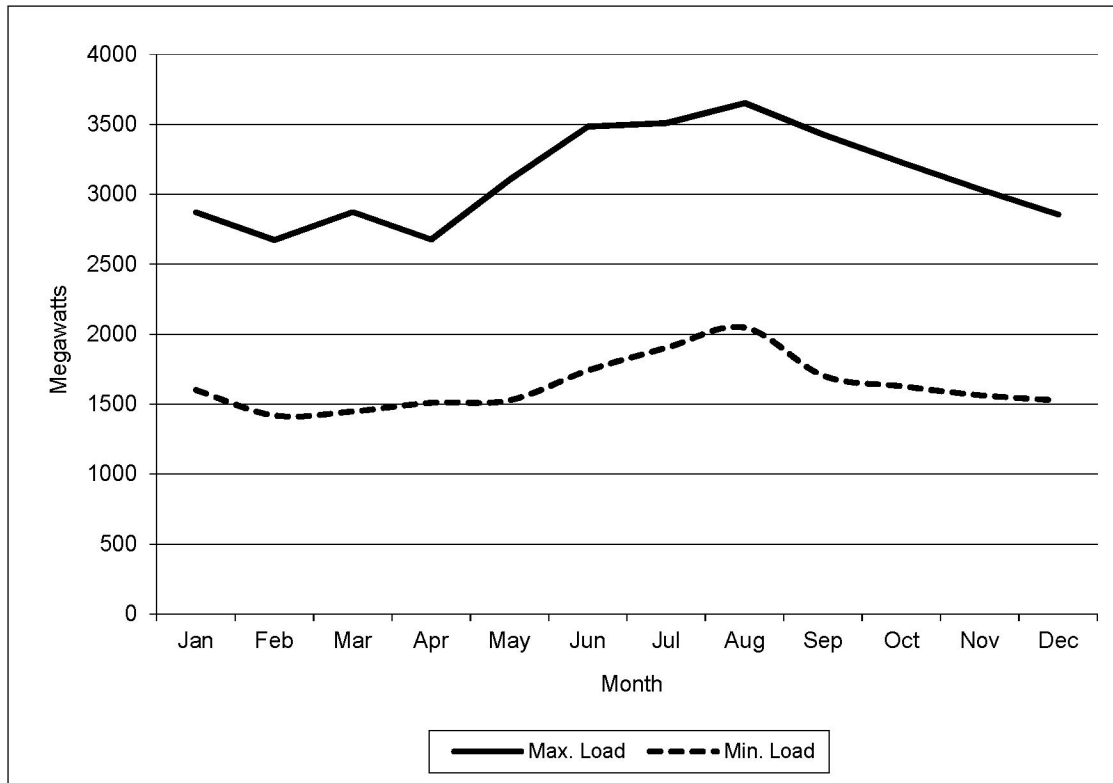

	Max. Load	Min. Load
Jan	2870	1601
Feb	2673	1419
Mar	2872	1448
Apr	2677	1510
May	3104	1528
Jun	3483	1741
Jul	3510	1903
Aug	3652	2047
Sep	3427	1704
Oct	3228	1628
Nov	3035	1564
Dec	2854	1527

**ENTERGY TEXAS, INC.
MONTHLY MINIMUM & PEAK DEMAND
CALENDAR YEAR 2018**

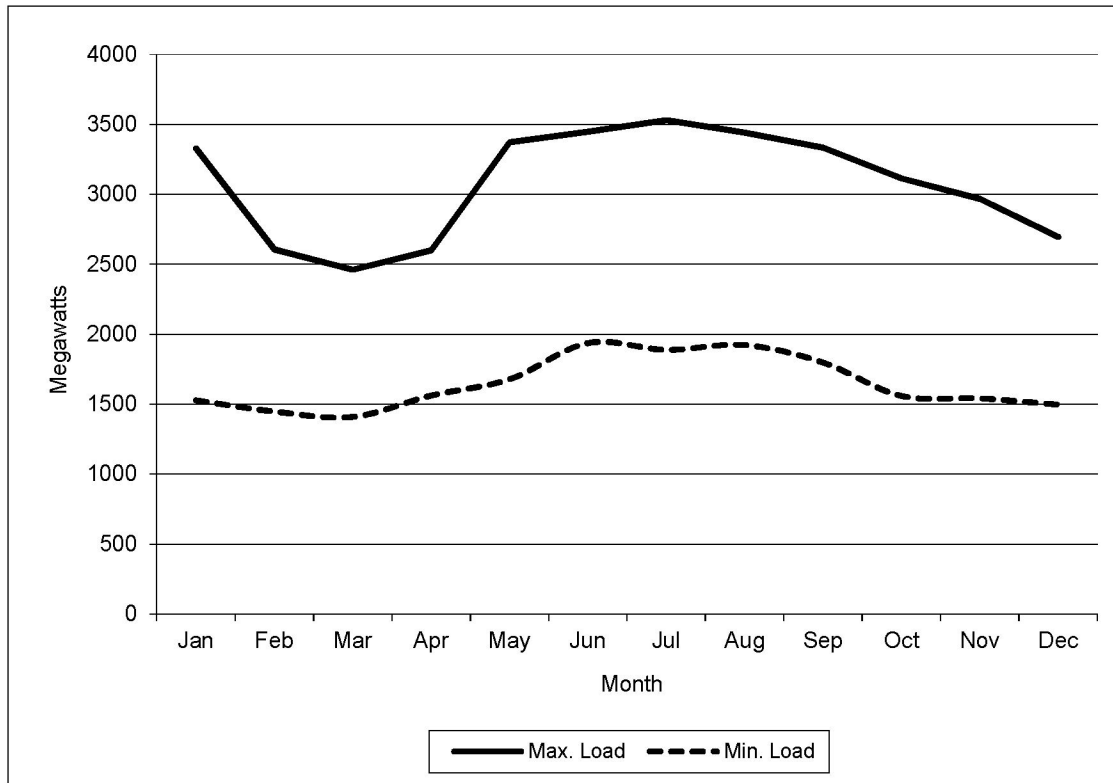


	Max. Load	Min. Load
Jan	3327	1527
Feb	2607	1447
Mar	2461	1409
Apr	2598	1562
May	3372	1678
Jun	3447	1937
Jul	3529	1888
Aug	3441	1922
Sep	3334	1797
Oct	3112	1558
Nov	2968	1542
Dec	2694	1496

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3122.614	1	1	0.134
99	3091.38786	0	1	0.134
98	3060.16172	1	2	0.269
97	3028.93558	2	4	0.538
96	2997.70944	2	6	0.806
95	2966.4833	2	8	1.075
94	2935.25716	3	11	1.478
93	2904.03102	4	15	2.016
92	2872.80488	2	17	2.285
91	2841.57874	7	24	3.226
90	2810.3526	1	25	3.360
89	2779.12646	4	29	3.898
88	2747.90032	6	35	4.704
87	2716.67418	4	39	5.242
86	2685.44804	7	46	6.183
85	2654.2219	6	52	6.989
84	2622.99576	4	56	7.527
83	2591.76962	7	63	8.468
82	2560.54348	8	71	9.543
81	2529.31734	7	78	10.484
80	2498.0912	7	85	11.425
79	2466.86506	17	102	13.710
78	2435.63892	10	112	15.054
77	2404.41278	16	128	17.204
76	2373.18664	14	142	19.086
75	2341.9605	26	168	22.581
74	2310.73436	31	199	26.747
73	2279.50822	26	225	30.242
72	2248.28208	22	247	33.199
71	2217.05594	22	269	36.156
70	2185.8298	17	286	38.441
69	2154.60366	21	307	41.263
68	2123.37752	33	340	45.699
67	2092.15138	40	380	51.075
66	2060.92524	50	430	57.796
65	2029.6991	55	485	65.188
64	1998.47296	41	526	70.699
63	1967.24682	33	559	75.134
62	1936.02068	40	599	80.511
61	1904.79454	20	619	83.199
60	1873.5684	21	640	86.022
59	1842.34226	17	657	88.306
58	1811.11612	7	664	89.247
57	1779.88998	17	681	91.532
56	1748.66384	9	690	92.742
55	1717.4377	12	702	94.355
54	1686.21156	10	712	95.699
53	1654.98542	13	725	97.446
52	1623.75928	12	737	99.059
51	1592.53314	7	744	100.000
50	1561.307	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2021 CURVE

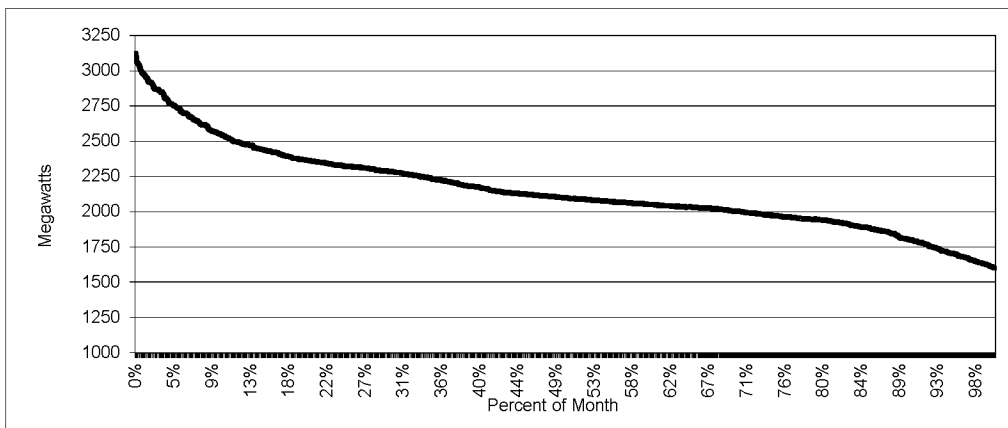

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3292.571	1	1	0.166
99	3259.64529	2	3	0.497
98	3226.71958	1	4	0.662
97	3193.79387	2	6	0.993
96	3160.86816	1	7	1.159
95	3127.94245	8	15	2.483
94	3095.01674	7	22	3.642
93	3062.09103	5	27	4.470
92	3029.16532	6	33	5.464
91	2996.23961	7	40	6.623
90	2963.3139	2	42	6.954
89	2930.38819	8	50	8.278
88	2897.46248	3	53	8.775
87	2864.53677	7	60	9.934
86	2831.61106	7	67	11.093
85	2798.68535	8	75	12.417
84	2765.75964	14	89	14.735
83	2732.83393	5	94	15.563
82	2699.90822	9	103	17.053
81	2666.98251	18	121	20.033
80	2634.0568	11	132	21.854
79	2601.13109	14	146	24.172
78	2568.20538	13	159	26.325
77	2535.27967	6	165	27.318
76	2502.35396	12	177	29.305
75	2469.42825	6	183	30.298
74	2436.50254	17	200	33.113
73	2403.57683	10	210	34.768
72	2370.65112	4	214	35.430
71	2337.72541	9	223	36.921
70	2304.7997	8	231	38.245
69	2271.87399	13	244	40.397
68	2238.94828	8	252	41.722
67	2206.02257	16	268	44.371
66	2173.09686	12	280	46.358
65	2140.17115	18	298	49.338
64	2107.24544	20	318	52.649
63	2074.31973	23	341	56.457
62	2041.39402	27	368	60.927
61	2008.46831	32	400	66.225
60	1975.5426	26	426	70.530
59	1942.61689	27	453	75.000
58	1909.69118	17	470	77.815
57	1876.76547	15	485	80.298
56	1843.83976	17	502	83.113
55	1810.91405	13	515	85.265
54	1777.98834	19	534	88.411
53	1745.06263	25	559	92.550
52	1712.13692	25	584	96.689
51	1679.21121	20	604	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2021 CURVE

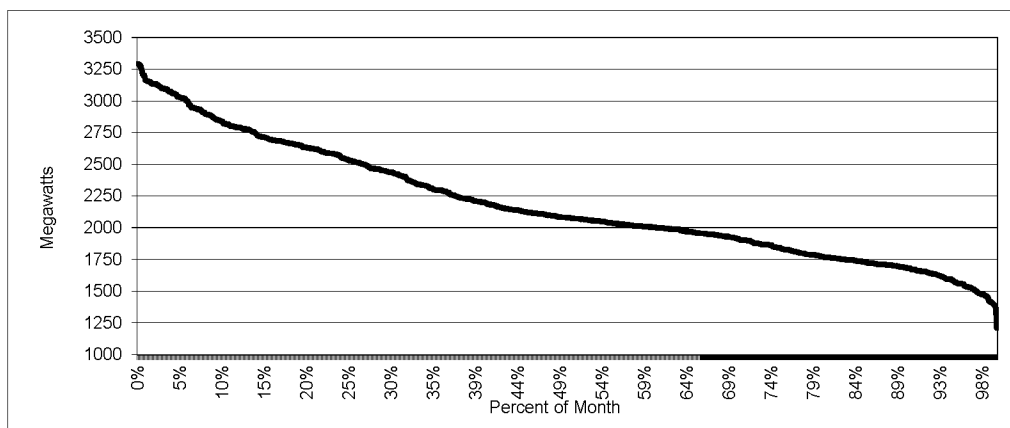

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2495.708	1	1	0.134
99	2470.75092	2	3	0.403
98	2445.79384	1	4	0.538
97	2420.83676	4	8	1.075
96	2395.87968	5	13	1.747
95	2370.9226	3	16	2.151
94	2345.96552	10	26	3.495
93	2321.00844	4	30	4.032
92	2296.05136	13	43	5.780
91	2271.09428	10	53	7.124
90	2246.1372	11	64	8.602
89	2221.18012	19	83	11.156
88	2196.22304	18	101	13.575
87	2171.26596	27	128	17.204
86	2146.30888	37	165	22.177
85	2121.3518	42	207	27.823
84	2096.39472	28	235	31.586
83	2071.43764	39	274	36.828
82	2046.48056	30	304	40.860
81	2021.52348	43	347	46.640
80	1996.5664	44	391	52.554
79	1971.60932	38	429	57.661
78	1946.65224	42	471	63.306
77	1921.69516	40	511	68.683
76	1896.73808	32	543	72.984
75	1871.781	43	586	78.763
74	1846.82392	20	606	81.452
73	1821.86684	32	638	85.753
72	1796.90976	18	656	88.172
71	1771.95268	17	673	90.457
70	1746.9956	26	699	93.952
69	1722.03852	15	714	95.968
68	1697.08144	14	728	97.849
67	1672.12436	6	734	98.656
66	1647.16728	5	739	99.328
65	1622.2102	1	740	99.462
64	1597.25312	1	741	99.597
63	1572.29604	2	743	99.866
62	1547.33896	1	744	100.000
61	1522.38188	0	744	100.000
60	1497.4248	0	744	100.000
59	1472.46772	0	744	100.000
58	1447.51064	0	744	100.000
57	1422.55356	0	744	100.000
56	1397.59648	0	744	100.000
55	1372.6394	0	744	100.000
54	1347.68232	0	744	100.000
53	1322.72524	0	744	100.000
52	1297.76816	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2021 CURVE

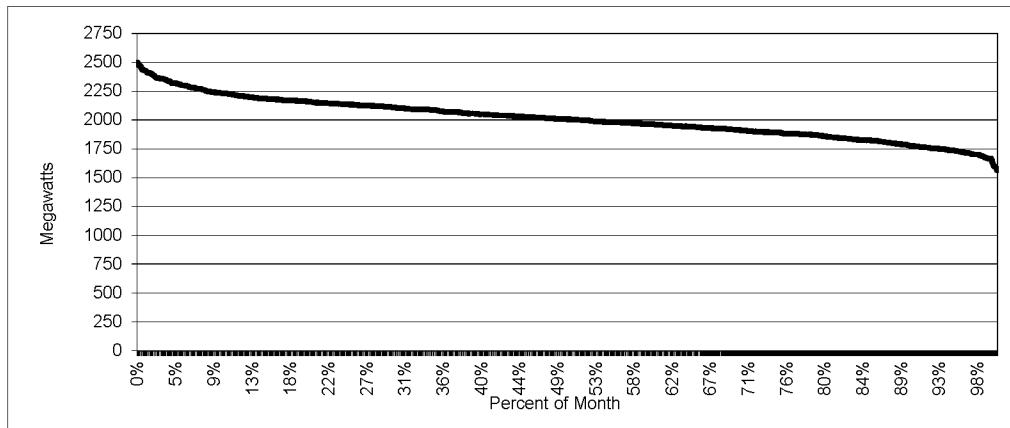

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2881.329	1	1	0.139
99	2852.51571	1	2	0.278
98	2823.70242	1	3	0.417
97	2794.88913	1	4	0.556
96	2766.07584	2	6	0.833
95	2737.26255	0	6	0.833
94	2708.44926	2	8	1.111
93	2679.63597	6	14	1.944
92	2650.82268	3	17	2.361
91	2622.00939	6	23	3.194
90	2593.1961	2	25	3.472
89	2564.38281	11	36	5.000
88	2535.56952	13	49	6.806
87	2506.75623	9	58	8.056
86	2477.94294	11	69	9.583
85	2449.12965	13	82	11.389
84	2420.31636	14	96	13.333
83	2391.50307	9	105	14.583
82	2362.68978	10	115	15.972
81	2333.87649	14	129	17.917
80	2305.0632	21	150	20.833
79	2276.24991	13	163	22.639
78	2247.43662	18	181	25.139
77	2218.62333	25	206	28.611
76	2189.81004	24	230	31.944
75	2160.99675	19	249	34.583
74	2132.18346	27	276	38.333
73	2103.37017	34	310	43.056
72	2074.55688	35	345	47.917
71	2045.74359	33	378	52.500
70	2016.9303	41	419	58.194
69	1988.11701	41	460	63.889
68	1959.30372	29	489	67.917
67	1930.49043	37	526	73.056
66	1901.67714	33	559	77.639
65	1872.86385	23	582	80.833
64	1844.05056	24	606	84.167
63	1815.23727	20	626	86.944
62	1786.42398	27	653	90.694
61	1757.61069	23	676	93.889
60	1728.7974	28	704	97.778
59	1699.98411	10	714	99.167
58	1671.17082	6	720	100.000
57	1642.35753	0	720	100.000
56	1613.54424	0	720	100.000
55	1584.73095	0	720	100.000
54	1555.91766	0	720	100.000
53	1527.10437	0	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2021 CURVE

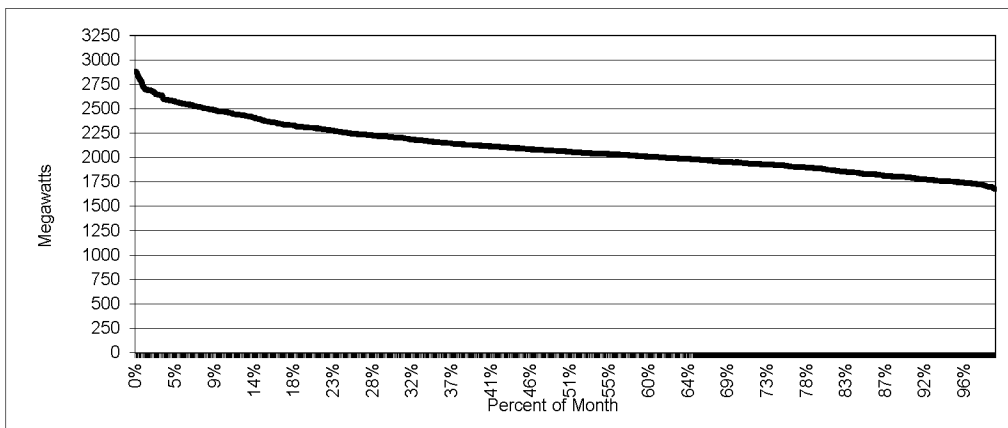

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3259.869	1	1	0.134
99	3227.27031	2	3	0.403
98	3194.67162	2	5	0.672
97	3162.07293	2	7	0.941
96	3129.47424	1	8	1.075
95	3096.87555	5	13	1.747
94	3064.27686	5	18	2.419
93	3031.67817	7	25	3.360
92	2999.07948	3	28	3.763
91	2966.48079	6	34	4.570
90	2933.8821	6	40	5.376
89	2901.28341	5	45	6.048
88	2868.68472	3	48	6.452
87	2836.08603	4	52	6.989
86	2803.48734	10	62	8.333
85	2770.88865	10	72	9.677
84	2738.28996	10	82	11.022
83	2705.69127	12	94	12.634
82	2673.09258	15	109	14.651
81	2640.49389	14	123	16.532
80	2607.8952	20	143	19.220
79	2575.29651	15	158	21.237
78	2542.69782	23	181	24.328
77	2510.09913	24	205	27.554
76	2477.50044	30	235	31.586
75	2444.90175	21	256	34.409
74	2412.30306	33	289	38.844
73	2379.70437	19	308	41.398
72	2347.10568	16	324	43.548
71	2314.50699	29	353	47.446
70	2281.9083	22	375	50.403
69	2249.30961	24	399	53.629
68	2216.71092	35	434	58.333
67	2184.11223	26	460	61.828
66	2151.51354	32	492	66.129
65	2118.91485	20	512	68.817
64	2086.31616	21	533	71.640
63	2053.71747	34	567	76.210
62	2021.11878	33	600	80.645
61	1988.52009	31	631	84.812
60	1955.9214	15	646	86.828
59	1923.32271	16	662	88.978
58	1890.72402	16	678	91.129
57	1858.12533	16	694	93.280
56	1825.52664	18	712	95.699
55	1792.92795	21	733	98.522
54	1760.32926	9	742	99.731
53	1727.73057	2	744	100.000
52	1695.13188	0	744	100.000
51	1662.53319	0	744	100.000

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2021 CURVE

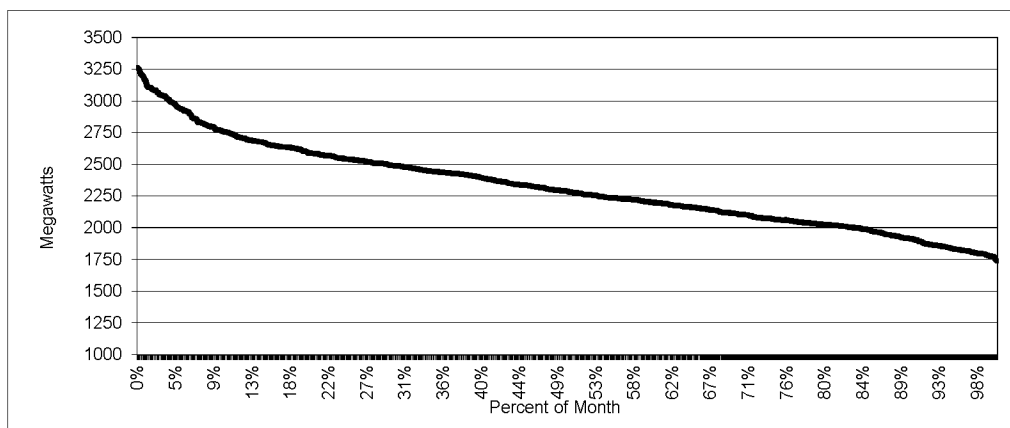

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3574.662	1	1	0.139
99	3538.91538	2	3	0.417
98	3503.16876	2	5	0.694
97	3467.42214	3	8	1.111
96	3431.67552	1	9	1.250
95	3395.9289	10	19	2.639
94	3360.18228	13	32	4.444
93	3324.43566	13	45	6.250
92	3288.68904	11	56	7.778
91	3252.94242	19	75	10.417
90	3217.1958	20	95	13.194
89	3181.44918	10	105	14.583
88	3145.70256	13	118	16.389
87	3109.95594	21	139	19.306
86	3074.20932	15	154	21.389
85	3038.4627	15	169	23.472
84	3002.71608	18	187	25.972
83	2966.96946	22	209	29.028
82	2931.22284	11	220	30.556
81	2895.47622	23	243	33.750
80	2859.7296	16	259	35.972
79	2823.98298	12	271	37.639
78	2788.23636	20	291	40.417
77	2752.48974	13	304	42.222
76	2716.74312	16	320	44.444
75	2680.9965	14	334	46.389
74	2645.24988	17	351	48.750
73	2609.50326	19	370	51.389
72	2573.75664	18	388	53.889
71	2538.01002	21	409	56.806
70	2502.2634	17	426	59.167
69	2466.51678	21	447	62.083
68	2430.77016	18	465	64.583
67	2395.02354	21	486	67.500
66	2359.27692	23	509	70.694
65	2323.5303	30	539	74.861
64	2287.78368	30	569	79.028
63	2252.03706	30	599	83.194
62	2216.29044	26	625	86.806
61	2180.54382	23	648	90.000
60	2144.7972	18	666	92.500
59	2109.05058	14	680	94.444
58	2073.30396	11	691	95.972
57	2037.55734	8	699	97.083
56	2001.81072	9	708	98.333
55	1966.0641	8	716	99.444
54	1930.31748	4	720	100.000
53	1894.57086	0	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2021 CURVE



ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3646.117	1	1	0.134
99	3609.65583	3	4	0.538
98	3573.19466	2	6	0.806
97	3536.73349	13	19	2.554
96	3500.27232	12	31	4.167
95	3463.81115	11	42	5.645
94	3427.34998	11	53	7.124
93	3390.88881	8	61	8.199
92	3354.42764	13	74	9.946
91	3317.96647	9	83	11.156
90	3281.5053	12	95	12.769
89	3245.04413	16	111	14.919
88	3208.58296	15	126	16.935
87	3172.12179	16	142	19.086
86	3135.66062	19	161	21.640
85	3099.19945	16	177	23.790
84	3062.73828	16	193	25.941
83	3026.27711	21	214	28.763
82	2989.81594	16	230	30.914
81	2953.35477	25	255	34.274
80	2916.8936	11	266	35.753
79	2880.43243	20	286	38.441
78	2843.97126	20	306	41.129
77	2807.51009	13	319	42.876
76	2771.04892	15	334	44.892
75	2734.58775	17	351	47.177
74	2698.12658	19	370	49.731
73	2661.66541	23	393	52.823
72	2625.20424	13	406	54.570
71	2588.74307	20	426	57.258
70	2552.2819	21	447	60.081
69	2515.82073	19	466	62.634
68	2479.35956	29	495	66.532
67	2442.89839	27	522	70.161
66	2406.43722	20	542	72.849
65	2369.97605	33	575	77.285
64	2333.51488	30	605	81.317
63	2297.05371	31	636	85.484
62	2260.59254	27	663	89.113
61	2224.13137	29	692	93.011
60	2187.6702	12	704	94.624
59	2151.20903	19	723	97.177
58	2114.74786	9	732	98.387
57	2078.28669	9	741	99.597
56	2041.82552	2	743	99.866
55	2005.36435	1	744	100.000
54	1968.90318	0	744	100.000
53	1932.44201	0	744	100.000
52	1895.98084	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2021 CURVE

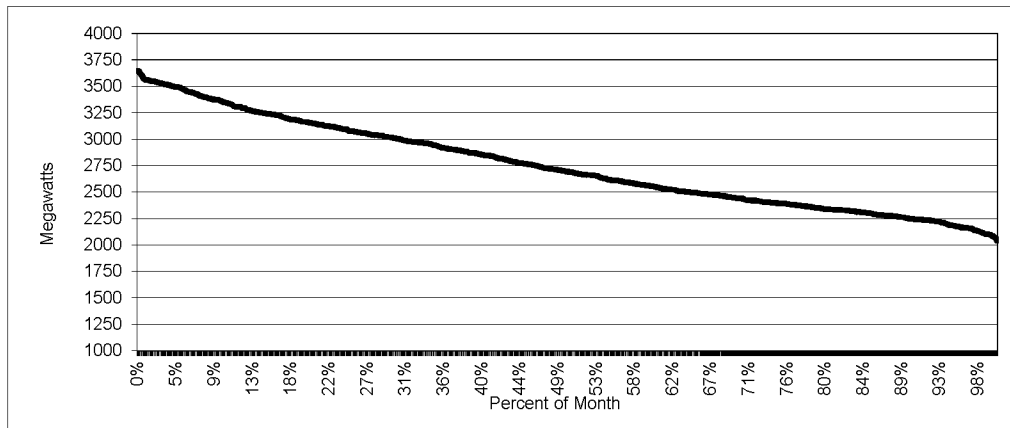

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
AUGUST 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3703.71	1	1	0.134
99	3666.6729	1	2	0.269
98	3629.6358	6	8	1.075
97	3592.5987	9	17	2.285
96	3555.5616	8	25	3.360
95	3518.5245	11	36	4.839
94	3481.4874	17	53	7.124
93	3444.4503	17	70	9.409
92	3407.4132	17	87	11.694
91	3370.3761	15	102	13.710
90	3333.339	23	125	16.801
89	3296.3019	20	145	19.489
88	3259.2648	21	166	22.312
87	3222.2277	29	195	26.210
86	3185.1906	10	205	27.554
85	3148.1535	18	223	29.973
84	3111.1164	18	241	32.392
83	3074.0793	20	261	35.081
82	3037.0422	18	279	37.500
81	3000.0051	14	293	39.382
80	2962.968	15	308	41.398
79	2925.9309	20	328	44.086
78	2888.8938	13	341	45.833
77	2851.8567	23	364	48.925
76	2814.8196	11	375	50.403
75	2777.7825	16	391	52.554
74	2740.7454	16	407	54.704
73	2703.7083	14	421	56.586
72	2666.6712	17	438	58.871
71	2629.6341	12	450	60.484
70	2592.597	20	470	63.172
69	2555.5599	9	479	64.382
68	2518.5228	21	500	67.204
67	2481.4857	29	529	71.102
66	2444.4486	33	562	75.538
65	2407.4115	24	586	78.763
64	2370.3744	28	614	82.527
63	2333.3373	33	647	86.962
62	2296.3002	30	677	90.995
61	2259.2631	24	701	94.220
60	2222.226	18	719	96.640
59	2185.1889	18	737	99.059
58	2148.1518	7	744	100.000
57	2111.1147	0	744	100.000
56	2074.0776	0	744	100.000
55	2037.0405	0	744	100.000
54	2000.0034	0	744	100.000
53	1962.9663	0	744	100.000
52	1925.9292	0	744	100.000
51	1888.8921	0	744	100.000
50	1851.855	0	744	100.000
49	1814.8179	0	744	100.000
48	1777.7808	0	744	100.000
47	1740.7437	0	744	100.000
46	1703.7066	0	744	100.000
45	1666.6695	0	744	100.000
44	1629.6324	0	744	100.000
43	1592.5953	0	744	100.000
42	1555.5582	0	744	100.000
41	1518.5211	0	744	100.000
40	1481.484	0	744	100.000
39	1444.4469	0	744	100.000
38	1407.4098	0	744	100.000
37	1370.3727	0	744	100.000
36	1333.3356	0	744	100.000
35	1296.2985	0	744	100.000
34	1259.2614	0	744	100.000
33	1222.2243	0	744	100.000
32	1185.1872	0	744	100.000
31	1148.1501	0	744	100.000
30	1111.113	0	744	100.000
29	1074.0759	0	744	100.000

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
AUGUST 2021 CURVE

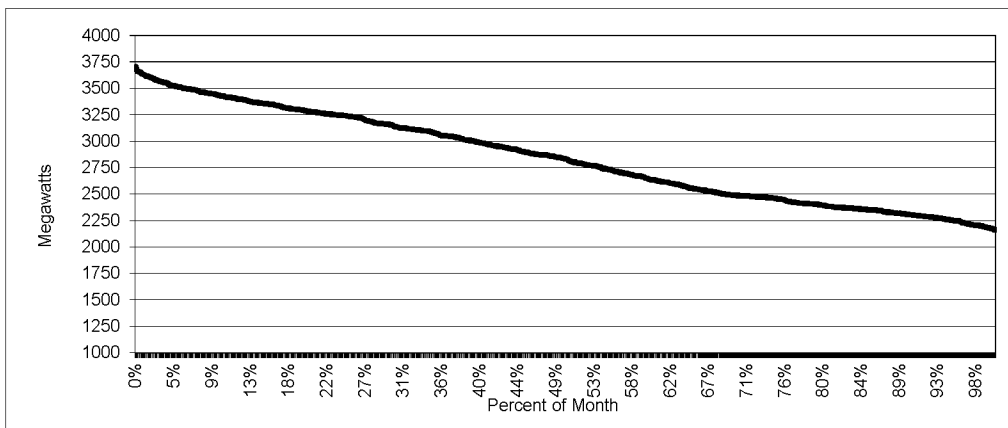

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
SEPTEMBER 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3531.285	1	1	0.142
99	3495.97215	1	2	0.285
98	3460.6593	0	2	0.285
97	3425.34645	4	6	0.855
96	3390.0336	6	12	1.709
95	3354.72075	12	24	3.419
94	3319.4079	7	31	4.416
93	3284.09505	10	41	5.840
92	3248.7822	9	50	7.123
91	3213.46935	8	58	8.262
90	3178.1565	3	61	8.689
89	3142.84365	12	73	10.399
88	3107.5308	3	76	10.826
87	3072.21795	8	84	11.966
86	3036.9051	12	96	13.675
85	3001.59225	9	105	14.957
84	2966.2794	11	116	16.524
83	2930.96655	14	130	18.519
82	2895.6537	9	139	19.801
81	2860.34085	12	151	21.510
80	2825.028	6	157	22.365
79	2789.71515	16	173	24.644
78	2754.4023	11	184	26.211
77	2719.08945	8	192	27.350
76	2683.7766	13	205	29.202
75	2648.46375	20	225	32.051
74	2613.1509	29	254	36.182
73	2577.83805	16	270	38.462
72	2542.5252	14	284	40.456
71	2507.21235	27	311	44.302
70	2471.8995	27	338	48.148
69	2436.58665	25	363	51.709
68	2401.2738	18	381	54.274
67	2365.96095	26	407	57.977
66	2330.6481	29	436	62.108
65	2295.33525	21	457	65.100
64	2260.0224	19	476	67.806
63	2224.70955	16	492	70.085
62	2189.3967	28	520	74.074
61	2154.08385	22	542	77.208
60	2118.771	24	566	80.627
59	2083.45815	21	587	83.618
58	2048.1453	22	609	86.752
57	2012.83245	19	628	89.459
56	1977.5196	19	647	92.165
55	1942.20675	18	665	94.729
54	1906.8939	12	677	96.439
53	1871.58105	9	686	97.721
52	1836.2682	8	694	98.860
51	1800.95535	2	696	99.145
50	1765.6425	6	702	100.000
49	1730.32965	12	714	100.000
48	1695.0168	5	719	100.000
47	1659.70395	1	720	100.000
46	1624.3911	0	720	100.000
45	1589.07825	0	720	100.000
44	1553.7654	0	720	100.000
43	1518.45255	0	720	100.000
42	1483.1397	0	720	100.000
41	1447.82685	0	720	100.000
40	1412.514	0	720	100.000
39	1377.20115	0	720	100.000
38	1341.8883	0	720	100.000
37	1306.57545	0	720	100.000
36	1271.2626	0	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
SEPTEMBER 2021 CURVE



ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
OCTOBER 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3167.62	1	1	0.134
99	3135.9438	2	3	0.403
98	3104.2676	4	7	0.941
97	3072.5914	2	9	1.210
96	3040.9152	3	12	1.613
95	3009.239	3	15	2.016
94	2977.5628	4	19	2.554
93	2945.8866	0	19	2.554
92	2914.2104	5	24	3.226
91	2882.5342	8	32	4.301
90	2850.858	18	50	6.720
89	2819.1818	11	61	8.199
88	2787.5056	13	74	9.946
87	2755.8294	15	89	11.962
86	2724.1532	10	99	13.306
85	2692.477	12	111	14.919
84	2660.8008	11	122	16.398
83	2629.1246	15	137	18.414
82	2597.4484	18	155	20.833
81	2565.7722	16	171	22.984
80	2534.096	15	186	25.000
79	2502.4198	10	196	26.344
78	2470.7436	13	209	28.091
77	2439.0674	12	221	29.704
76	2407.3912	15	236	31.720
75	2375.715	8	244	32.796
74	2344.0388	27	271	36.425
73	2312.3626	22	293	39.382
72	2280.6864	14	307	41.263
71	2249.0102	15	322	43.280
70	2217.334	28	350	47.043
69	2185.6578	18	368	49.462
68	2153.9816	20	388	52.151
67	2122.3054	22	410	55.108
66	2090.6292	30	440	59.140
65	2058.953	35	475	63.844
64	2027.2768	34	509	68.414
63	1995.6006	25	534	71.774
62	1963.9244	33	567	76.210
61	1932.2482	31	598	80.376
60	1900.572	37	635	85.349
59	1868.8958	17	652	87.634
58	1837.2196	14	666	89.516
57	1805.5434	17	683	91.801
56	1773.8672	12	695	93.414
55	1742.191	15	710	95.430
54	1710.5148	12	722	97.043
53	1678.8386	8	730	98.118
52	1647.1624	11	741	99.597
51	1615.4862	2	743	99.866
50	1583.81	1	744	100.000
49	1552.1338	0	744	100.000
48	1520.4576	0	744	100.000
47	1488.7814	0	744	100.000
46	1457.1052	0	744	100.000
45	1425.429	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
OCTOBER 2021 CURVE

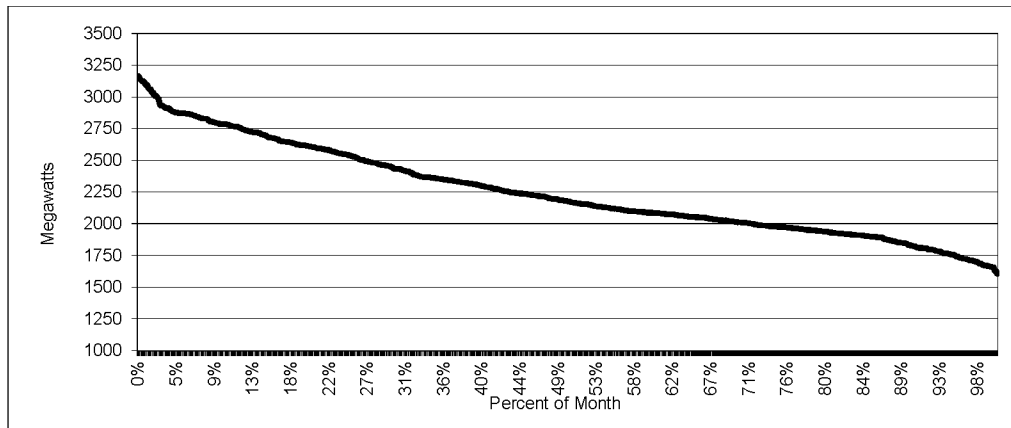

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
NOVEMBER 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2432.306	1	1	0.139
99	2407.98294	2	3	0.417
98	2383.65988	1	4	0.556
97	2359.33682	3	7	0.972
96	2335.01376	1	8	1.111
95	2310.6907	1	9	1.250
94	2286.36764	8	17	2.361
93	2262.04458	9	26	3.611
92	2237.72152	15	41	5.694
91	2213.39846	12	53	7.361
90	2189.0754	13	66	9.167
89	2164.75234	18	84	11.667
88	2140.42928	21	105	14.583
87	2116.10622	39	144	20.000
86	2091.78316	46	190	26.389
85	2067.4601	38	228	31.667
84	2043.13704	64	292	40.556
83	2018.81398	38	330	45.833
82	1994.49092	39	369	51.250
81	1970.16786	58	427	59.306
80	1945.8448	31	458	63.611
79	1921.52174	27	485	67.361
78	1897.19868	27	512	71.111
77	1872.87562	30	542	75.278
76	1848.55256	29	571	79.306
75	1824.2295	20	591	82.083
74	1799.90644	28	619	85.972
73	1775.58338	15	634	88.056
72	1751.26032	18	652	90.556
71	1726.93726	23	675	93.750
70	1702.6142	20	695	96.528
69	1678.29114	15	710	98.611
68	1653.96808	8	718	99.722
67	1629.64502	1	719	99.861
66	1605.32196	0	719	99.861
65	1580.9989	1	720	100.000
64	1556.67584	0	720	100.000
63	1532.35278	0	720	100.000
62	1508.02972	0	720	100.000
61	1483.70666	0	720	100.000
60	1459.3836	0	720	100.000
59	1435.06054	0	720	100.000
58	1410.73748	0	720	100.000
57	1386.41442	0	720	100.000
56	1362.09136	0	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
NOVEMBER 2021 CURVE

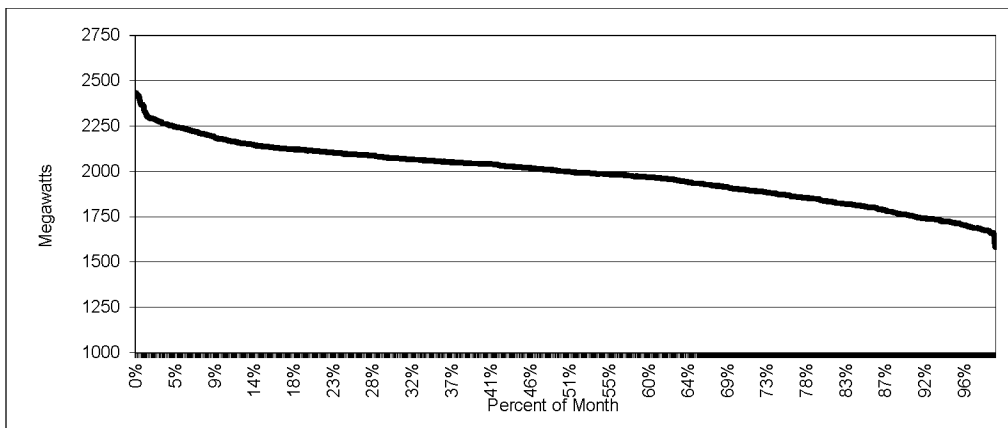

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
DECEMBER 2021 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2577.14	1	1	0.134
99	2551.3686	3	4	0.538
98	2525.5972	7	11	1.478
97	2499.8258	11	22	2.957
96	2474.0544	7	29	3.898
95	2448.283	12	41	5.511
94	2422.5116	19	60	8.065
93	2396.7402	14	74	9.946
92	2370.9688	21	95	12.769
91	2345.1974	19	114	15.323
90	2319.426	15	129	17.339
89	2293.6546	17	146	19.624
88	2267.8832	15	161	21.640
87	2242.1118	28	189	25.403
86	2216.3404	32	221	29.704
85	2190.569	47	268	36.022
84	2164.7976	47	315	42.339
83	2139.0262	33	348	46.774
82	2113.2548	38	386	51.882
81	2087.4834	25	411	55.242
80	2061.712	36	447	60.081
79	2035.9406	34	481	64.651
78	2010.1692	33	514	69.086
77	1984.3978	32	546	73.387
76	1958.6264	29	575	77.285
75	1932.855	24	599	80.511
74	1907.0836	17	616	82.796
73	1881.3122	22	638	85.753
72	1855.5408	28	666	89.516
71	1829.7694	14	680	91.398
70	1803.998	9	689	92.608
69	1778.2266	14	703	94.489
68	1752.4552	9	712	95.699
67	1726.6838	12	724	97.312
66	1700.9124	13	737	99.059
65	1675.141	7	744	100.000
64	1649.3696	0	744	100.000
63	1623.5982	0	744	100.000
62	1597.8268	0	744	100.000
61	1572.0554	0	744	100.000
60	1546.284	0	744	100.000
59	1520.5126	0	744	100.000
58	1494.7412	0	744	100.000
57	1468.9698	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
DECEMBER 2021 CURVE

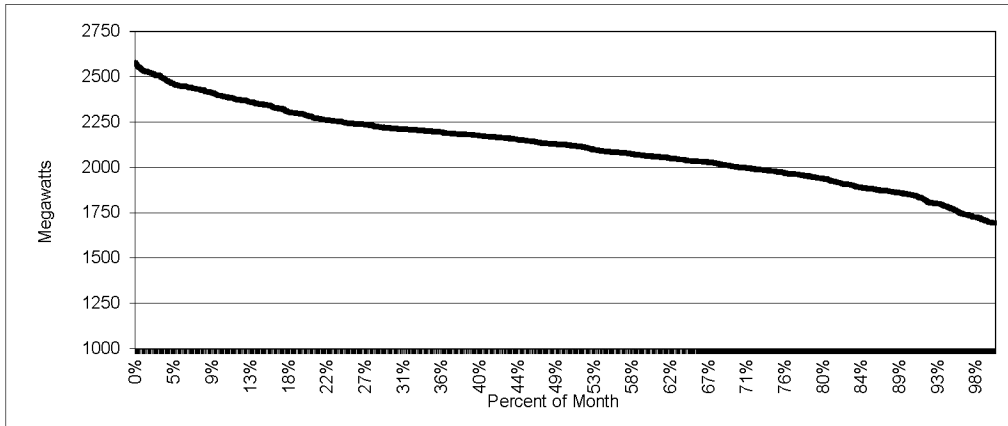

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2662.009	1	1	0.134
99	2635.38891	0	1	0.134
98	2608.76882	0	1	0.134
97	2582.14873	3	4	0.538
96	2555.52864	1	5	0.672
95	2528.90855	5	10	1.344
94	2502.28846	3	13	1.747
93	2475.66837	4	17	2.285
92	2449.04828	5	22	2.957
91	2422.42819	0	22	2.957
90	2395.8081	7	29	3.898
89	2369.18801	6	35	4.704
88	2342.56792	6	41	5.511
87	2315.94783	4	45	6.048
86	2289.32774	10	55	7.392
85	2262.70765	7	62	8.333
84	2236.08756	14	76	10.215
83	2209.46747	14	90	12.097
82	2182.84738	16	106	14.247
81	2156.22729	28	134	18.011
80	2129.6072	28	162	21.774
79	2102.98711	36	198	26.613
78	2076.36702	45	243	32.661
77	2049.74693	36	279	37.500
76	2023.12684	47	326	43.817
75	1996.50675	55	381	51.210
74	1969.88666	61	442	59.409
73	1943.26657	43	485	65.188
72	1916.64648	49	534	71.774
71	1890.02639	42	576	77.419
70	1863.4063	22	598	80.376
69	1836.78621	22	620	83.333
68	1810.16612	20	640	86.022
67	1783.54603	8	648	87.097
66	1756.92594	16	664	89.247
65	1730.30585	16	680	91.398
64	1703.68576	17	697	93.683
63	1677.06567	10	707	95.027
62	1650.44558	13	720	96.774
61	1623.82549	10	730	98.118
60	1597.2054	7	737	99.059
59	1570.58531	5	742	99.731
58	1543.96522	2	744	100.000
57	1517.34513	0	744	100.000
56	1490.72504	0	744	100.000
55	1464.10495	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2020 CURVE

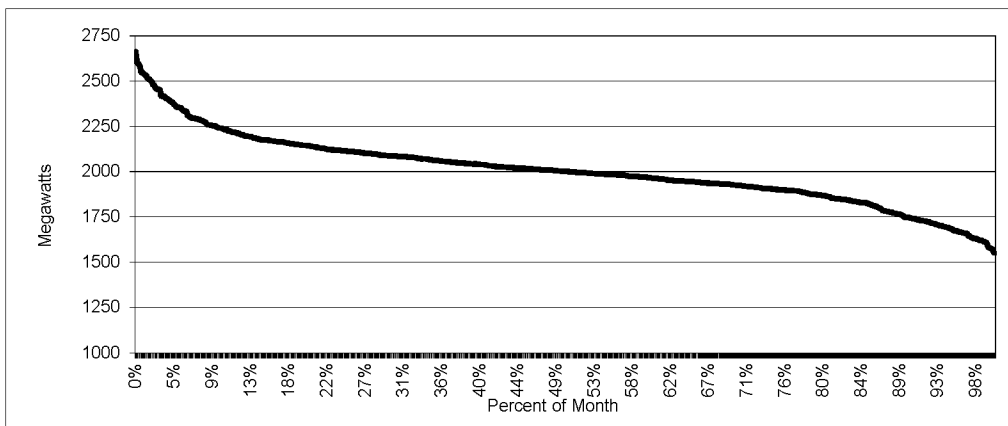

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2780.903	1	1	0.144
99	2753.09397	1	2	0.287
98	2725.28494	2	4	0.575
97	2697.47591	0	4	0.575
96	2669.66688	1	5	0.718
95	2641.85785	3	8	1.149
94	2614.04882	3	11	1.580
93	2586.23979	5	16	2.299
92	2558.43076	1	17	2.443
91	2530.62173	7	24	3.448
90	2502.8127	4	28	4.023
89	2475.00367	7	35	5.029
88	2447.19464	4	39	5.603
87	2419.38561	7	46	6.609
86	2391.57658	12	58	8.333
85	2363.76755	13	71	10.201
84	2335.95852	11	82	11.782
83	2308.14949	15	97	13.937
82	2280.34046	10	107	15.374
81	2252.53143	17	124	17.816
80	2224.7224	13	137	19.684
79	2196.91337	12	149	21.408
78	2169.10434	22	171	24.569
77	2141.29531	19	190	27.299
76	2113.48628	37	227	32.615
75	2085.67725	32	259	37.213
74	2057.86822	35	294	42.241
73	2030.05919	38	332	47.701
72	2002.25016	36	368	52.874
71	1974.44113	32	400	57.471
70	1946.6321	32	432	62.069
69	1918.82307	41	473	67.960
68	1891.01404	38	511	73.420
67	1863.20501	30	541	77.730
66	1835.39598	34	575	82.615
65	1807.58695	15	590	84.770
64	1779.77792	20	610	87.644
63	1751.96889	17	627	90.086
62	1724.15986	15	642	92.241
61	1696.35083	13	655	94.109
60	1668.5418	12	667	95.833
59	1640.73277	14	681	97.845
58	1612.92374	11	692	99.425
57	1585.11471	4	696	100.000
56	1557.30568	0	696	100.000
55	1529.49665	0	696	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2020 CURVE

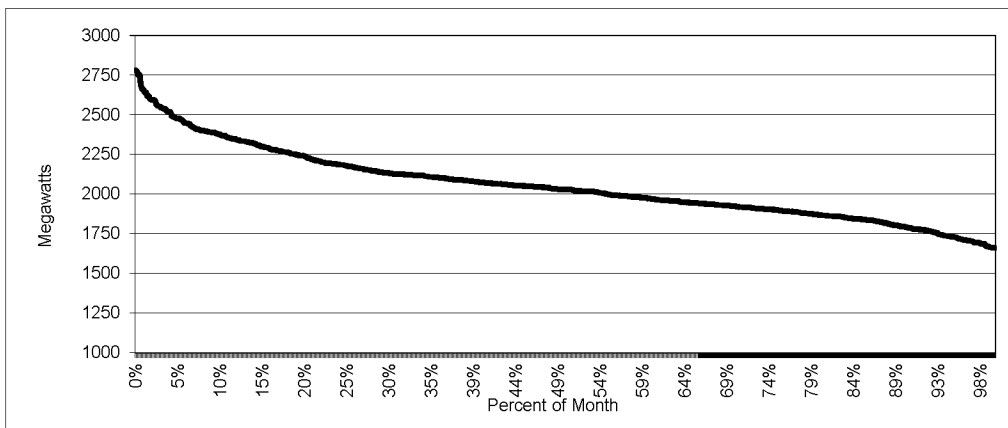

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2848.133	1	1	0.158
99	2819.65167	3	4	0.632
98	2791.17034	1	5	0.790
97	2762.68901	1	6	0.948
96	2734.20768	3	9	1.422
95	2705.72635	2	11	1.738
94	2677.24502	1	12	1.896
93	2648.76369	3	15	2.370
92	2620.28236	2	17	2.686
91	2591.80103	0	17	2.686
90	2563.3197	3	20	3.160
89	2534.83837	3	23	3.633
88	2506.35704	3	26	4.107
87	2477.87571	7	33	5.213
86	2449.39438	4	37	5.845
85	2420.91305	3	40	6.319
84	2392.43172	12	52	8.215
83	2363.95039	14	66	10.427
82	2335.46906	11	77	12.164
81	2306.98773	12	89	14.060
80	2278.5064	20	109	17.220
79	2250.02507	16	125	19.747
78	2221.54374	14	139	21.959
77	2193.06241	28	167	26.382
76	2164.58108	18	185	29.226
75	2136.09975	27	212	33.491
74	2107.61842	27	239	37.757
73	2079.13709	30	269	42.496
72	2050.65576	34	303	47.867
71	2022.17443	27	330	52.133
70	1993.6931	36	366	57.820
69	1965.21177	46	412	65.087
68	1936.73044	43	455	71.880
67	1908.24911	37	492	77.725
66	1879.76778	38	530	83.728
65	1851.28645	27	557	87.994
64	1822.80512	34	591	93.365
63	1794.32379	21	612	96.682
62	1765.84246	21	633	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2020 CURVE

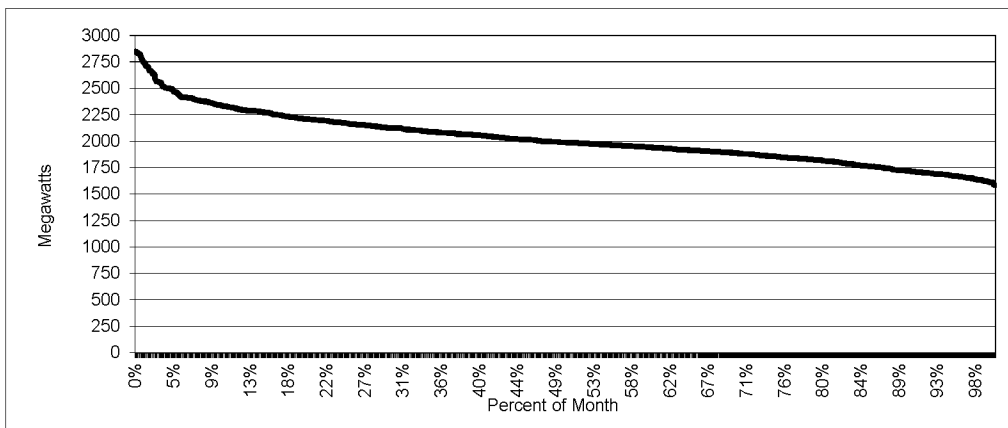

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2797.078	1	1	0.139
99	2769.10722	1	2	0.278
98	2741.13644	1	3	0.417
97	2713.16566	2	5	0.694
96	2685.19488	0	5	0.694
95	2657.2241	4	9	1.250
94	2629.25332	4	13	1.806
93	2601.28254	6	19	2.639
92	2573.31176	5	24	3.333
91	2545.34098	5	29	4.028
90	2517.3702	8	37	5.139
89	2489.39942	5	42	5.833
88	2461.42864	10	52	7.222
87	2433.45786	7	59	8.194
86	2405.48708	9	68	9.444
85	2377.5163	12	80	11.111
84	2349.54552	8	88	12.222
83	2321.57474	11	99	13.750
82	2293.60396	12	111	15.417
81	2265.63318	9	120	16.667
80	2237.6624	12	132	18.333
79	2209.69162	21	153	21.250
78	2181.72084	9	162	22.500
77	2153.75006	15	177	24.583
76	2125.77928	21	198	27.500
75	2097.8085	29	227	31.528
74	2069.83772	19	246	34.167
73	2041.86694	30	276	38.333
72	2013.89616	23	299	41.528
71	1985.92538	25	324	45.000
70	1957.9546	43	367	50.972
69	1929.98382	36	403	55.972
68	1902.01304	31	434	60.278
67	1874.04226	34	468	65.000
66	1846.07148	29	497	69.028
65	1818.1007	26	523	72.639
64	1790.12992	24	547	75.972
63	1762.15914	20	567	78.750
62	1734.18836	23	590	81.944
61	1706.21758	24	614	85.278
60	1678.2468	32	646	89.722
59	1650.27602	32	678	94.167
58	1622.30524	23	701	97.361
57	1594.33446	15	716	99.444
56	1566.36368	4	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2020 CURVE

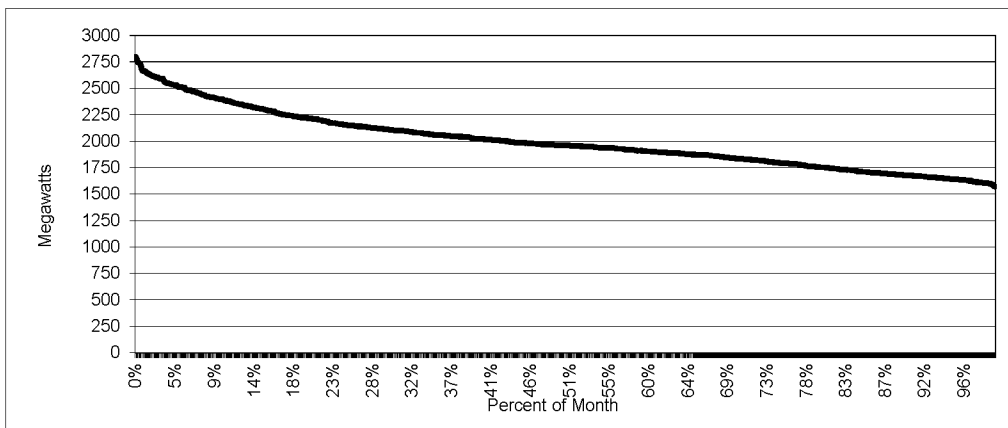

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3149.699	1	1	0.143
99	3118.20201	4	5	0.713
98	3086.70502	3	8	1.141
97	3055.20803	0	8	1.141
96	3023.71104	3	11	1.569
95	2992.21405	1	12	1.712
94	2960.71706	3	15	2.140
93	2929.22007	6	21	2.996
92	2897.72308	7	28	3.994
91	2866.22609	6	34	4.850
90	2834.7291	8	42	5.991
89	2803.23211	5	47	6.705
88	2771.73512	6	53	7.561
87	2740.23813	6	59	8.417
86	2708.74114	8	67	9.558
85	2677.24415	12	79	11.270
84	2645.74716	11	90	12.839
83	2614.25017	11	101	14.408
82	2582.75318	14	115	16.405
81	2551.25619	17	132	18.830
80	2519.7592	12	144	20.542
79	2488.26221	23	167	23.823
78	2456.76522	14	181	25.820
77	2425.26823	21	202	28.816
76	2393.77124	19	221	31.526
75	2362.27425	15	236	33.666
74	2330.77726	16	252	35.949
73	2299.28027	20	272	38.802
72	2267.78328	24	296	42.225
71	2236.28629	16	312	44.508
70	2204.7893	19	331	47.218
69	2173.29231	19	350	49.929
68	2141.79532	22	372	53.067
67	2110.29833	14	386	55.064
66	2078.80134	21	407	58.060
65	2047.30435	17	424	60.485
64	2015.80736	21	445	63.481
63	1984.31037	18	463	66.049
62	1952.81338	27	490	69.900
61	1921.31639	29	519	74.037
60	1889.8194	29	548	78.174
59	1858.32241	21	569	81.170
58	1826.82542	16	585	83.452
57	1795.32843	25	610	87.019
56	1763.83144	28	638	91.013
55	1732.33445	24	662	94.437
54	1700.83746	16	678	96.719
53	1669.34047	23	701	100.000
52	1637.84348	15	716	100.000
51	1606.34649	13	729	100.000

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2020 CURVE

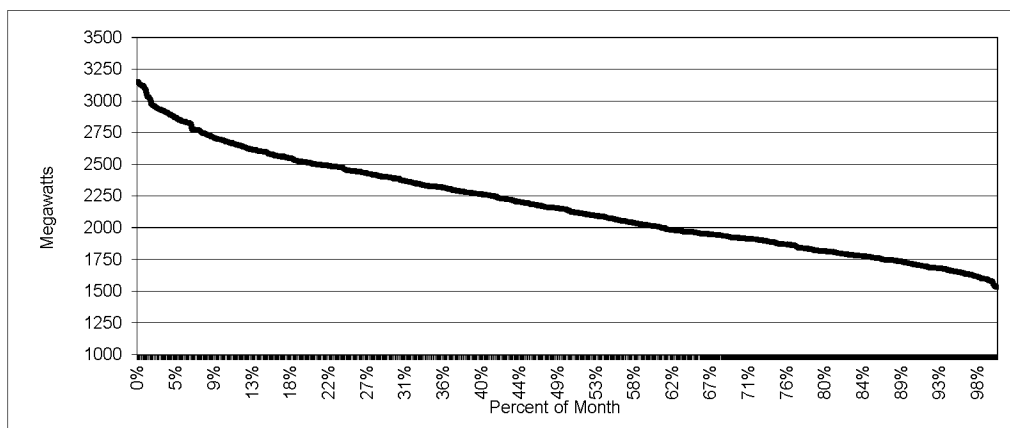

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3461.326	1	1	0.142
99	3426.71274	1	2	0.284
98	3392.09948	1	3	0.426
97	3357.48622	1	4	0.567
96	3322.87296	0	4	0.567
95	3288.2597	3	7	0.993
94	3253.64644	0	7	0.993
93	3219.03318	6	13	1.844
92	3184.41992	9	22	3.121
91	3149.80666	11	33	4.681
90	3115.1934	8	41	5.816
89	3080.58014	14	55	7.801
88	3045.96688	13	68	9.645
87	3011.35362	18	86	12.199
86	2976.74036	23	109	15.461
85	2942.1271	20	129	18.298
84	2907.51384	18	147	20.851
83	2872.90058	17	164	23.262
82	2838.28732	17	181	25.674
81	2803.67406	12	193	27.376
80	2769.0608	16	209	29.645
79	2734.44754	19	228	32.340
78	2699.83428	13	241	34.184
77	2665.22102	16	257	36.454
76	2630.60776	19	276	39.149
75	2595.9945	20	296	41.986
74	2561.38124	18	314	44.539
73	2526.76798	16	330	46.809
72	2492.15472	15	345	48.936
71	2457.54146	17	362	51.348
70	2422.9282	18	380	53.901
69	2388.31494	16	396	56.170
68	2353.70168	19	415	58.865
67	2319.08842	25	440	62.411
66	2284.47516	18	458	64.965
65	2249.8619	17	475	67.376
64	2215.24864	21	496	70.355
63	2180.63538	15	511	72.482
62	2146.02212	19	530	75.177
61	2111.40886	23	553	78.440
60	2076.7956	23	576	81.702
59	2042.18234	21	597	84.681
58	2007.56908	32	629	89.220
57	1972.95582	16	645	91.489
56	1938.34256	15	660	93.617
55	1903.7293	15	675	95.745
54	1869.11604	18	693	98.298
53	1834.50278	12	705	100.000
52	1799.88952	10	715	100.000
51	1765.27626	4	719	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2020 CURVE



ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3614.302	1	1	0.136
99	3578.15898	0	1	0.136
98	3542.01596	4	5	0.678
97	3505.87294	6	11	1.493
96	3469.72992	2	13	1.764
95	3433.5869	12	25	3.392
94	3397.44388	13	38	5.156
93	3361.30086	12	50	6.784
92	3325.15784	13	63	8.548
91	3289.01482	13	76	10.312
90	3252.8718	13	89	12.076
89	3216.72878	16	105	14.247
88	3180.58576	7	112	15.197
87	3144.44274	21	133	18.046
86	3108.29972	24	157	21.303
85	3072.1567	19	176	23.881
84	3036.01368	16	192	26.052
83	2999.87066	21	213	28.901
82	2963.72764	15	228	30.936
81	2927.58462	17	245	33.243
80	2891.4416	13	258	35.007
79	2855.29858	23	281	38.128
78	2819.15556	14	295	40.027
77	2783.01254	18	313	42.469
76	2746.86952	20	333	45.183
75	2710.7265	17	350	47.490
74	2674.58348	16	366	49.661
73	2638.44046	15	381	51.696
72	2602.29744	20	401	54.410
71	2566.15442	21	422	57.259
70	2530.0114	17	439	59.566
69	2493.86838	15	454	61.601
68	2457.72536	18	472	64.043
67	2421.58234	16	488	66.214
66	2385.43932	30	518	70.285
65	2349.2963	29	547	74.220
64	2313.15328	29	576	78.155
63	2277.01026	31	607	82.361
62	2240.86724	30	637	86.431
61	2204.72422	28	665	90.231
60	2168.5812	21	686	93.080
59	2132.43818	19	705	95.658
58	2096.29516	14	719	97.558
57	2060.15214	14	733	99.457
56	2024.00912	4	737	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2020 CURVE

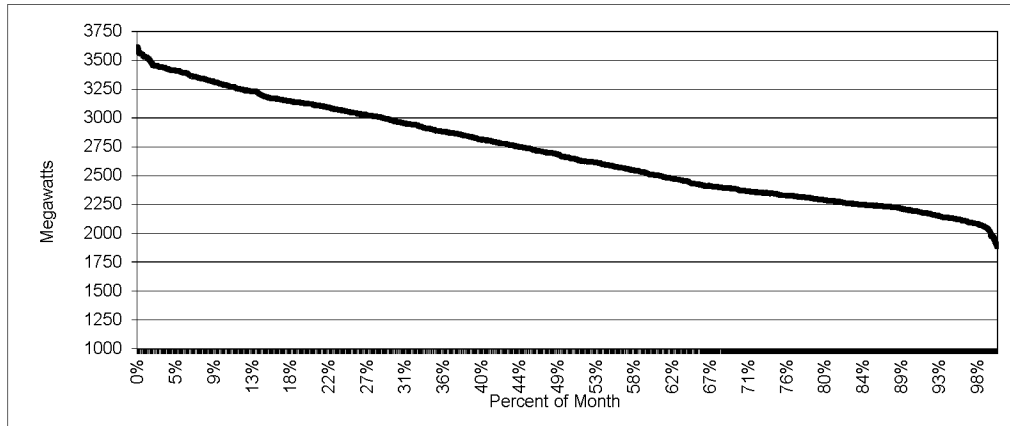

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
AUGUST 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3708.061	1	1	0.153
99	3670.98039	4	5	0.763
98	3633.89978	6	11	1.679
97	3596.81917	5	16	2.443
96	3559.73856	10	26	3.969
95	3522.65795	7	33	5.038
94	3485.57734	7	40	6.107
93	3448.49673	12	52	7.939
92	3411.41612	9	61	9.313
91	3374.33551	11	72	10.992
90	3337.2549	14	86	13.130
89	3300.17429	12	98	14.962
88	3263.09368	13	111	16.947
87	3226.01307	11	122	18.626
86	3188.93246	14	136	20.763
85	3151.85185	20	156	23.817
84	3114.77124	13	169	25.802
83	3077.69063	9	178	27.176
82	3040.61002	14	192	29.313
81	3003.52941	11	203	30.992
80	2966.4488	16	219	33.435
79	2929.36819	9	228	34.809
78	2892.28758	13	241	36.794
77	2855.20697	6	247	37.710
76	2818.12636	16	263	40.153
75	2781.04575	13	276	42.137
74	2743.96514	15	291	44.427
73	2706.88453	10	301	45.954
72	2669.80392	9	310	47.328
71	2632.72331	16	326	49.771
70	2595.6427	14	340	51.908
69	2558.56209	23	363	55.420
68	2521.48148	15	378	57.710
67	2484.40087	13	391	59.695
66	2447.32026	16	407	62.137
65	2410.23965	17	424	64.733
64	2373.15904	26	450	68.702
63	2336.07843	23	473	72.214
62	2298.99782	27	500	76.336
61	2261.91721	18	518	79.084
60	2224.8366	20	538	82.137
59	2187.75599	29	567	86.565
58	2150.67538	17	584	89.160
57	2113.59477	21	605	92.366
56	2076.51416	18	623	95.115
55	2039.43355	16	639	97.557
54	2002.35294	3	642	98.015
53	1965.27233	6	648	98.931
52	1928.19172	7	655	100.000
51	1891.11111	5	660	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
AUGUST 2020 CURVE

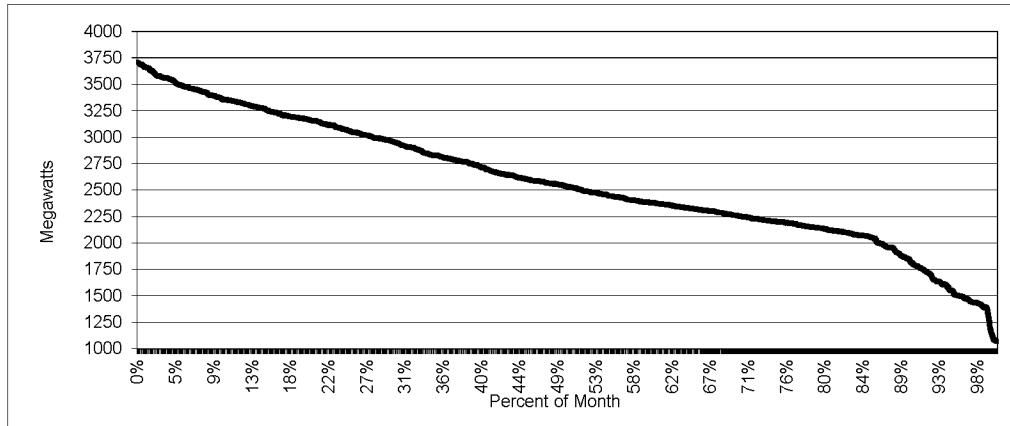

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
SEPTEMBER 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3293.762	1	1	0.141
99	3260.82438	1	2	0.282
98	3227.88676	1	3	0.423
97	3194.94914	4	7	0.986
96	3162.01152	1	8	1.127
95	3129.0739	1	9	1.268
94	3096.13628	1	10	1.408
93	3063.19866	0	10	1.408
92	3030.26104	2	12	1.690
91	2997.32342	8	20	2.817
90	2964.3858	5	25	3.521
89	2931.44818	8	33	4.648
88	2898.51056	8	41	5.775
87	2865.57294	15	56	7.887
86	2832.63532	10	66	9.296
85	2799.6977	7	73	10.282
84	2766.76008	12	85	11.972
83	2733.82246	11	96	13.521
82	2700.88484	12	108	15.211
81	2667.94722	14	122	17.183
80	2635.0096	14	136	19.155
79	2602.07198	16	152	21.408
78	2569.13436	13	165	23.239
77	2536.19674	16	181	25.493
76	2503.25912	16	197	27.746
75	2470.3215	8	205	28.873
74	2437.38388	18	223	31.408
73	2404.44626	9	232	32.676
72	2371.50864	13	245	34.507
71	2338.57102	23	268	37.746
70	2305.6334	21	289	40.704
69	2272.69578	16	305	42.958
68	2239.75816	18	323	45.493
67	2206.82054	24	347	48.873
66	2173.88292	28	375	52.817
65	2140.9453	27	402	56.620
64	2108.00768	31	433	60.986
63	2075.07006	23	456	64.225
62	2042.13244	28	484	68.169
61	2009.19482	25	509	71.690
60	1976.2572	22	531	74.789
59	1943.31958	24	555	78.169
58	1910.38196	21	576	81.127
57	1877.44434	32	608	85.634
56	1844.50672	24	632	89.014
55	1811.5691	26	658	92.676
54	1778.63148	18	676	95.211
53	1745.69386	18	694	97.746
52	1712.75624	8	702	98.873
51	1679.81862	7	709	99.859
50	1646.881	1	710	100.000
49	1613.94338	1	711	100.000
48	1581.00576	2	713	100.000
47	1548.06814	3	716	100.000
46	1515.13052	1	717	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
SEPTEMBER 2020 CURVE

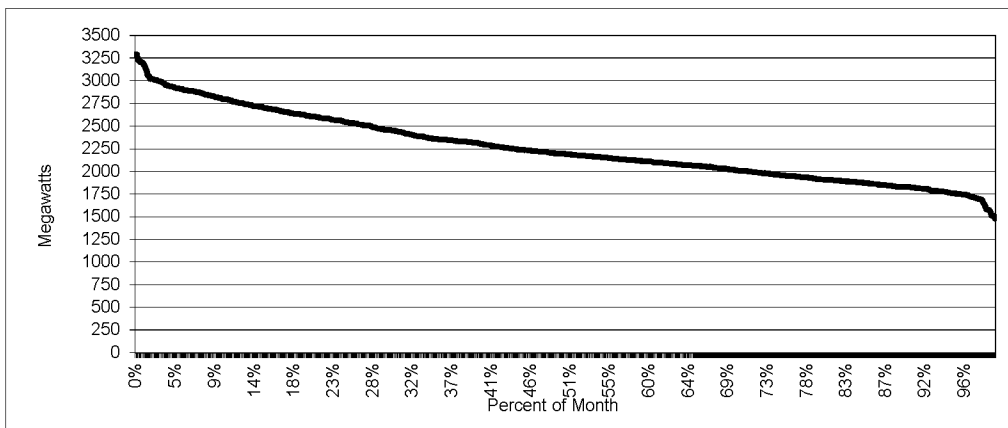

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
OCTOBER 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2956.902	1	1	0.136
99	2927.33298	1	2	0.271
98	2897.76396	3	5	0.678
97	2868.19494	0	5	0.678
96	2838.62592	4	9	1.221
95	2809.0569	1	10	1.357
94	2779.48788	6	16	2.171
93	2749.91886	3	19	2.578
92	2720.34984	13	32	4.342
91	2690.78082	2	34	4.613
90	2661.2118	8	42	5.699
89	2631.64278	5	47	6.377
88	2602.07376	12	59	8.005
87	2572.50474	7	66	8.955
86	2542.93572	10	76	10.312
85	2513.3667	11	87	11.805
84	2483.79768	13	100	13.569
83	2454.22866	11	111	15.061
82	2424.65964	14	125	16.961
81	2395.09062	10	135	18.318
80	2365.5216	16	151	20.488
79	2335.95258	12	163	22.117
78	2306.38356	13	176	23.881
77	2276.81454	7	183	24.830
76	2247.24552	17	200	27.137
75	2217.6765	16	216	29.308
74	2188.10748	26	242	32.836
73	2158.53846	23	265	35.957
72	2128.96944	20	285	38.670
71	2099.40042	21	306	41.520
70	2069.8314	20	326	44.233
69	2040.26238	30	356	48.304
68	2010.69336	33	389	52.782
67	1981.12434	25	414	56.174
66	1951.55532	40	454	61.601
65	1921.9863	20	474	64.315
64	1892.41728	29	503	68.250
63	1862.84826	29	532	72.185
62	1833.27924	29	561	76.119
61	1803.71022	27	588	79.783
60	1774.1412	22	610	82.768
59	1744.57218	24	634	86.024
58	1715.00316	20	654	88.738
57	1685.43414	22	676	91.723
56	1655.86512	15	691	93.758
55	1626.2961	16	707	95.929
54	1596.72708	17	724	98.236
53	1567.15806	5	729	98.915
52	1537.58904	4	733	99.457
51	1508.02002	0	733	99.457
50	1478.451	2	735	99.729
49	1448.88198	0	735	99.729
48	1419.31296	1	736	99.864
47	1389.74394	1	737	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
OCTOBER 2020 CURVE

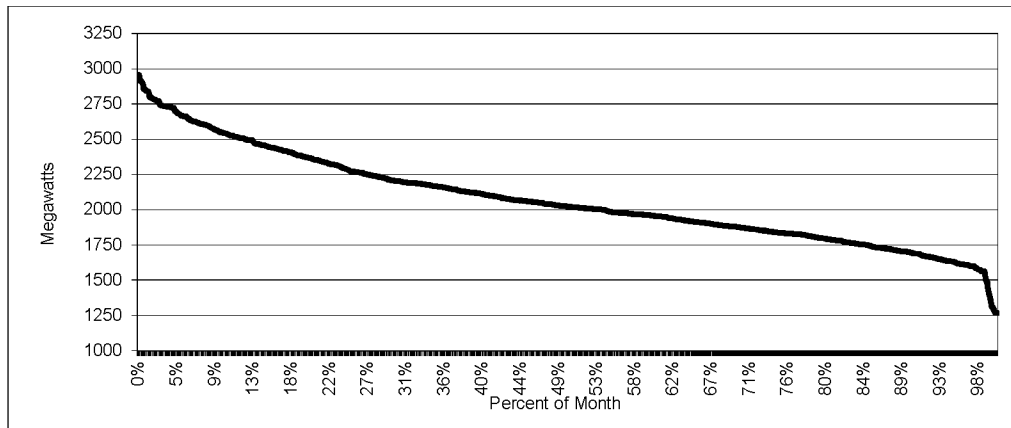

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
NOVEMBER 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2639.879	1	1	0.139
99	2613.48021	2	3	0.417
98	2587.08142	2	5	0.694
97	2560.68263	4	9	1.250
96	2534.28384	6	15	2.083
95	2507.88505	8	23	3.194
94	2481.48626	4	27	3.750
93	2455.08747	8	35	4.861
92	2428.68868	4	39	5.417
91	2402.28989	10	49	6.806
90	2375.8911	5	54	7.500
89	2349.49231	9	63	8.750
88	2323.09352	6	69	9.583
87	2296.69473	15	84	11.667
86	2270.29594	13	97	13.472
85	2243.89715	14	111	15.417
84	2217.49836	22	133	18.472
83	2191.09957	32	165	22.917
82	2164.70078	26	191	26.528
81	2138.30199	44	235	32.639
80	2111.9032	36	271	37.639
79	2085.50441	41	312	43.333
78	2059.10562	44	356	49.444
77	2032.70683	32	388	53.889
76	2006.30804	35	423	58.750
75	1979.90925	29	452	62.778
74	1953.51046	24	476	66.111
73	1927.11167	20	496	68.889
72	1900.71288	24	520	72.222
71	1874.31409	29	549	76.250
70	1847.9153	23	572	79.444
69	1821.51651	22	594	82.500
68	1795.11772	30	624	86.667
67	1768.71893	25	649	90.139
66	1742.32014	33	682	94.722
65	1715.92135	18	700	97.222
64	1689.52256	14	714	99.167
63	1663.12377	5	719	99.861
62	1636.72498	1	720	100.000
61	1610.32619	0	720	100.000
60	1583.9274	0	720	100.000
59	1557.52861	0	720	100.000
58	1531.12982	0	720	100.000
57	1504.73103	0	720	100.000
56	1478.33224	0	720	100.000
55	1451.93345	0	720	100.000
54	1425.53466	0	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
NOVEMBER 2020 CURVE

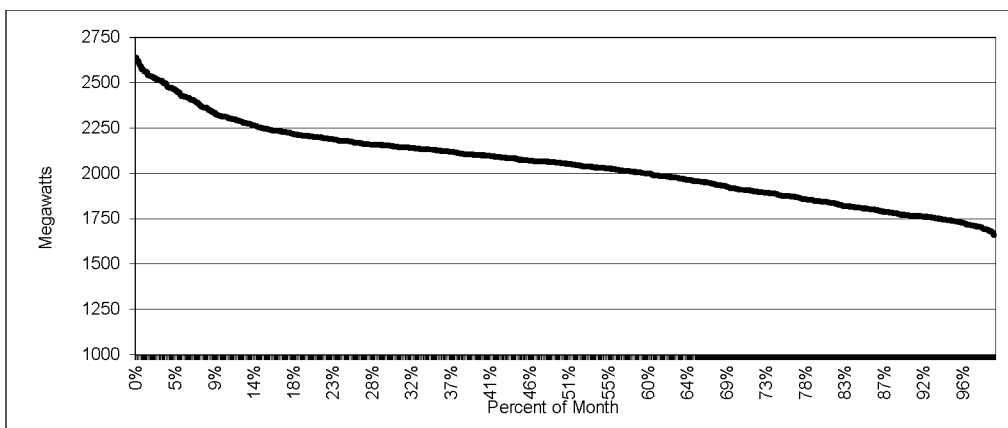

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
DECEMBER 2020 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3017.01	1	1	0.135
99	2986.8399	2	3	0.404
98	2956.6698	0	3	0.404
97	2926.4997	0	3	0.404
96	2896.3296	0	3	0.404
95	2866.1595	1	4	0.538
94	2835.9894	1	5	0.673
93	2805.8193	2	7	0.942
92	2775.6492	3	10	1.346
91	2745.4791	0	10	1.346
90	2715.309	3	13	1.750
89	2685.1389	4	17	2.288
88	2654.9688	6	23	3.096
87	2624.7987	2	25	3.365
86	2594.6286	12	37	4.980
85	2564.4585	12	49	6.595
84	2534.2884	19	68	9.152
83	2504.1183	10	78	10.498
82	2473.9482	8	86	11.575
81	2443.7781	16	102	13.728
80	2413.608	21	123	16.555
79	2383.4379	17	140	18.843
78	2353.2678	15	155	20.861
77	2323.0977	22	177	23.822
76	2292.9276	14	191	25.707
75	2262.7575	30	221	29.744
74	2232.5874	24	245	32.974
73	2202.4173	41	286	38.493
72	2172.2472	36	322	43.338
71	2142.0771	24	346	46.568
70	2111.907	55	401	53.970
69	2081.7369	54	455	61.238
68	2051.5668	45	500	67.295
67	2021.3967	41	541	72.813
66	1991.2266	41	582	78.331
65	1961.0565	31	613	82.503
64	1930.8864	31	644	86.676
63	1900.7163	20	664	89.367
62	1870.5462	15	679	91.386
61	1840.3761	21	700	94.213
60	1810.206	7	707	95.155
59	1780.0359	8	715	96.231
58	1749.8658	13	728	97.981
57	1719.6957	6	734	98.789
56	1689.5256	6	740	99.596
55	1659.3555	3	743	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
DECEMBER 2020 CURVE

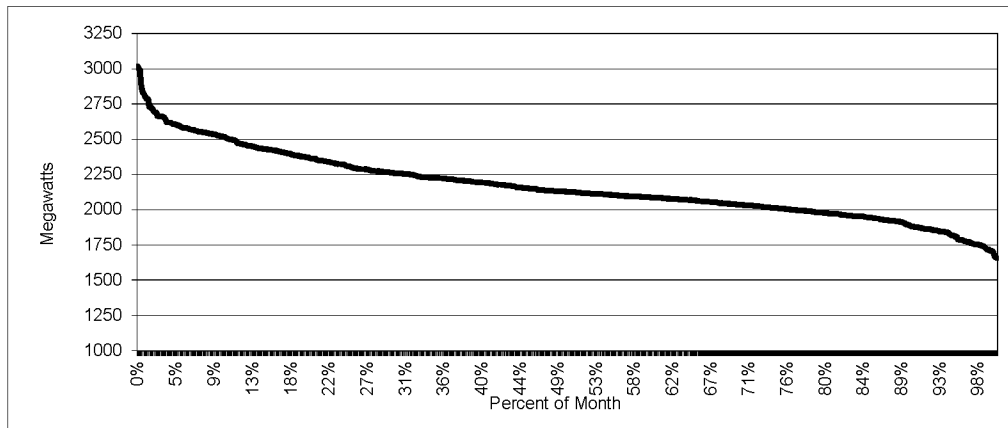

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2870.29	1	1	0.134
99	2841.5871	1	2	0.269
98	2812.8842	0	2	0.269
97	2784.1813	0	2	0.269
96	2755.4784	0	2	0.269
95	2726.7755	1	3	0.403
94	2698.0726	0	3	0.403
93	2669.3697	3	6	0.806
92	2640.6668	2	8	1.075
91	2611.9639	3	11	1.478
90	2583.261	10	21	2.823
89	2554.5581	10	31	4.167
88	2525.8552	8	39	5.242
87	2497.1523	6	45	6.048
86	2468.4494	7	52	6.989
85	2439.7465	12	64	8.602
84	2411.0436	24	88	11.828
83	2382.3407	8	96	12.903
82	2353.6378	10	106	14.247
81	2324.9349	16	122	16.398
80	2296.232	14	136	18.280
79	2267.5291	22	158	21.237
78	2238.8262	34	192	25.806
77	2210.1233	26	218	29.301
76	2181.4204	29	247	33.199
75	2152.7175	31	278	37.366
74	2124.0146	28	306	41.129
73	2095.3117	22	328	44.086
72	2066.6088	39	367	49.328
71	2037.9059	28	395	53.091
70	2009.203	41	436	58.602
69	1980.5001	55	491	65.995
68	1951.7972	41	532	71.505
67	1923.0943	39	571	76.747
66	1894.3914	39	610	81.989
65	1865.6885	31	641	86.156
64	1836.9856	15	656	88.172
63	1808.2827	24	680	91.398
62	1779.5798	9	689	92.608
61	1750.8769	14	703	94.489
60	1722.174	11	714	95.968
59	1693.4711	9	723	97.177
58	1664.7682	6	729	97.984
57	1636.0653	4	733	98.522
56	1607.3624	10	743	99.866
55	1578.6595	1	744	100.000
54	1549.9566	0	744	100.000
53	1521.2537	0	744	100.000
52	1492.5508	0	744	100.000
51	1463.8479	0	744	100.000
50	1435.145	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2019 CURVE

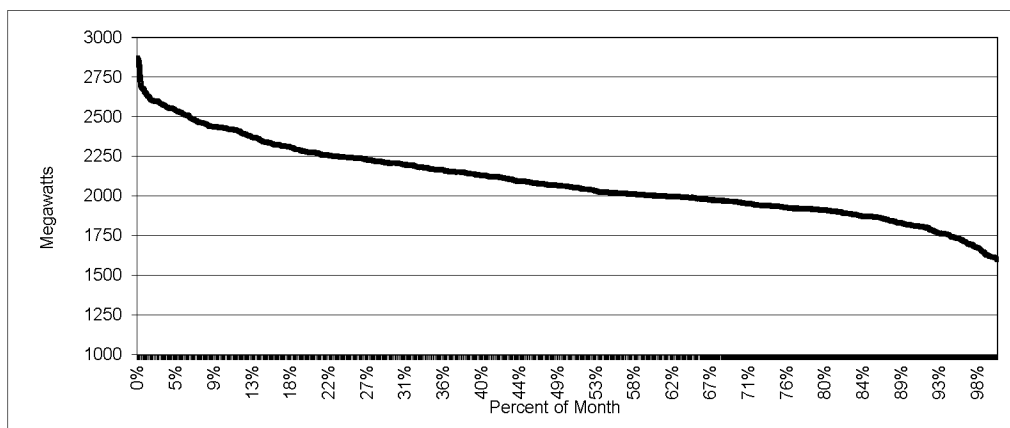

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2672.728	1	1	0.149
99	2646.00072	1	2	0.298
98	2619.27344	1	3	0.446
97	2592.54616	0	3	0.446
96	2565.81888	1	4	0.595
95	2539.0916	2	6	0.893
94	2512.36432	2	8	1.190
93	2485.63704	4	12	1.786
92	2458.90976	5	17	2.530
91	2432.18248	3	20	2.976
90	2405.4552	4	24	3.571
89	2378.72792	1	25	3.720
88	2352.00064	5	30	4.464
87	2325.27336	1	31	4.613
86	2298.54608	6	37	5.506
85	2271.8188	7	44	6.548
84	2245.09152	6	50	7.440
83	2218.36424	10	60	8.929
82	2191.63696	7	67	9.970
81	2164.90968	8	75	11.161
80	2138.1824	6	81	12.054
79	2111.45512	8	89	13.244
78	2084.72784	9	98	14.583
77	2058.00056	12	110	16.369
76	2031.27328	19	129	19.196
75	2004.546	25	154	22.917
74	1977.81872	27	181	26.935
73	1951.09144	32	213	31.696
72	1924.36416	30	243	36.161
71	1897.63688	34	277	41.220
70	1870.9096	48	325	48.363
69	1844.18232	45	370	55.060
68	1817.45504	31	401	59.673
67	1790.72776	29	430	63.988
66	1764.00048	42	472	70.238
65	1737.2732	28	500	74.405
64	1710.54592	17	517	76.935
63	1683.81864	21	538	80.060
62	1657.09136	18	556	82.738
61	1630.36408	15	571	84.970
60	1603.6368	23	594	88.393
59	1576.90952	13	607	90.327
58	1550.18224	19	626	93.155
57	1523.45496	21	647	96.280
56	1496.72768	16	663	98.661
55	1470.0004	4	667	99.256
54	1443.27312	1	668	99.405
53	1416.54584	4	672	100.000
52	1389.81856	0	672	100.000
51	1363.09128	0	672	100.000
50	1336.364	0	672	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2019 CURVE

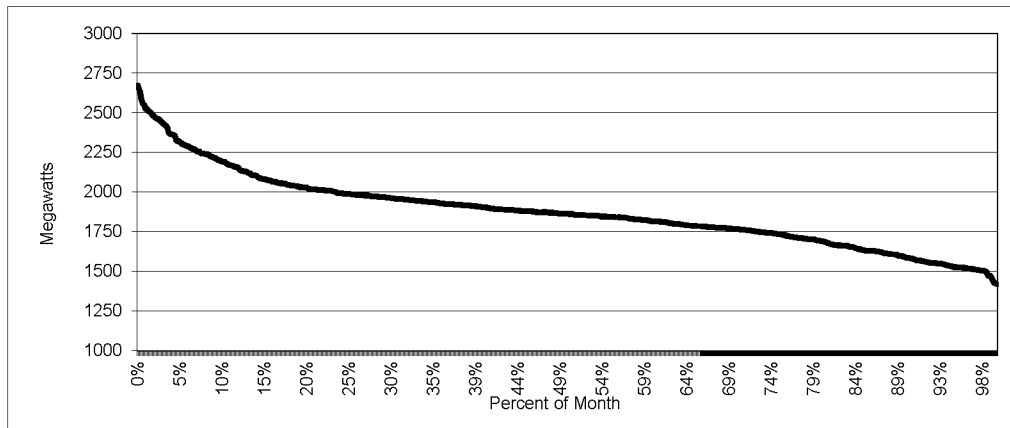

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2872.493	1	1	0.134
99	2843.76807	2	3	0.403
98	2815.04314	2	5	0.672
97	2786.31821	0	5	0.672
96	2757.59328	0	5	0.672
95	2728.86835	3	8	1.075
94	2700.14342	2	10	1.344
93	2671.41849	1	11	1.478
92	2642.69356	1	12	1.613
91	2613.96863	1	13	1.747
90	2585.2437	2	15	2.016
89	2556.51877	6	21	2.823
88	2527.79384	5	26	3.495
87	2499.06891	1	27	3.629
86	2470.34398	2	29	3.898
85	2441.61905	4	33	4.435
84	2412.89412	4	37	4.973
83	2384.16919	2	39	5.242
82	2355.44426	1	40	5.376
81	2326.71933	1	41	5.511
80	2297.9944	5	46	6.183
79	2269.26947	1	47	6.317
78	2240.54454	5	52	6.989
77	2211.81961	2	54	7.258
76	2183.09468	4	58	7.796
75	2154.36975	4	62	8.333
74	2125.64482	10	72	9.677
73	2096.91989	5	77	10.349
72	2068.19496	13	90	12.097
71	2039.47003	16	106	14.247
70	2010.7451	19	125	16.801
69	1982.02017	26	151	20.296
68	1953.29524	34	185	24.866
67	1924.57031	39	224	30.108
66	1895.84538	44	268	36.022
65	1867.12045	59	327	43.952
64	1838.39552	52	379	50.941
63	1809.67059	57	436	58.602
62	1780.94566	44	480	64.516
61	1752.22073	23	503	67.608
60	1723.4958	27	530	71.237
59	1694.77087	31	561	75.403
58	1666.04594	23	584	78.495
57	1637.32101	19	603	81.048
56	1608.59608	30	633	85.081
55	1579.87115	30	663	89.113
54	1551.14622	24	687	92.339
53	1522.42129	32	719	96.640
52	1493.69636	18	737	99.059
51	1464.97143	5	742	99.731
50	1436.2465	2	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2019 CURVE

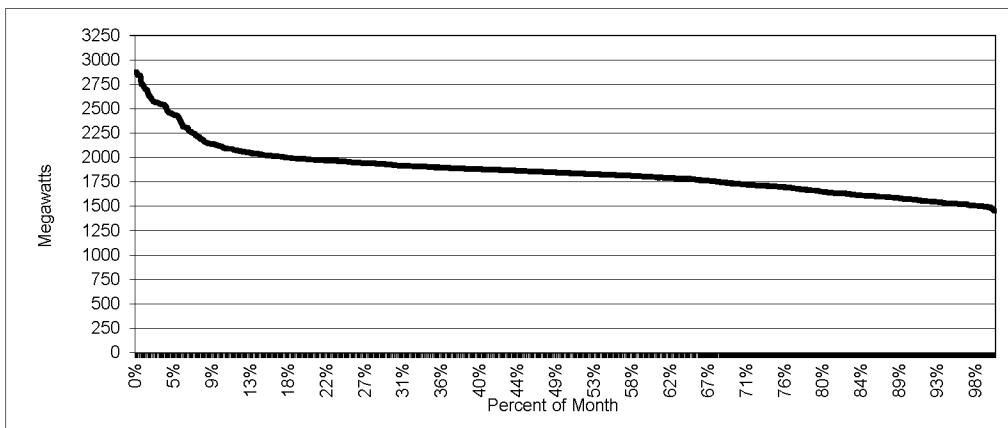

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2676.827	1	1	0.139
99	2650.05873	4	5	0.694
98	2623.29046	0	5	0.694
97	2596.52219	2	7	0.972
96	2569.75392	5	12	1.667
95	2542.98565	4	16	2.222
94	2516.21738	1	17	2.361
93	2489.44911	3	20	2.778
92	2462.68084	9	29	4.028
91	2435.91257	5	34	4.722
90	2409.1443	9	43	5.972
89	2382.37603	6	49	6.806
88	2355.60776	9	58	8.056
87	2328.83949	5	63	8.750
86	2302.07122	5	68	9.444
85	2275.30295	11	79	10.972
84	2248.53468	15	94	13.056
83	2221.76641	13	107	14.861
82	2194.99814	14	121	16.806
81	2168.22987	20	141	19.583
80	2141.4616	25	166	23.056
79	2114.69333	20	186	25.833
78	2087.92506	25	211	29.306
77	2061.15679	27	238	33.056
76	2034.38852	35	273	37.917
75	2007.62025	34	307	42.639
74	1980.85198	28	335	46.528
73	1954.08371	25	360	50.000
72	1927.31544	28	388	53.889
71	1900.54717	35	423	58.750
70	1873.7789	27	450	62.500
69	1847.01063	32	482	66.944
68	1820.24236	29	511	70.972
67	1793.47409	18	529	73.472
66	1766.70582	15	544	75.556
65	1739.93755	25	569	79.028
64	1713.16928	28	597	82.917
63	1686.40101	19	616	85.556
62	1659.63274	29	645	89.583
61	1632.86447	19	664	92.222
60	1606.0962	20	684	95.000
59	1579.32793	21	705	97.917
58	1552.55966	9	714	99.167
57	1525.79139	4	718	99.722
56	1499.02312	2	720	100.000
55	1472.25485	0	720	100.000
54	1445.48658	0	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2019 CURVE

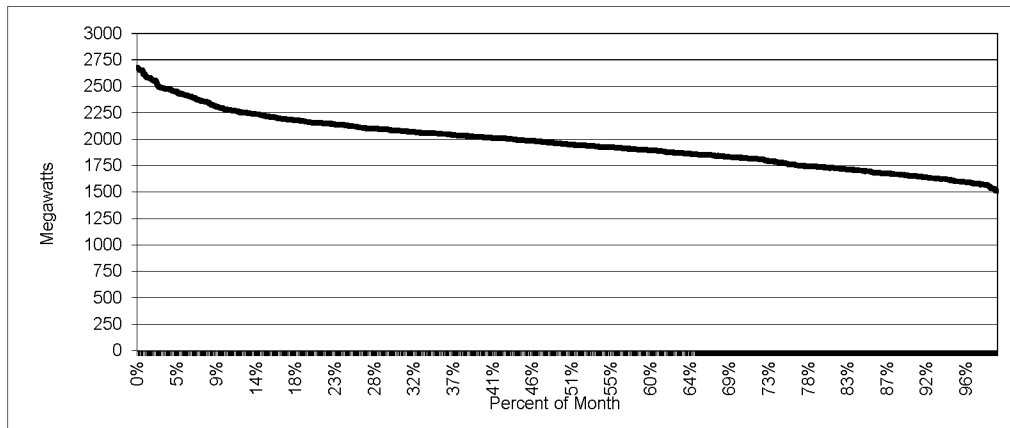

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3103.906	1	1	0.138
99	3072.86694	3	4	0.550
98	3041.82788	1	5	0.688
97	3010.78882	4	9	1.238
96	2979.74976	6	15	2.063
95	2948.71107	11	26	3.576
94	2917.67164	10	36	4.952
93	2886.63258	8	44	6.052
92	2855.59352	8	52	7.153
91	2824.55446	10	62	8.528
90	2793.5154	8	70	9.629
89	2762.47634	8	78	10.729
88	2731.43728	19	97	13.343
87	2700.39822	16	113	15.543
86	2669.35916	14	127	17.469
85	2638.3201	17	144	19.807
84	2607.28104	16	160	22.008
83	2576.24198	23	183	25.172
82	2545.20292	15	198	27.235
81	2514.16386	15	213	29.298
80	2483.1248	19	232	31.912
79	2452.08574	17	249	34.250
78	2421.04668	26	275	37.827
77	2390.00762	14	289	39.752
76	2358.96856	18	307	42.228
75	2327.9295	12	319	43.879
74	2296.89044	19	338	46.492
73	2265.85138	18	356	48.968
72	2234.81232	9	365	50.206
71	2203.77326	21	386	53.095
70	2172.7342	23	409	56.259
69	2141.69514	24	433	59.560
68	2110.65608	28	461	63.411
67	2079.61702	31	492	67.675
66	2048.57796	27	519	71.389
65	2017.5389	31	550	75.653
64	1986.49984	26	576	79.230
63	1955.46078	26	602	82.806
62	1924.42172	20	622	85.557
61	1893.38266	16	638	87.758
60	1862.3436	13	651	89.546
59	1831.30454	11	662	91.059
58	1800.26548	14	676	92.985
57	1769.22642	13	689	94.773
56	1738.18736	9	698	96.011
55	1707.1483	7	705	96.974
54	1676.10924	16	721	99.175
53	1645.07018	6	727	100.000
52	1614.03112	5	732	100.000
51	1582.99206	8	740	100.000
50	1551.953	1	741	100.000
49	1520.91394	3	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2019 CURVE

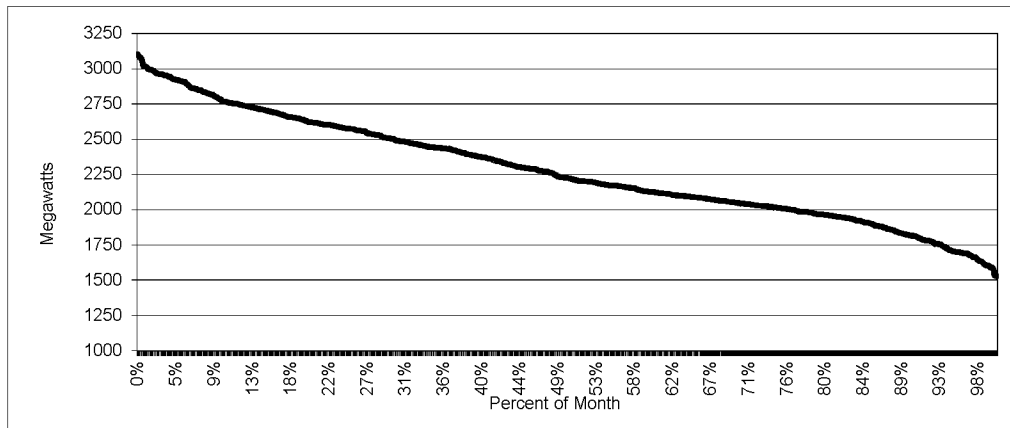

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3482.791	1	1	0.143
99	3447.96309	1	2	0.286
98	3413.13518	1	3	0.429
97	3378.30727	3	6	0.858
96	3343.47936	5	11	1.574
95	3308.65145	8	19	2.718
94	3273.82354	3	22	3.147
93	3238.99563	5	27	3.863
92	3204.16772	9	36	5.150
91	3169.33981	13	49	7.010
90	3134.5119	12	61	8.727
89	3099.68399	13	74	10.587
88	3064.85608	17	91	13.019
87	3030.02817	13	104	14.878
86	2995.20026	17	121	17.310
85	2960.37235	15	136	19.456
84	2925.54444	19	155	22.175
83	2890.71653	22	177	25.322
82	2855.88862	6	183	26.180
81	2821.06071	17	200	28.612
80	2786.2328	19	219	31.330
79	2751.40489	16	235	33.619
78	2716.57698	13	248	35.479
77	2681.74907	20	268	38.340
76	2646.92116	15	283	40.486
75	2612.09325	15	298	42.632
74	2577.26534	22	320	45.780
73	2542.43743	16	336	48.069
72	2507.60952	18	354	50.644
71	2472.78161	14	368	52.647
70	2437.9537	17	385	55.079
69	2403.12579	17	402	57.511
68	2368.29788	23	425	60.801
67	2333.46997	24	449	64.235
66	2298.64206	20	469	67.096
65	2263.81415	25	494	70.672
64	2228.98624	19	513	73.391
63	2194.15833	20	533	76.252
62	2159.33042	12	545	77.969
61	2124.50251	27	572	81.831
60	2089.6746	17	589	84.263
59	2054.84669	16	605	86.552
58	2020.01878	30	635	90.844
57	1985.19087	16	651	93.133
56	1950.36296	18	669	95.708
55	1915.53505	17	686	98.140
54	1880.70714	13	699	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2019 CURVE

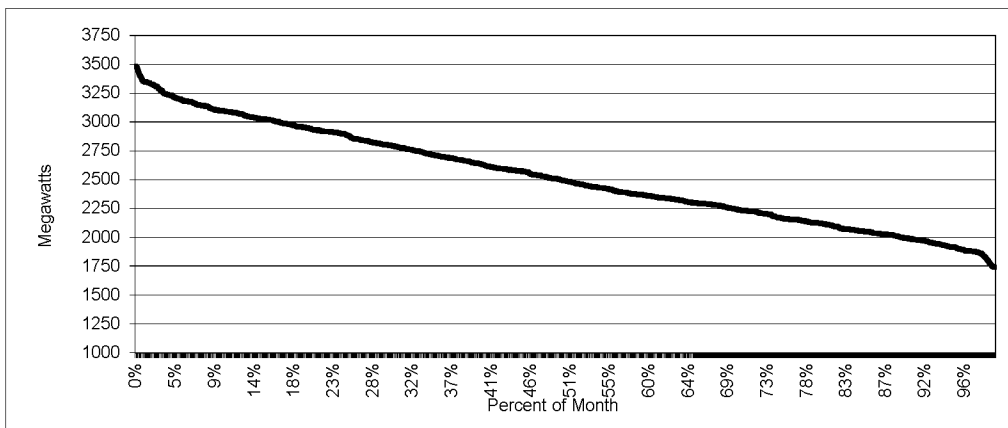

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3509.69	1	1	0.134
99	3474.5931	6	7	0.941
98	3439.4962	6	13	1.747
97	3404.3993	8	21	2.823
96	3369.3024	8	29	3.898
95	3334.2055	15	44	5.914
94	3299.1086	14	58	7.796
93	3264.0117	16	74	9.946
92	3228.9148	9	83	11.156
91	3193.8179	10	93	12.500
90	3158.721	14	107	14.382
89	3123.6241	18	125	16.801
88	3088.5272	11	136	18.280
87	3053.4303	19	155	20.833
86	3018.3334	18	173	23.253
85	2983.2365	20	193	25.941
84	2948.1396	15	208	27.957
83	2913.0427	17	225	30.242
82	2877.9458	19	244	32.796
81	2842.8489	12	256	34.409
80	2807.752	13	269	36.156
79	2772.6551	29	298	40.054
78	2737.5582	14	312	41.935
77	2702.4613	17	329	44.220
76	2667.3644	26	355	47.715
75	2632.2675	19	374	50.269
74	2597.1706	15	389	52.285
73	2562.0737	19	408	54.839
72	2526.9768	15	423	56.855
71	2491.8799	15	438	58.871
70	2456.783	14	452	60.753
69	2421.6861	22	474	63.710
68	2386.5892	15	489	65.726
67	2351.4923	22	511	68.683
66	2316.3954	28	539	72.446
65	2281.2985	33	572	76.882
64	2246.2016	33	605	81.317
63	2211.1047	24	629	84.543
62	2176.0078	26	655	88.038
61	2140.9109	8	663	89.113
60	2105.814	25	688	92.473
59	2070.7171	12	700	94.086
58	2035.6202	12	712	95.699
57	2000.5233	14	726	97.581
56	1965.4264	8	734	98.656
55	1930.3295	5	739	99.328
54	1895.2326	5	744	100.000
53	1860.1357	0	744	100.000
52	1825.0388	0	744	100.000
51	1789.9419	0	744	100.000
50	1754.845	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2019 CURVE

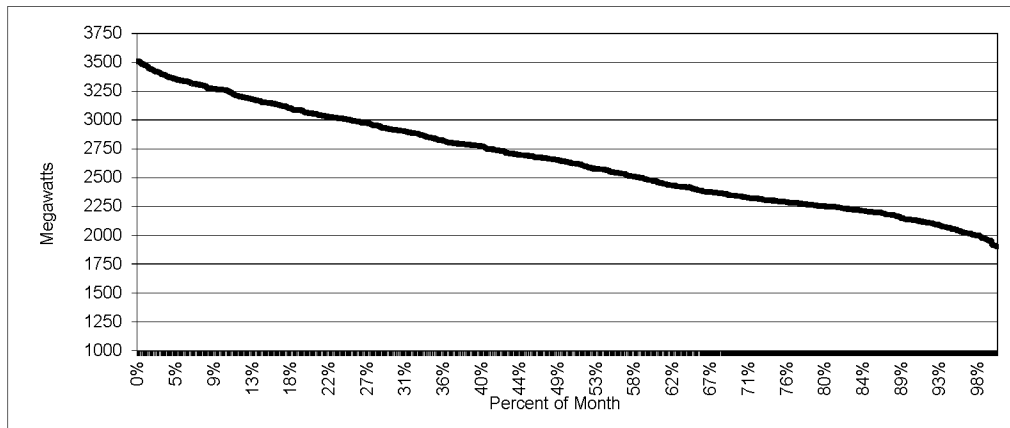

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
AUGUST 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3652.16	1	1	0.134
99	3615.6384	4	5	0.672
98	3579.1168	4	9	1.210
97	3542.5952	3	12	1.613
96	3506.0736	8	20	2.688
95	3469.552	12	32	4.301
94	3433.0304	8	40	5.376
93	3396.5088	12	52	6.989
92	3359.9872	19	71	9.543
91	3323.4656	15	86	11.559
90	3286.944	13	99	13.306
89	3250.4224	22	121	16.263
88	3213.9008	23	144	19.355
87	3177.3792	9	153	20.565
86	3140.8576	17	170	22.849
85	3104.336	19	189	25.403
84	3067.8144	14	203	27.285
83	3031.2928	14	217	29.167
82	2994.7712	17	234	31.452
81	2958.2496	25	259	34.812
80	2921.728	21	280	37.634
79	2885.2064	10	290	38.978
78	2848.6848	18	308	41.398
77	2812.1632	15	323	43.414
76	2775.6416	20	343	46.102
75	2739.12	16	359	48.253
74	2702.5984	13	372	50.000
73	2666.0768	14	386	51.882
72	2629.5552	17	403	54.167
71	2593.0336	20	423	56.855
70	2556.512	12	435	58.468
69	2519.9904	16	451	60.618
68	2483.4688	19	470	63.172
67	2446.9472	13	483	64.919
66	2410.4256	31	514	69.086
65	2373.904	28	542	72.849
64	2337.3824	25	567	76.210
63	2300.8608	26	593	79.704
62	2264.3392	26	619	83.199
61	2227.8176	31	650	87.366
60	2191.296	28	678	91.129
59	2154.7744	17	695	93.414
58	2118.2528	23	718	96.505
57	2081.7312	10	728	97.849
56	2045.2096	16	744	100.000
55	2008.688	0	744	100.000
54	1972.1664	0	744	100.000
53	1935.6448	0	744	100.000
52	1899.1232	0	744	100.000
51	1862.6016	0	744	100.000
50	1826.08	0	744	100.000
49	1789.5584	0	744	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
AUGUST 2019 CURVE

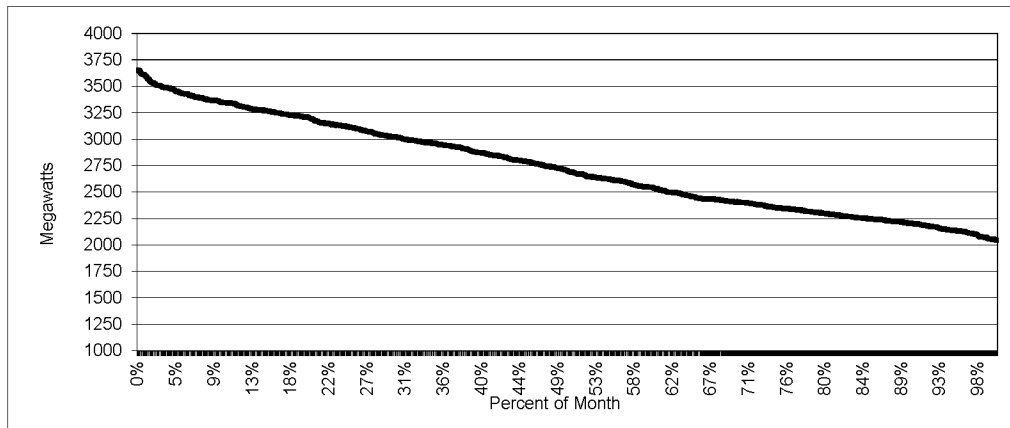

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
SEPTEMBER 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3427.217	1	1	0.139
99	3392.94483	4	5	0.695
98	3358.67266	4	9	1.252
97	3324.40049	7	16	2.225
96	3290.12832	6	22	3.060
95	3255.85615	6	28	3.894
94	3221.58398	16	44	6.120
93	3187.31181	5	49	6.815
92	3153.03964	9	58	8.067
91	3118.76747	16	74	10.292
90	3084.4953	11	85	11.822
89	3050.22313	15	100	13.908
88	3015.95096	16	116	16.134
87	2981.67879	18	134	18.637
86	2947.40662	13	147	20.445
85	2913.13445	10	157	21.836
84	2878.86228	19	176	24.478
83	2844.59011	15	191	26.565
82	2810.31794	18	209	29.068
81	2776.04577	16	225	31.293
80	2741.7736	12	237	32.962
79	2707.50143	13	250	34.771
78	2673.22926	12	262	36.439
77	2638.95709	13	275	38.248
76	2604.68492	16	291	40.473
75	2570.41275	11	302	42.003
74	2536.14058	11	313	43.533
73	2501.86841	15	328	45.619
72	2467.59624	13	341	47.427
71	2433.32407	14	355	49.374
70	2399.0519	12	367	51.043
69	2364.77973	15	382	53.129
68	2330.50756	26	408	56.745
67	2296.23539	15	423	58.832
66	2261.96322	17	440	61.196
65	2227.69105	25	465	64.673
64	2193.41888	19	484	67.316
63	2159.14671	25	509	70.793
62	2124.87454	30	539	74.965
61	2090.60237	36	575	79.972
60	2056.3302	31	606	84.284
59	2022.05803	33	639	88.873
58	1987.78586	25	664	92.350
57	1953.51369	24	688	95.688
56	1919.24152	12	700	97.357
55	1884.96935	4	704	97.914
54	1850.69718	3	707	98.331
53	1816.42501	2	709	98.609
52	1782.15284	4	713	99.166
51	1747.88067	5	718	99.861
50	1713.6085	1	719	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
SEPTEMBER 2019 CURVE

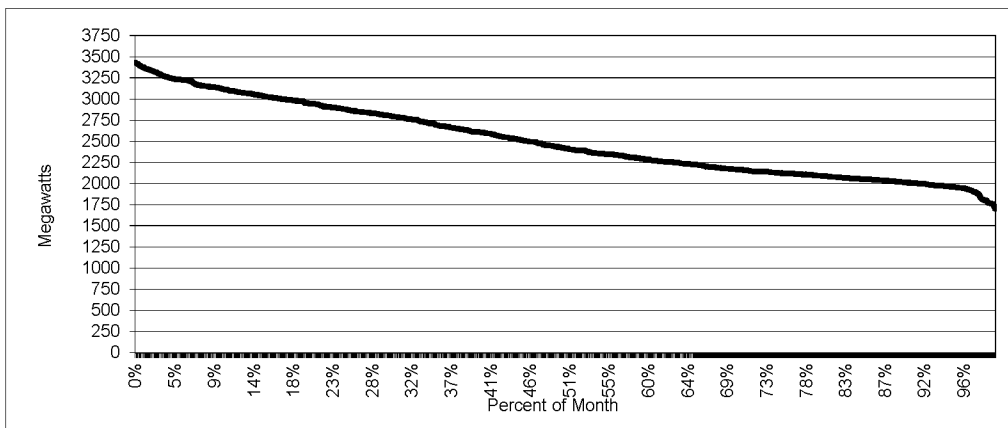

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
OCTOBER 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3227.77	1	1	0.135
99	3195.4923	3	4	0.541
98	3163.2146	4	8	1.081
97	3130.9369	3	11	1.486
96	3098.6592	4	15	2.027
95	3066.3815	6	21	2.838
94	3034.1038	4	25	3.378
93	3001.8261	2	27	3.649
92	2969.5484	6	33	4.459
91	2937.2707	7	40	5.405
90	2904.993	5	45	6.081
89	2872.7153	9	54	7.297
88	2840.4376	4	58	7.838
87	2808.1599	5	63	8.514
86	2775.8822	9	72	9.730
85	2743.6045	6	78	10.541
84	2711.3268	6	84	11.351
83	2679.0491	6	90	12.162
82	2646.7714	7	97	13.108
81	2614.4937	8	105	14.189
80	2582.216	10	115	15.541
79	2549.9383	7	122	16.486
78	2517.6606	7	129	17.432
77	2485.3829	8	137	18.514
76	2453.1052	13	150	20.270
75	2420.8275	10	160	21.622
74	2388.5498	8	168	22.703
73	2356.2721	8	176	23.784
72	2323.9944	10	186	25.135
71	2291.7167	12	198	26.757
70	2259.439	24	222	30.000
69	2227.1613	22	244	32.973
68	2194.8836	42	286	38.649
67	2162.6059	37	323	43.649
66	2130.3282	25	348	47.027
65	2098.0505	31	379	51.216
64	2065.7728	36	415	56.081
63	2033.4951	43	458	61.892
62	2001.2174	30	488	65.946
61	1968.9397	45	533	72.027
60	1936.662	37	570	77.027
59	1904.3843	26	596	80.541
58	1872.1066	27	623	84.189
57	1839.8289	13	636	85.946
56	1807.5512	22	658	88.919
55	1775.2735	21	679	91.757
54	1742.9958	19	698	94.324
53	1710.7181	17	715	96.622
52	1678.4404	15	730	98.649
51	1646.1627	10	740	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
OCTOBER 2019 CURVE

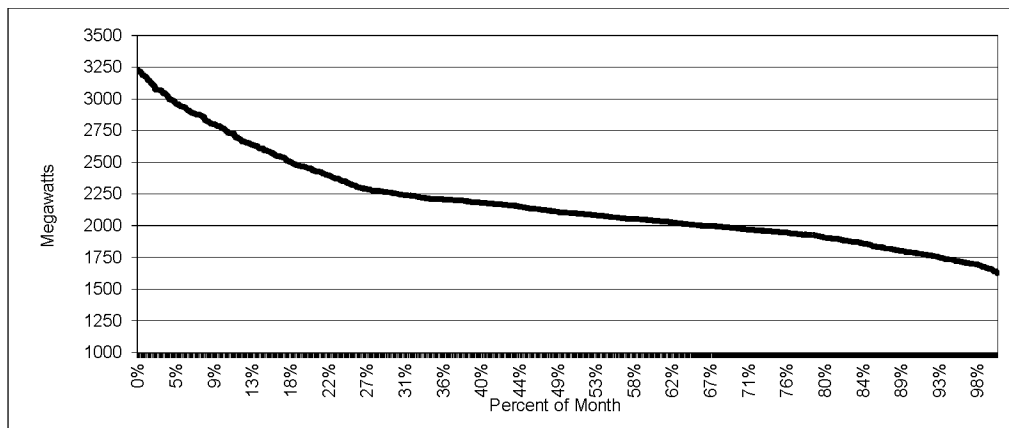

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
NOVEMBER 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3034.715	1	1	0.141
99	3004.36785	1	2	0.283
98	2974.0207	1	3	0.424
97	2943.67355	0	3	0.424
96	2913.3264	0	3	0.424
95	2882.97925	0	3	0.424
94	2852.6321	2	5	0.707
93	2822.28495	1	6	0.849
92	2791.9378	4	10	1.414
91	2761.59065	1	11	1.556
90	2731.2435	4	15	2.122
89	2700.89635	2	17	2.405
88	2670.5492	5	22	3.112
87	2640.20205	5	27	3.819
86	2609.8549	5	32	4.526
85	2579.50775	4	36	5.092
84	2549.1606	5	41	5.799
83	2518.81345	14	55	7.779
82	2488.4663	5	60	8.487
81	2458.11915	8	68	9.618
80	2427.772	1	69	9.760
79	2397.42485	6	75	10.608
78	2367.0777	6	81	11.457
77	2336.73055	8	89	12.588
76	2306.3834	19	108	15.276
75	2276.03625	21	129	18.246
74	2245.6891	20	149	21.075
73	2215.34195	29	178	25.177
72	2184.9948	34	212	29.986
71	2154.64765	35	247	34.936
70	2124.3005	58	305	43.140
69	2093.95335	38	343	48.515
68	2063.6062	50	393	55.587
67	2033.25905	34	427	60.396
66	2002.9119	39	466	65.912
65	1972.56475	41	507	71.711
64	1942.2176	41	548	77.511
63	1911.87045	29	577	81.612
62	1881.5233	21	598	84.583
61	1851.17615	18	616	87.129
60	1820.829	14	630	89.109
59	1790.48185	21	651	92.079
58	1760.1347	22	673	95.191
57	1729.78755	11	684	96.747
56	1699.4404	9	693	98.020
55	1669.09325	8	701	99.151
54	1638.7461	6	707	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
NOVEMBER 2019 CURVE

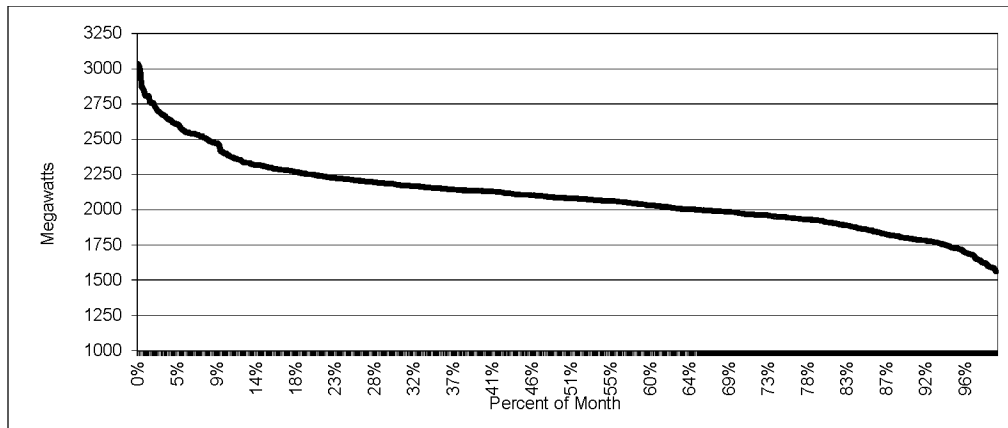

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
DECEMBER 2019 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2854.027	1	1	0.189
99	2825.48673	0	1	0.189
98	2796.94646	2	3	0.566
97	2768.40619	1	4	0.755
96	2739.86592	1	5	0.943
95	2711.32565	0	5	0.943
94	2682.78538	1	6	1.132
93	2654.24511	0	6	1.132
92	2625.70484	1	7	1.321
91	2597.16457	3	10	1.887
90	2568.6243	4	14	2.642
89	2540.08403	3	17	3.208
88	2511.54376	5	22	4.151
87	2483.00349	9	31	5.849
86	2454.46322	3	34	6.415
85	2425.92295	8	42	7.925
84	2397.38268	8	50	9.434
83	2368.84241	19	69	13.019
82	2340.30214	10	79	14.906
81	2311.76187	7	86	16.226
80	2283.2216	9	95	17.925
79	2254.68133	9	104	19.623
78	2226.14106	19	123	23.208
77	2197.60079	22	145	27.358
76	2169.06052	20	165	31.132
75	2140.52025	23	188	35.472
74	2111.97998	22	210	39.623
73	2083.43971	34	244	46.038
72	2054.89944	29	273	51.509
71	2026.35917	33	306	57.736
70	1997.8189	46	352	66.415
69	1969.27863	43	395	74.528
68	1940.73836	53	448	84.528
67	1912.19809	42	490	92.453
66	1883.65782	40	530	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
DECEMBER 2019 CURVE

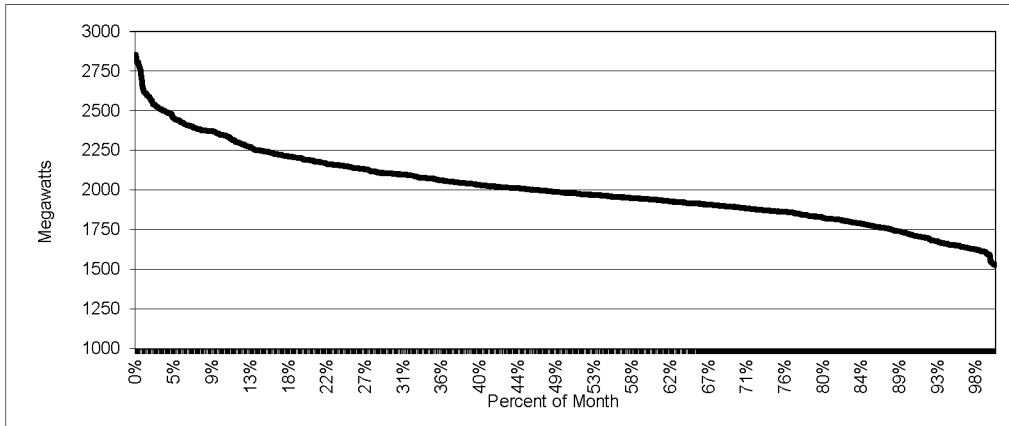

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2018 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3327.207	1	1	0.136
99	3293.93493	2	3	0.408
98	3260.66286	1	4	0.544
97	3227.39079	5	9	1.224
96	3194.11872	2	11	1.497
95	3160.84665	10	21	2.857
94	3127.57458	0	21	2.857
93	3094.30251	4	25	3.401
92	3061.03044	5	30	4.082
91	3027.75837	8	38	5.170
90	2994.4863	10	48	6.531
89	2961.21423	5	53	7.211
88	2927.94216	8	61	8.299
87	2894.67009	8	69	9.388
86	2861.39802	12	81	11.020
85	2828.12595	4	85	11.565
84	2794.85388	11	96	13.061
83	2761.58181	12	108	14.694
82	2728.30974	8	116	15.782
81	2695.03767	12	128	17.415
80	2661.7656	14	142	19.320
79	2628.49353	10	152	20.680
78	2595.22146	10	162	22.041
77	2561.94939	9	171	23.265
76	2528.67732	11	182	24.762
75	2495.40525	13	195	26.531
74	2462.13318	16	211	28.707
73	2428.86111	19	230	31.293
72	2395.58904	13	243	33.061
71	2362.31697	22	265	36.054
70	2329.0449	14	279	37.959
69	2295.77283	12	291	39.592
68	2262.50076	10	301	40.952
67	2229.22869	24	325	44.218
66	2195.95662	19	344	46.803
65	2162.68455	17	361	49.116
64	2129.41248	28	389	52.925
63	2096.14041	27	416	56.599
62	2062.86834	25	441	60.000
61	2029.59627	17	458	62.313
60	1996.3242	31	489	66.531
59	1963.05213	48	537	73.061
58	1929.78006	40	577	78.503
57	1896.50799	35	612	83.265
56	1863.23592	39	651	88.571
55	1829.96385	17	668	90.884
54	1796.69178	19	687	93.469
53	1763.41971	10	697	94.830
52	1730.14764	6	703	95.646
51	1696.87557	7	710	96.599
50	1663.6035	8	718	97.687
49	1630.33143	7	725	98.639
48	1597.05936	10	735	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JANUARY 2018 CURVE

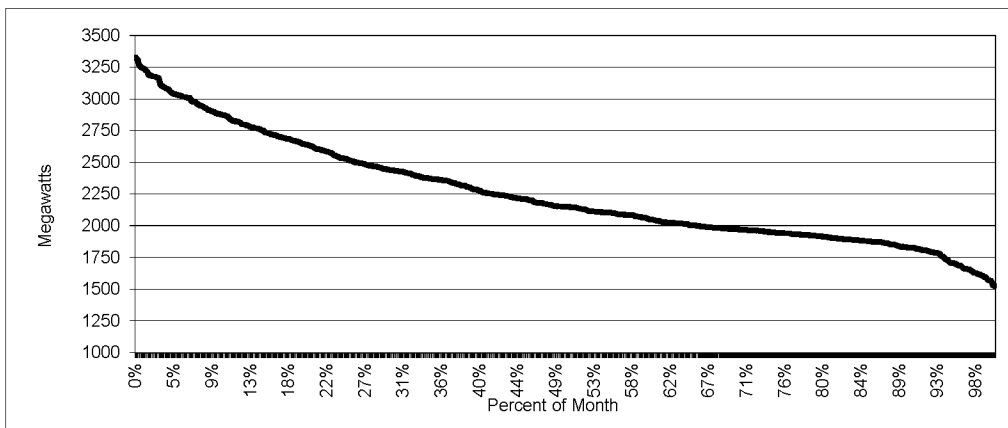

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2018 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2606.701	1	1	0.149
99	2580.63399	3	4	0.595
98	2554.56698	1	5	0.744
97	2528.49997	0	5	0.744
96	2502.43296	4	9	1.339
95	2476.36595	4	13	1.935
94	2450.29894	1	14	2.083
93	2424.23193	5	19	2.827
92	2398.16492	2	21	3.125
91	2372.09791	2	23	3.423
90	2346.0309	5	28	4.167
89	2319.96389	6	34	5.060
88	2293.89688	2	36	5.357
87	2267.82987	6	42	6.250
86	2241.76286	11	53	7.887
85	2215.69585	20	73	10.863
84	2189.62884	10	83	12.351
83	2163.56183	12	95	14.137
82	2137.49482	7	102	15.179
81	2111.42781	11	113	16.815
80	2085.3608	13	126	18.750
79	2059.29379	24	150	22.321
78	2033.22678	15	165	24.554
77	2007.15977	28	193	28.720
76	1981.09276	18	211	31.399
75	1955.02575	31	242	36.012
74	1928.95874	30	272	40.476
73	1902.89173	28	300	44.643
72	1876.82472	23	323	48.065
71	1850.75771	45	368	54.762
70	1824.6907	28	396	58.929
69	1798.62369	31	427	63.542
68	1772.55668	27	454	67.560
67	1746.48967	25	479	71.280
66	1720.42266	18	497	73.958
65	1694.35565	20	517	76.935
64	1668.28864	27	544	80.952
63	1642.22163	20	564	83.929
62	1616.15462	33	597	88.839
61	1590.08761	9	606	90.179
60	1564.0206	14	620	92.262
59	1537.95359	13	633	94.196
58	1511.88658	10	643	95.685
57	1485.81957	16	659	98.065
56	1459.75256	10	669	99.554
55	1433.68555	3	672	100.000
54	1407.61854	0	672	100.000
53	1381.55153	0	672	100.000
52	1355.48452	0	672	100.000
51	1329.41751	0	672	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
FEBRUARY 2018 CURVE

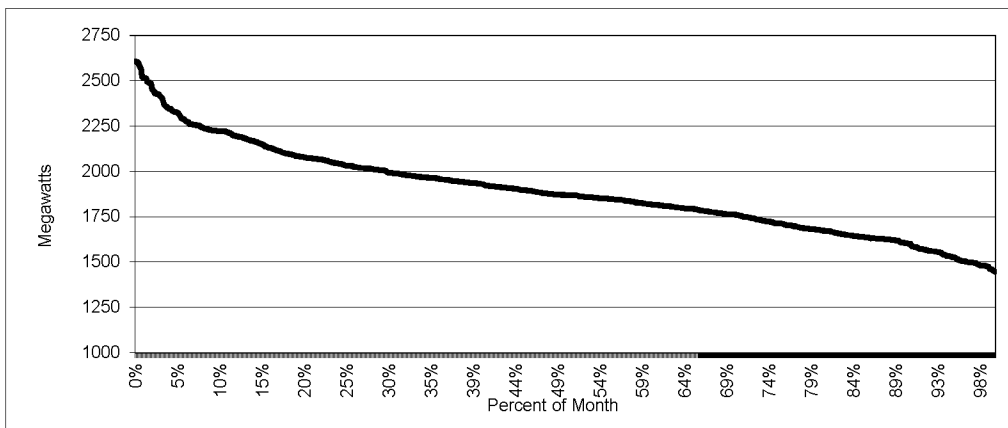

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2018 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2460.95	1	1	0.134
99	2436.3405	1	2	0.269
98	2411.731	1	3	0.403
97	2387.1215	2	5	0.672
96	2362.512	1	6	0.806
95	2337.9025	1	7	0.941
94	2313.293	5	12	1.613
93	2288.6835	1	13	1.747
92	2264.074	6	19	2.554
91	2239.4645	4	23	3.091
90	2214.855	7	30	4.032
89	2190.2455	7	37	4.973
88	2165.636	17	54	7.258
87	2141.0265	13	67	9.005
86	2116.417	13	80	10.753
85	2091.8075	14	94	12.634
84	2067.198	14	108	14.516
83	2042.5885	17	125	16.801
82	2017.979	16	141	18.952
81	1993.3695	28	169	22.715
80	1968.76	28	197	26.478
79	1944.1505	34	231	31.048
78	1919.541	33	264	35.484
77	1894.9315	34	298	40.054
76	1870.322	32	330	44.355
75	1845.7125	35	365	49.059
74	1821.103	37	402	54.032
73	1796.4935	58	460	61.828
72	1771.884	28	488	65.591
71	1747.2745	30	518	69.624
70	1722.665	25	543	72.984
69	1698.0555	18	561	75.403
68	1673.446	25	586	78.763
67	1648.8365	25	611	82.124
66	1624.227	28	639	85.887
65	1599.6175	24	663	89.113
64	1575.008	16	679	91.263
63	1550.3985	21	700	94.086
62	1525.789	17	717	96.371
61	1501.1795	9	726	97.581
60	1476.57	6	732	98.387
59	1451.9605	2	734	98.656
58	1427.351	5	739	99.328
57	1402.7415	5	744	100.000
56	1378.132	0	744	100.000
55	1353.5225	0	744	100.000
54	1328.913	0	744	100.000
53	1304.3035	0	744	100.000
52	1279.694	0	744	100.000

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MARCH 2018 CURVE

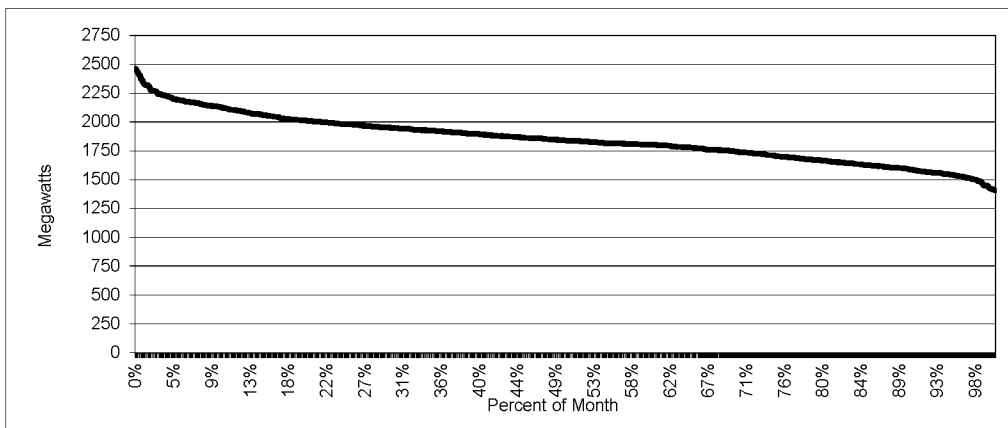

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2018 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	2598.259	1	1	0.139
99	2572.27641	2	3	0.417
98	2546.29382	0	3	0.417
97	2520.31123	2	5	0.694
96	2494.32864	2	7	0.972
95	2468.34605	3	10	1.389
94	2442.36346	5	15	2.083
93	2416.38087	2	17	2.361
92	2390.39828	9	26	3.611
91	2364.41569	8	34	4.722
90	2338.4331	12	46	6.389
89	2312.45051	13	59	8.194
88	2286.46792	15	74	10.278
87	2260.48533	25	99	13.750
86	2234.50274	15	114	15.833
85	2208.52015	12	126	17.500
84	2182.53756	15	141	19.583
83	2156.55497	17	158	21.944
82	2130.57238	12	170	23.611
81	2104.58979	21	191	26.528
80	2078.6072	14	205	28.472
79	2052.62461	18	223	30.972
78	2026.64202	32	255	35.417
77	2000.65943	24	279	38.750
76	1974.67684	38	317	44.028
75	1948.69425	42	359	49.861
74	1922.71166	36	395	54.861
73	1896.72907	35	430	59.722
72	1870.74648	30	460	63.889
71	1844.76389	24	484	67.222
70	1818.7813	28	512	71.111
69	1792.79871	26	538	74.722
68	1766.81612	22	560	77.778
67	1740.83353	18	578	80.278
66	1714.85094	25	603	83.750
65	1688.86835	43	646	89.722
64	1662.88576	26	672	93.333
63	1636.90317	22	694	96.389
62	1610.92058	12	706	98.056
61	1584.93799	6	712	98.889
60	1558.9554	8	720	100.000
59	1532.97281	0	720	100.000
58	1506.99022	0	720	100.000
57	1481.00763	0	720	100.000
56	1455.02504	0	720	100.000
55	1429.04245	0	720	100.000
54	1403.05986	0	720	100.000


ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
APRIL 2018 CURVE



ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2018 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3372.419	1	1	0.138
99	3338.69481	3	4	0.552
98	3304.97062	2	6	0.828
97	3271.24643	2	8	1.103
96	3237.52224	5	13	1.793
95	3203.79805	6	19	2.621
94	3170.07386	5	24	3.310
93	3136.34967	1	25	3.448
92	3102.62548	7	32	4.414
91	3068.90129	9	41	5.655
90	3035.1771	6	47	6.483
89	3001.45291	10	57	7.862
88	2967.72872	13	70	9.655
87	2934.00453	6	76	10.483
86	2900.28034	9	85	11.724
85	2866.55615	21	106	14.621
84	2832.83196	14	120	16.552
83	2799.10777	16	136	18.759
82	2765.38358	20	156	21.517
81	2731.65939	22	178	24.552
80	2697.9352	12	190	26.207
79	2664.21101	18	208	28.690
78	2630.48682	20	228	31.448
77	2596.76263	17	245	33.793
76	2563.03844	24	269	37.103
75	2529.31425	18	287	39.586
74	2495.59006	16	303	41.793
73	2461.86587	19	322	44.414
72	2428.14168	15	337	46.483
71	2394.41749	22	359	49.517
70	2360.6933	21	380	52.414
69	2326.96911	21	401	55.310
68	2293.24492	12	413	56.966
67	2259.52073	15	428	59.034
66	2225.79654	24	452	62.345
65	2192.07235	18	470	64.828
64	2158.34816	16	486	67.034
63	2124.62397	21	507	69.931
62	2090.89978	28	535	73.793
61	2057.17559	22	557	76.828
60	2023.4514	24	581	80.138
59	1989.72721	30	611	84.276
58	1956.00302	17	628	86.621
57	1922.27883	26	654	90.207
56	1888.55464	25	679	93.655
55	1854.83045	21	700	96.552
54	1821.10626	15	715	98.621
53	1787.38207	10	725	100.000

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
MAY 2018 CURVE

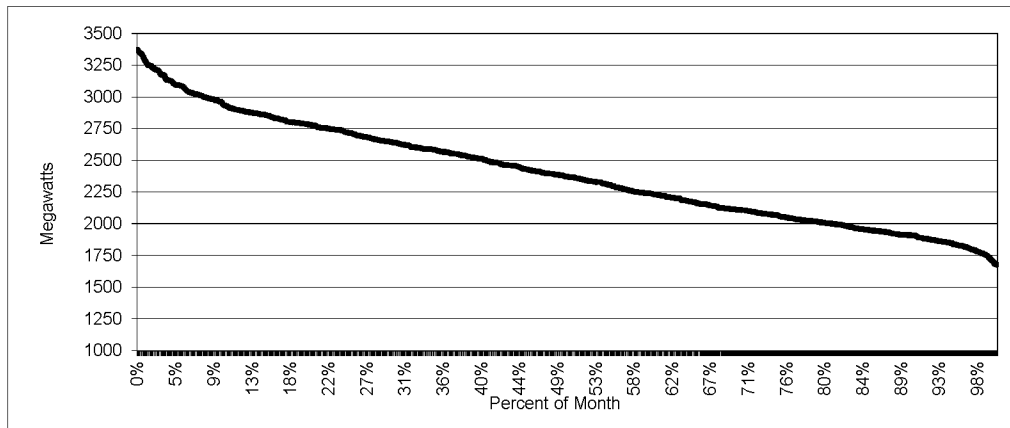

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2018 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3446.915	1	1	0.139
99	3412.44585	1	2	0.278
98	3377.9767	1	3	0.417
97	3343.50755	8	11	1.528
96	3309.0384	11	22	3.056
95	3274.56925	23	45	6.250
94	3240.1001	17	62	8.611
93	3205.63095	16	78	10.833
92	3171.1618	9	87	12.083
91	3136.69265	14	101	14.028
90	3102.2235	21	122	16.944
89	3067.75435	14	136	18.889
88	3033.2852	16	152	21.111
87	2998.81605	20	172	23.889
86	2964.3469	10	182	25.278
85	2929.87775	23	205	28.472
84	2895.4086	14	219	30.417
83	2860.93945	21	240	33.333
82	2826.4703	15	255	35.417
81	2792.00115	19	274	38.056
80	2757.532	12	286	39.722
79	2723.06285	11	297	41.250
78	2688.5937	13	310	43.056
77	2654.12455	19	329	45.694
76	2619.6554	14	343	47.639
75	2585.18625	16	359	49.861
74	2550.7171	12	371	51.528
73	2516.24795	17	388	53.889
72	2481.7788	19	407	56.528
71	2447.30965	14	421	58.472
70	2412.8405	19	440	61.111
69	2378.37135	20	460	63.889
68	2343.9022	13	473	65.694
67	2309.43305	19	492	68.333
66	2274.9639	26	518	71.944
65	2240.49475	22	540	75.000
64	2206.0256	28	568	78.889
63	2171.55645	29	597	82.917
62	2137.0873	36	633	87.917
61	2102.61815	25	658	91.389
60	2068.149	29	687	95.417
59	2033.67985	12	699	97.083
58	1999.2107	12	711	98.750
57	1964.74155	7	718	99.722
56	1930.2724	2	720	100.000
55	1895.80325	0	720	100.000
54	1861.3341	0	720	100.000
53	1826.86495	0	720	100.000

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JUNE 2018 CURVE



ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2018 DATA

Percent of Peak	Equivalent MW Load	Number of Occurrences	Accumulated Occurrence Hours	Accumulated Occurrence Percent
100	3529.222	1	1	0.134
99	3493.92978	2	3	0.403
98	3458.63756	4	7	0.941
97	3423.34534	11	18	2.419
96	3388.05312	15	33	4.435
95	3352.7609	18	51	6.855
94	3317.46868	14	65	8.737
93	3282.17646	12	77	10.349
92	3246.88424	22	99	13.306
91	3211.59202	16	115	15.457
90	3176.2998	17	132	17.742
89	3141.00758	11	143	19.220
88	3105.71536	21	164	22.043
87	3070.42314	18	182	24.462
86	3035.13092	15	197	26.478
85	2999.8387	11	208	27.957
84	2964.54648	17	225	30.242
83	2929.25426	8	233	31.317
82	2893.96204	16	249	33.468
81	2858.66982	19	268	36.022
80	2823.3776	8	276	37.097
79	2788.08538	14	290	38.978
78	2752.79316	12	302	40.591
77	2717.50094	15	317	42.608
76	2682.20872	15	332	44.624
75	2646.9165	17	349	46.909
74	2611.62428	16	365	49.059
73	2576.33206	14	379	50.941
72	2541.03984	16	395	53.091
71	2505.74762	26	421	56.586
70	2470.4554	14	435	58.468
69	2435.16318	21	456	61.290
68	2399.87096	25	481	64.651
67	2364.57874	17	498	66.935
66	2329.28652	24	522	70.161
65	2293.9943	31	553	74.328
64	2258.70208	27	580	77.957
63	2223.40986	31	611	82.124
62	2188.11764	28	639	85.887
61	2152.82542	18	657	88.306
60	2117.5332	19	676	90.860
59	2082.24098	26	702	94.355
58	2046.94876	13	715	96.102
57	2011.65654	10	725	97.446
56	1976.36432	7	732	98.387
55	1941.0721	8	740	99.462
54	1905.77988	2	742	99.731
53	1870.48766	2	744	100.000
52	1835.19544	0	744	100.000

ENTERGY TEXAS, INC.
MONTHLY LOAD DURATION CURVE
JULY 2018 CURVE

